

THE SQUARE AT CRYSTAL FALLS

1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

SHELL BUILDING OWNER:

BANDALI COMMERCIAL
CONTACT: AMAN BANDALI
7817 ROCK WOOD LANE, SUITE 300
AUSTIN, TX 78701
(512) 374-4949
AMAN@BANDALICOMMERCIAL.COM

ARCHITECT:

CORNERSTONE ARCHITECTS
CONTACT: KRISTIN SCHIEFFER
7000 BEE CAVE RD, SUITE 200
AUSTIN, TX 78746
(512) 329-0007
KRISTIN@CORNERSTONEARCHITECTSLLP.COM

CIVIL ENGINEER:


JAMISON CIVIL ENGINEERING LLC
CONTACT: STEPHEN R. JAMISON, P.E.
13812 RESEARCH BLVD, #B-2
AUSTIN, TX 78750
(737) 484-0880
STEVE@JAMISONENG.COM

STRUCTURAL ENGINEER:

JCA CONSULTING ENGINEERS LLC
CONTACT: NICHOLAS H. ROHR, P.E., S.E.
4100 WADSWORTH BLVD.
WHEAT RIDGE, CO 80033
(561) 562-9919
ROHR@JCAACE.COM

MEP ENGINEER:

AYS ENGINEERING, LLC
CONTACT: ROSS ALEMAN, P.E.
411 W. MAIN ST., SUITE 310
ROUND ROCK, TX 78664
(512) 961-6835
RALEMAN@AYSENG.COM

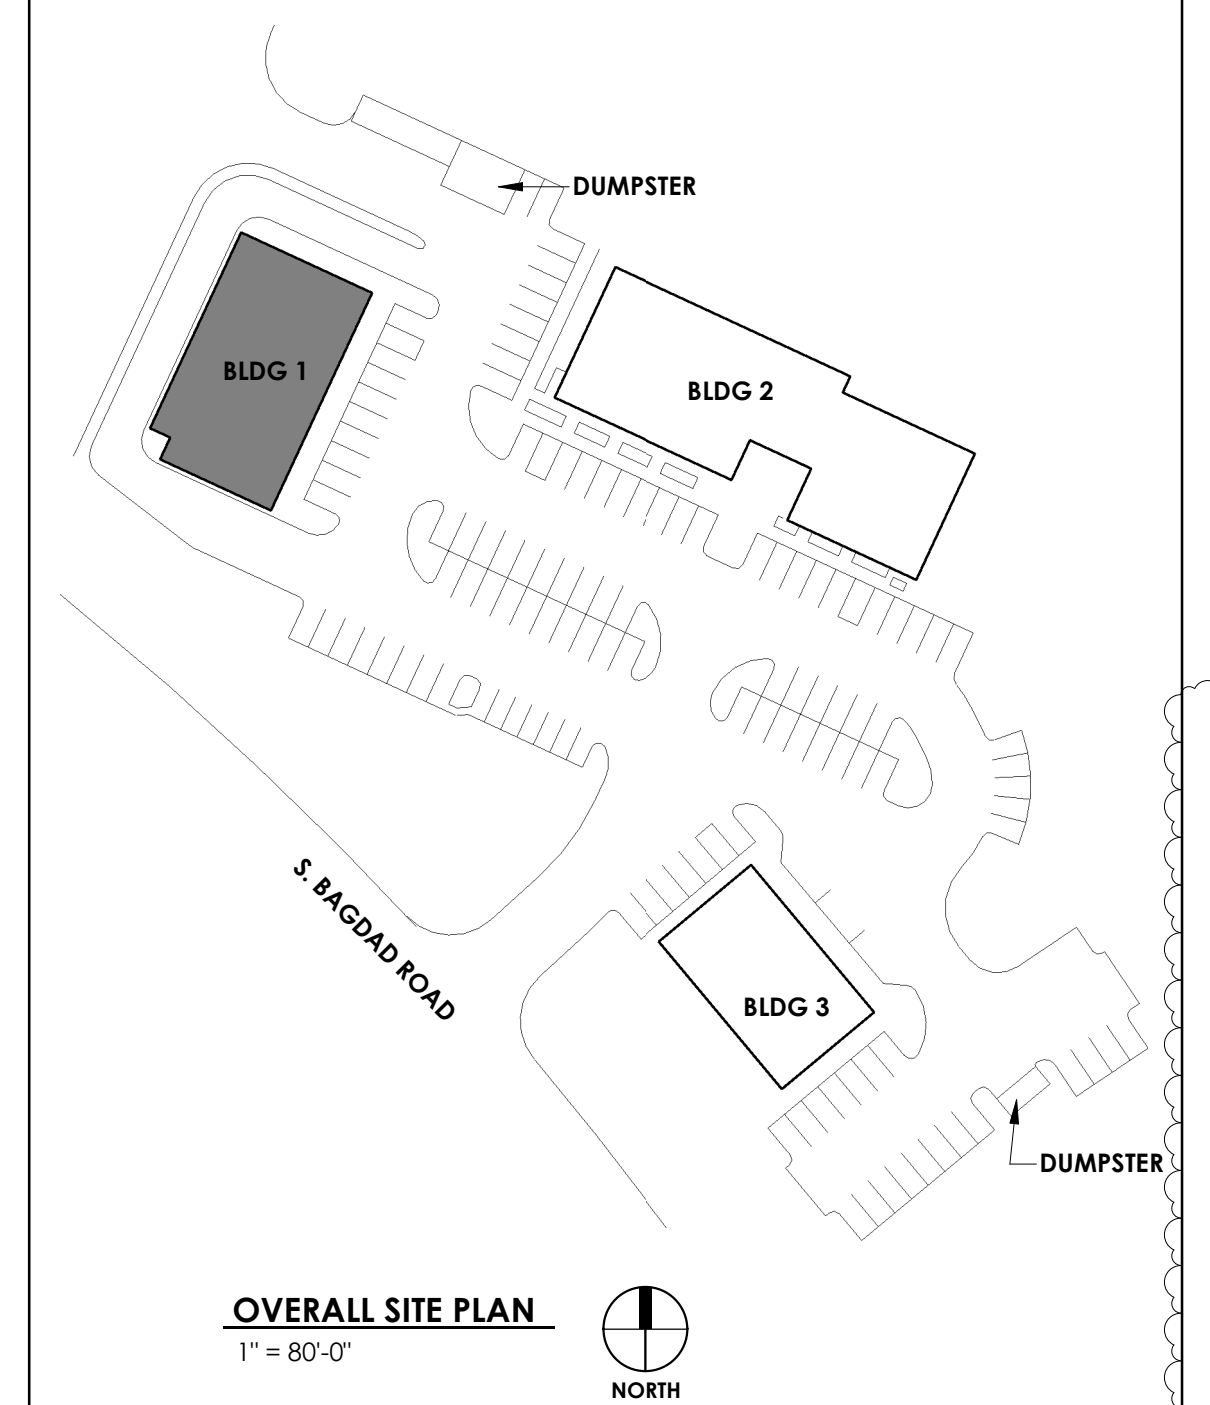

GENERAL NOTES

- CONTRACTOR SHALL COORDINATE HIS WORK AND SCHEDULE TO ALLOW UNINTERRUPTED PROGRESS OF ALL WORK AND TO COMPLETE PROJECT WITHIN THE ESTABLISHED SCHEDULE.
- CONTRACTOR TO VERIFY DELIVERY DATES FOR ANY LONG LEAD TIME ITEMS AND MATERIALS TO ENSURE THEIR INSTALLATION ON THE PROPER SEQUENCE OF THE JOB.
- THESE CONSTRUCTION DOCUMENTS AND SPECIFICATIONS ARE INTENDED TO MEET ALL APPLICABLE CODES AND ORDINANCES. CONTRACTOR TO COMPLY WITH ALL LOCAL CODES, ORDINANCES.
- ANY DISCREPANCIES IN CONSTRUCTION DOCUMENTS TO BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO WORK BEING PERFORMED OR MATERIALS BEING ORDERED.
- ALL PERMIT COSTS TO BE PAID FOR BY THE OWNER. THE CONTRACTOR IS RESPONSIBLE FOR ASSURING THAT ALL PERMITS NECESSARY TO LEGALLY PERFORM THE WORK HAVE BEEN OBTAINED PRIOR TO COMMENCING CONSTRUCTION.
- ALL DIMENSIONS TO BE VERIFIED IN THE FIELD. REPORT ANY AND ALL DISCREPANCIES, ERRORS OR OMISSIONS TO THE ARCHITECT PRIOR TO COMMENCING WORK AND/OR THE ORDERING OF MATERIALS.
- UNDER NO CIRCUMSTANCES SHALL ANY DIMENSIONS BE SCALED FROM THESE DRAWINGS. ANY CRUCIAL DIMENSION NOT GIVEN SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT. EXISTING DIMENSIONS CAN BE VERIFIED IN THE FIELD.
- THE CONTRACTOR SHALL GIVE NOTICE TO ALL AUTHORIZED INSPECTORS, SUPERINTENDENTS OR PERSONS IN CHARGE OF UTILITIES AFFECTED BY HIS OPERATIONS PRIOR TO COMMENCING WORK.
- CONTRACTOR SHALL CLEAN UP AREAS AFFECTED BY DAILY WORK AND REMOVE DEBRIS AND MATERIALS FROM THE SITE UPON COMPLETION OF THE WORK AND MAINTAIN A CLEAN AND ORDERLY WORK AREA AT ALL TIMES.
- LOCATION, SIZE, QUANTITY AND GRAPHIC DESIGNATIONS FOR FIRE EXTINGUISHERS SHALL BE DETERMINED BY GOVERNING FIRE DEPARTMENT.
- THESE DRAWINGS DO NOT ADDRESS ANY FIRE ALARM OR FIRE SUPPRESSION/SPRINKLER SYSTEM REQUIREMENTS. SYSTEM DESIGN AND REQUIRED PERMITS FROM OTHERS ARE THE RESPONSIBILITY OF THE CONTRACTOR AND ARE SEPARATE FROM THIS SUBMITTAL.
- ARCHITECTS ARE GOVERNED BY THE TEXAS BOARD OF ARCHITECTURAL EXAMINERS. (512) 458-1363.
- ALL SIGNAGE PERMIT APPLICATIONS TO BE SUBMITTED AT A LATER DATE. BUILDING SIGNAGE TO BE PERMITTED SEPARATELY BY FUTURE TENANTS.

CODE SUMMARY

GOVERNING AGENCIES:
CITY OF LEANDER
TEXAS ACCESSIBILITY STANDARDS COMMISSION

GOVERNING CODE:
2015 INTERNATIONAL BUILDING CODE
(AS ADOPTED BY THE CITY OF LEANDER)
2015 INTERNATIONAL PLUMBING CODE
2015 INTERNATIONAL MECHANICAL CODE
2014 NATIONAL ELECTRIC CODE (NFPA 70)
2015 INT'L ENERGY CONSERVATION CODE
2015 INTERNATIONAL FIRE CODE
2015 INTERNATIONAL FUEL GAS CODE
2012 TEXAS ACCESSIBILITY STANDARDS

PROJECT DESCRIPTION:
1 STORY SHELL RETAIL/BUSINESS BUILDING

BUILDING TYPE:
V-B NON-RATED
NON-SPRINKLERED

PROJECT AREA:


ALLOWABLE BUILDING HEIGHT	40 FT
ALLOWABLE NUMBER OF STORIES	2
ALLOWABLE AREA	9,000 SF
ACTUAL BUILDING HEIGHT	28'-6"
ACTUAL NUMBER OF STORIES	1
TOTAL BUILDING AREA	5,941 SF

OCCUPANCY TYPE:
OCCUPANCY TYPE
CLASSIFICATION - "BUSINESS"
OCCUPANT LOAD FACTOR: 1 PER 100 S.F.
OCCUPANCY LOAD: 5,900/100 = 60 OCCUPANTS


RESTROOM, SERVICE SINK, AND DRINKING FOUNTAIN REQUIREMENTS:
RESTROOMS TO BE DESIGNED AND PROVIDED WITH EACH SEPARATE FINISH-OUT, ACCORDING TO OCCUPANCY USAGE AND CURRENT APPLICABLE CODE

FIRE RATED ASSEMBLIES:
N/A

EGRESS SYSTEM:
REFER TO LIFE SAFETY ANALYSIS ON THIS SHEET

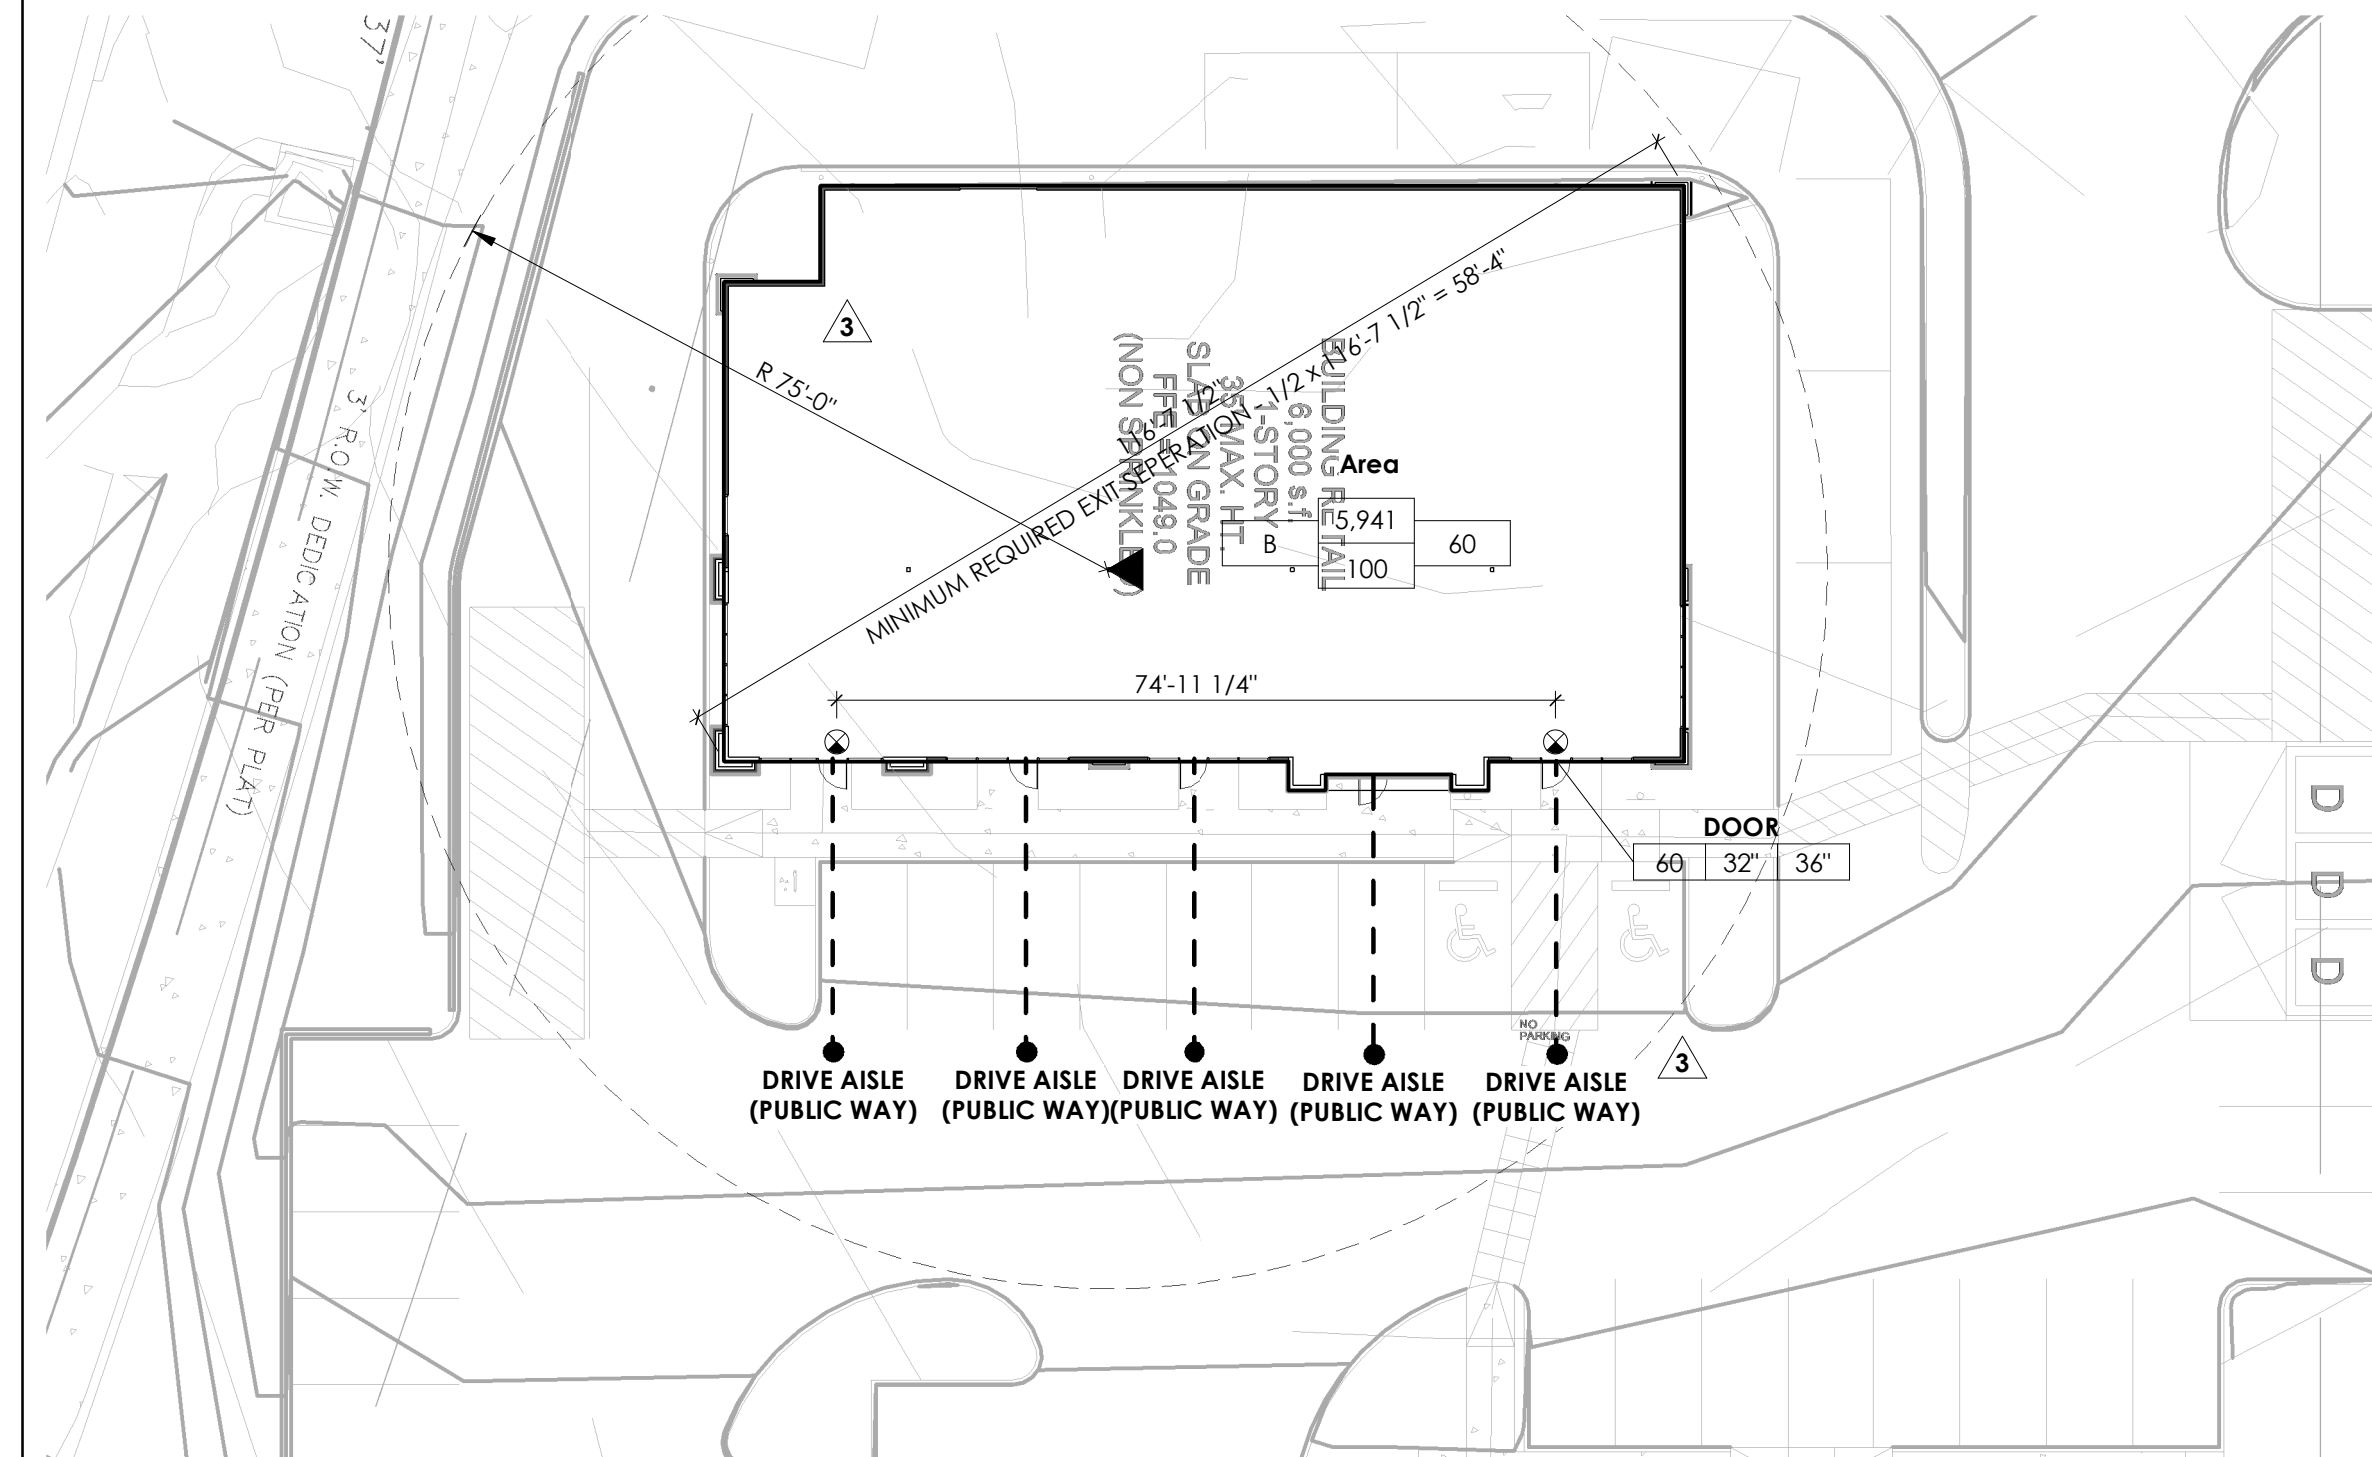

EGRESS LEGEND

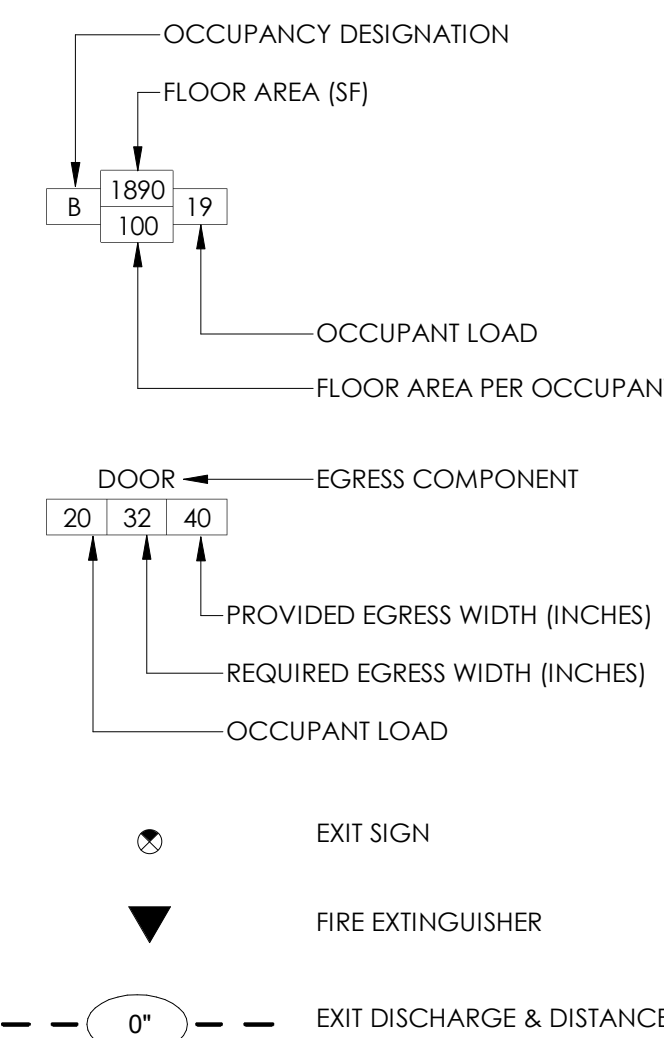


EGRESS NOTES

- IBC 1005.3.2 MAXIMUM REQUIRED EGRESS WIDTH: 0.2 INCH/OCC. OTHER EGRESS COMPONENTS:
0.2 X 60 = 32 INCHES
PROVIDED = 36 INCHES
- TABLE IBC 1006.3.1 MAXIMUM NUMBER OF EXITS: 2 EXITS FOR 1 - 500 OCCUPANT LOAD
- IBC 1007.1.1 EXIT DOOR SEPARATION DISTANCE TO BE A DISTANCE APART EQUAL TO NOT LESS THAN ONE-HALF OF THE LENGTH OF THE OVERALL DIAGONAL DIMENSION OF THE BUILDING
- TABLE IBC 1017.2 EXIT ACCESS TRAVEL DISTANCE:
OCCUPANCY B DISTANCE(W/O SPRINKLER SYSTEM) 200'

INDEX OF DRAWINGS

- GENERAL**
- G000 COVER & LIFE SAFETY
 - G001 TEXAS ACCESSIBILITY STANDARDS
- STRUCTURAL**
- S001 GENERAL NOTES
 - S002 GENERAL NOTES SCHEDULES AND DIAGRAMS
 - S003 STRUCTURAL LEGENDS AND SCHEDULES
 - S101 FOUNDATION PLANS
 - S102 ROOF FRAMING PLAN
 - S201 TILT WALL ELEVATIONS
 - S301 FOUNDATION DETAILS
 - S302 FOUNDATION DETAILS
 - S303 FOUNDATION DETAILS
 - S401 BUILDING SECTIONS
 - S402 BUILDING SECTIONS
 - S403 HIGH ROOF SECTIONS
 - S501 STEEL JOISTS AT FRAMING
 - S502 STEEL DECK AT JOIST FRAMING
 - S503 FLANGE CONNECTIONS
 - S601 TILT WALL DETAILS
 - S602 TILT WALL DETAILS
- ARCHITECTURE**
- A101 FLOOR PLAN
 - A121 ROOF PLAN
 - A201 EXTERIOR ELEVATIONS
 - A202 EXTERIOR ELEVATIONS
 - A301 BUILDING SECTIONS
 - A311 WALL SECTIONS
 - A312 WALL SECTIONS
 - A321 SECTION DETAILS
 - A322 SECTION DETAILS
 - A501 DOOR/WINDOW - SCHEDULES DETAILS
 - A601 REFLECTED CEILING PLAN
- ELECTRICAL**
- E100 ELECTRICAL LEGEND, NOTES AND SCHEDULE
 - E200 FLOOR PLAN - LIGHTING & POWER
 - E300 ELECTRICAL RISER AND DIAGRAMS
 - E400 ELECTRICAL SPECIFICATIONS
 - EU100 SITE PLAN - ELECTRICAL
 - EU200 SITE PLAN - PHOTOMETRICS
- PLUMBING**
- P100 PLUMBING LEGEND, NOTES AND SCHEDULE
 - P200 FLOOR PLAN - PLUMBING
 - P201 ROOF PLAN - PLUMBING
 - P202 SITE PLAN - PLUMBING

ANNOTATION SYMBOLS

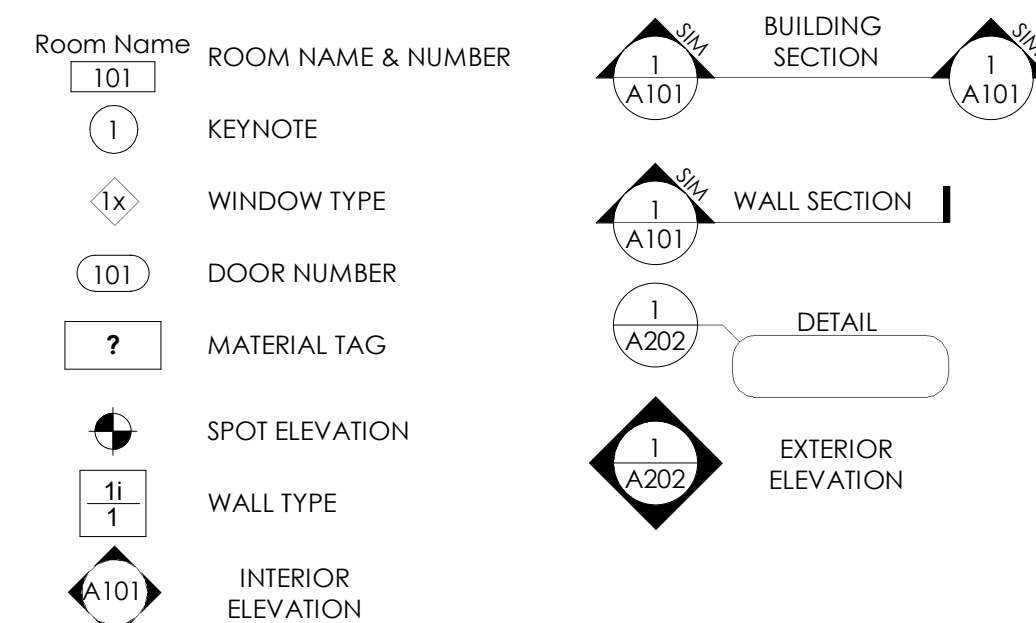

SCHEDULE OF RESPONSIBILITY

ITEM	SPECIFICATION			PURCHASING			INSTALLATION		
	GC	OWNER	OTHER	GC	OWNER	OTHER	GC	OWNER	OTHER
GENERAL									
PERMITS						●			
ADA INSPECTIONS						●			
ALL ACCENT LIGHTING			ARCH						●
FIRE EXTINGUISHERS			OTHER			●			●
EXTERIOR SIGNAGE			V			●			V
TELEPHONE SYSTEM									
CONDUIT			MEP			●			●
SECURITY SYSTEM									
CONDUIT			V			●			●

LEGEND: ARCH = ARCHITECT, I.D. = INTERIOR DESIGNER, G.C. = GENERAL CONTRACTOR, MEP = ENGINEER, COD = CODE, V = VENDOR (BY OWNER)

100% CDS - REV. 05 - VE AUG. XX, 2024

ALIGN
AUSTIN ARCHITECTS

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

© COPYRIGHT © 2024. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE
PROPERTY OF ALIGN AUSTIN ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM
BY ANY METHOD FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.

- 06.17.22 Revision 2
- 09.12.22 City Comments
- 08.XX.24 VE


NOT FOR
REGULATORY
APPROVAL,
PERMITTING, OR
CONSTRUCTION.

THIS DOCUMENT IS RELEASED FOR
THE PURPOSE OF INTERIM REVIEW
UNDER THE AUTHORITY OF
RODNEY PALMER
08.09.2024
PERMIT SET



COVER & LIFE SAFETY

SHEET: **G000**



PROJECT NO: 21099
DRAWN BY: MD, AG
DATE: 09.12.22
PROJECT MGR: KS

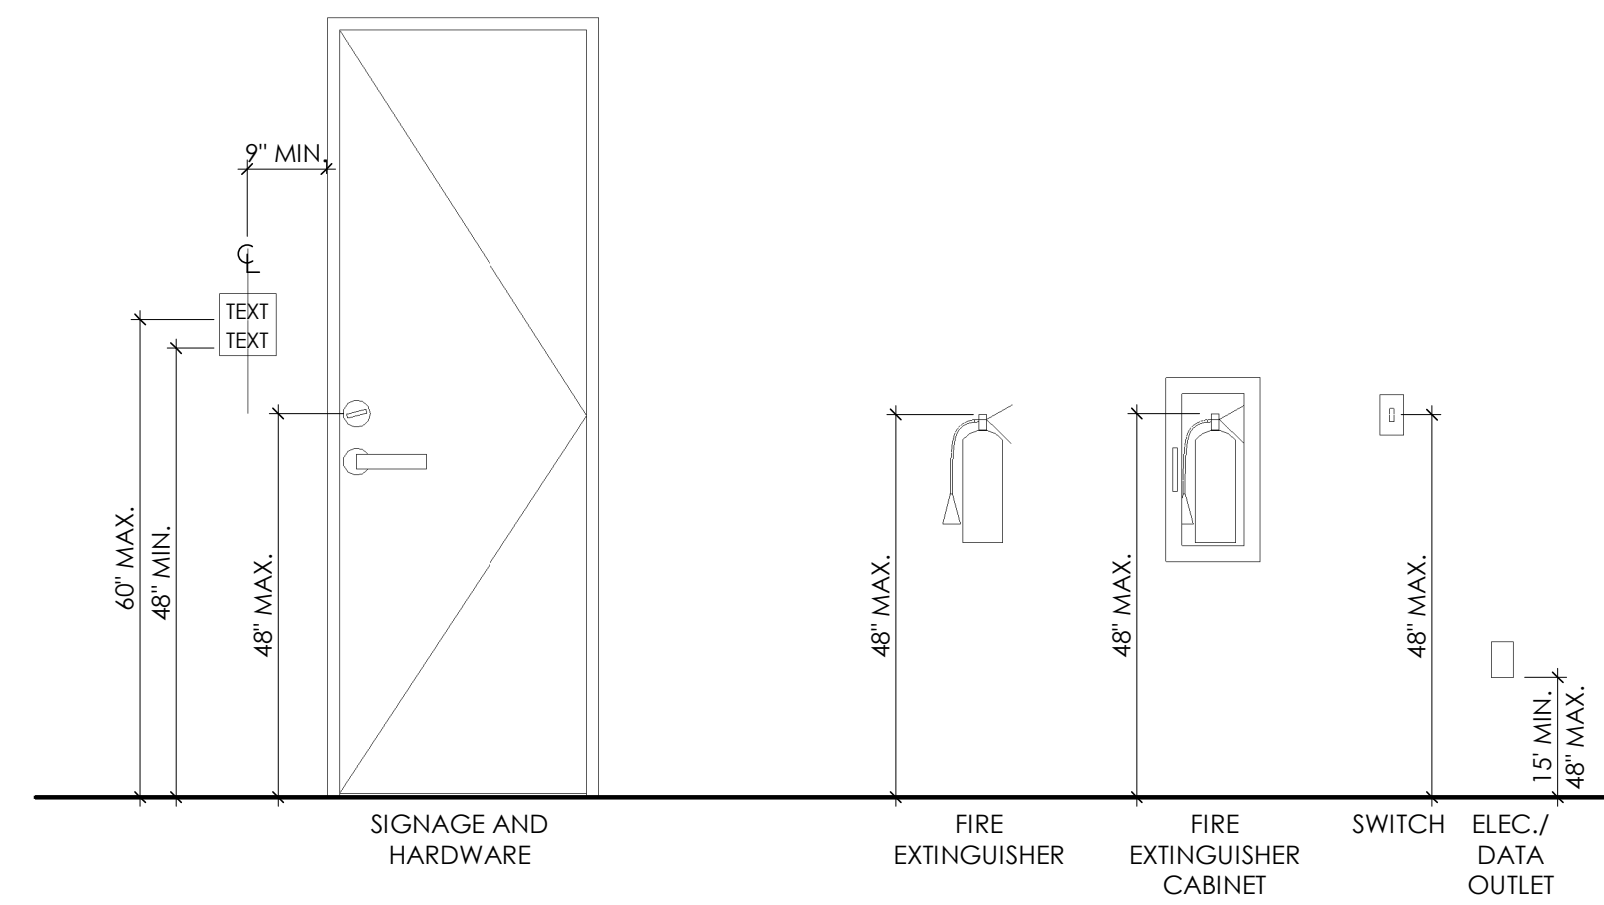

3 TAS - TYP. MOUNTING HEIGHTS
1/2" = 1'-0"


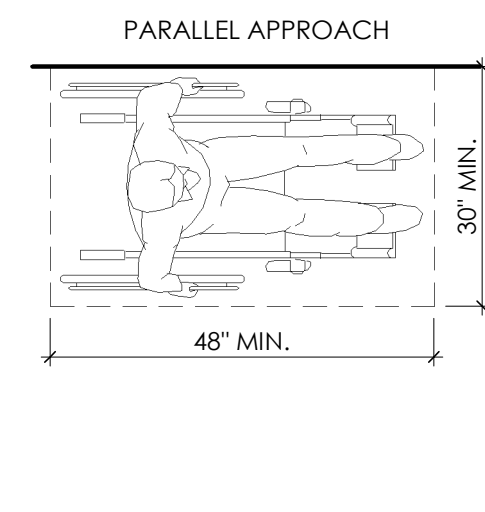
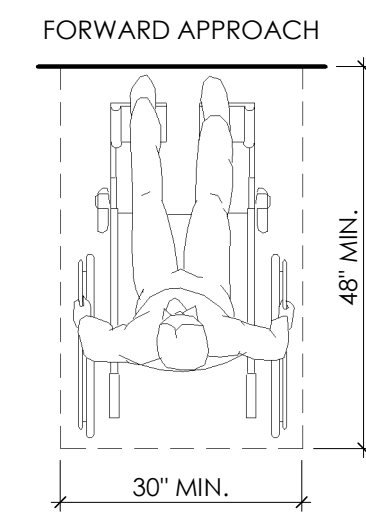


POSITION OF CLEAR FLOOR OR GROUND SPACE

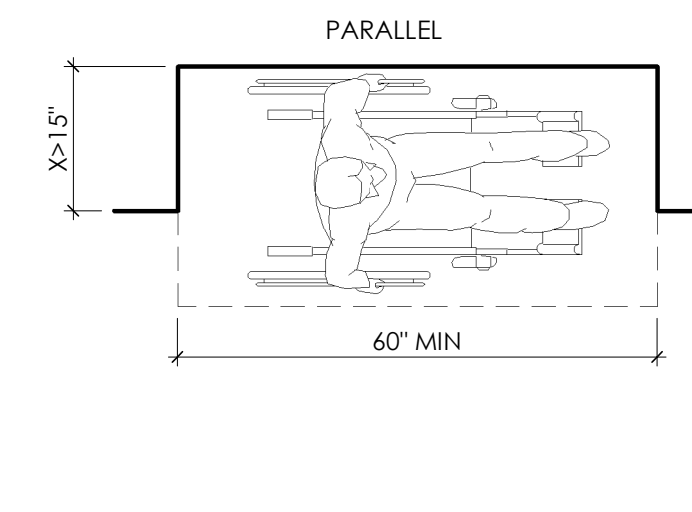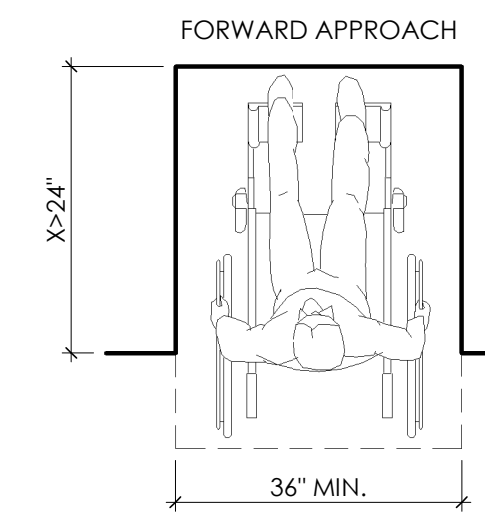

MANEUVERING CLEARANCE IN AN ALCOVE

2 MANEUVERING CLEARANCES
1/2" = 1'-0"

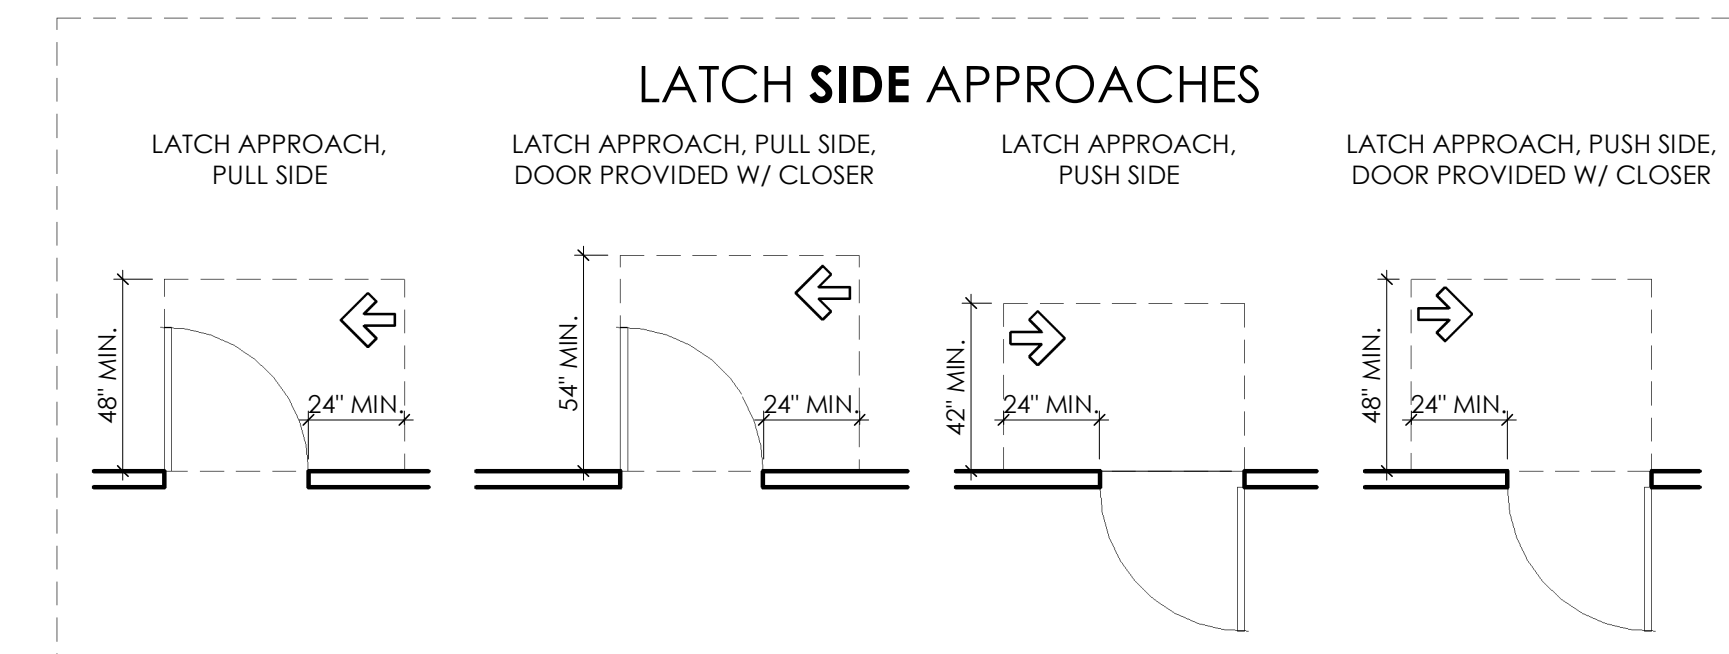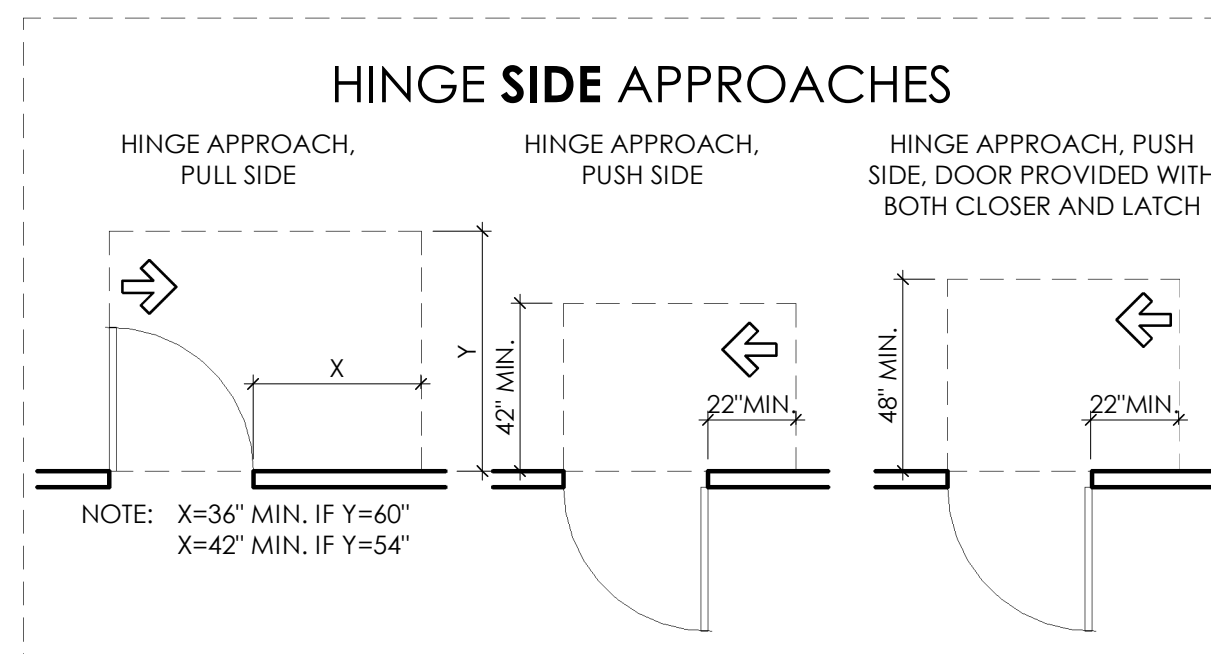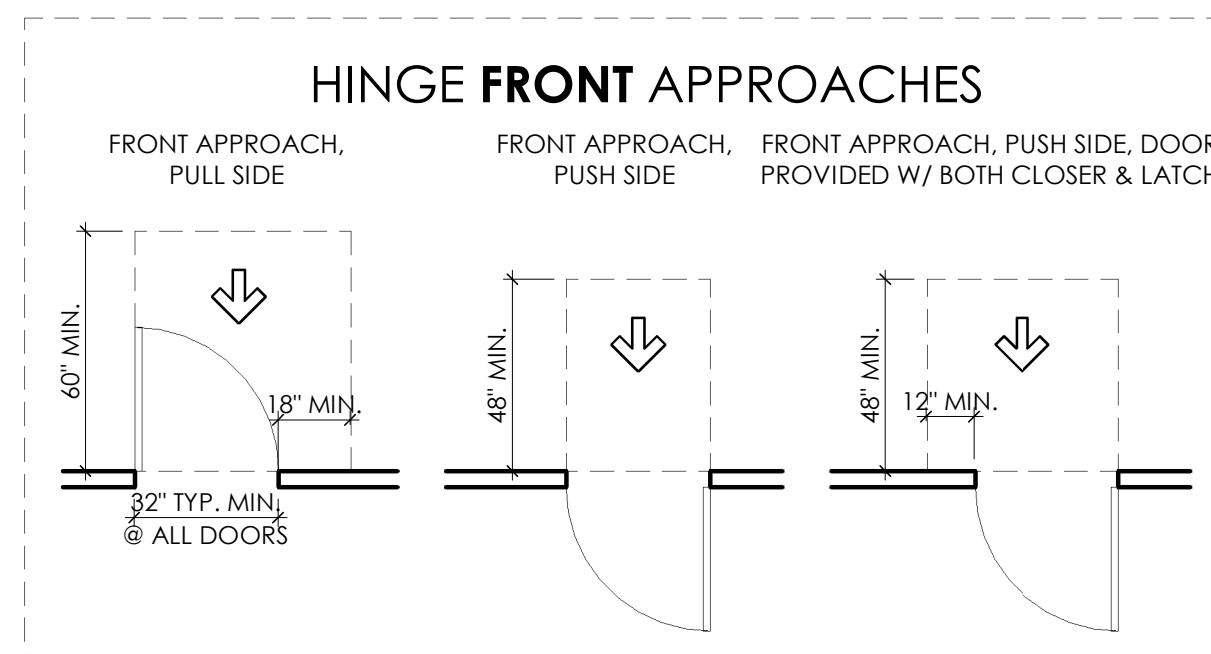

1 TAS - MANEUVERING CLEARANCES AT MANUAL SWINGING DOORS
1/4" = 1'-0"

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

NOT FOR REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.
THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF INTERIM REVIEW UNDER THE AUTHORITY OF RODNEY PALMER
01.28.2022 PERMIT SET

TEXAS ACCESSIBILITY STANDARDS


SHEET: **G001**

PROJECT NO: 21099
DRAWN BY: AG
DATE: 09.12.22
PROJECT MGR: KS

LEGEND

- 5 1/2" TILT WALL PANEL U.N.O.
- 3 5/8" METAL STUDS U.N.O.
- 6" METAL STUDS U.N.O.

WALL LEGEND

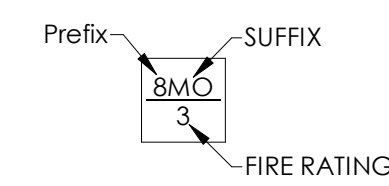

- PREFIX**
- 0 FURRING
 - 1 5 1/2" TILT WALL PANEL
 - 2 7 1/4" TILT WALL PANEL
 - 3 9 1/4" TILT WALL PANEL
 - 4 3 5/8" METAL STUD
 - 5 6" METAL STUD
 - 6 8" METAL STUD

FIRE RATING

- N NON RATED
- 1 1-HOUR RATING
- 2 2-HOUR RATING
- 3 3-HOUR RATING
- 4 4-HOUR RATING

SUFFIX


- A LOW WALL - HEIGHT PER ELEVATIONS
- B R-25 BATT INSULATION

PLAN KEY-NOTES


- 1 OUTLINE OF SOFFIT / ROOF ABOVE
- 2 LEAVE OUT IN CONCRETE FOR FUTURE UTILITIES. SEE MEP
- 3 TILT WALL PANEL JOINT
- 4 DOWNSPOUT LOCATION, PROVIDE 4" PREFINISHED METAL DOWNSPOUT, FINISH TO MATCH ADJACENT WALL FINISH MATERIAL, TYP.
- 5 STEEL COLUMN, SEE STRUCTURAL
- 6 PROVIDE 4" DIAMETER PVC PIPE SLEEVES FOR REFRIGERANT LINES RUNNING FROM ROOF
- 7 6" BOLLARD, GROUT FILLED
- 8 LEAVE OUT IN CONC. TILT WALL FOR FUTURE DRIVE THRU WINDOW, BY TENANT
- 9 RECESSED KNOX BOX LOCATION MOUNT 4-6 FEET FROM FINISHED GRADE W/ UNOBSTRUCTED VIEW FROM THE ROUTING FIRE DEPARTMENT ROADWAY - TO INCLUDE VEGETATION GROWTH UPON MATURITY, VERIFY LOCATION AND MOUNTING HEIGHT WITH FIRE MARSHALL
- 10 CONCRETE SIDEWALK / PAVING - SEE CIVIL & STRUCTURAL FOR ADDITIONAL INFORMATION.
- 11 22 GA. ARCHITECTURAL STANDING SEAM ROOF, EQUAL TO BERRIDGE, <ZINC GREY>, CEE-LOCK W/ 1/2" TALL RIBS @ 16" O.C., TYP., OVER HIGH-HEAT PEEL AND STICK MEMBRANE
- 12 TAPERED INSULATION TO CREATE MIN. OF 1/4"/12" SLOPE AWAY FROM PARAPET, TYP.
- 13 90 MIL TPO ROOF SYSTEM
- 14 PREFAB. ALUMINUM CANOPY, EQUAL TO ARCHITECTURAL FABRICATIONS, HELIOS CANOPY SYSTEM, 20 YR WARRANTY POWDER-COATED FINISH.
- 15 PREFINISHED METAL COPING, SEE WALL DETAILS FOR ADDITIONAL INFORMATION.
- 16 SMOOTH STONE WALL CAP, SLOPED TO DRAIN, SEE WALL DETAILS FOR ADDITIONAL INFORMATION.
- 17 LINE OF FRAME WALL BELOW, TYP.
- 18 LOCATION FOR FUTURE RTU ZONE ON ROOF, SEE MEP AND STRUCTURAL FOR ADDITIONAL INFORMATION.
- 19 ALUMINUM THRU-WALL SCUPPER, PAINTED TO MATCH DOWNSPOUTS.
- 20 5" PREFINISHED SQUARED METAL GUTTER
- 21 TPO WALKWAY PAD, INSTALLED PER MANUFACTURER REQUIREMENTS, EQUAL TO FIRESTONE ULTRAPLY
- 22 LOCATION OF ELECTRICAL PANEL BOX, SEE MEP
- 23 WALL MOUNTED ACCESS LADDER WITH SECURITY DOOR, PER CODE
- 24 LOCATION FOR FUTURE DRIVE THRU ORDER SIGNAGE

GENERAL PLAN NOTES

- A. FIRE EXTINGUISHERS - PROVIDE A MINIMUM SIZE 2A: 10ABC FIRE EXTINGUISHERS MEETING THE TRAVEL DISTANCE OF 75 FEET TO AN EXTINGUISHER FROM ALL PORTIONS. INSTALLATION LOCATIONS TO BE VERIFIED BY LICENSED INSPECTOR. SEE LIFE SAFETY PLAN FOR SUGGESTED LOCATIONS.
- B. SPRAY FOAM INSULATION APPLICATION IS TO BE INSTALLED PER CODE AND AN ICC-ES REPORT MUST BE PROVIDED TO FIRE DEPARTMENT FOR SEPARATE REVIEW AND APPROVAL.
- C. REFER TO WALL SECTIONS & DETAILS SHEETS FOR EXTERIOR WALL TYPES
- D. KNOX BOX LOCATION(S) TO BE APPROVED BY FIRE DEPARTMENT AND SHALL BE INSTALLED NO LESS THAN 48" AND NO MORE THAN 72" ABOVE FINISHED GRADE.
- E. ALL SIGNAGE REQUIRES A SEPARATE APPLICATION AND APPROVAL FROM THE BUILDING INSPECTIONS DEPARTMENT. NO SIGNAGE IS APPROVED WITH THE SITE DEVELOPMENT PLAN OR BUILDING'S CONSTRUCTION DOCUMENTS.
- F. DIMENSIONS ARE TO THE FACE OF STUD OR FACE OF CMU UNO.
- G. ALIGN FACE OF WALLS WITH FACE OF COLUMN WRAPS, WHERE POSSIBLE, WHERE OCCURS, TYP., UNO.
- H. PROVIDE CJS AT 30'-0" OC MAX AT DOORS AND WINDOWS (AS INDICATED ON INTERIOR ELEVATIONS OF GYP BD WALL ASSEMBLIES.)

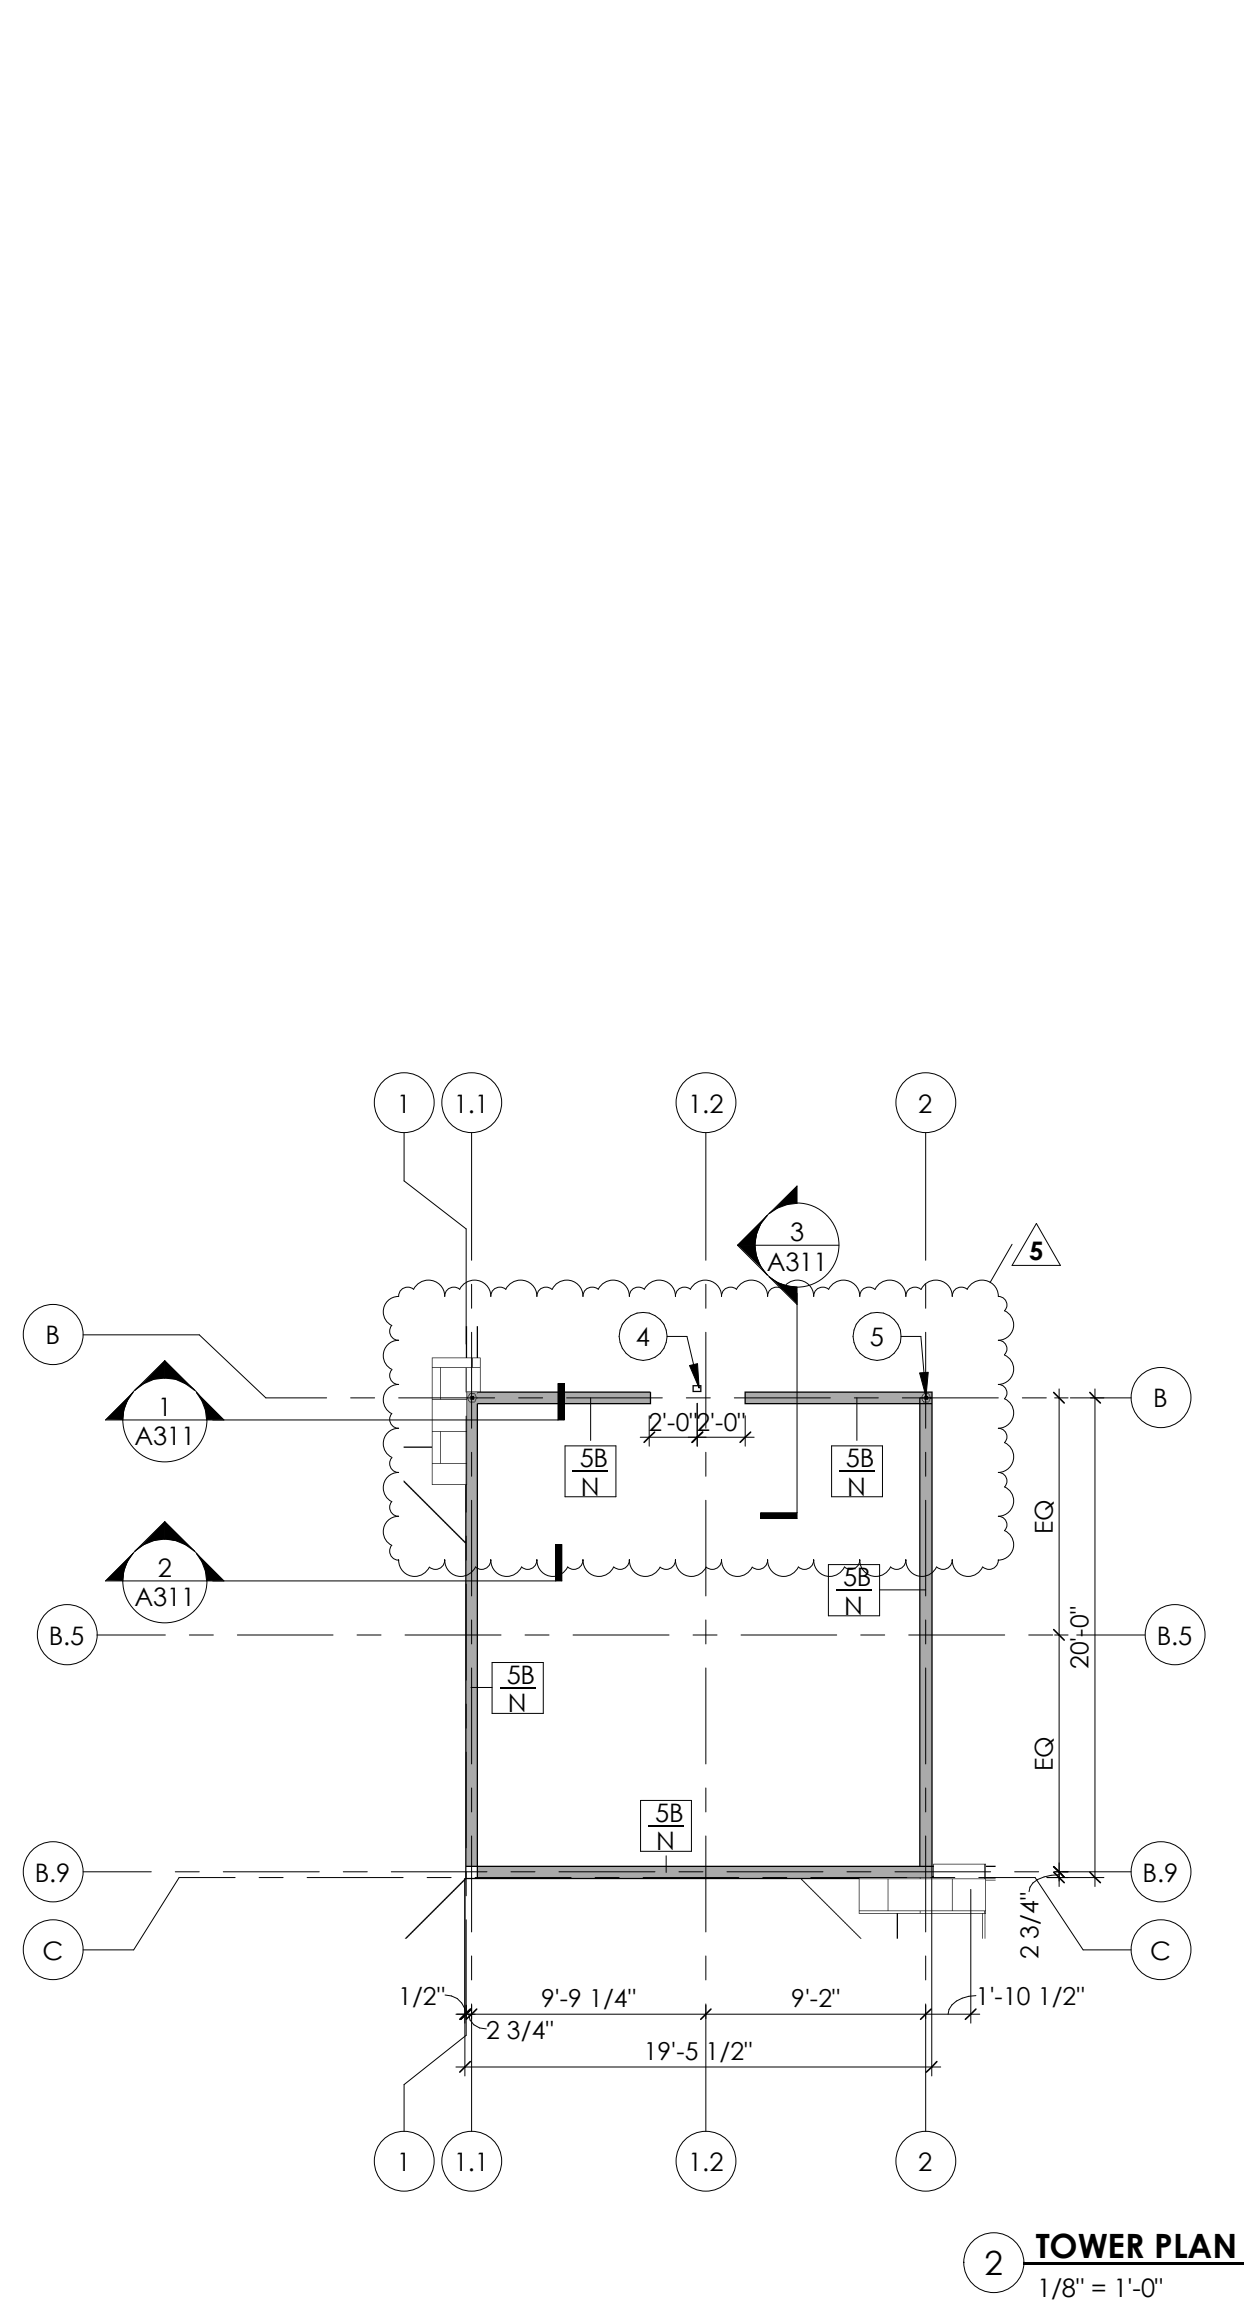

2 TOWER PLAN
1/8" = 1'-0"

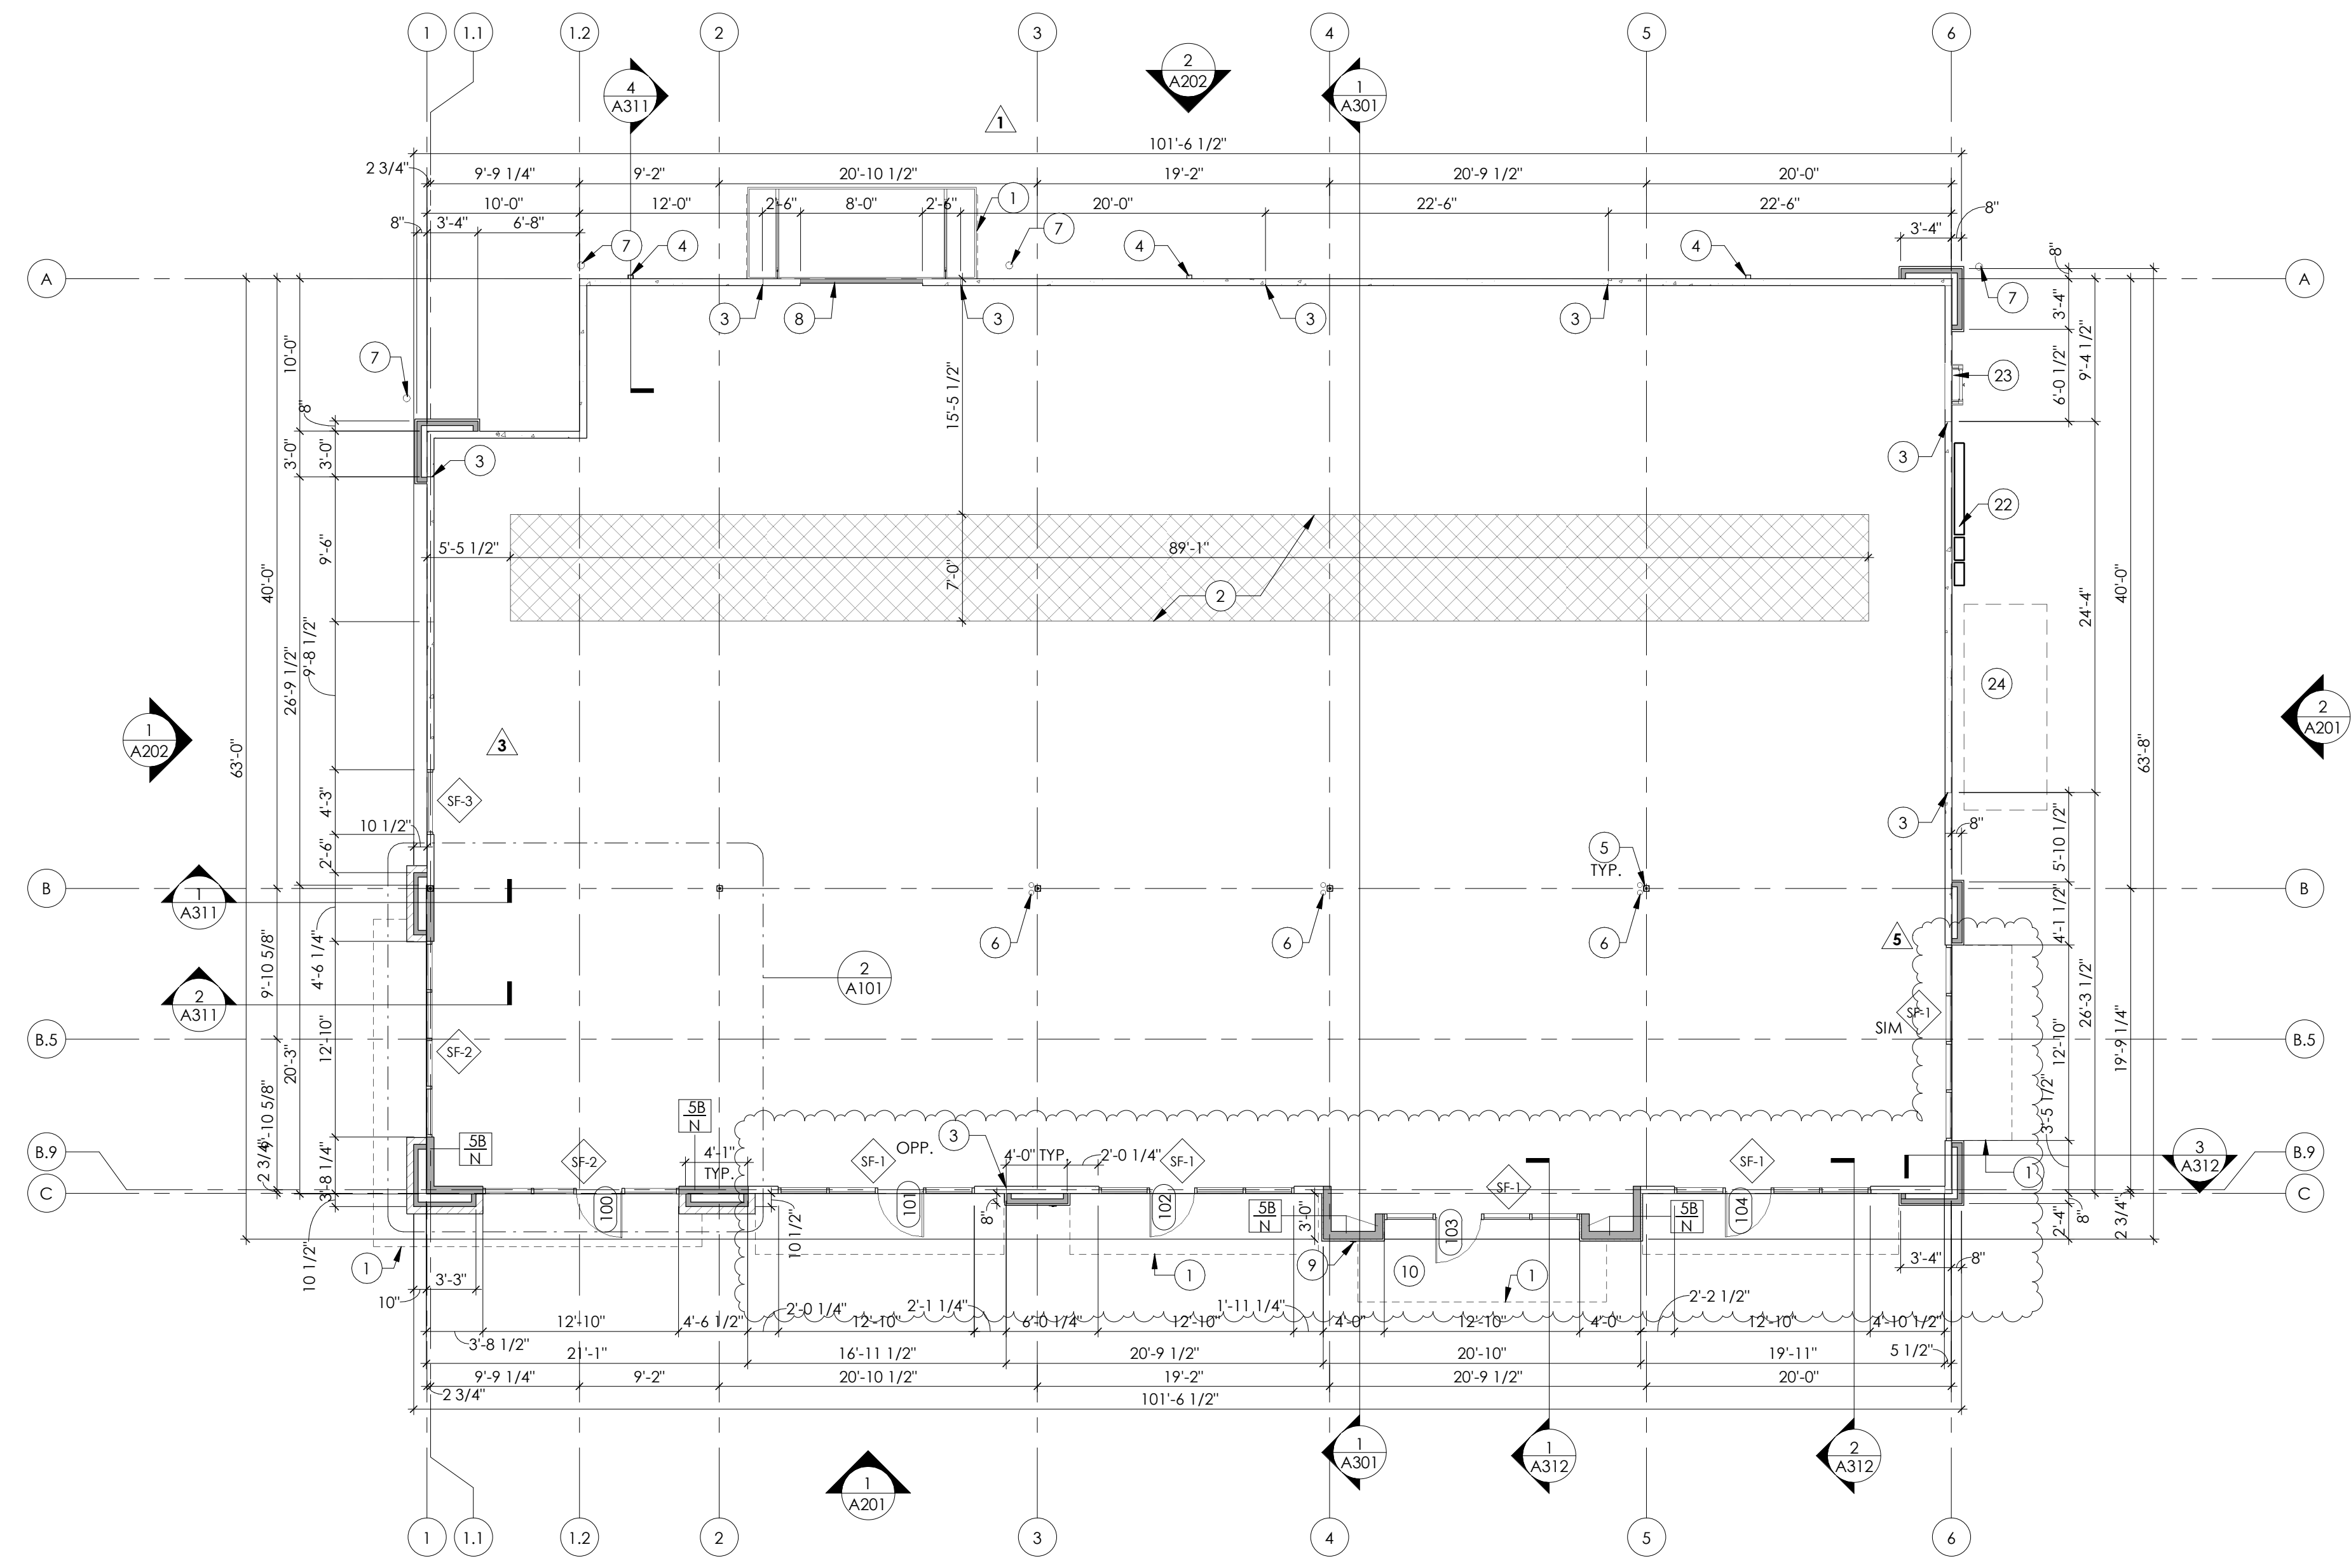

1 FLOOR PLAN
1/8" = 1'-0"

ALIGN
AUSTIN ARCHITECTS

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

- 1 05.25.22 Revision 1
- 3 09.12.22 City Comments
- 5 08.XX.24 VE

NOT FOR REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF INTERIM REVIEW UNDER THE AUTHORITY OF RODNEY PALMER ARCHITECT

01.28.2022
PERMIT SET
FLOOR PLAN

SHEET: **A101**

PROJECT NO: 21099
DRAWN BY: MD, AG
DATE: 09.12.22
PROJECT MGR: KS

PLAN KEY-NOTES

- 1 OUTLINE OF SOFFIT/ ROOF ABOVE
- 2 LEAVE OUT IN CONCRETE FOR FUTURE UTILITIES, SEE MEP
- 3 TILT WALL PANEL JOINT
- 4 DOWNSPOUT LOCATION, PROVIDE 4" PREFINISHED METAL DOWNSPOUT, FINISH TO MATCH ADJACENT WALL FINISH MATERIAL, TYP.
- 5 STEEL COLUMN, SEE STRUCTURAL
- 6 PROVIDE 4" DIAMETER PVC PIPE SLEEVES FOR REFRIGERANT LINES RUNNING FROM ROOF
- 7 6" BOLLARD, GROUT FILLED
- 8 LEAVE OUT IN CONC. TILT WALL FOR FUTURE DRIVE THRU WINDOW, BY TENANT
- 9 RECESSED KNOX BOX LOCATION MOUNT 4-6 FEET FROM FINISHED GRADE W/ UNOBSTRUCTED VIEW FROM THE ROUTING FIRE DEPARTEMENT ROADWAY - TO INCLUDE VEGETATION GROWTH UPON MATURITY, VERIFY LOCATION AND MOUNTING HEIGHT WITH FIRE MARSHALL
- 10 CONCRETE SIDEWALK / PAVING - SEE CIVIL & STRUCTURAL FOR ADDITIONAL INFORMATION.
- 11 22 GA. ARCHITECTURAL STANDING SEAM ROOF, EQUAL TO BERRIDGE, <ZIN GREY>, CEE-LOCK W/ 1/2" TALL RIBS @ 16" O.C., TYP., OVER HIGH-HEAT PEEL AND STICK MEMBRANE
- 12 TAPERED INSULATION TO CREATE MIN. OF 1/4" / 12" SLOPE AWAY FROM PARAPET, TYP.
- 13 90 MIL TPO ROOF SYSTEM
- 14 PREFAB. ALUMINUM CANOPY, EQUAL TO ARCHITECTURAL FABRICATIONS, HELIOS CANOPY SYSTEM, 20 YR WARRANTY POWDER-COATED FINISH, PREFINISHED METAL COPING, SEE WALL DETAILS FOR ADDITIONAL INFORMATION.
- 15 SMOOTH STONE WALL CAP, SLOPED TO DRAIN, SEE WALL DETAILS FOR ADDITIONAL INFORMATION.
- 16 LINE OF FRAME WALL BELOW, TYP.
- 17 LOCATION FOR FUTURE RTU ZONE ON ROOF, SEE MEP AND STRUCTURAL FOR ADDITIONAL INFORMATION.
- 18 ALUMINUM THRU-WALL SCUPPER, PAINTED TO MATCH DOWNSPOUTS.
- 19 5" PREFINISHED SQUARED METAL GUTTER
- 20 TPO WALKWAY PAD, INSTALLED PER MANUFACTURER REQUIREMENTS, EQUAL TO FIRESTONE ULTRAFLY
- 21 LOCATION OF ELECTRICAL PANEL BOX, SEE MEP
- 22 WALL MOUNTED ACCESS LADDER WITH SECURITY DOOR, PER CODE
- 23 LOCATION FOR FUTURE DRIVE THRU ORDER SIGNAGE

ALIGN
AUSTIN ARCHITECTS

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.


1 05.25.22 Revision 1
5 08.XX.24 VE

NOT FOR REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.
THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF INTERIM REVIEW UNDER THE AUTHORITY OF RODNEY PALMER ARCHITECT

01.28.2022
PERMIT SET

SHEET: **A121**

PROJECT NO: 21099
DRAWN BY: MD, AG
DATE: 09.12.22
PROJECT MGR: KS

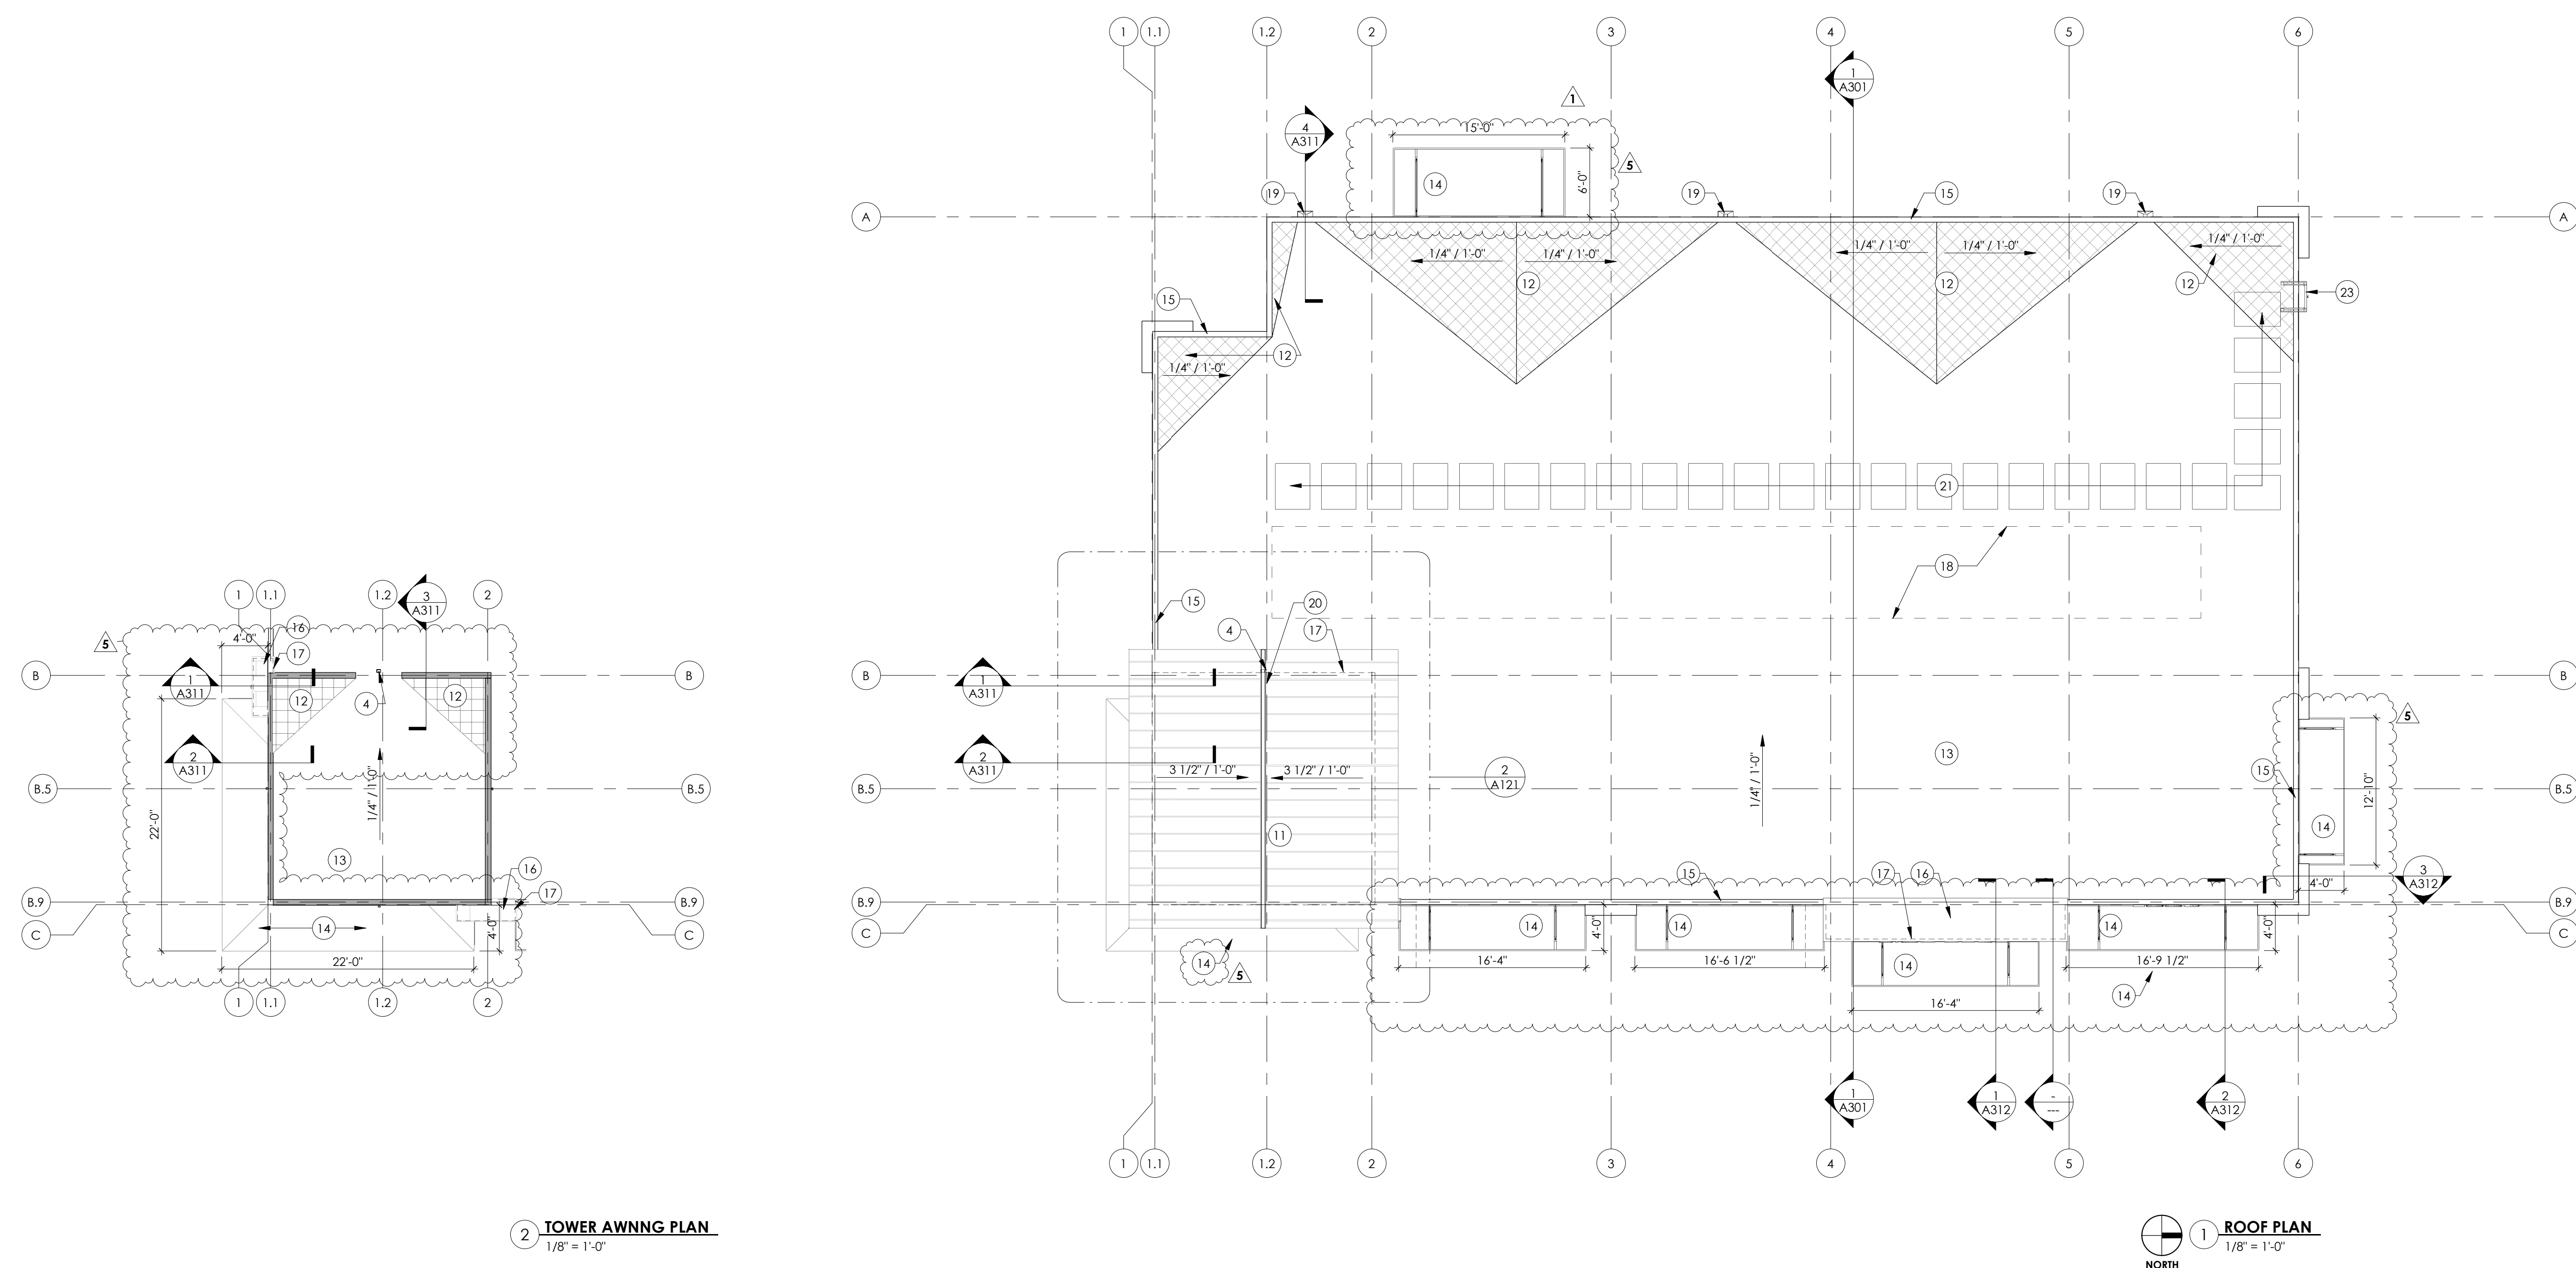


2 TOWER AWNING PLAN
1/8" = 1'-0"

1 ROOF PLAN
1/8" = 1'-0"



4 NORTH CENTRIA PANEL LAYOUT
1/4" = 1'-0"

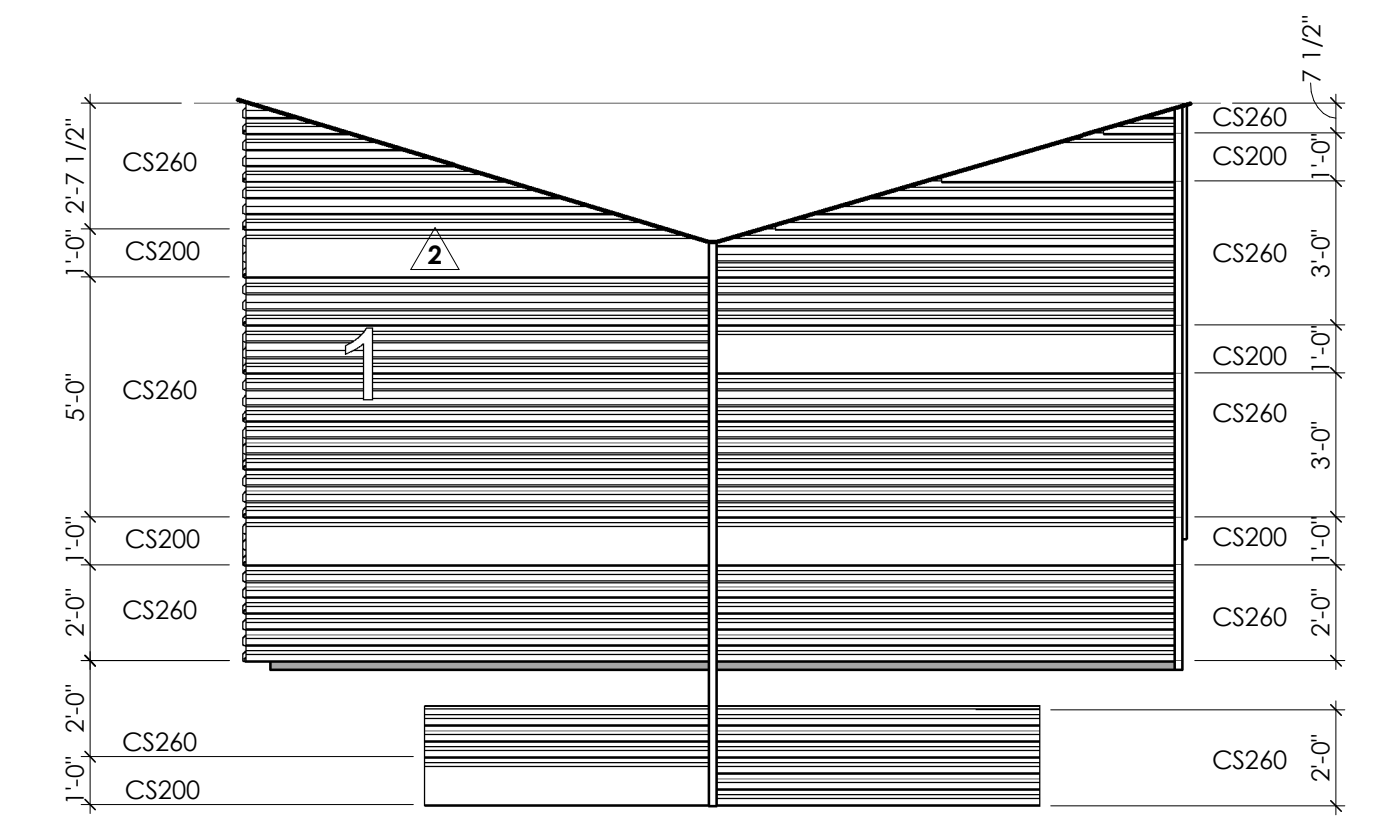

3 EAST CENTRIA PANEL LAYOUT
1/4" = 1'-0"

MATERIAL LEGEND

- MT-1 22 GA GALVANIZED CENTRIA PANEL, CONCEPT SERIES (REFER TO ENLARGED VIEWS FOR PROFILE LAYOUT), CHARCOAL GREY
- MT-2 22 GA ARCHITECTURAL METAL STANDING SEAM ROOF, EQUAL TO BERRIDGE, PREWEATHERED GALVALUME, CEE-LOCK W/ 1 1/2" TALL RIBS AT 16" O.C.
- MT-3 PREFINISHED METAL FASCIA, PREWEATHERED GALVALUME
- CP-1 STUCCO 1, APPLIED STUCCO FINISH, COLOR TO MATCH STO EIDER WHITE
- CP-2 STUCCO 2, COLOR TO MATCH STO ELEPHANT EAR
- ST-1 STONEBROOK NATURAL STONE VENEER, WHITE, FACE CUT ALL SIDES
- WD-1 NICHHA WOOD SERIES, VINTAGEWOOD, CEDAR

EXTERIOR WALL MATERIAL (EWS) CALCULATIONS:

WEST :	ACTUAL
GROSS WALL AREA	1815.12 SF
DOORS AND WINDOWS	0 SF (0%)
NET WALL AREA	1815.12 SF
EWS	1815.12 SF (100%)

NORTH :	ACTUAL
GROSS WALL AREA	1139.08 SF
DOORS AND WINDOWS	128.33 SF (11.3%)
NET WALL AREA	1010.75 SF
EWS	967.25 SF (95.6%)


EAST:	ACTUAL
GROSS WALL AREA	1986.21 SF
DOORS AND WINDOWS	669.46 SF (33.5%)
NET WALL AREA	1316.75 SF
EWS	844.83 SF (64.1%)

SOUTH (STREET FACING WALL):	ACTUAL
GROSS WALL AREA	1325.74 SF
DOORS AND WINDOWS	198.86 (15 %)
NET WALL AREA	1126.88SF
EWS	844.9 SF (75%)


TOTAL BUILDING:	ACTUAL	REQUIRED
GROSS WALL AREA	6245.3 SF	
DOORS AND WINDOWS	976.65 SF (15%)	
NET WALL AREA	5268.07 SF	
EWS	4472.1 SF (85%)	85% MIN REQ'D

NOTES:
EXTERIOR SURFACE AREA OF BUILDING IS COMPRISED OF AT LEAST 85% MASONRY FOR FIRST STORY WALLS AND AT LEAST 50% MASONRY FOR THE EXTERIOR SURFACE AREA OF EACH ADDITIONAL STORY PER CITY OF LEANDER COMPOSITE ZONING ORDINANCE, ARTICLE VI, SECTION 6, PARAGRAPH G-1.
A MINIMUM OF 15% OF THE FRONT PRIMARY BUILDING FACADE CONSISTS OF WINDOW AND DOOR OPENINGS PER CITY OF LEANDER COMPOSITE ZONING ORDINANCE, ARTICLE VI, SECTION 2, PARAGRAPH B-1.
EWS = CUT STONE AND CONCRETE TILT WALL WITH A DECORATIVE FINISH
(4) DESIGN FEATURES REPRESENTED ON THE BUILDING FRONT PER CITY OF LEANDER COMPOSITE ZONING ORDINANCE, ARTICLE VII, SECTION 2, PARAGRAPH B-2.

NOTES:
1. ALL PERMANENT EXTERIOR LIGHTING SHALL BE NON-FLASHING AND SHIELDED SUCH THAT THE LIGHT SOURCES IS NOT VISIBLE FROM THE PUBLIC RIGHT-OF-WAY OR ADJACENT RESIDENTIAL USES AT THE PROPERTY LINE. WALL PACK LIGHTING AND OTHER LIGHTING THAT DIRECTS THE LIGHT IN A HORIZONTAL DIRECTION WITHOUT AN ADEQUATE SHIELD IS NOT PERMITTED IF THERE ARE STREETS OR RESIDENTIAL USES IN THE DIRECTION OF THE LIGHT.
2. ALL SITE UTILITY LINES ARE PROPOSED TO BE LOCATED UNDERGROUND.
3. WINDOWS SHALL HAVE A MAXIMUM EXTERIOR REFLECTIVITY OF TWENTY (20%) PERCENT.

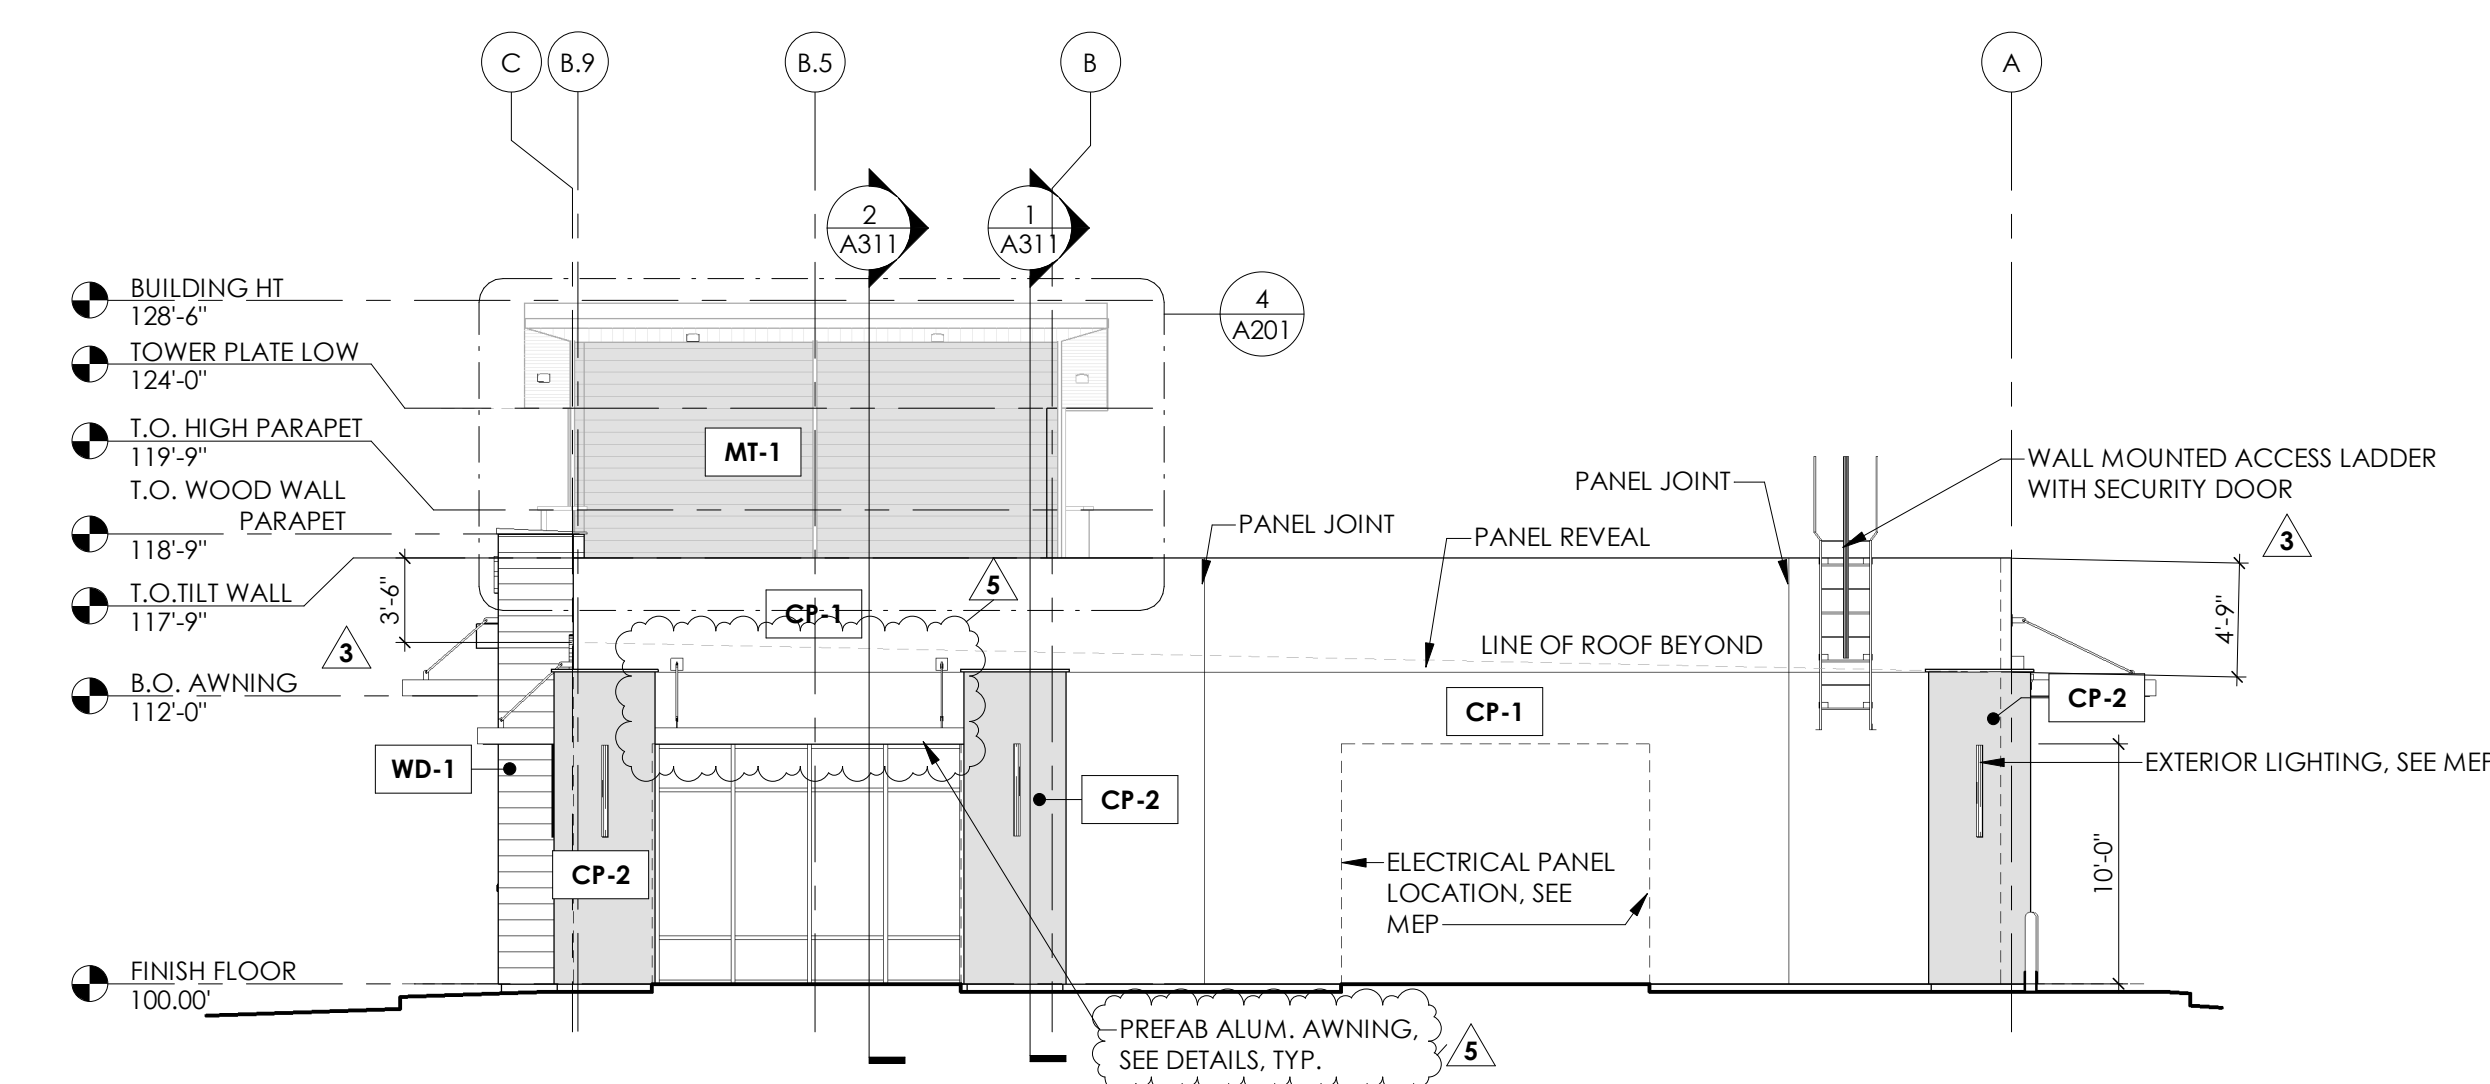

2 EXTERIOR ELEVATION - NORTH
1/8" = 1'-0"

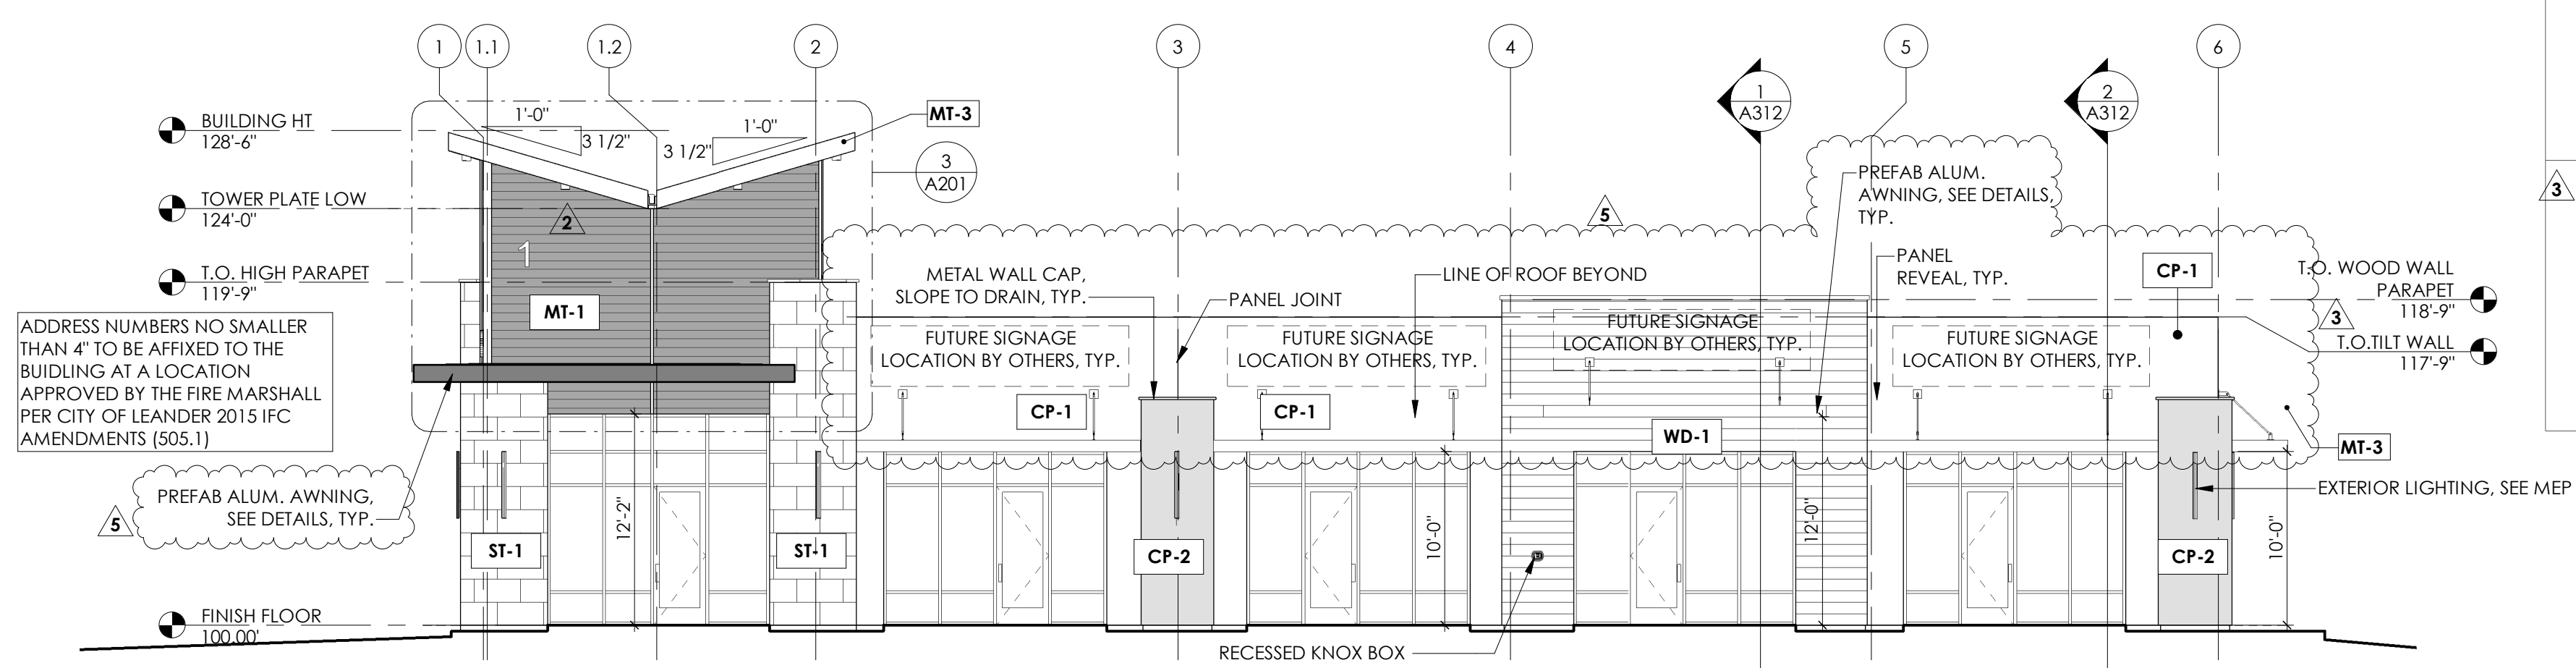

1 EXTERIOR ELEVATION - EAST
1/8" = 1'-0"

ADDRESS NUMBERS NO SMALLER THAN 4" TO BE AFFIXED TO THE BUILDING AT A LOCATION APPROVED BY THE FIRE MARSHALL PER CITY OF LEANDER 2015 IFC AMENDMENTS (505.1)

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM BY ANY METHOD FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.


- 2 06.17.22 Revision 2
- 3 09.12.22 City Comments
- 5 08.XX.24 VE

NOT FOR REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.
THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF INTERIM REVIEW UNDER THE AUTHORITY OF RODNEY PALMER
01.28.2022 PERMIT SET

EXTERIOR ELEVATIONS

SHEET: **A201**

PROJECT NO: 21099
DRAWN BY: MD, AG
DATE: 09.12.22
PROJECT MGR: KS

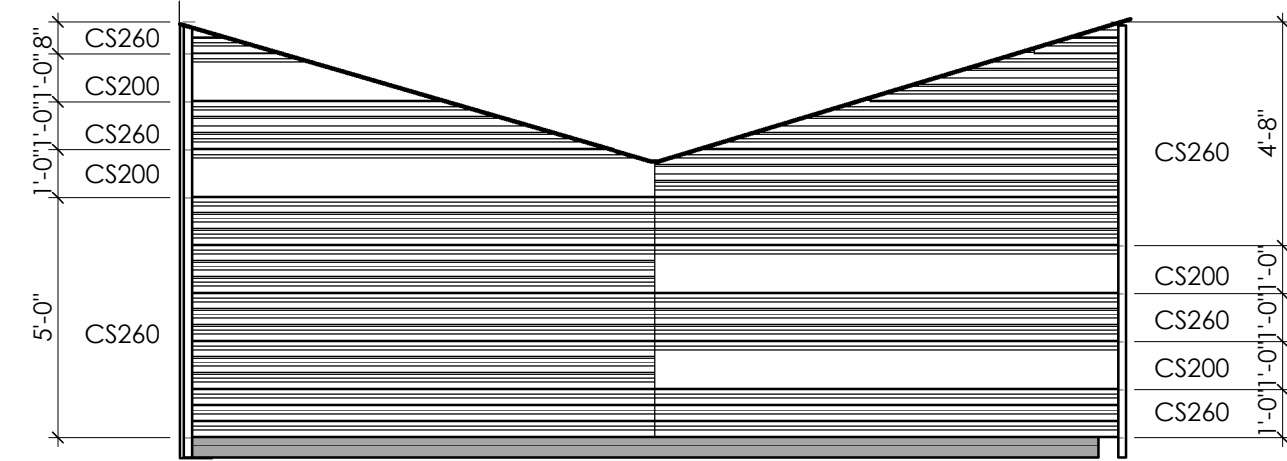

4 WEST CENTRIA PANEL LAYOUT
1/4" = 1'-0"




3 SOUTH CENTRIA PANEL LAYOUT
1/4" = 1'-0"

MATERIAL LEGEND


- MT-1 22 GA GALVANIZED CENTRIA PANEL, CONCEPT SERIES (REFER TO ENLARGED VIEWS FOR PROFILE LAYOUT), CHARCOAL GREY
- MT-2 22 GA ARCHITECTURAL METAL STANDING SEAM ROOF, EQUAL TO BERRIDGE, PREWEATHERED GALVALUME, CEE-LOCK W/ 1 1/2" TALL RIBS AT 16" O.C.
- MT-3 PREFINISHED METAL FASCIA, PREWEATHERED GALVALUME
- CP-1 STUCCO 1, APPLIED STUCCO FINISH, COLOR TO MATCH STO EIDER WHITE
- CP-2 STUCCO 2, COLOR TO MATCH STO ELEPHANT EAR
- ST-1 STONEBROOK NATURAL STONE VENEER, WHITE, FACE CUT ALL SIDES
- WD-1 NICHIIHA WOOD SERIES, VINTAGEWOOD, CEDAR

NOTES:

1. ALL PERMANENT EXTERIOR LIGHTING SHALL BE NON-FLASHING AND SHIELDED SUCH THAT THE LIGHT SOURCES IS NOT VISIBLE FROM THE PUBLIC RIGHT-OF-WAY OR ADJACENT RESIDENTIAL USES AT THE PROPERTY LINE. WALL PACK LIGHTING AND OTHER LIGHTING THAT DIRECTS THE LIGHT IN A HORIZONTAL DIRECTION WITHOUT AN ADEQUATE SHIELD IS NOT PERMITTED IF THERE ARE STREETS OR RESIDENTIAL USES IN THE DIRECTION OF THE LIGHT.
2. ALL SITE UTILITY LINES ARE PROPOSED TO BE LOCATED UNDERGROUND.
3. WINDOWS SHALL HAVE A MAXIMUM EXTERIOR REFLECTIVITY OF TWENTY (20%) PERCENT.

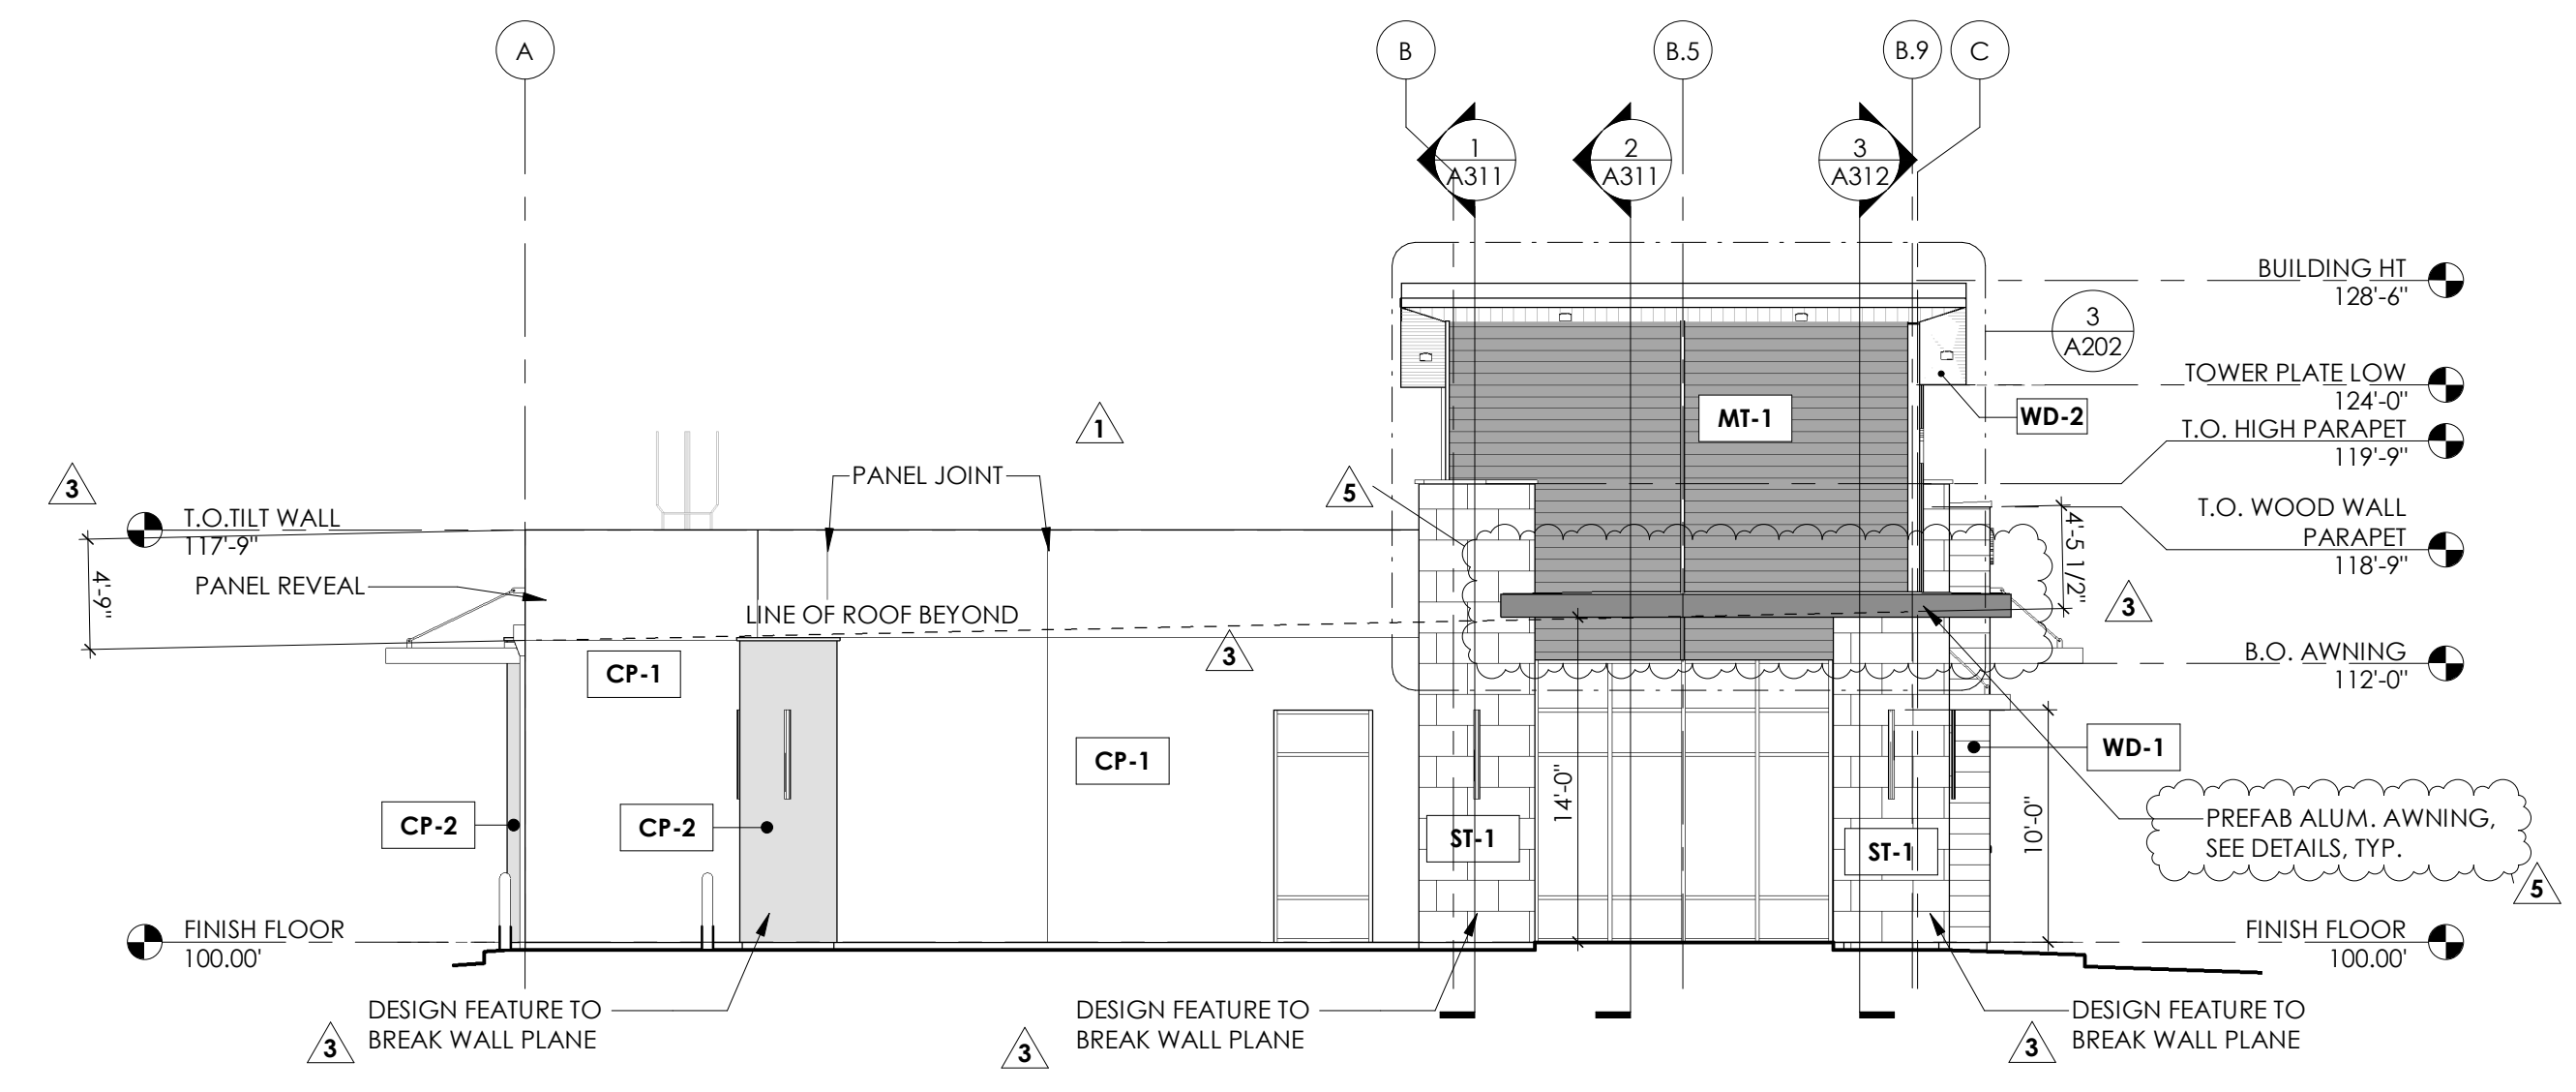

1 EXTERIOR ELEVATION - SOUTH
(ROW)
1/8" = 1'-0"

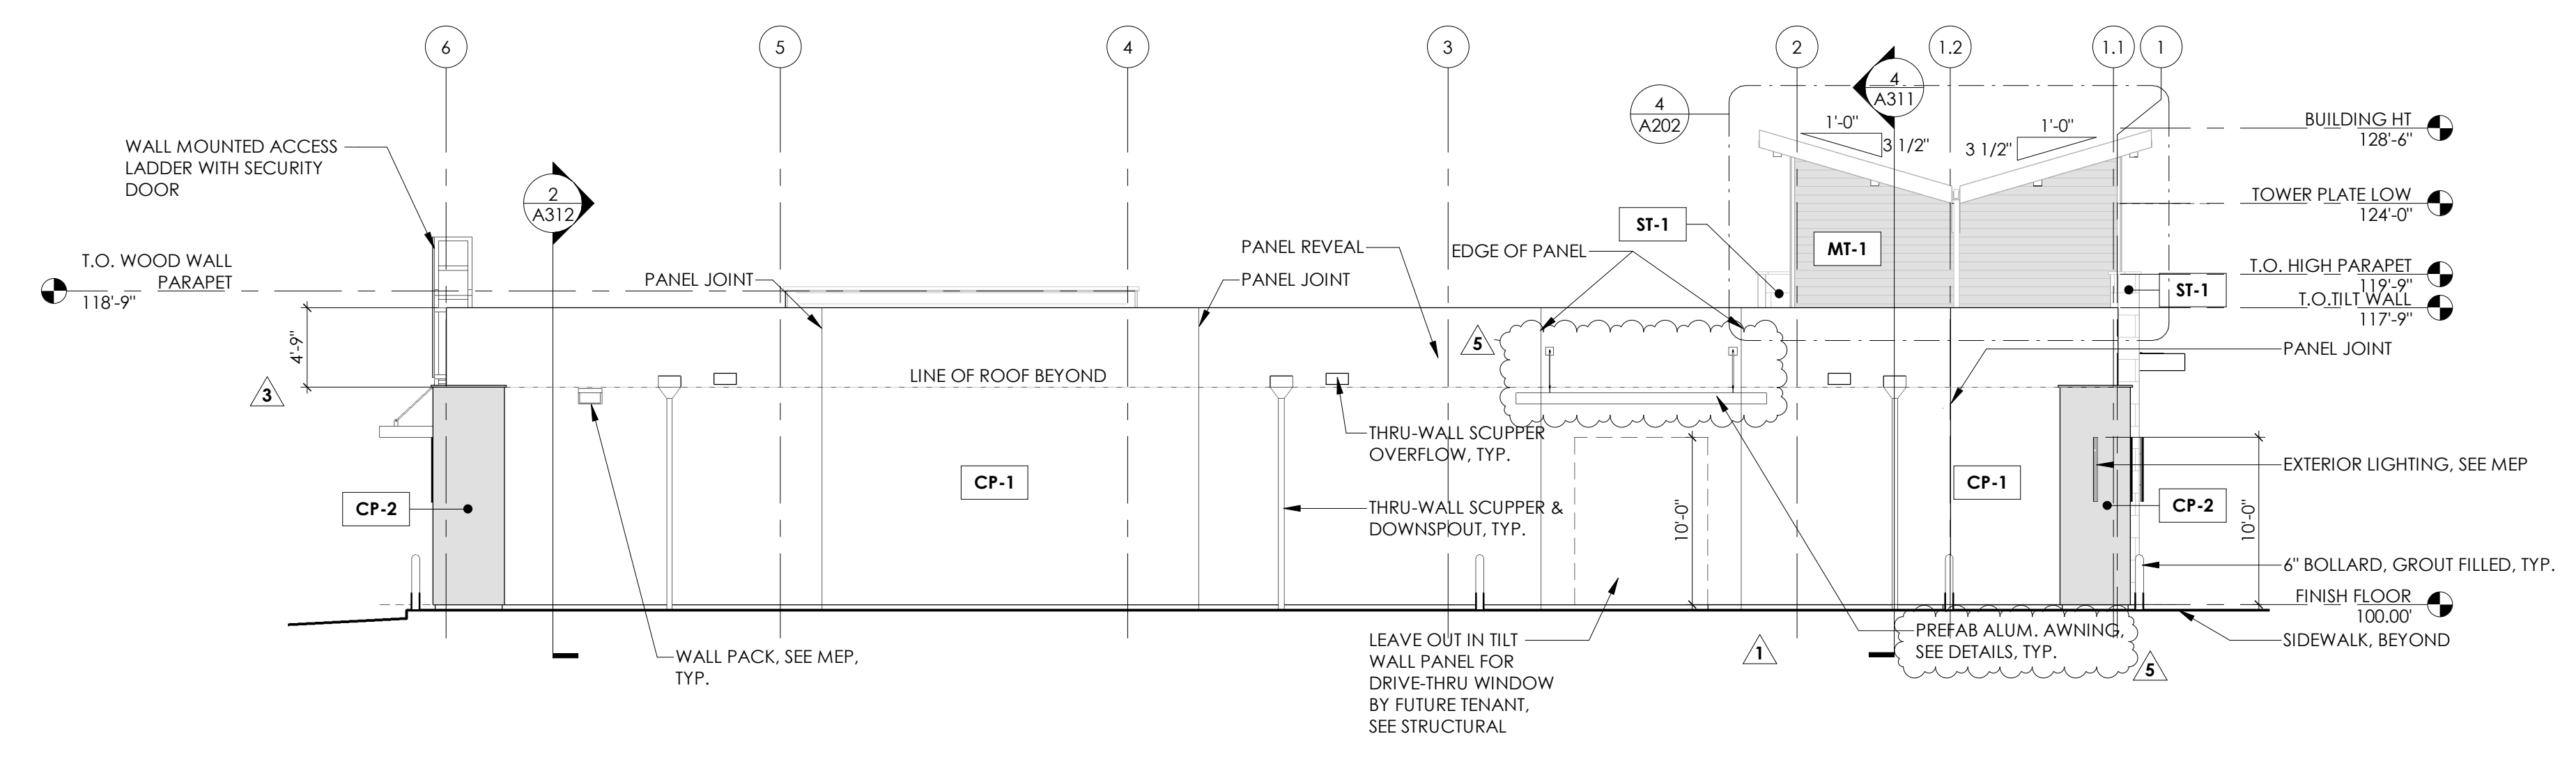

2 EXTERIOR ELEVATION - WEST
1/8" = 1'-0"

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.


- 1 05.25.22 Revision 1
- 3 09.12.22 City Comments
- 5 08.XX.24 VE

NOT FOR REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.
THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF INTERIM REVIEW UNDER THE AUTHORITY OF RODNEY PALMER
01.28.2022 PERMIT SET

EXTERIOR ELEVATIONS

SHEET: **A202**

PROJECT NO: 21099
DRAWN BY: AG
DATE: 09.12.22
PROJECT MGR: KS

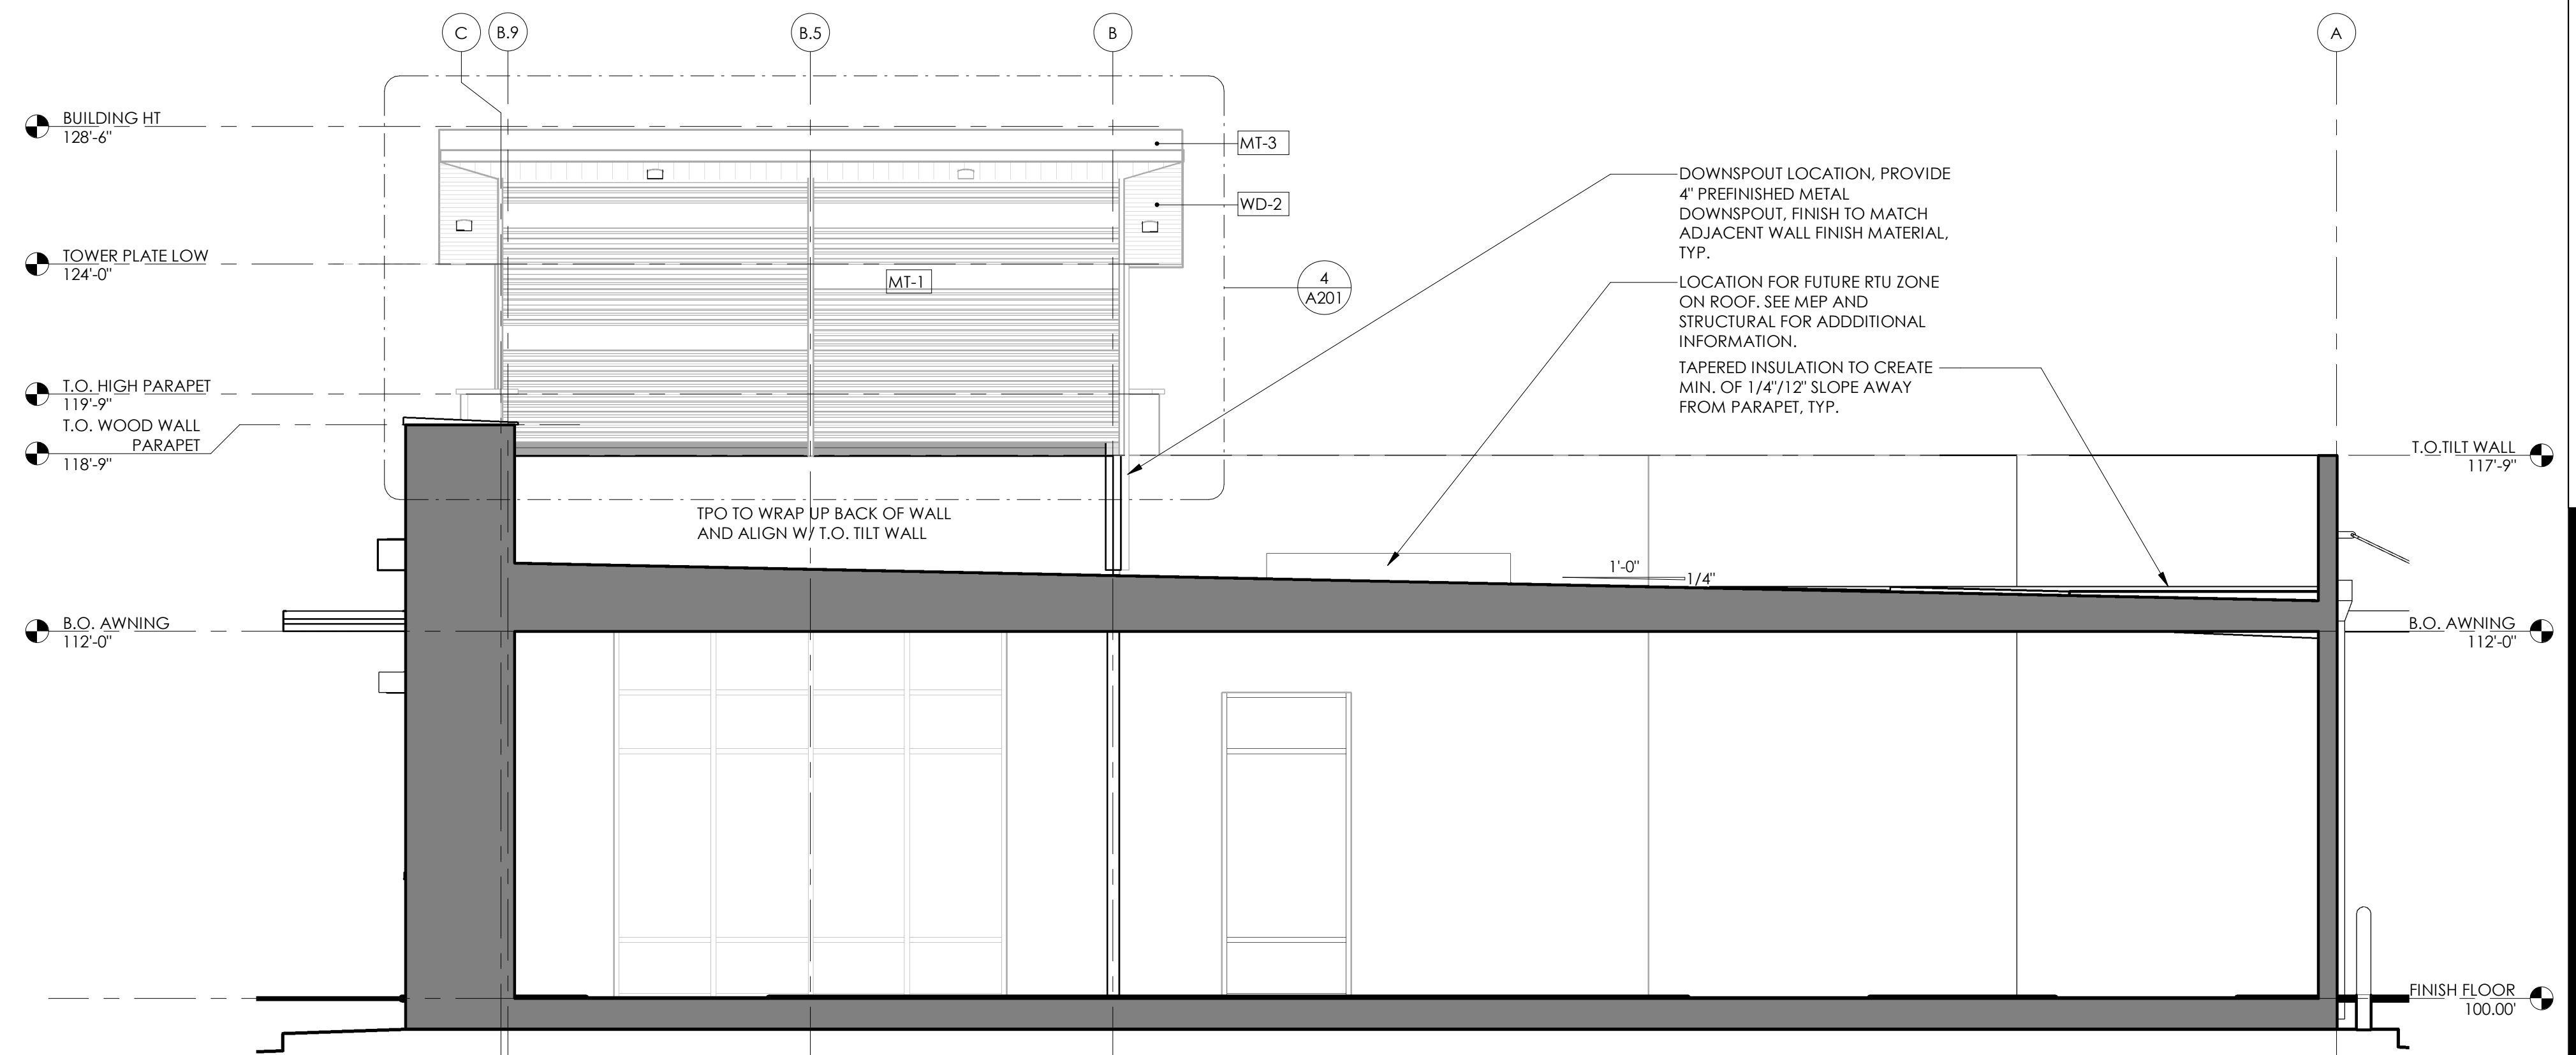

1 BUILDING SECTION
 1/4" = 1'-0"

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
 THESE DESIGNS/DRAWINGS ARE THE SOLE
 PROPERTY OF ALIGN AUSTIN ARCHITECTS
 AND MAY NOT BE REPRODUCED IN ANY FORM
 BY ANY METHOD, FOR ANY PURPOSE
 WITHOUT PREVIOUS WRITTEN PERMISSION.


**NOT FOR
 REGULATORY
 APPROVAL,
 PERMITTING, OR
 CONSTRUCTION.**




THIS DOCUMENT IS RELEASED FOR
 THE PURPOSE OF INTERIM REVIEW
 UNDER THE AUTHORITY OF
 RODNEY PALMER
 ARCHITECT

01.28.2022
 PERMIT SET

SHEET: A301

PROJECT NO: 21099
DRAWN BY: AG
DATE: 09.12.22
PROJECT MGR: KS

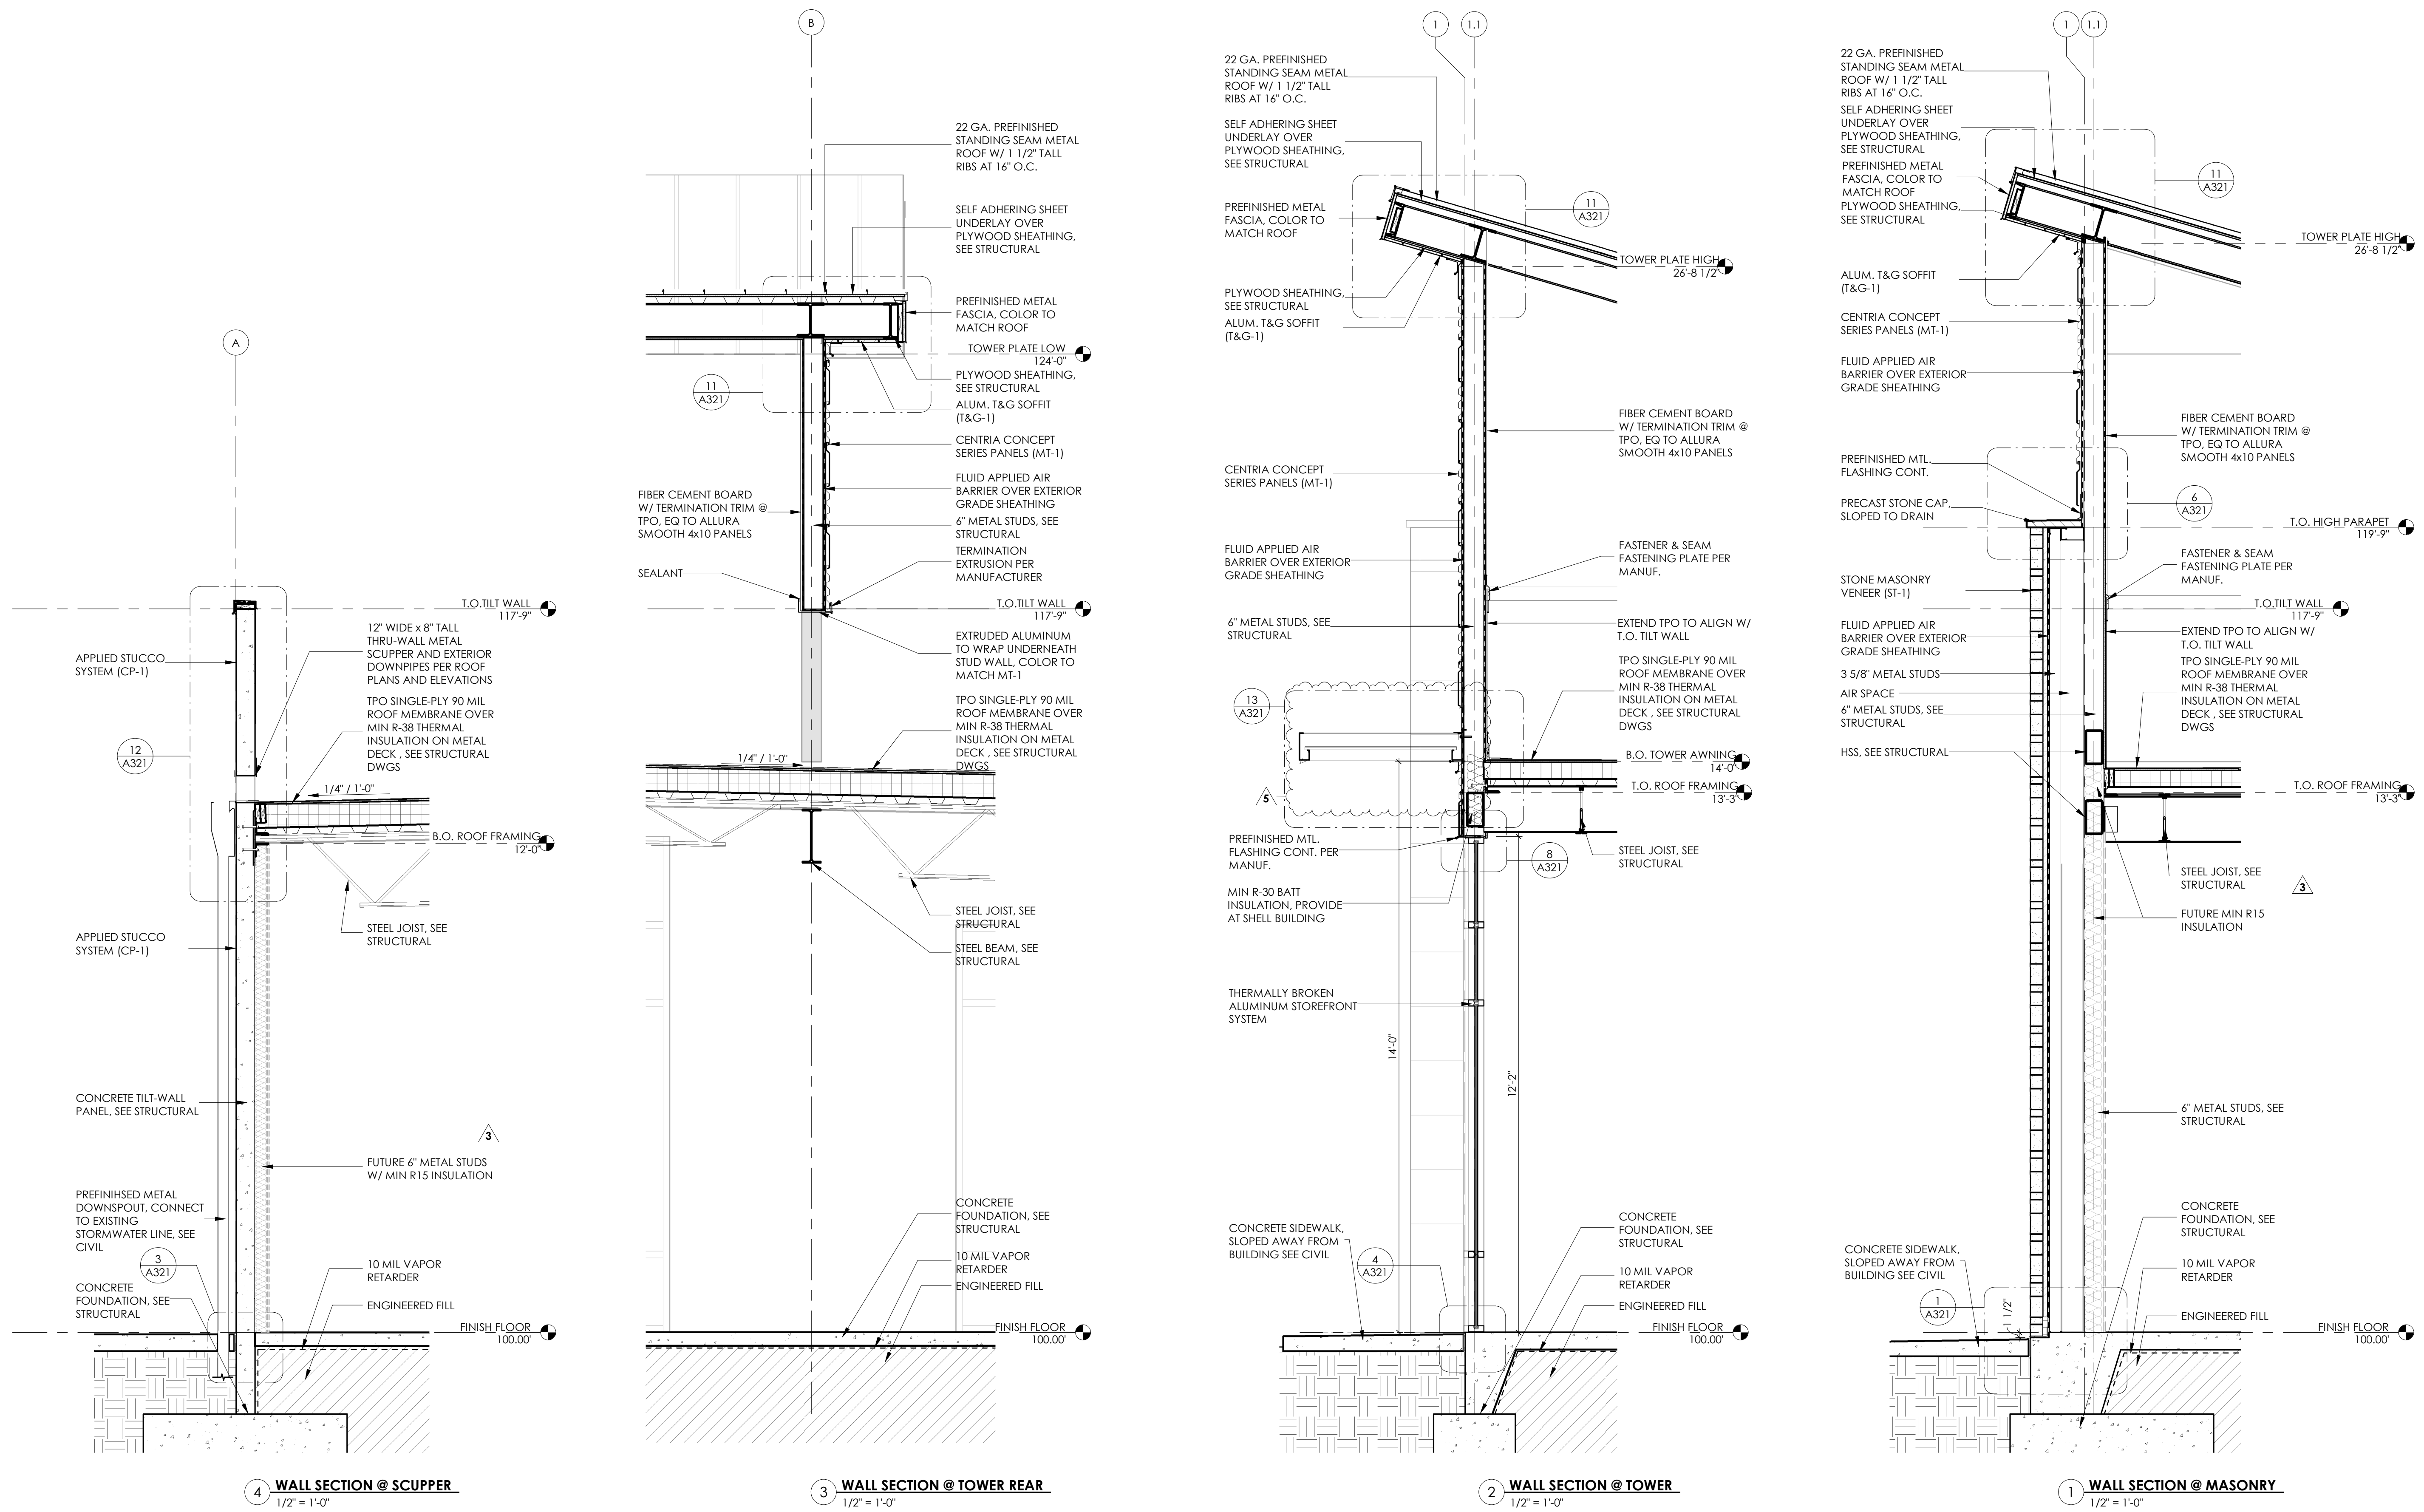

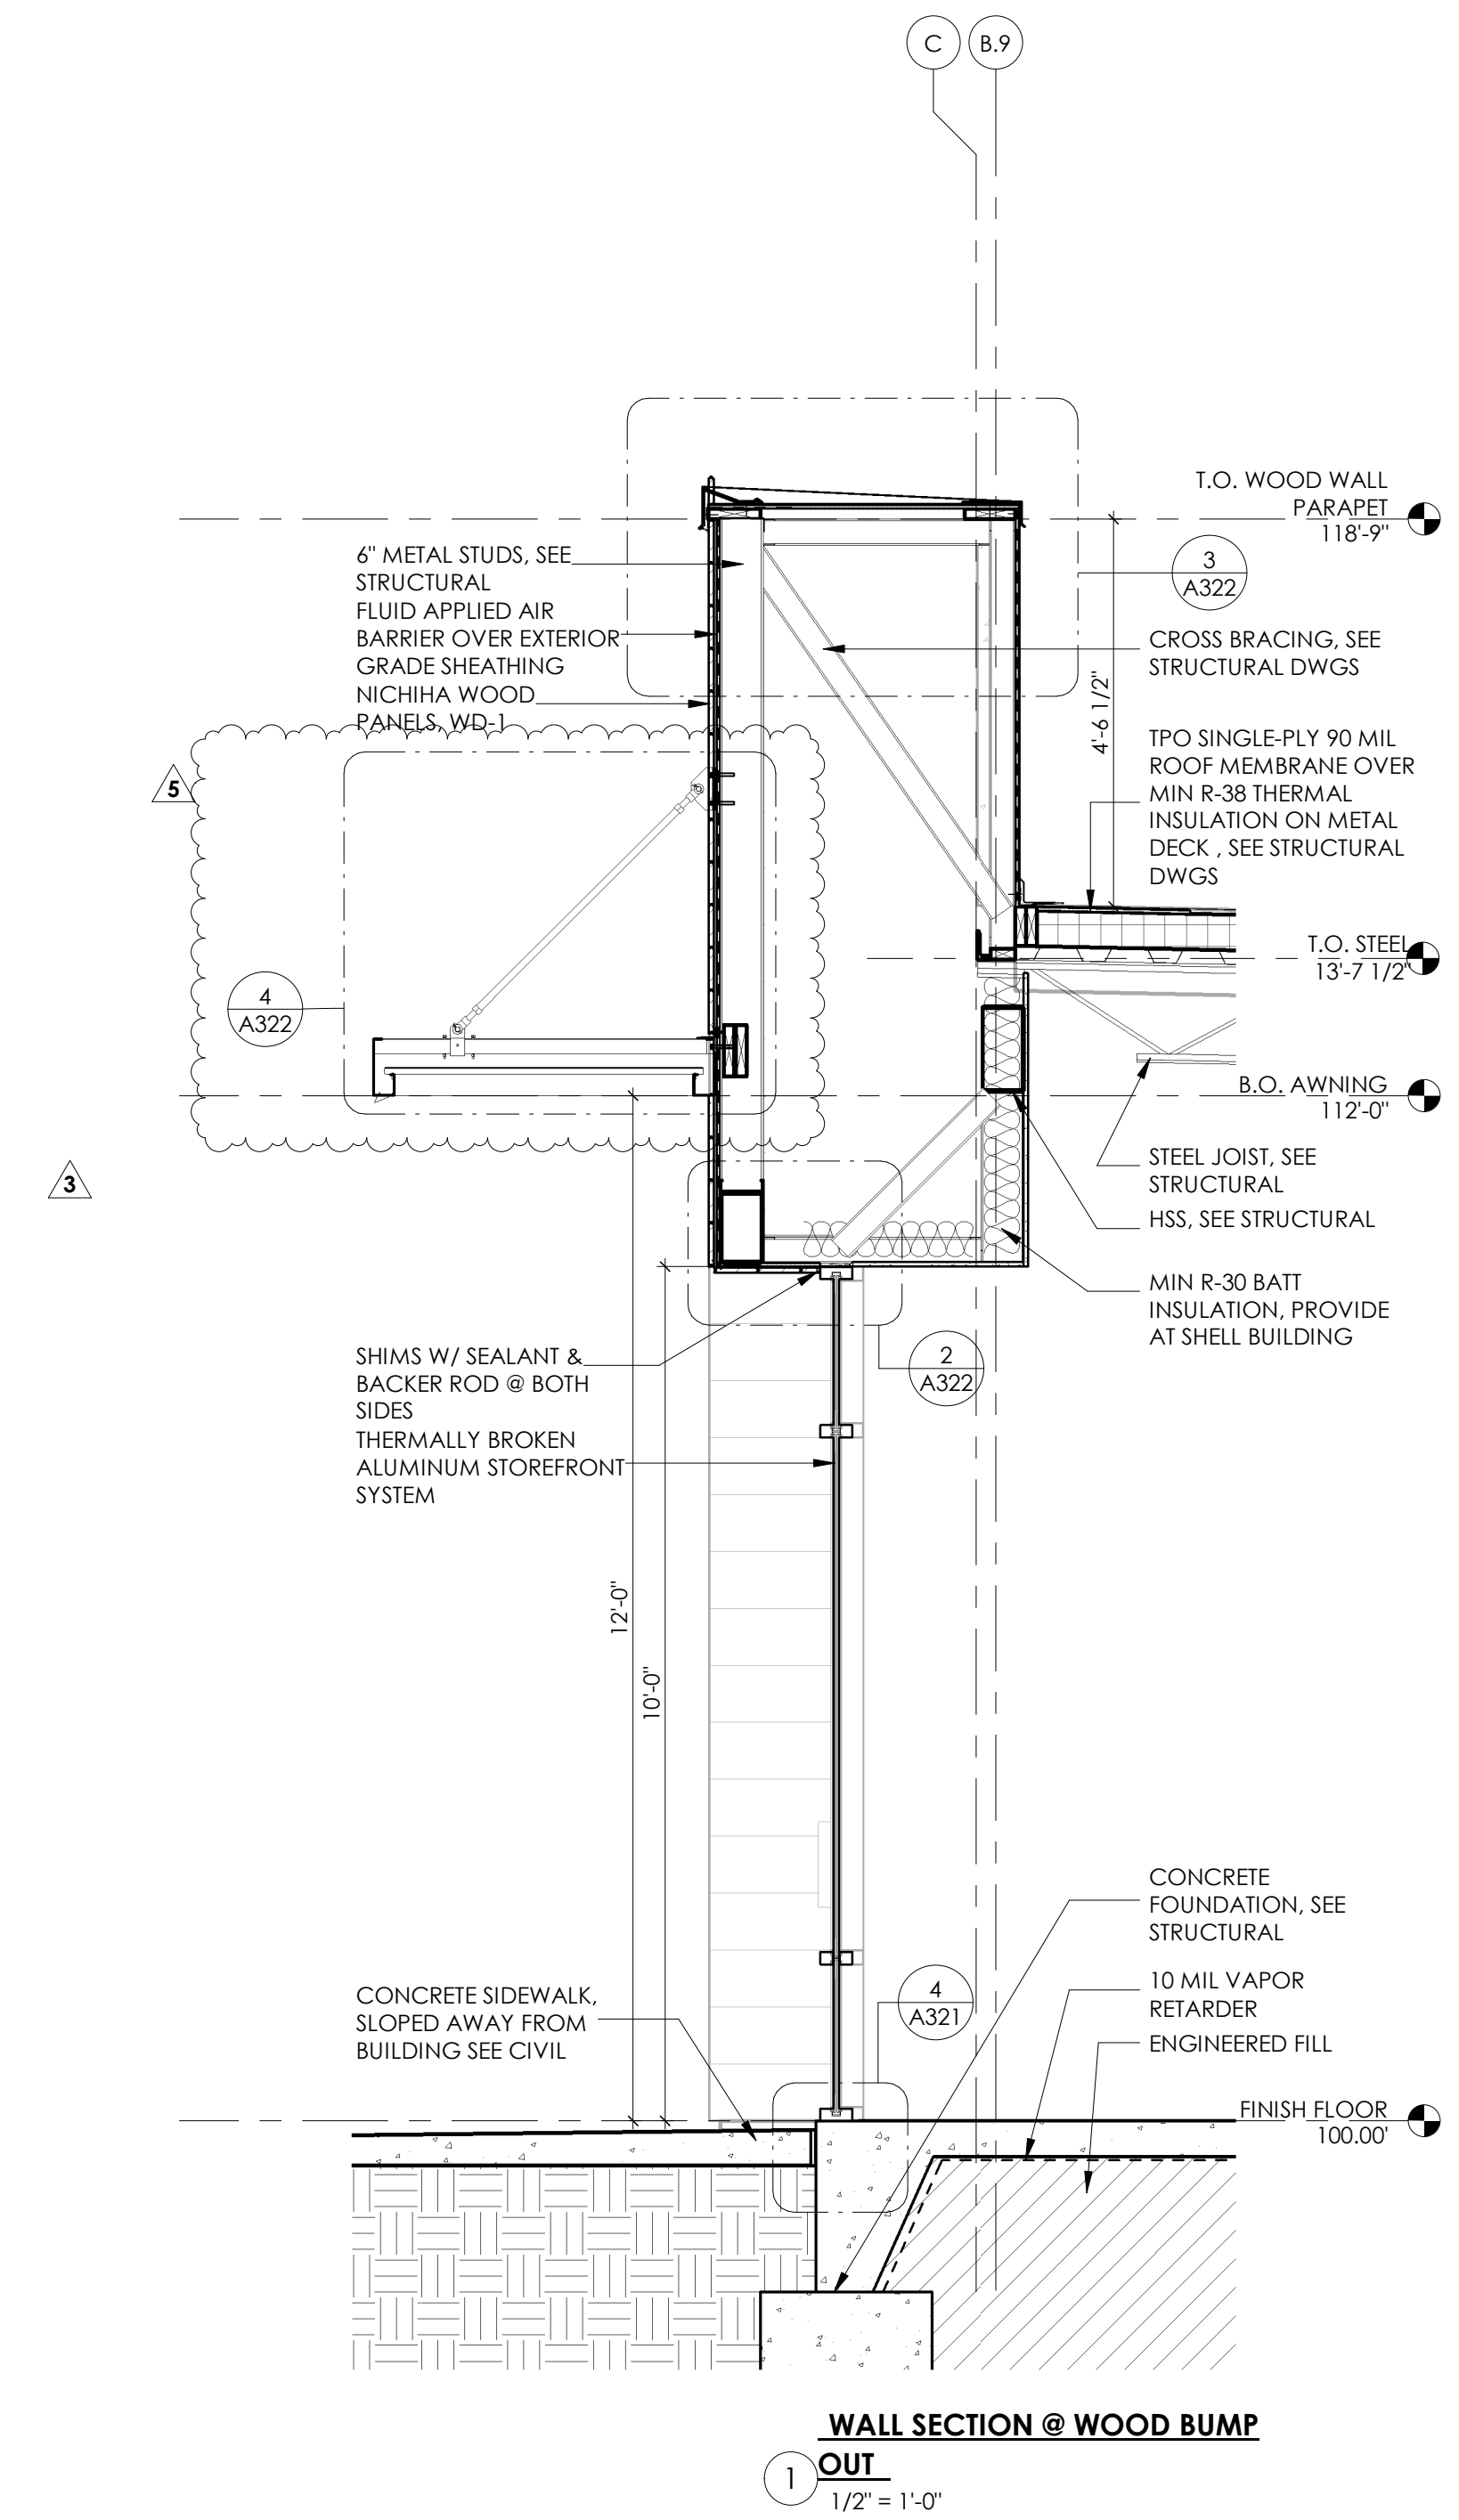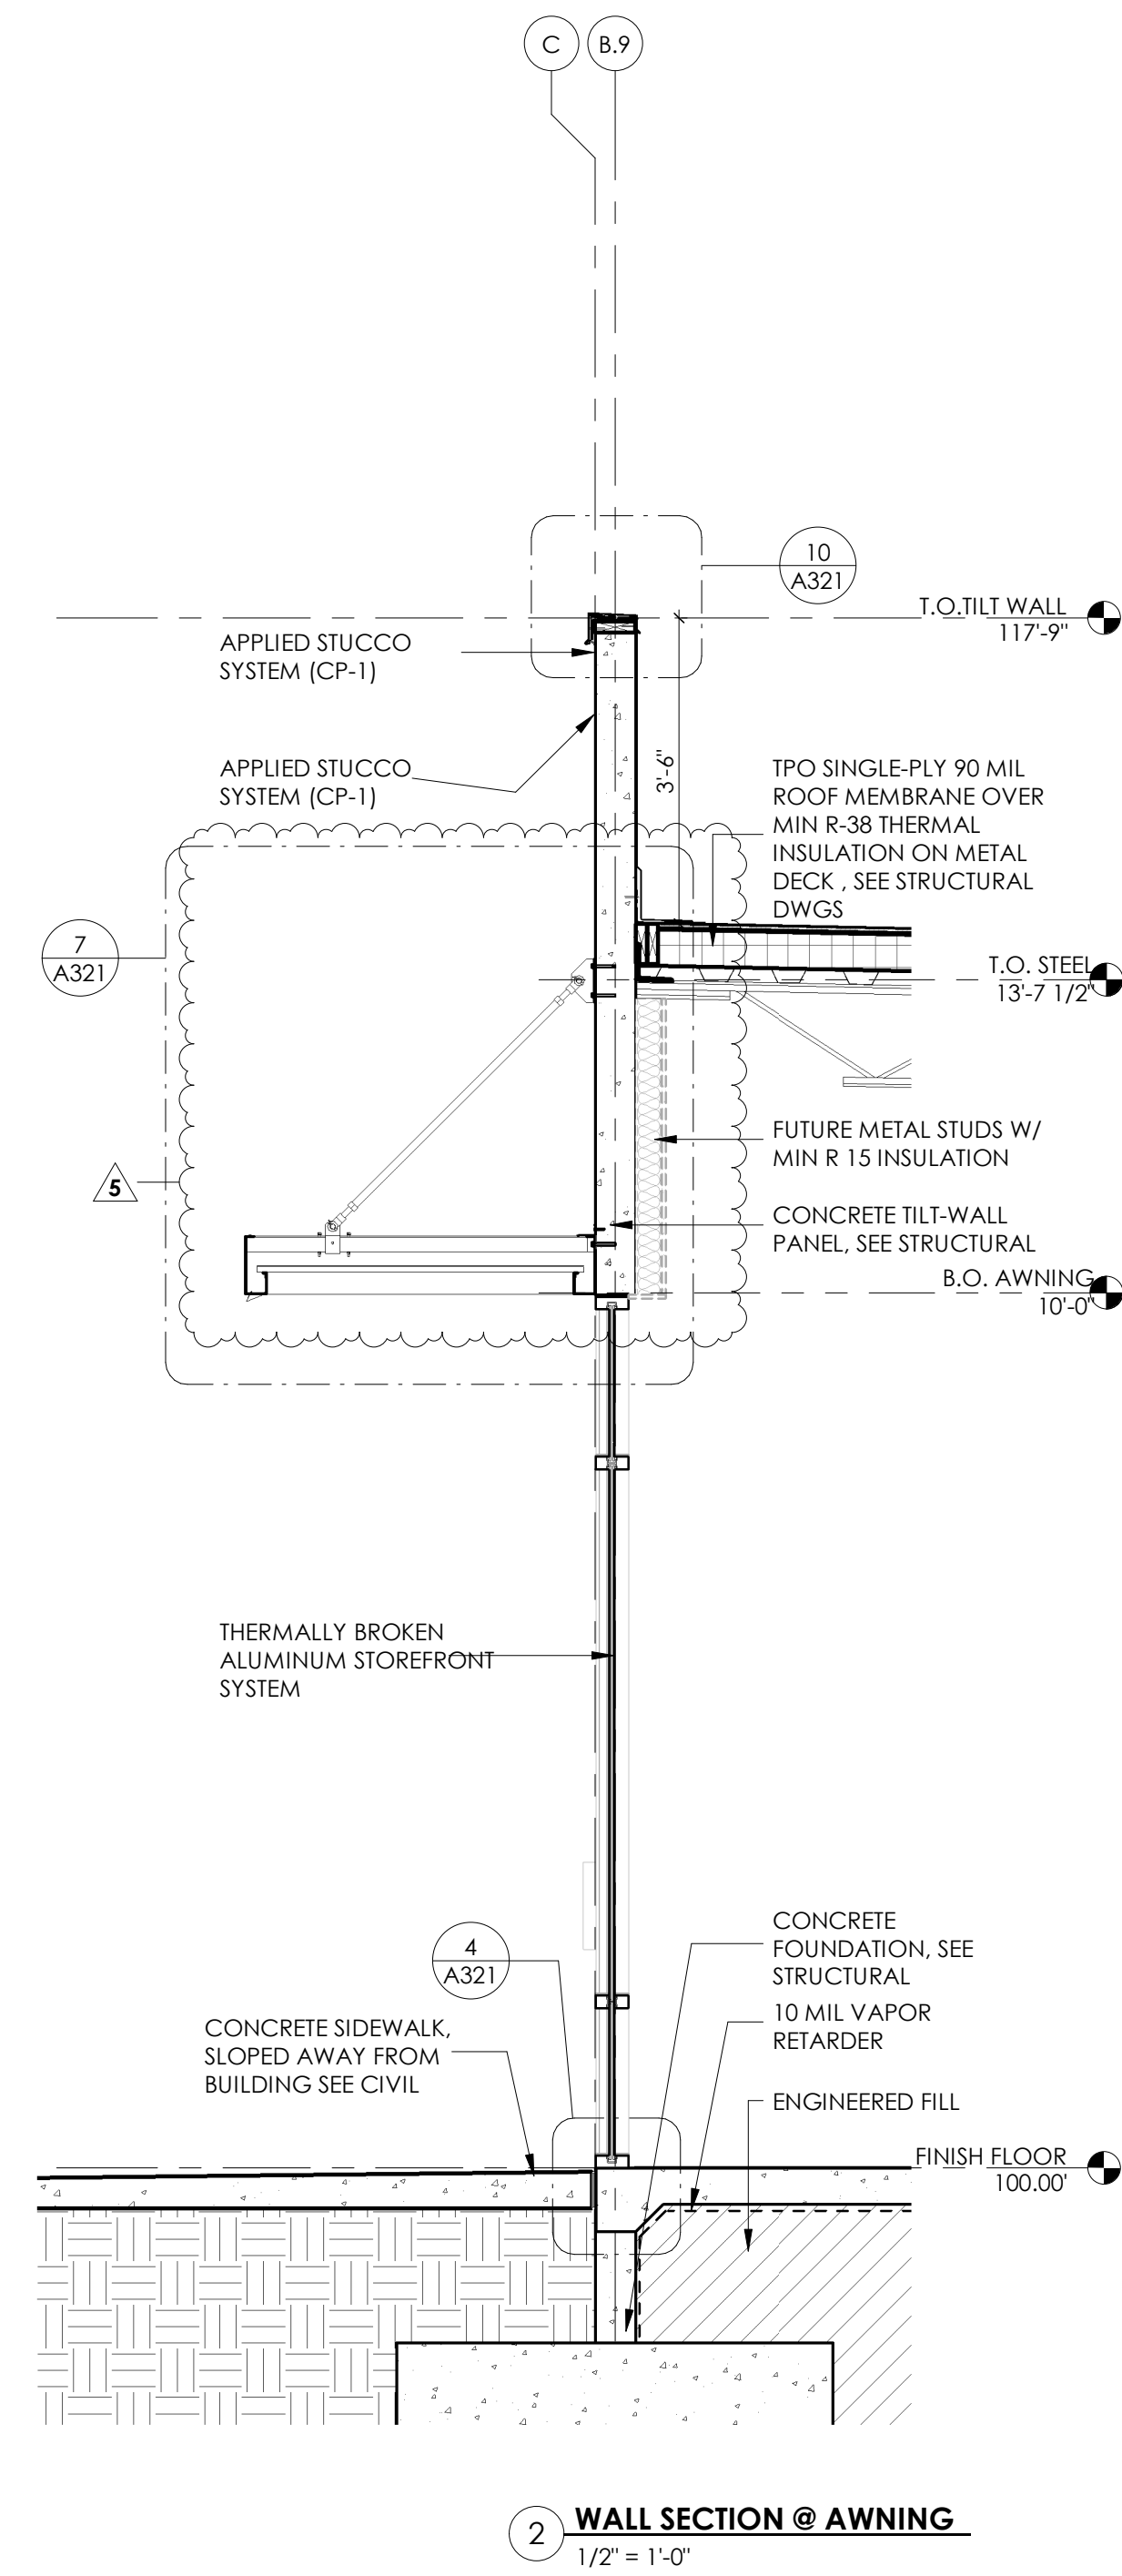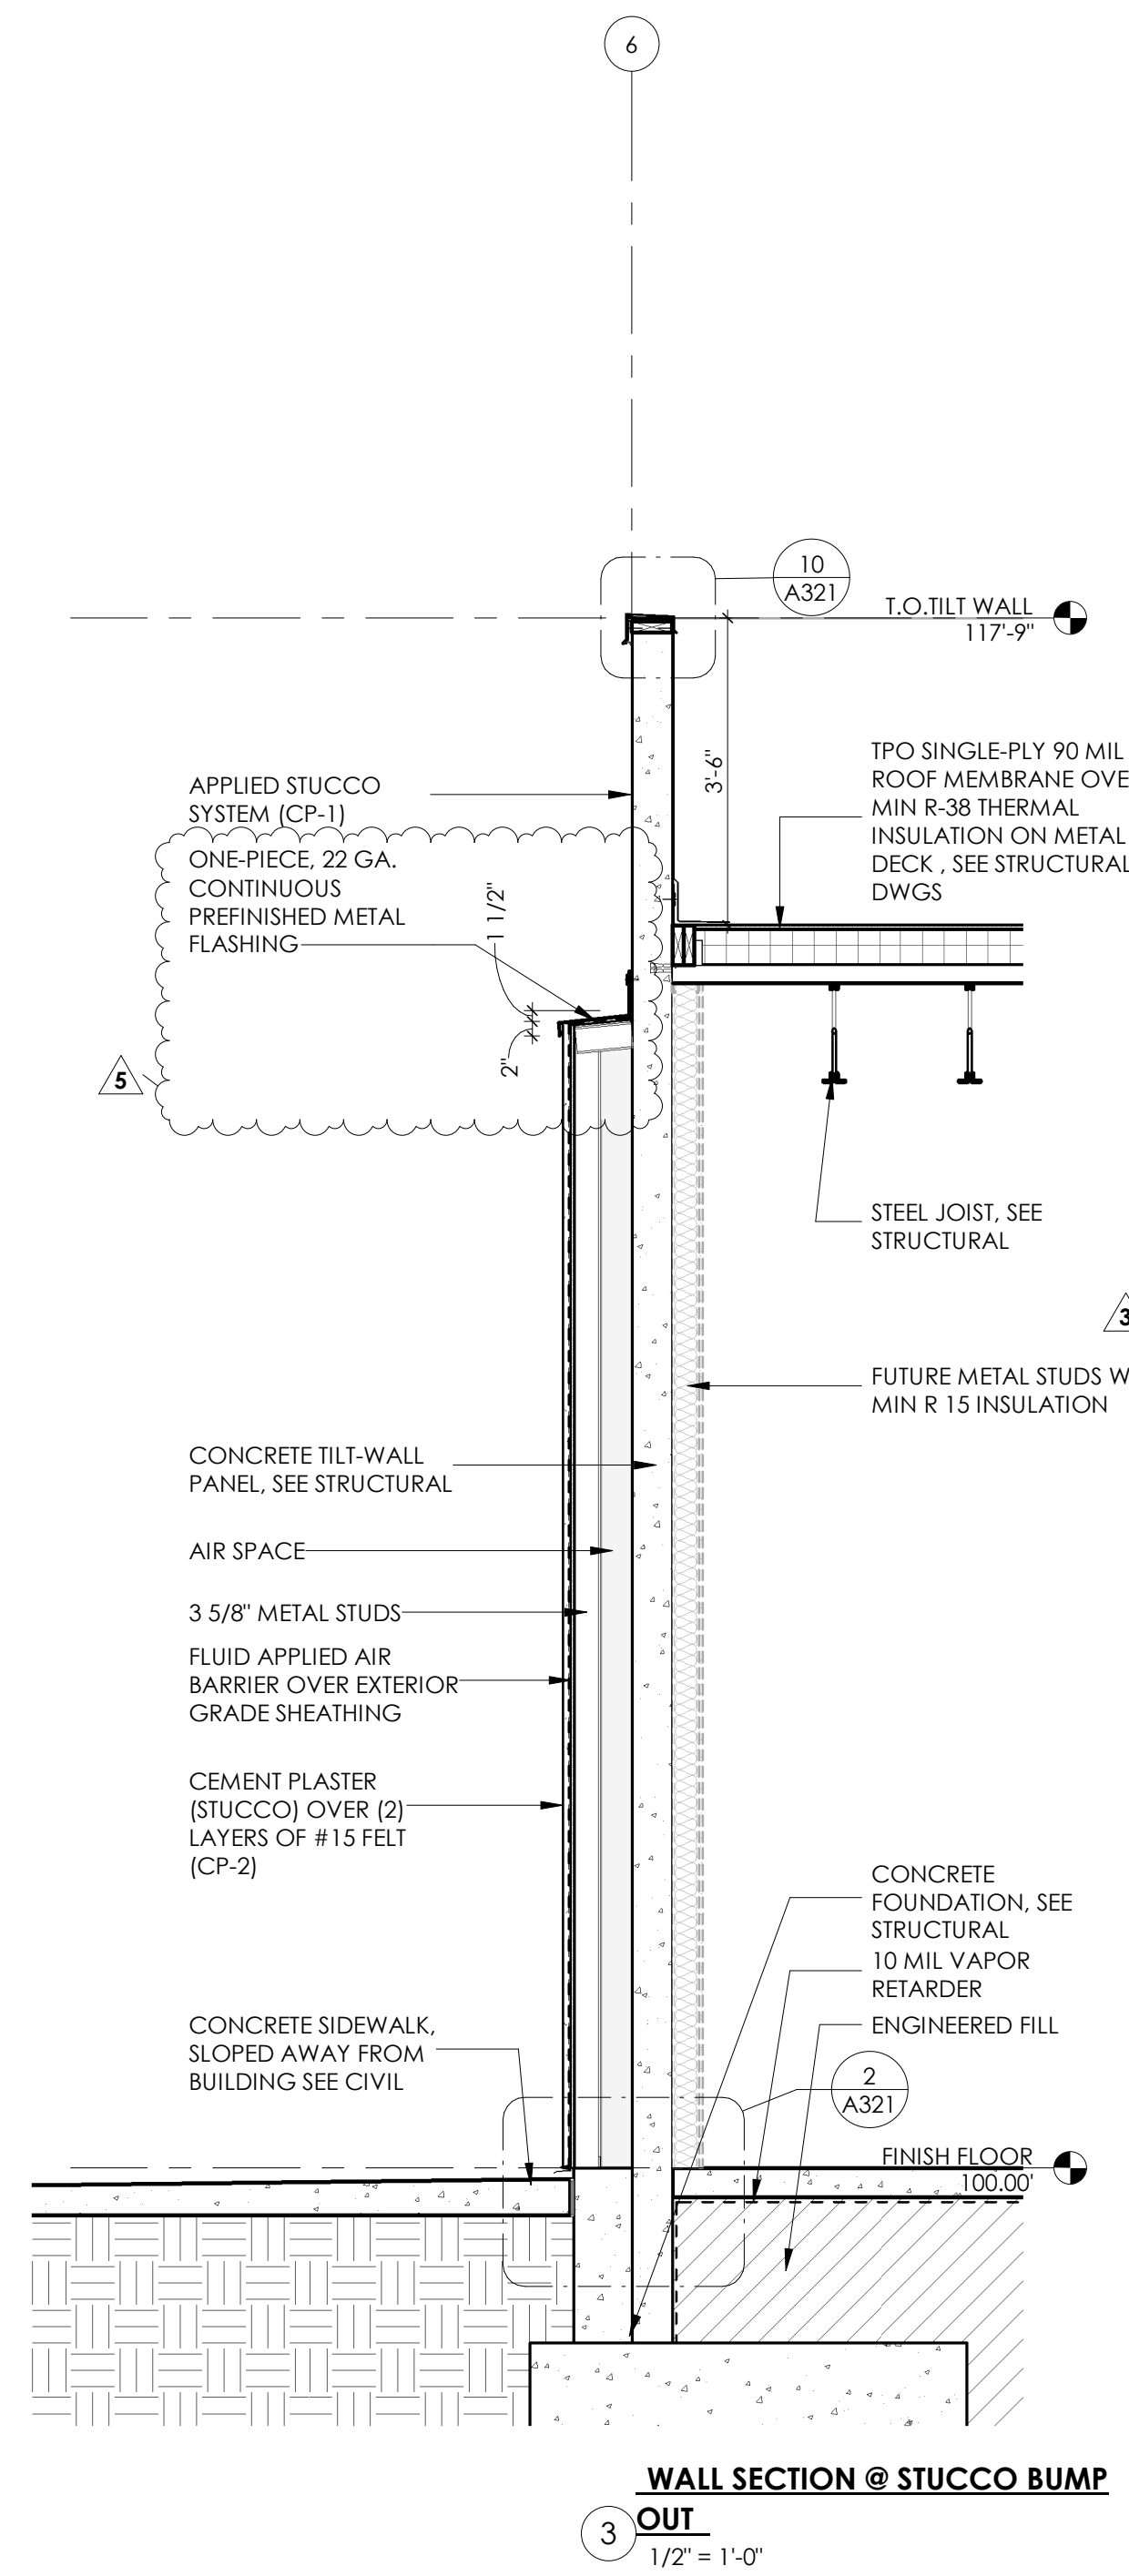

BUILDING 1

THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE
PROPERTY OF ALIGN ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM
BY ANY METHOD, FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.

3 09.12.22 City Comments
5 08.XX.24 VE

NOT FOR
REGULATORY
APPROVAL,
PERMITTING, OR
CONSTRUCTION.


















THIS DOCUMENT IS RELEASED FOR
THE PURPOSE OF INTERIM REVIEW
UNDER THE AUTHORITY OF
RODNEY PALMER

01.28.2022
PERMIT SET

WALL SECTIONS

SHEET: **A312**

PROJECT NO: 21099
DRAWN BY: MD, AG
DATE: 09.12.22
PROJECT MGR: KS

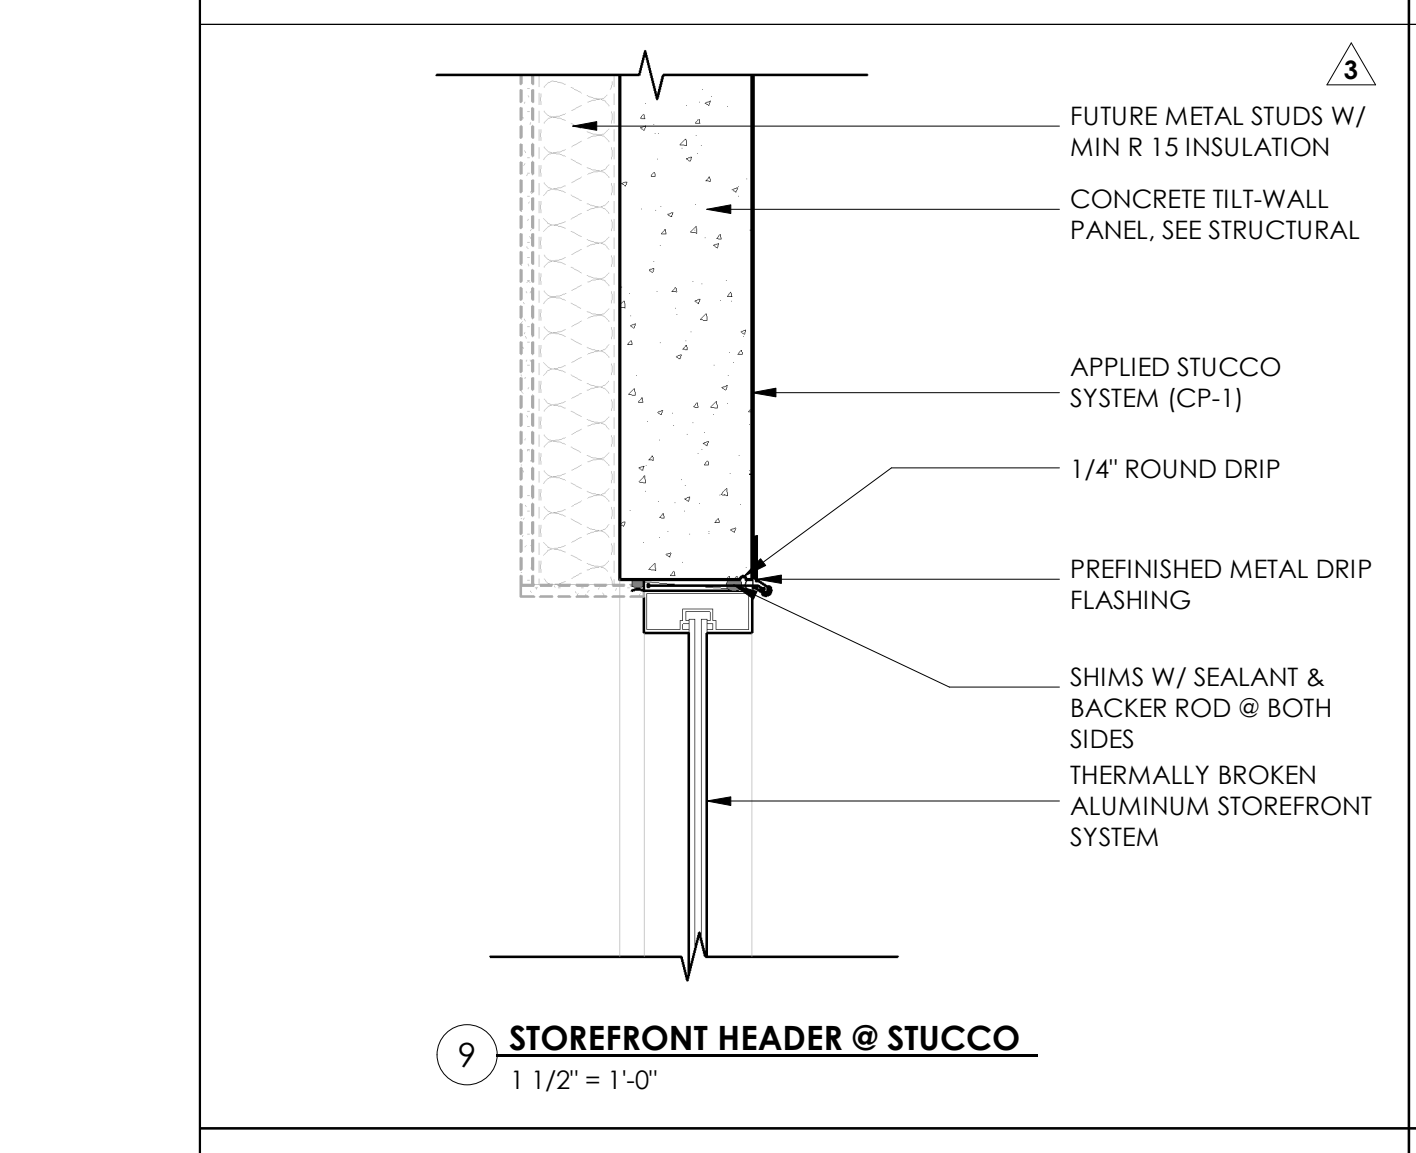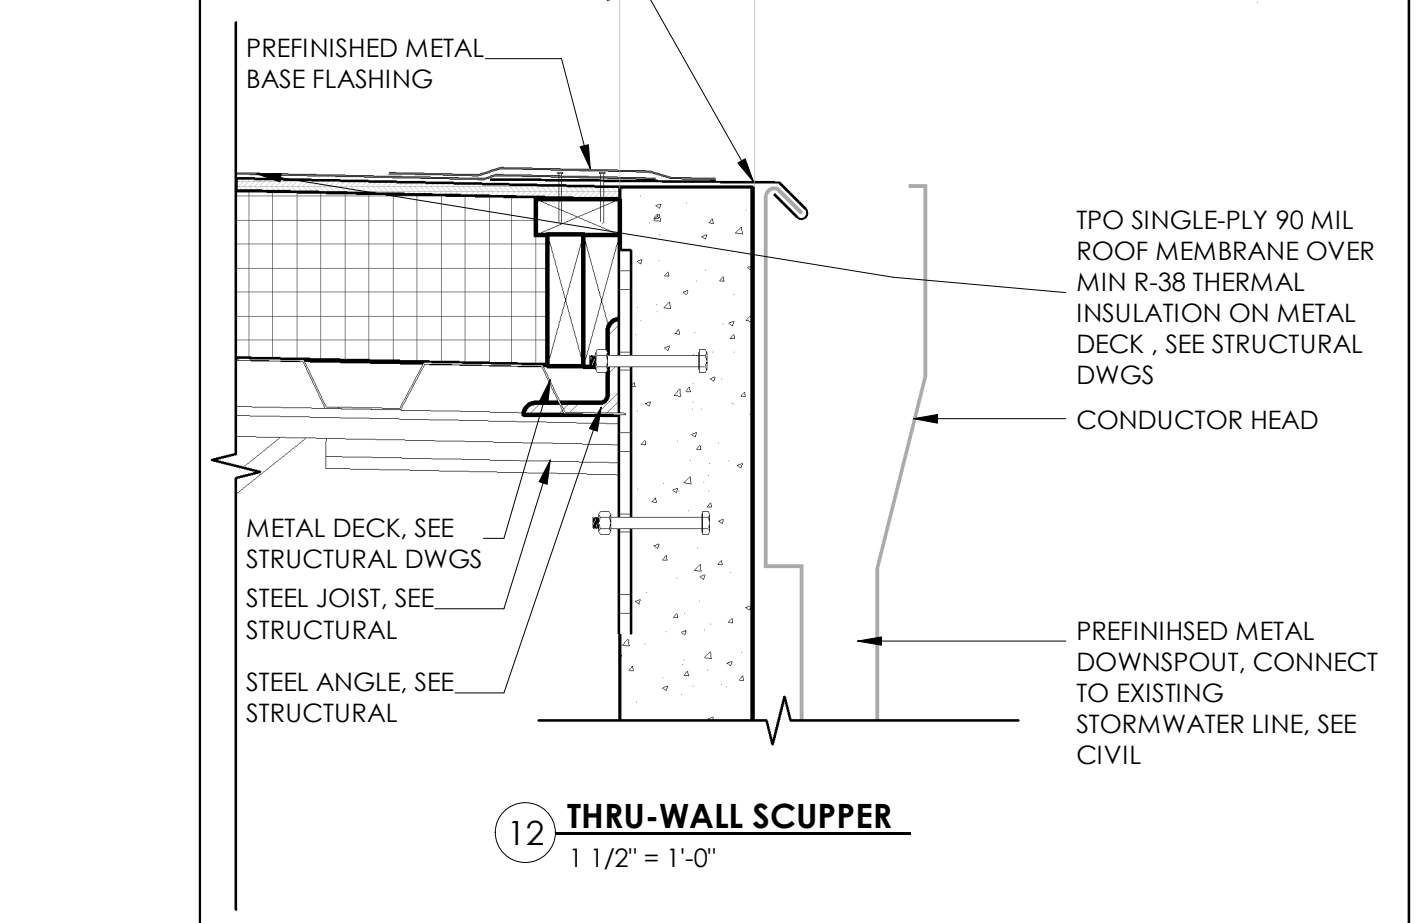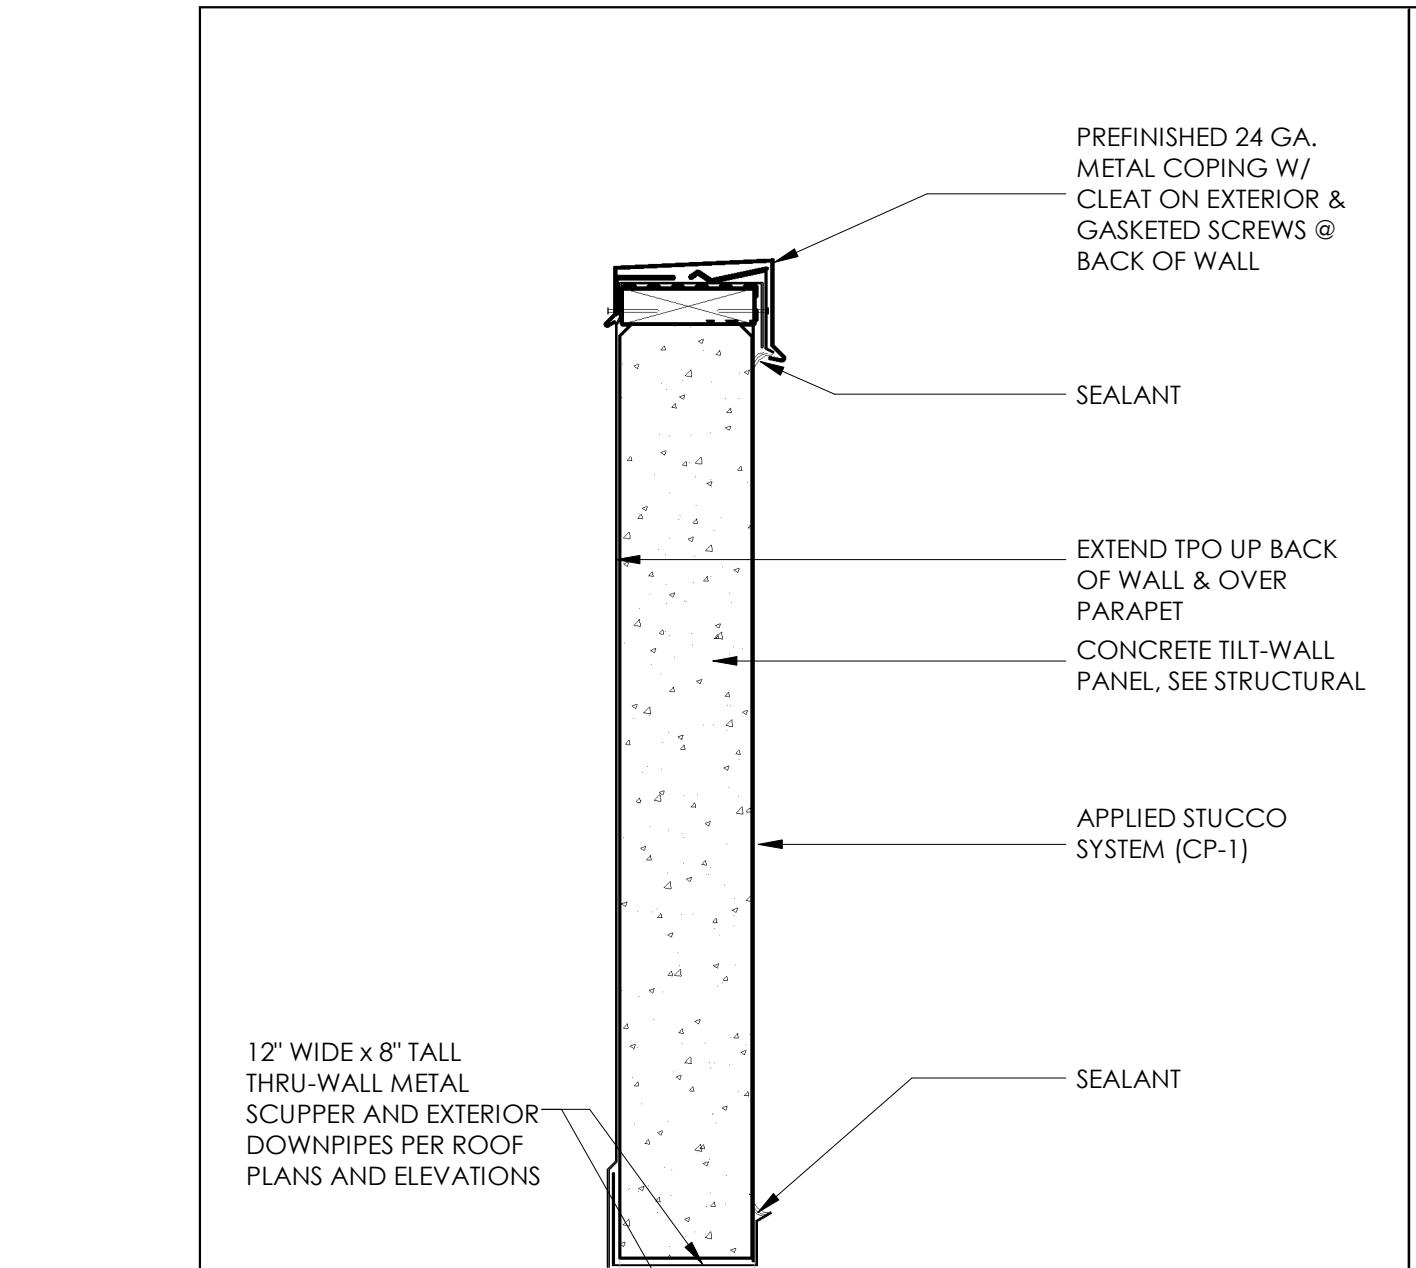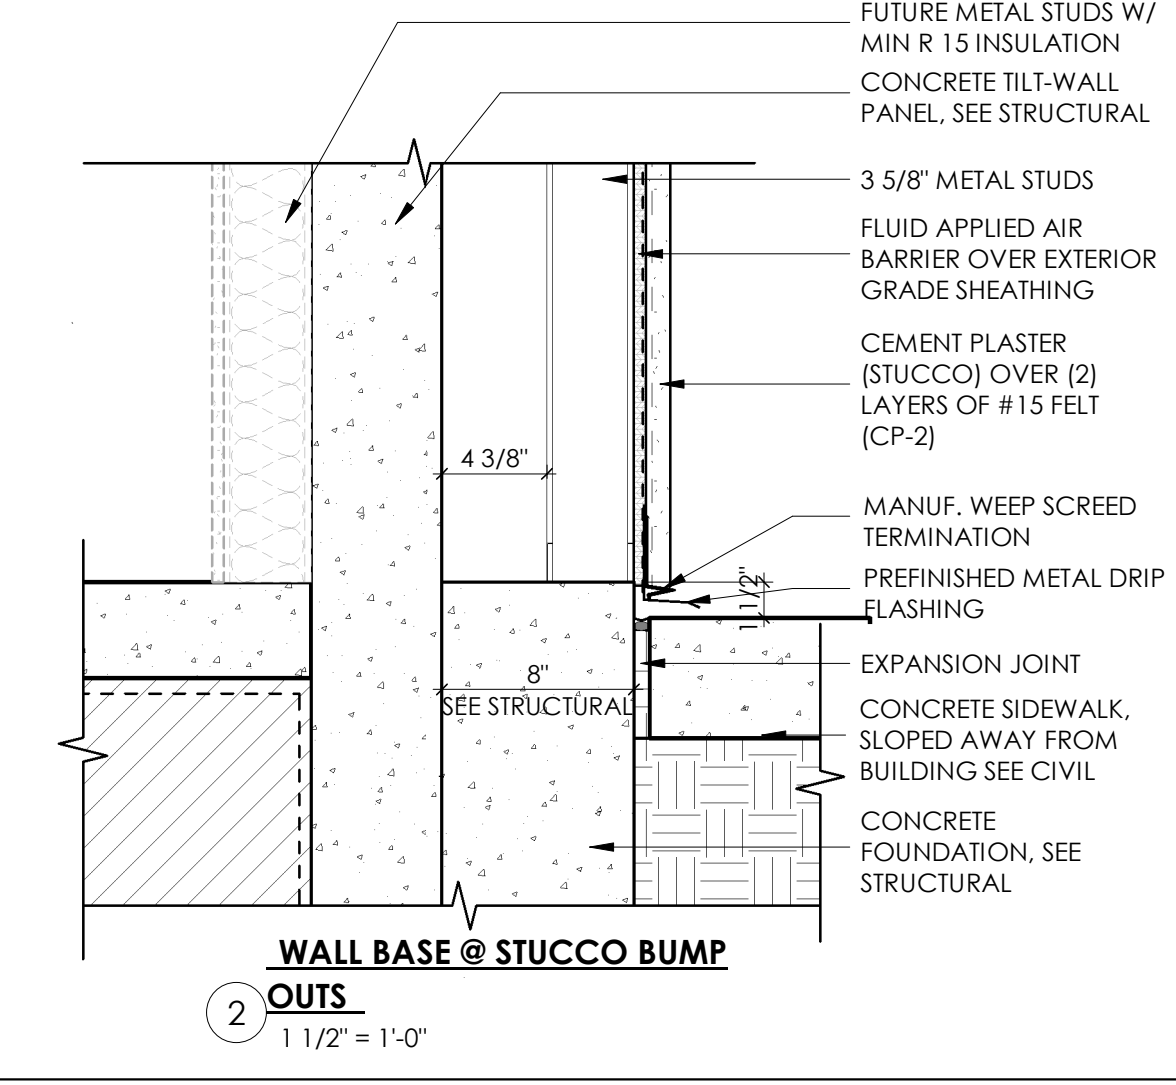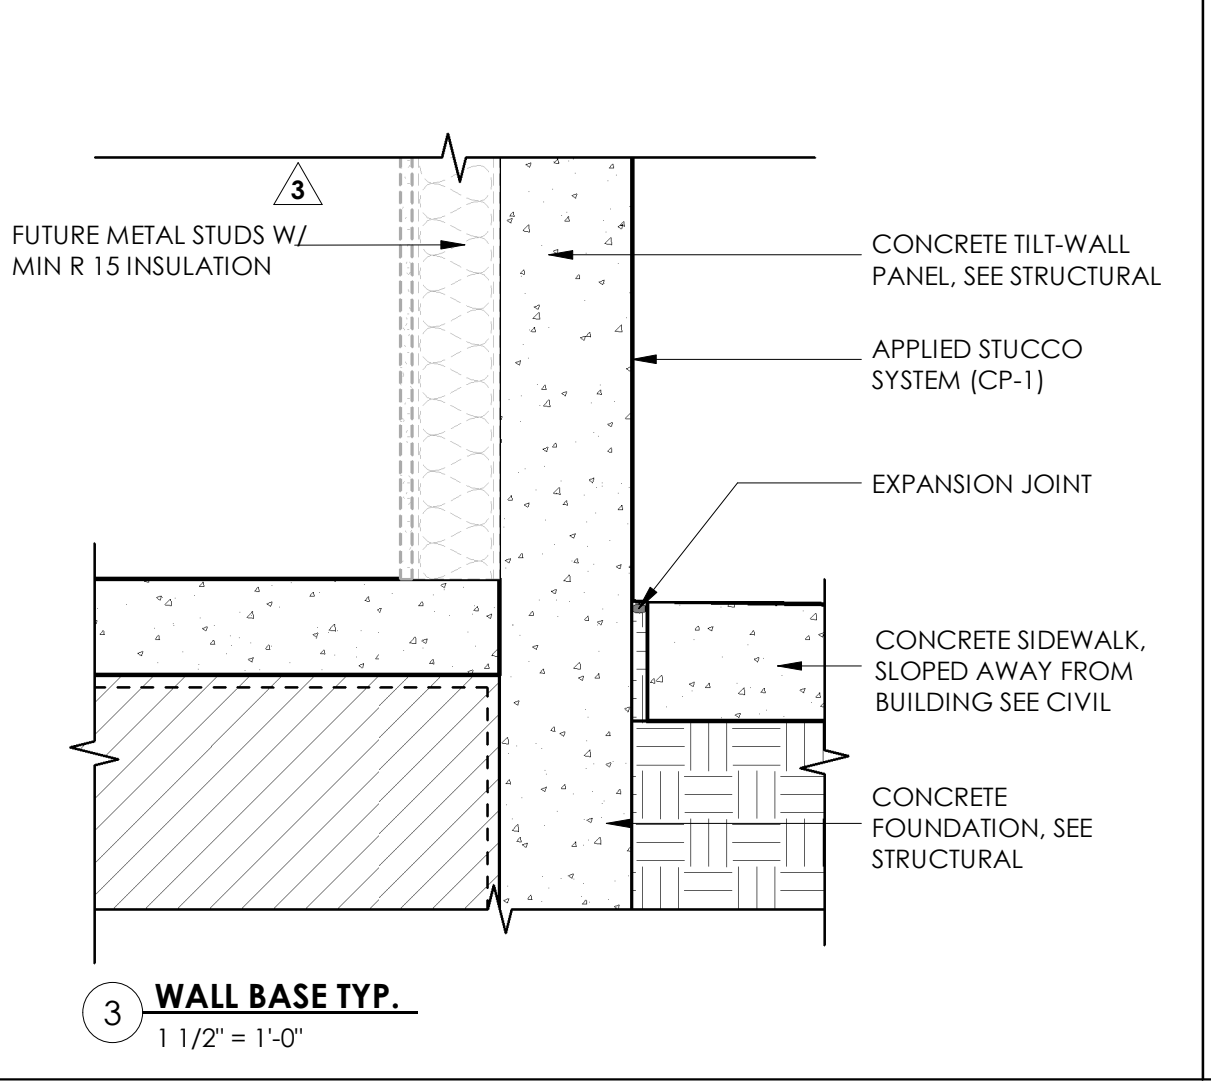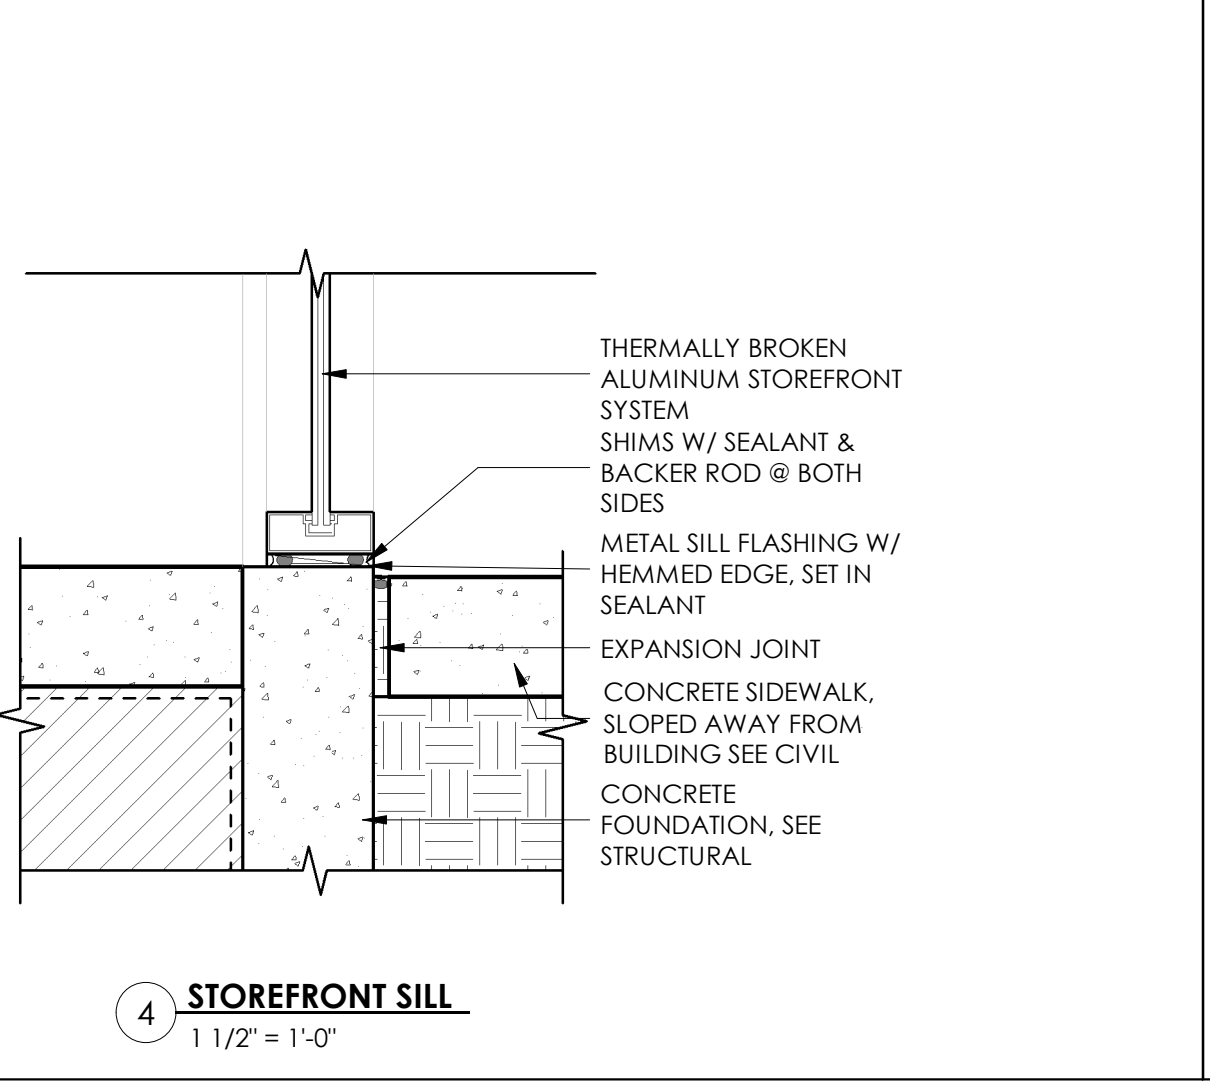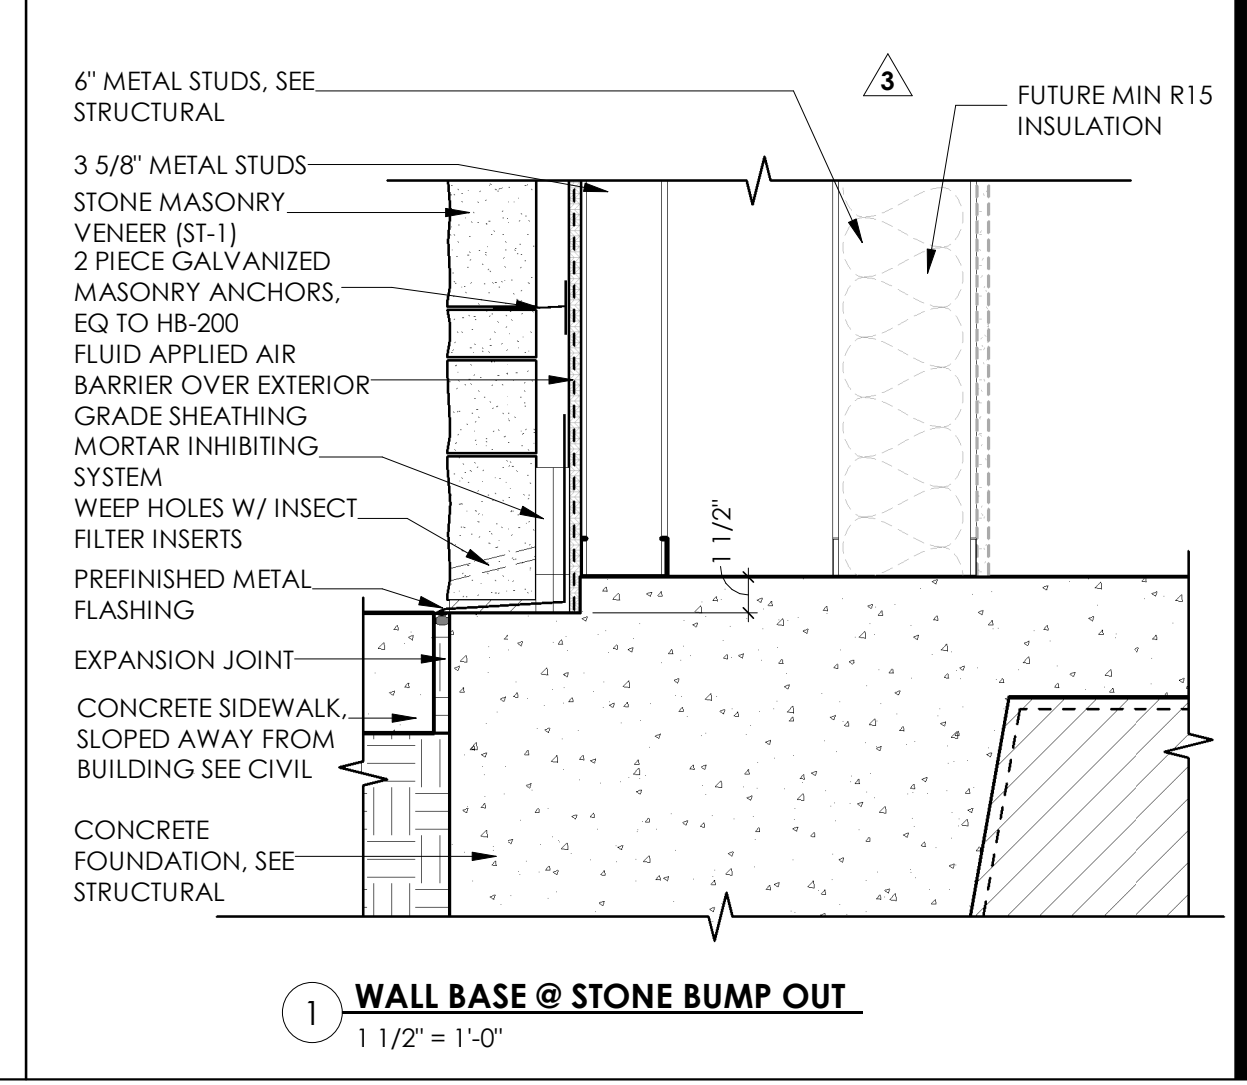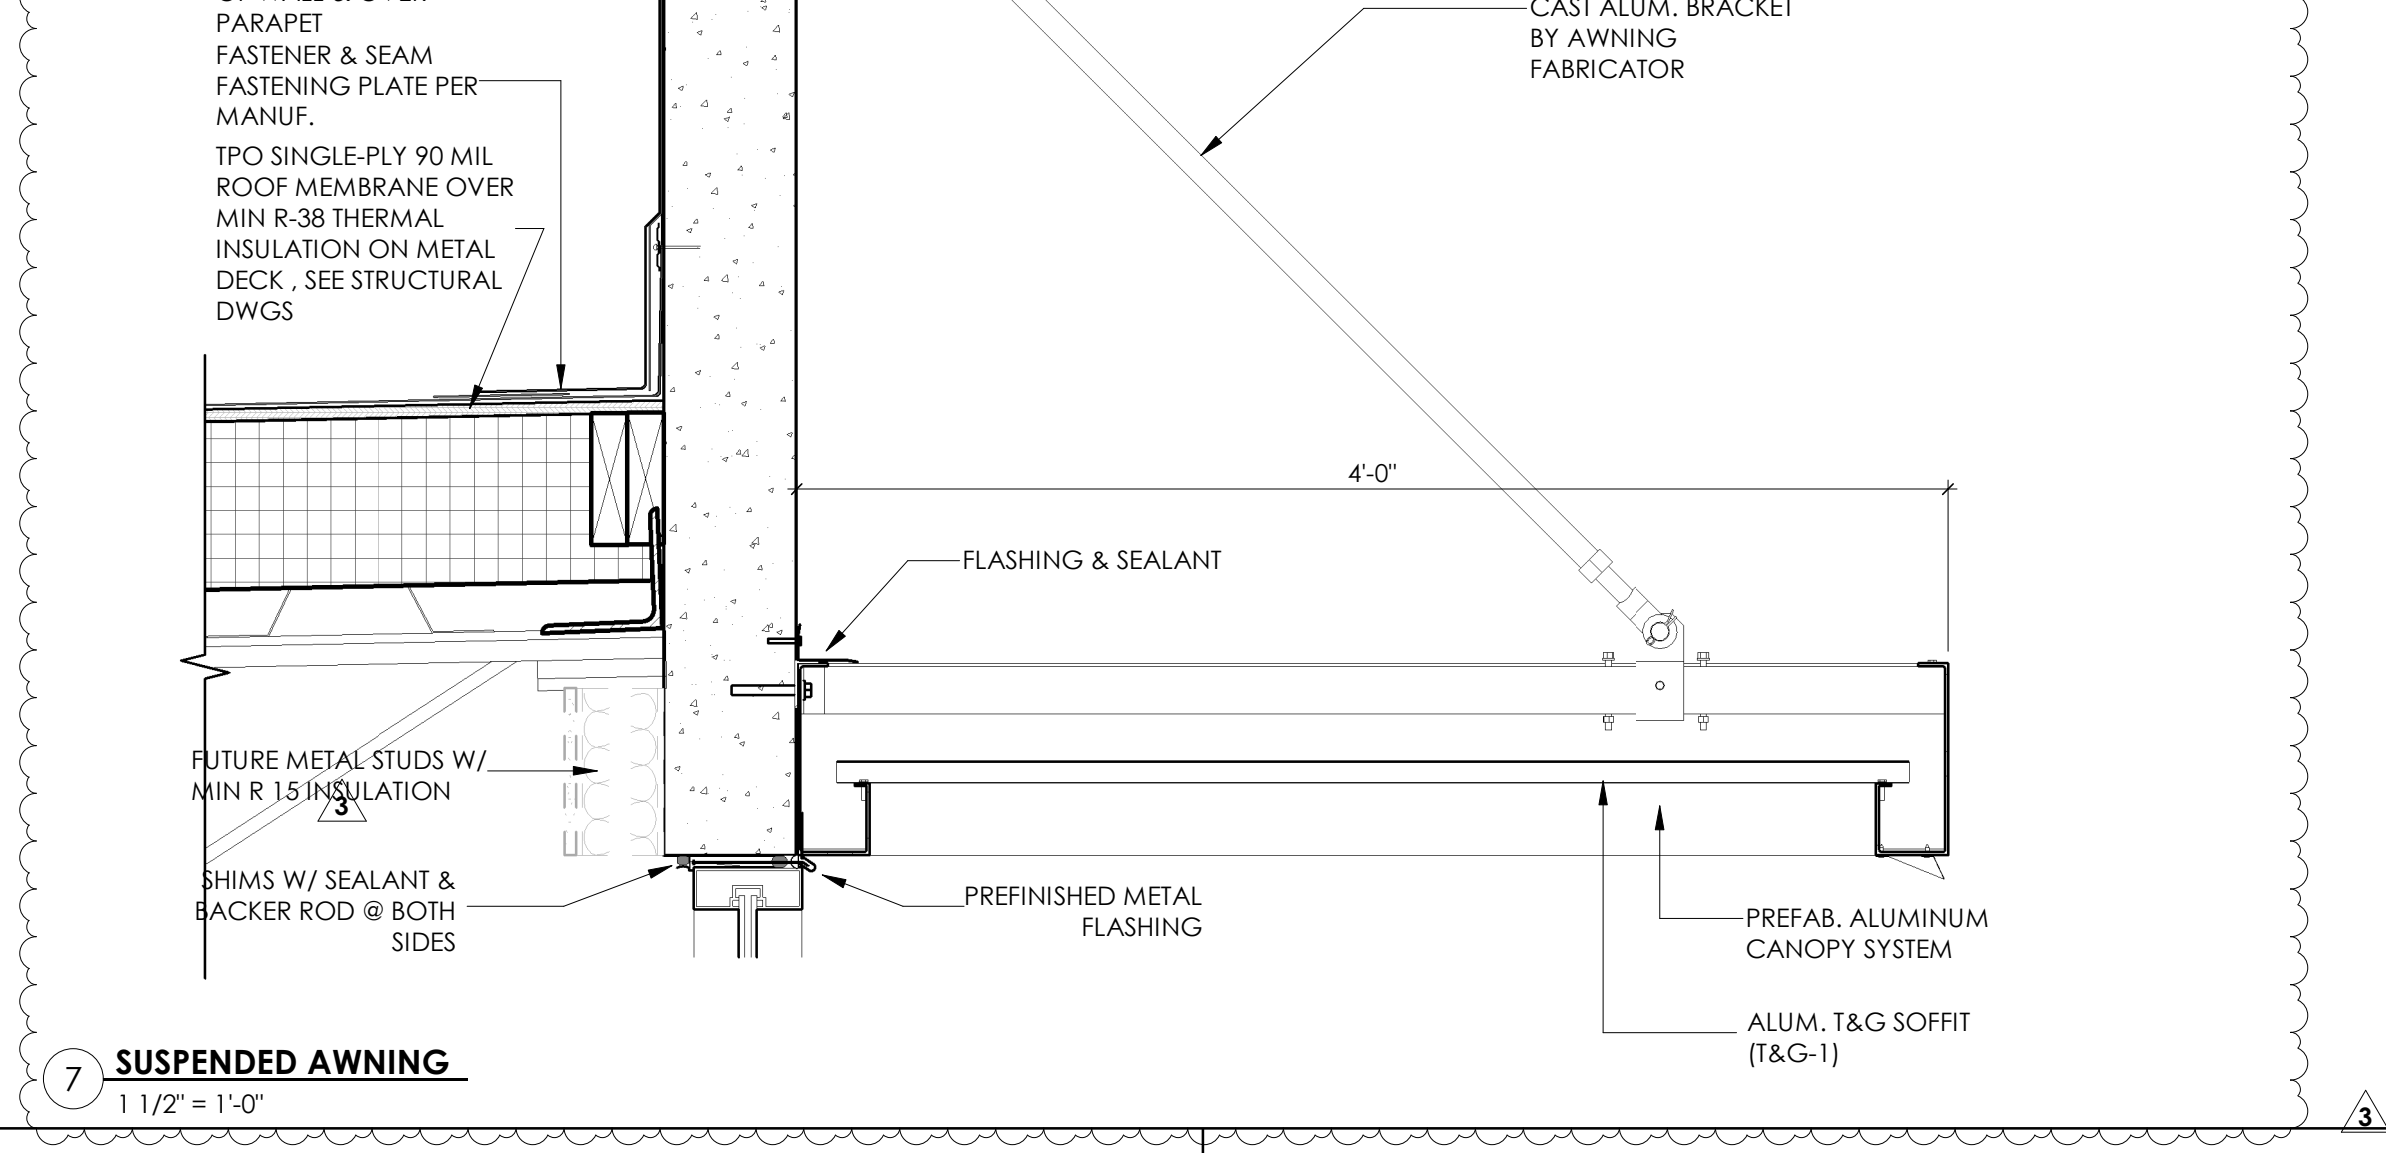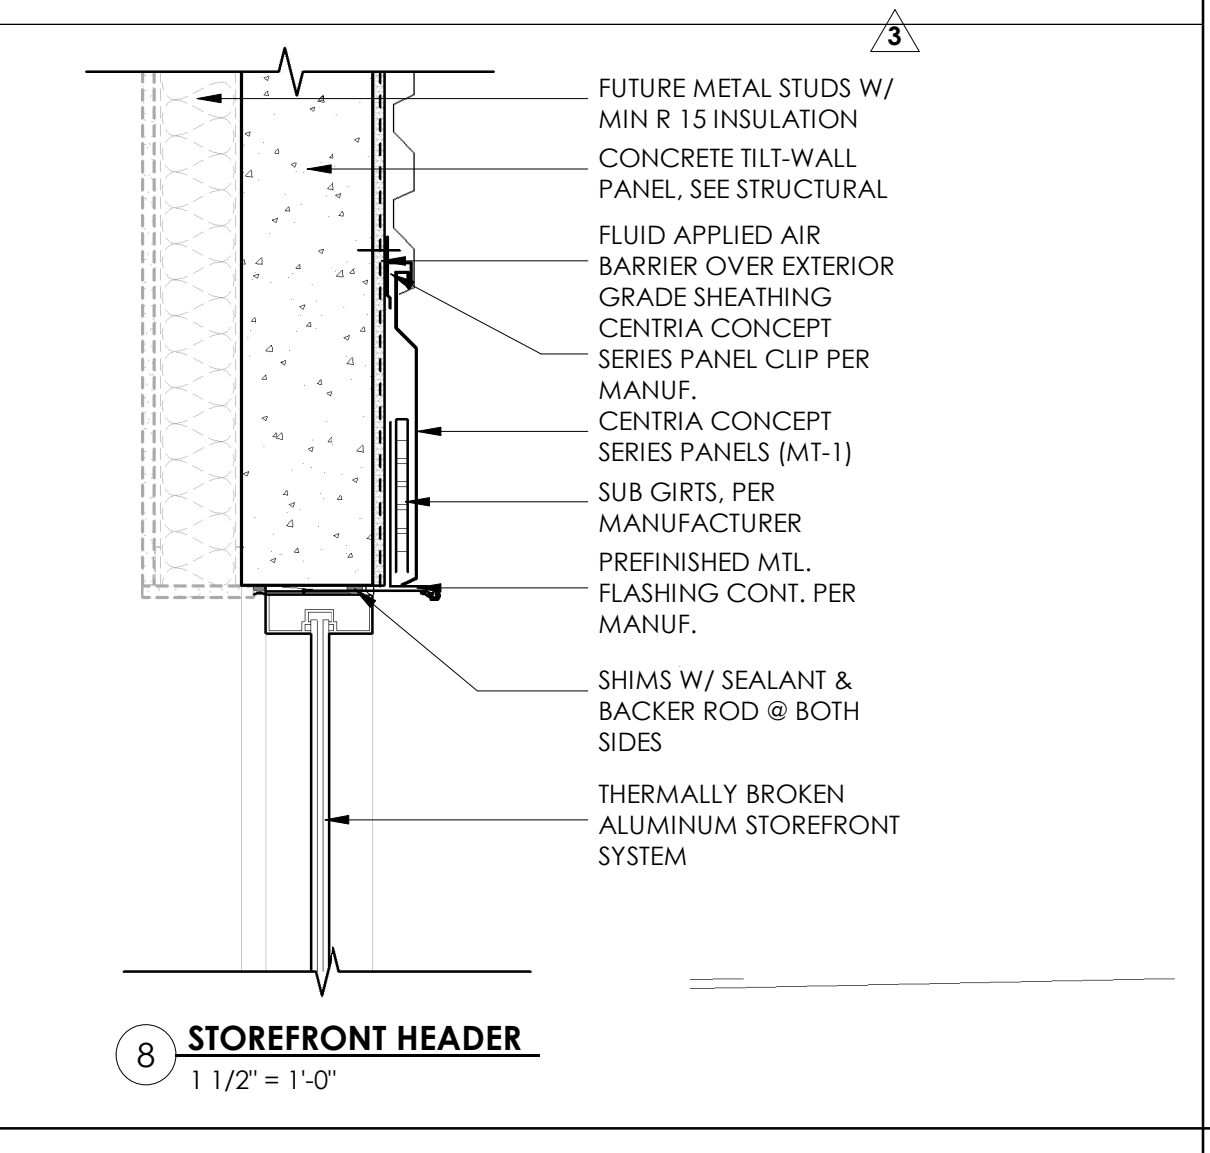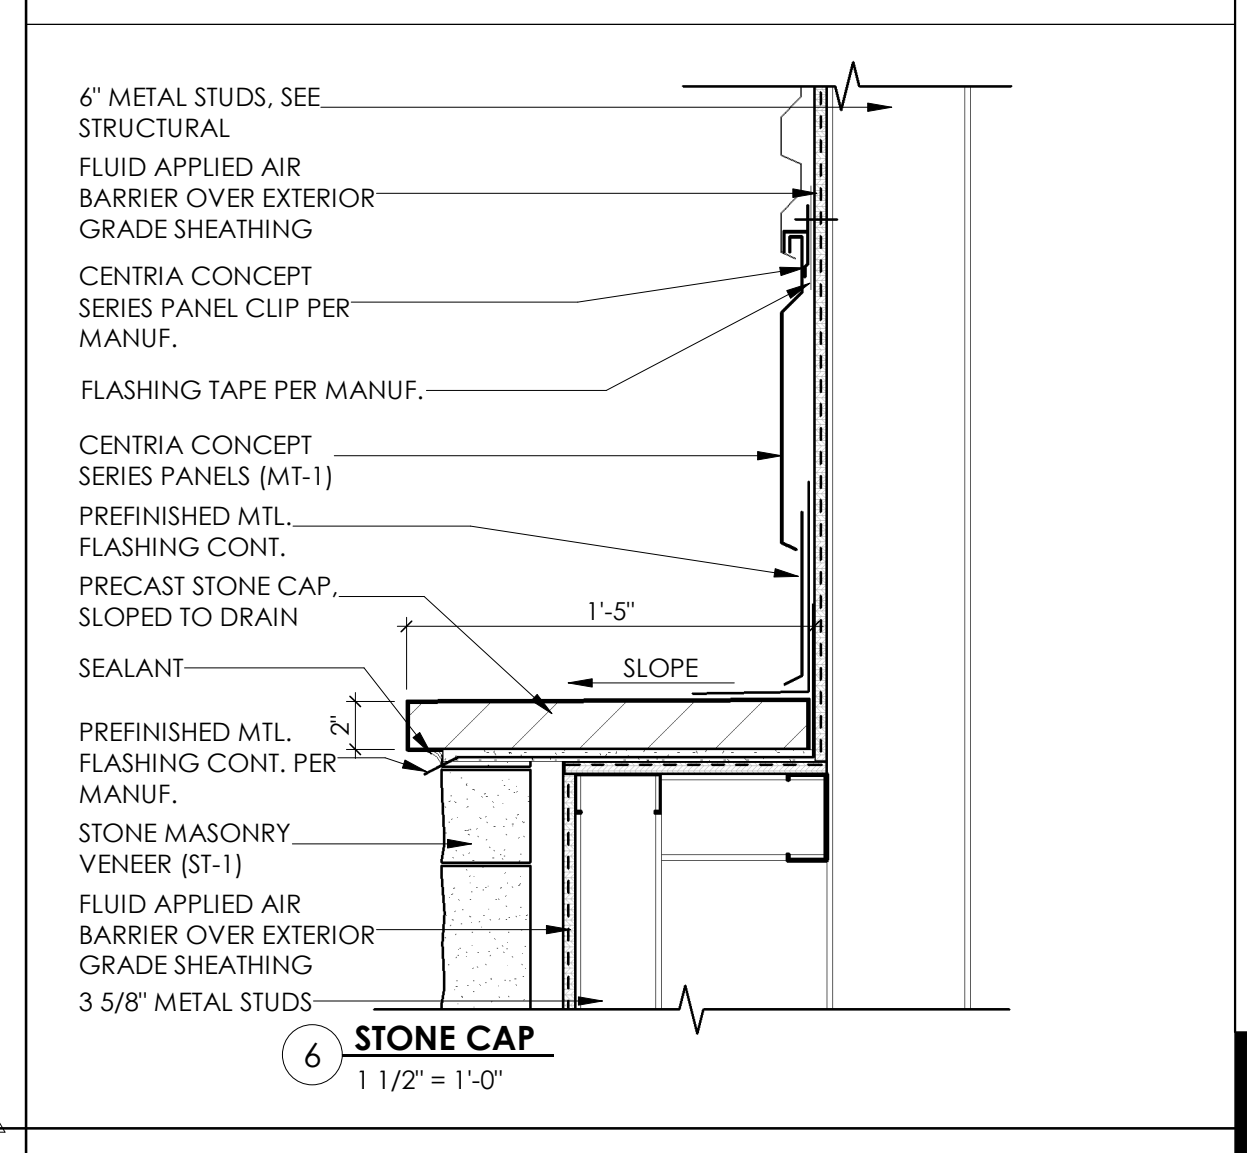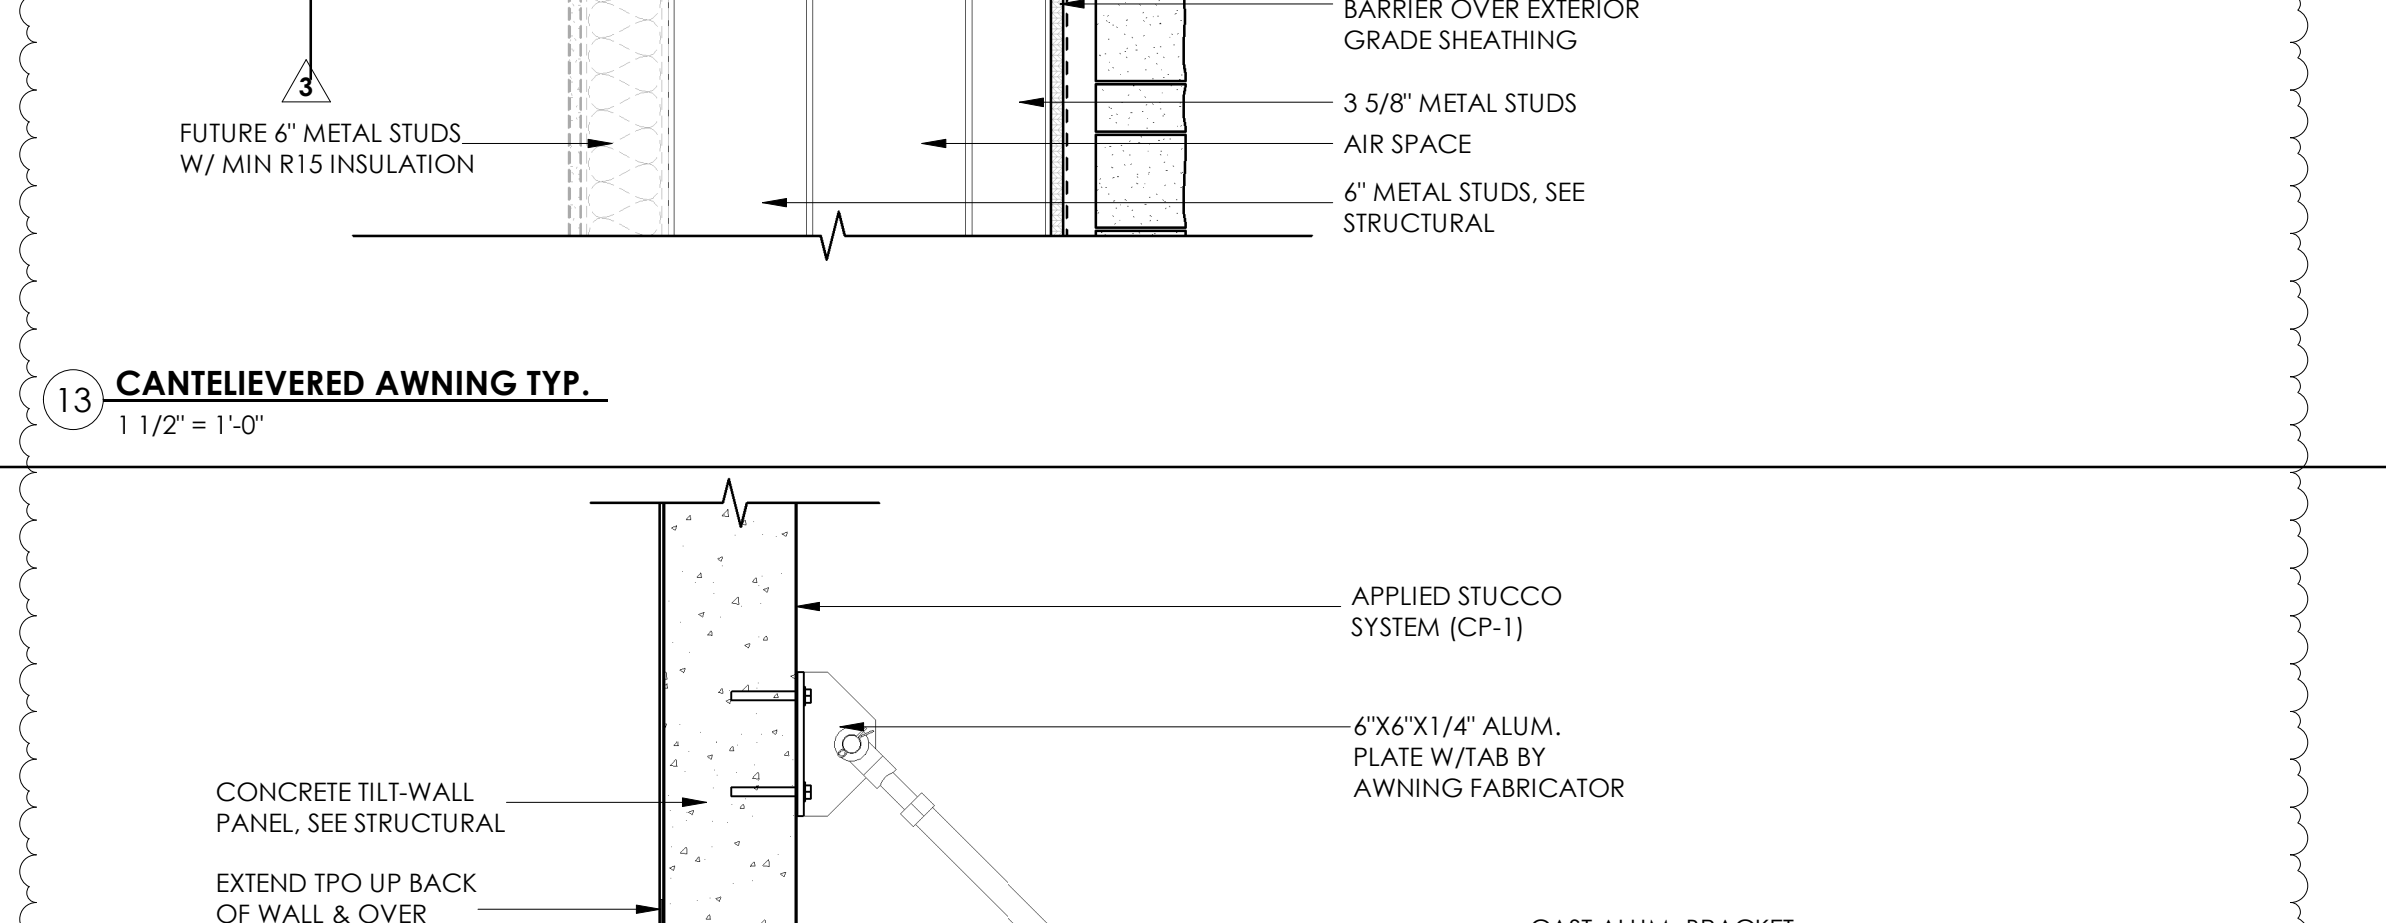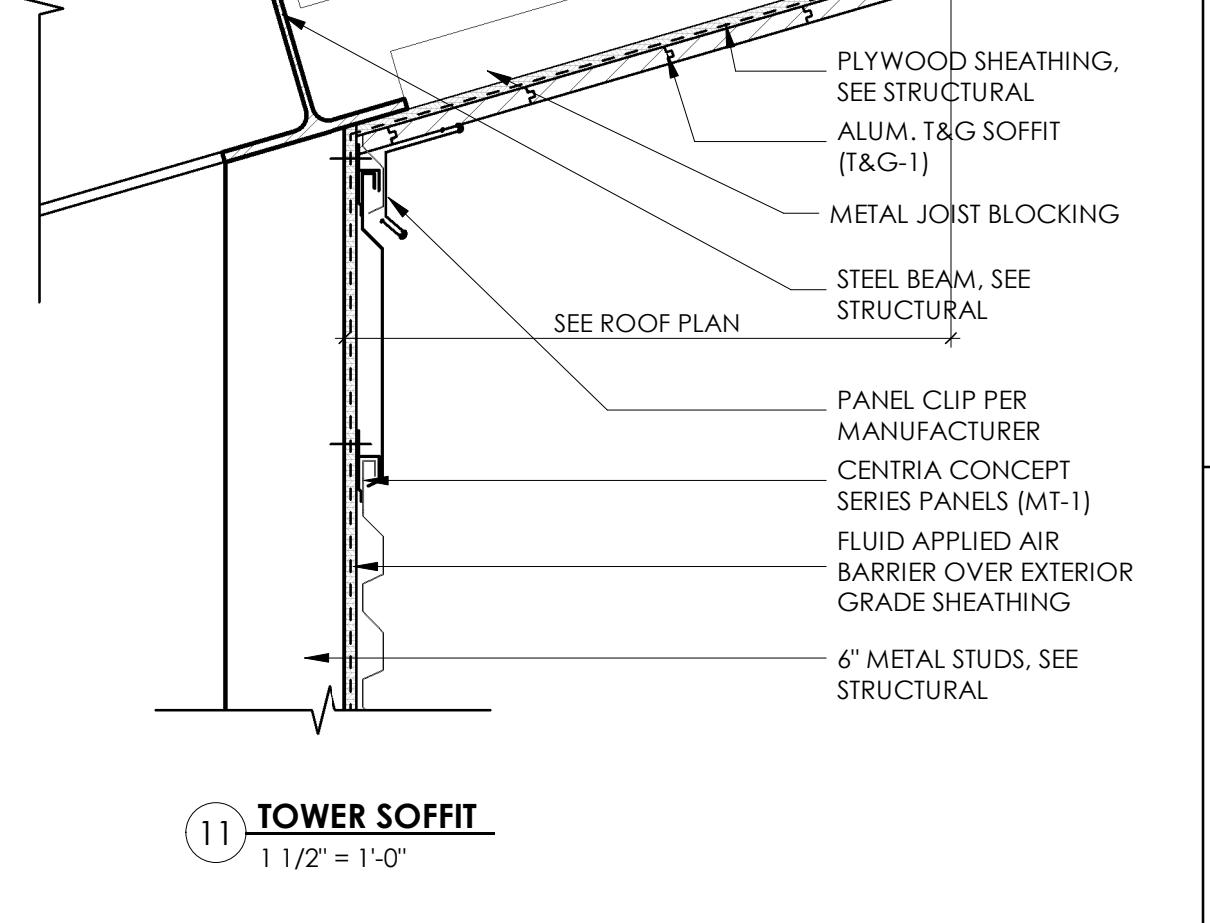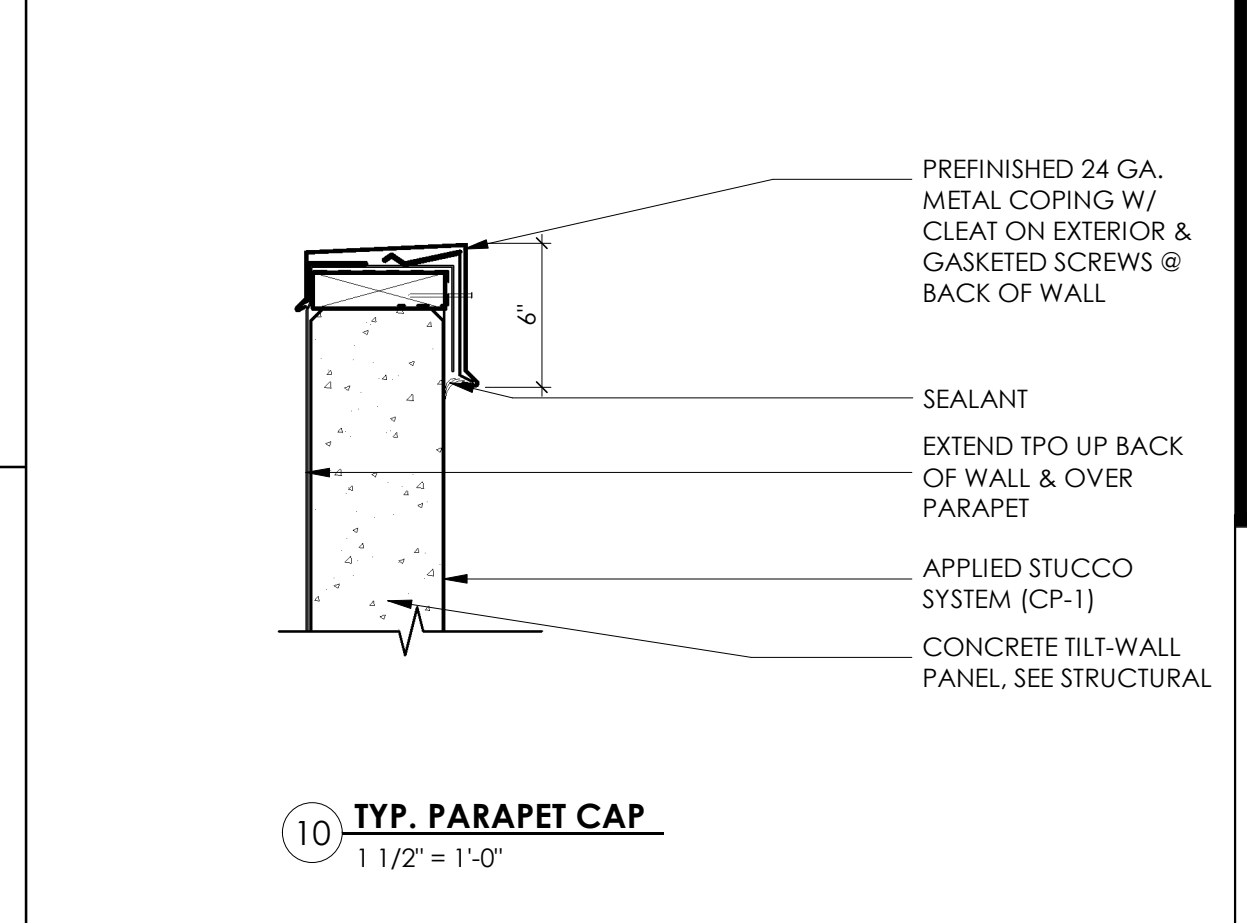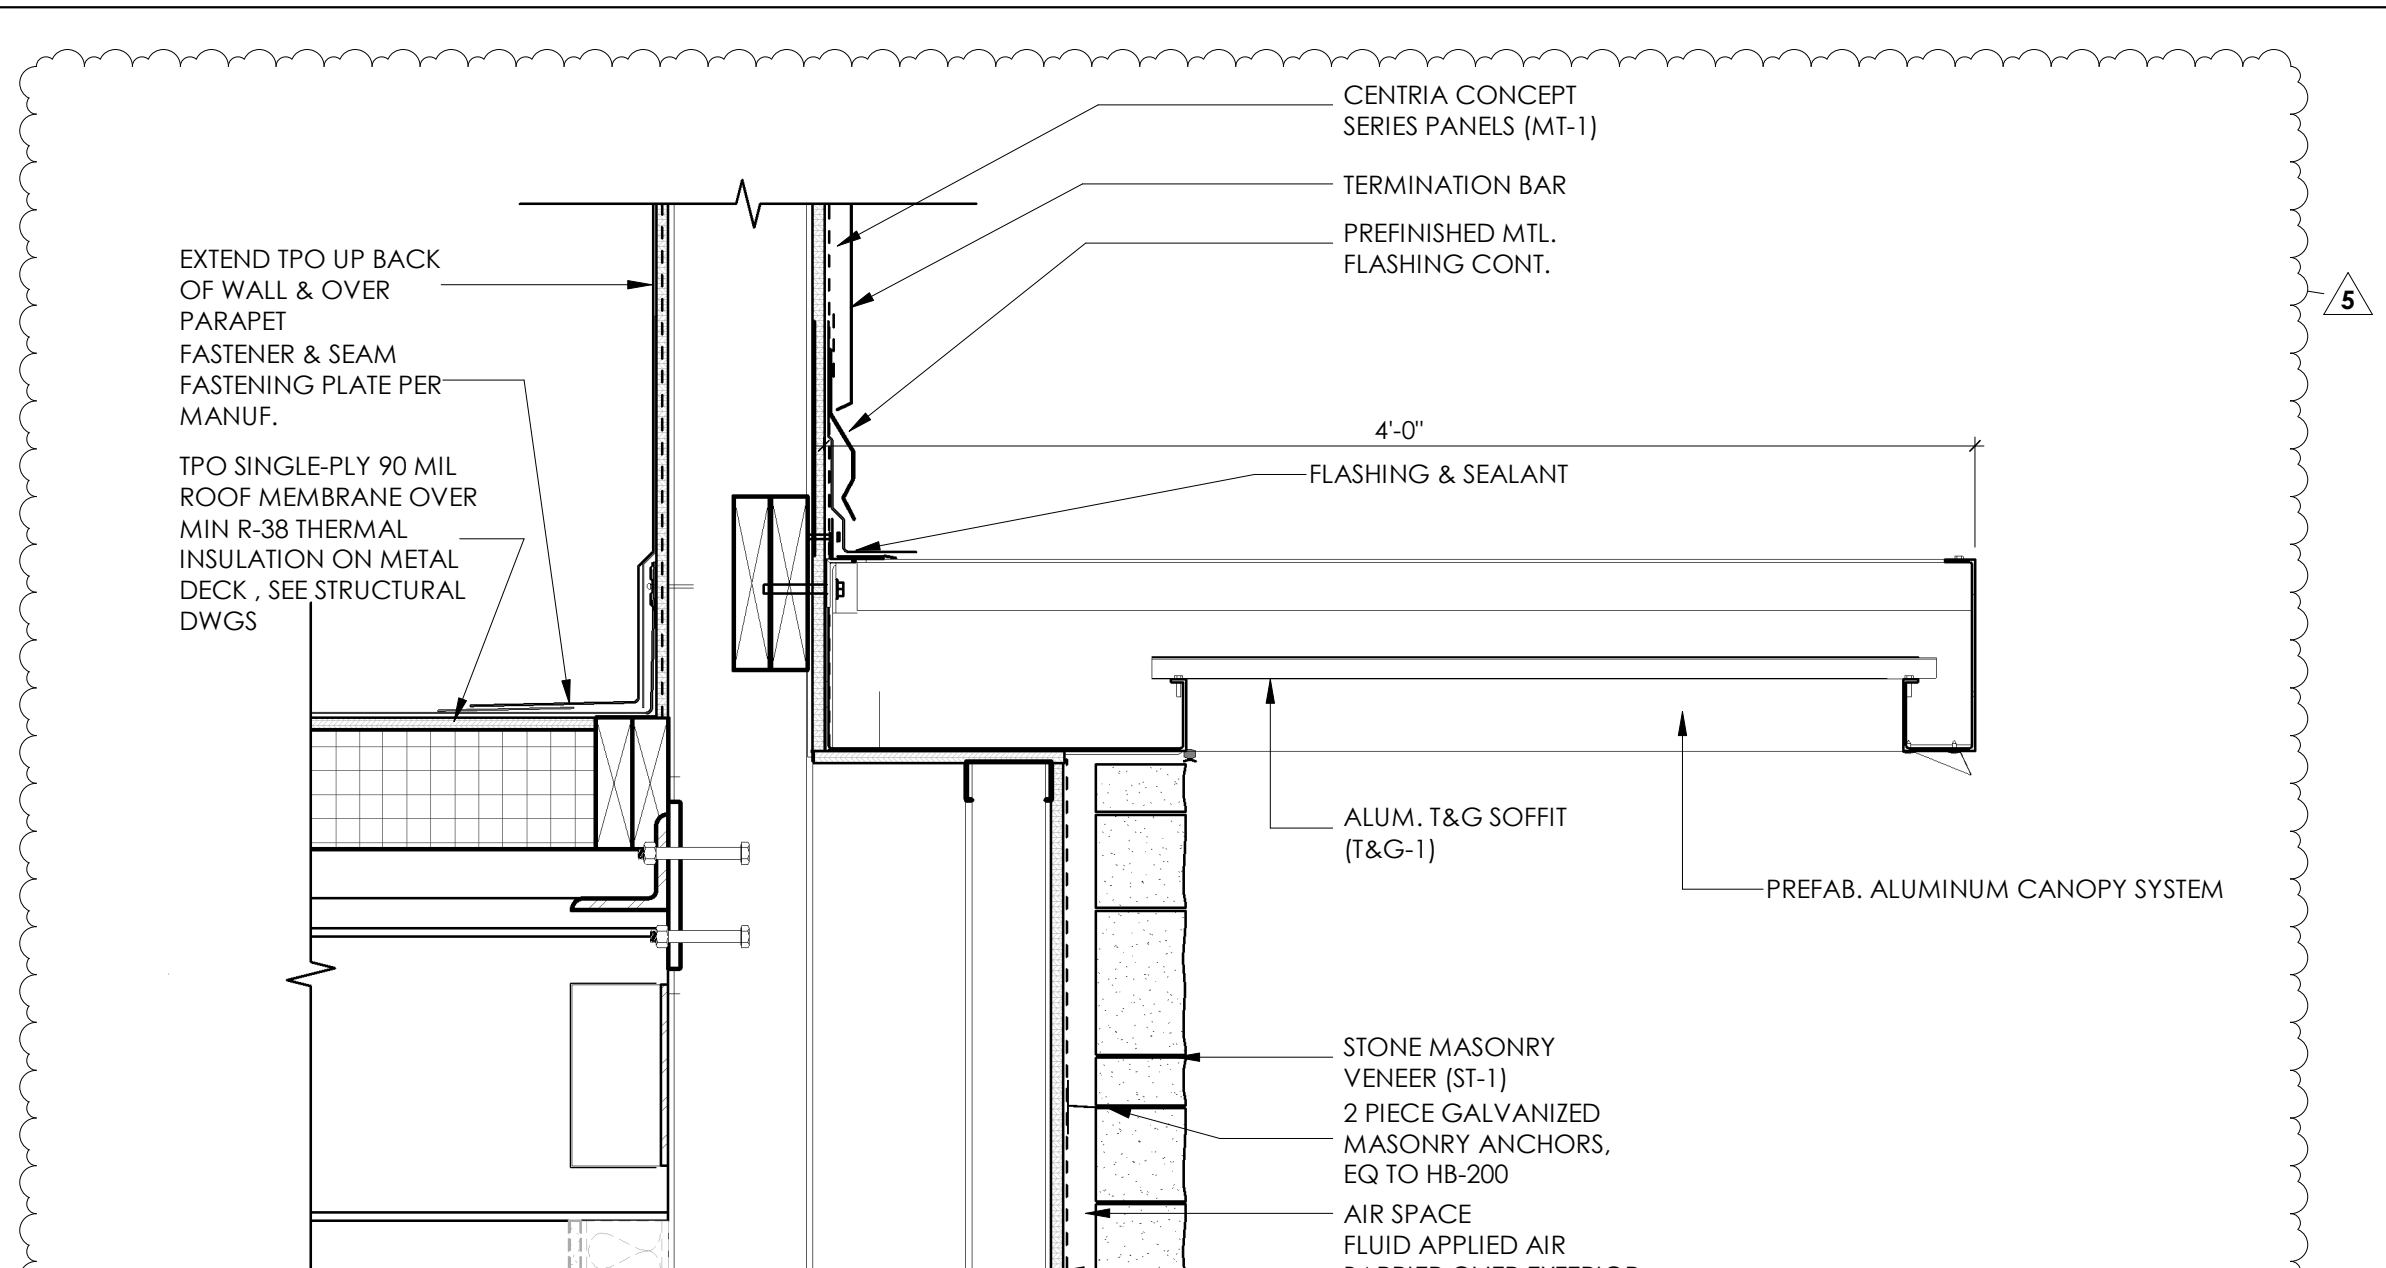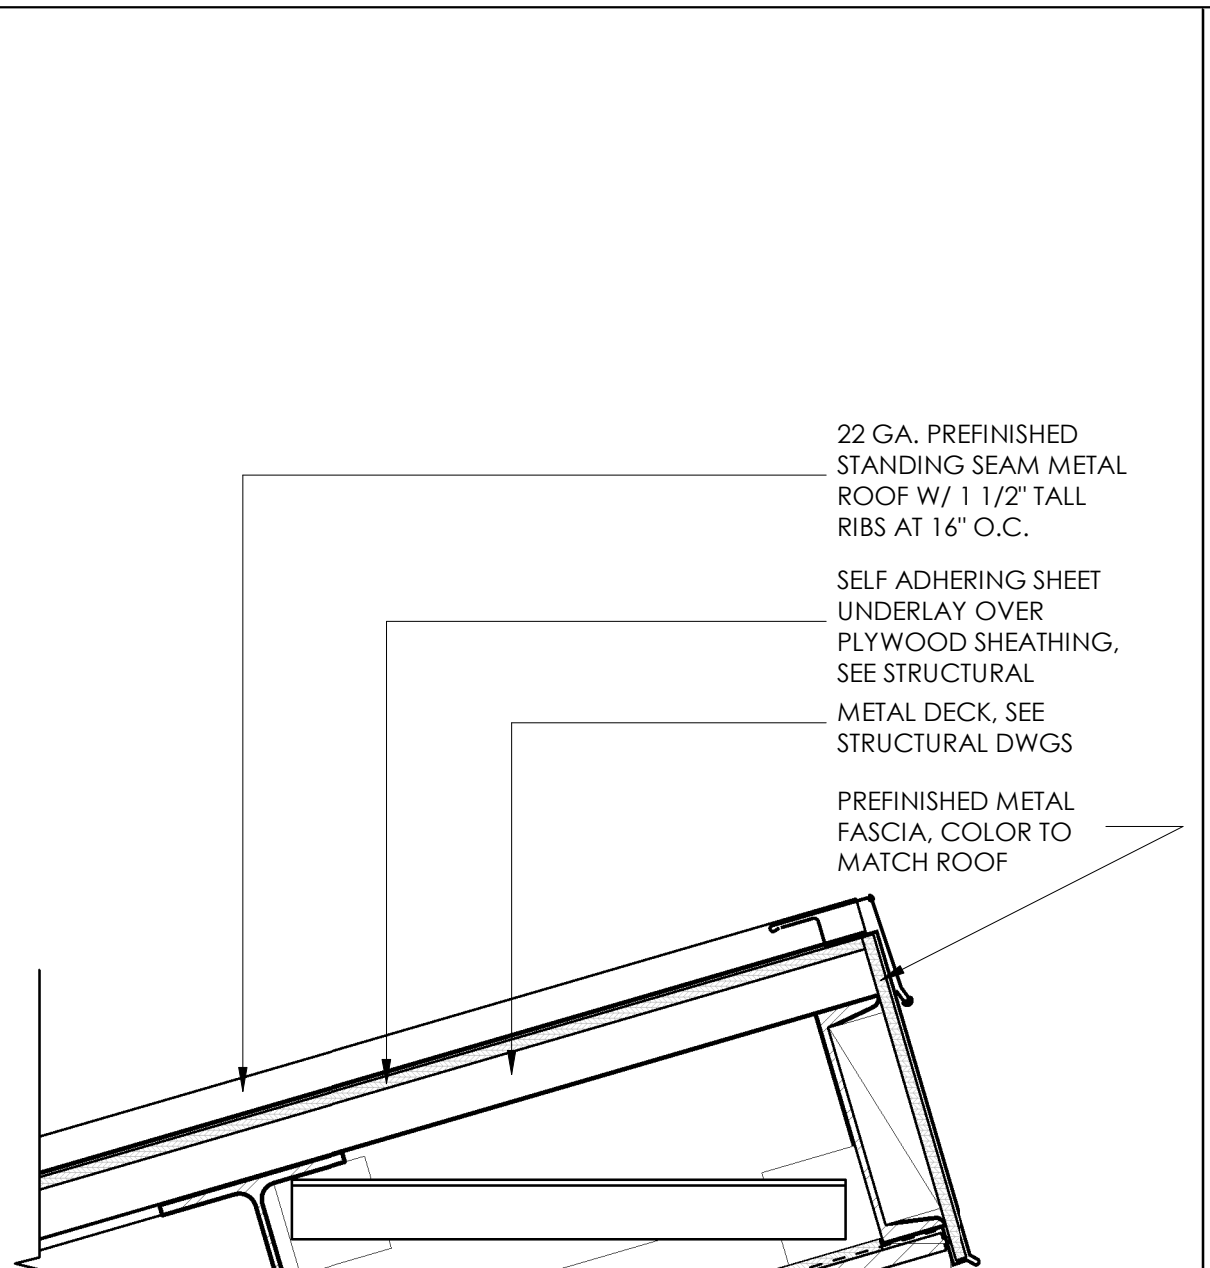

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
 THESE DESIGNS/DRAWINGS ARE THE SOLE
 PROPERTY OF ALIGN AUSTIN ARCHITECTS
 AND MAY NOT BE REPRODUCED IN ANY FORM,
 BY ANY METHOD, FOR ANY PURPOSE
 WITHOUT PREVIOUS WRITTEN PERMISSION.

3 09.12.22 City Comments
 5 08.XX.24 VE







**NOT FOR
 REGULATORY
 APPROVAL,
 PERMITTING, OR
 CONSTRUCTION.**



THIS DOCUMENT IS RELEASED FOR
 THE PURPOSE OF INTERIM REVIEW
 UNDER THE AUTHORITY OF
 RODNEY PALMER

01.28.2022
 PERMIT SET

SECTION DETAILS
 SHEET: **A322**

PROJECT NO: 21099
 DRAWN BY: AG
 DATE: 09.12.22
 PROJECT MGR: KS

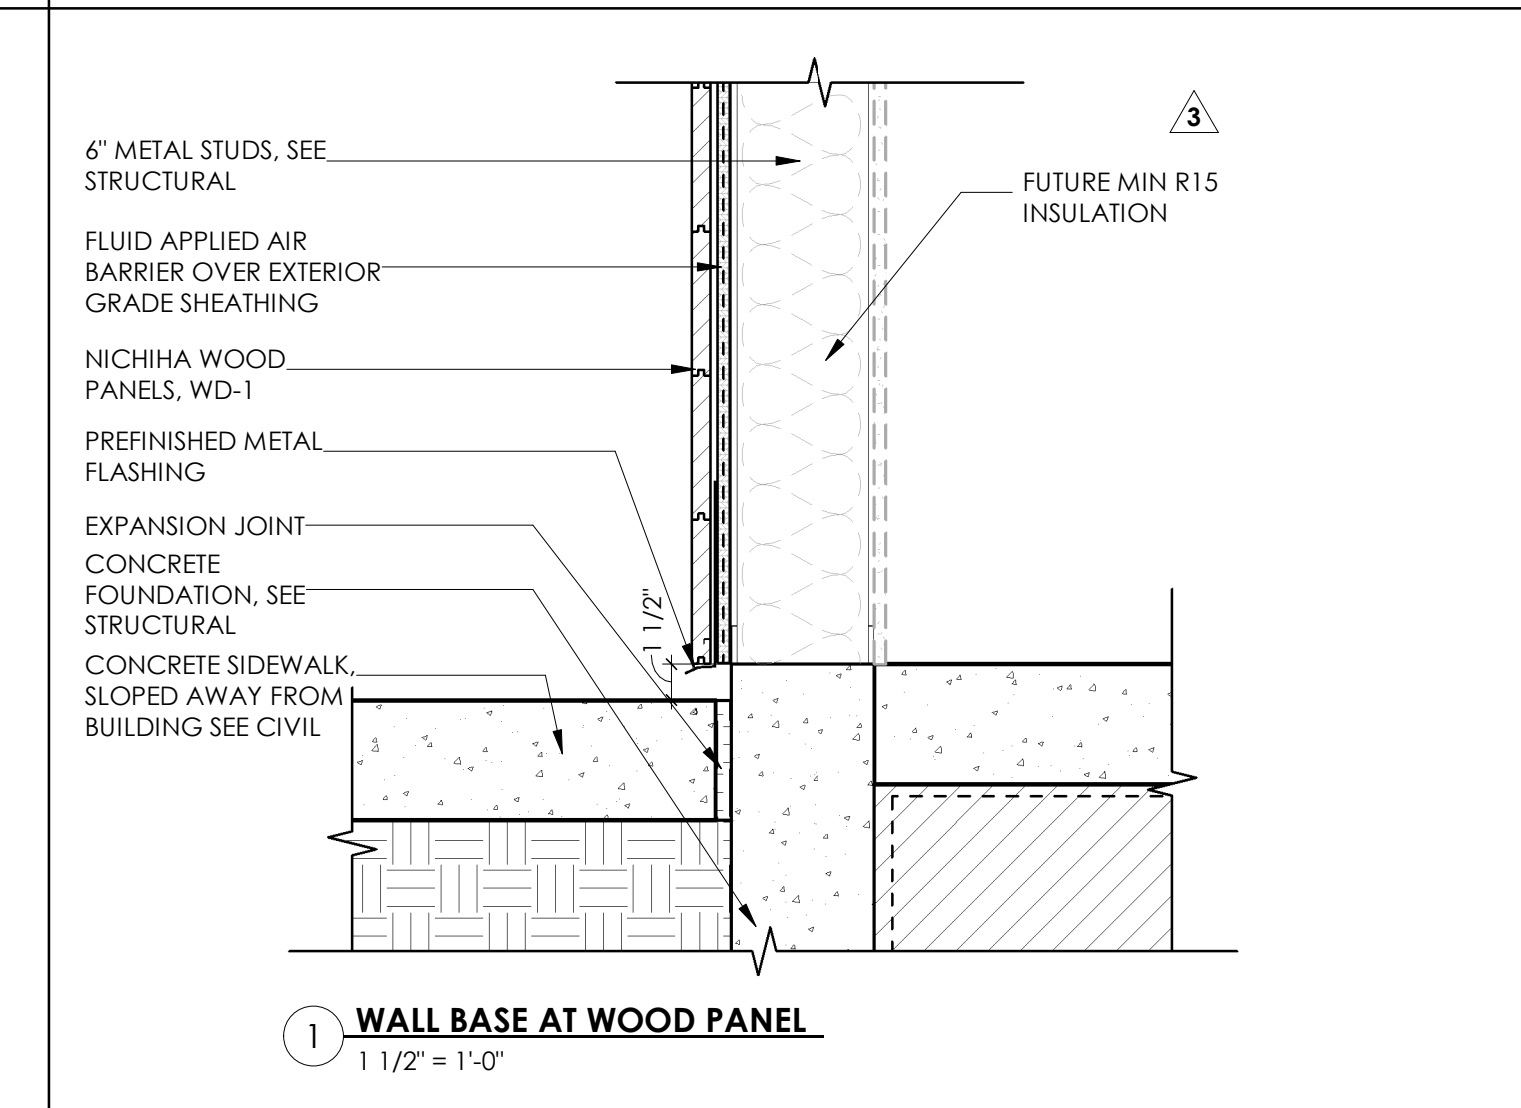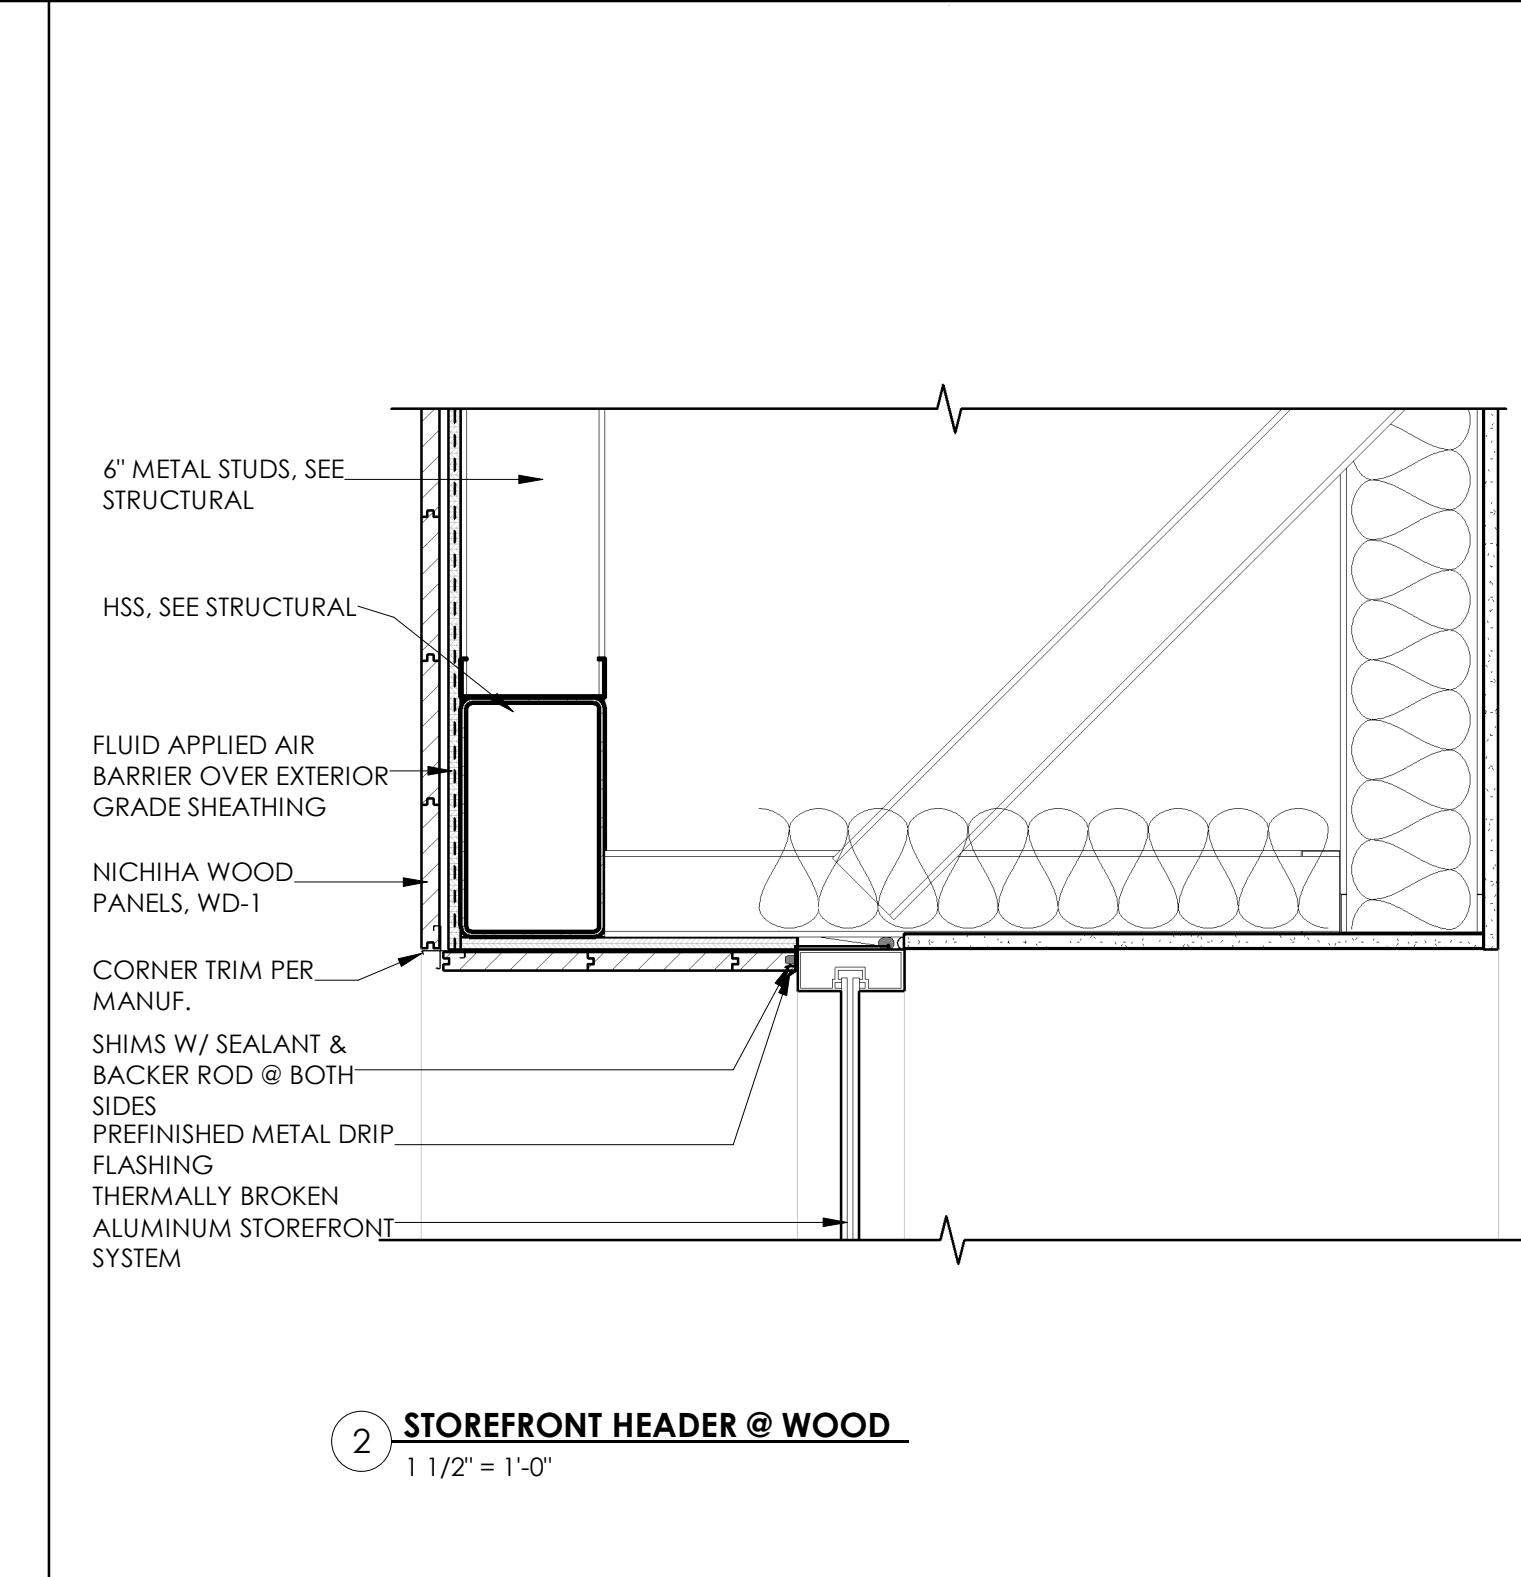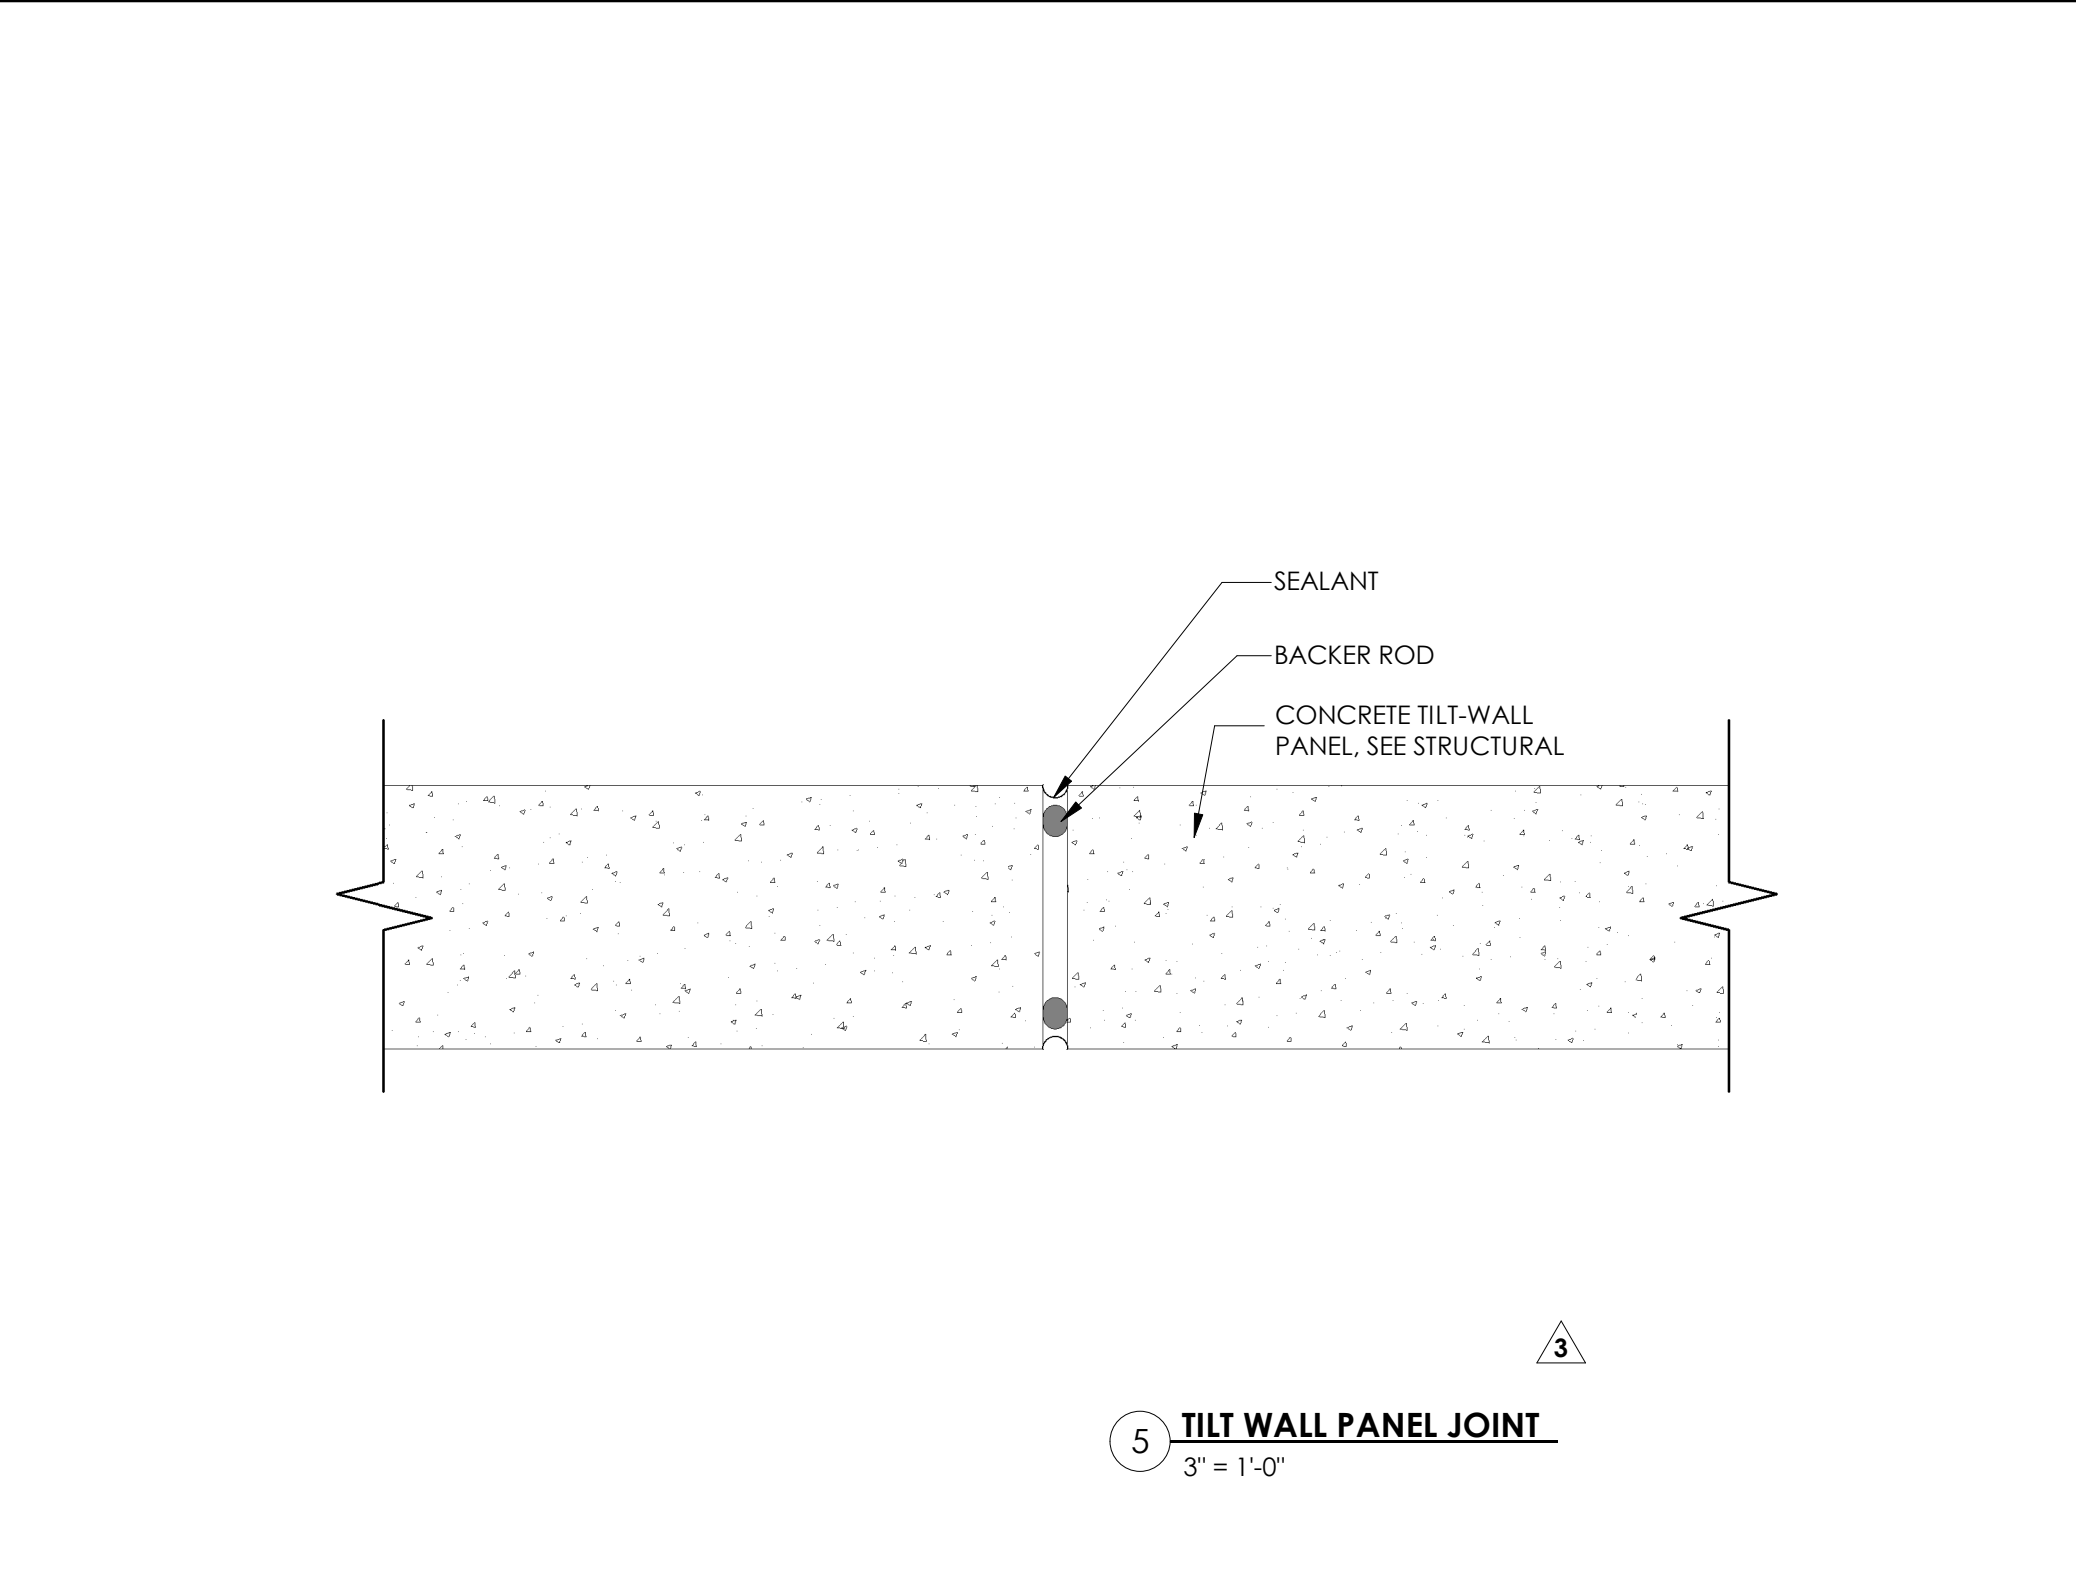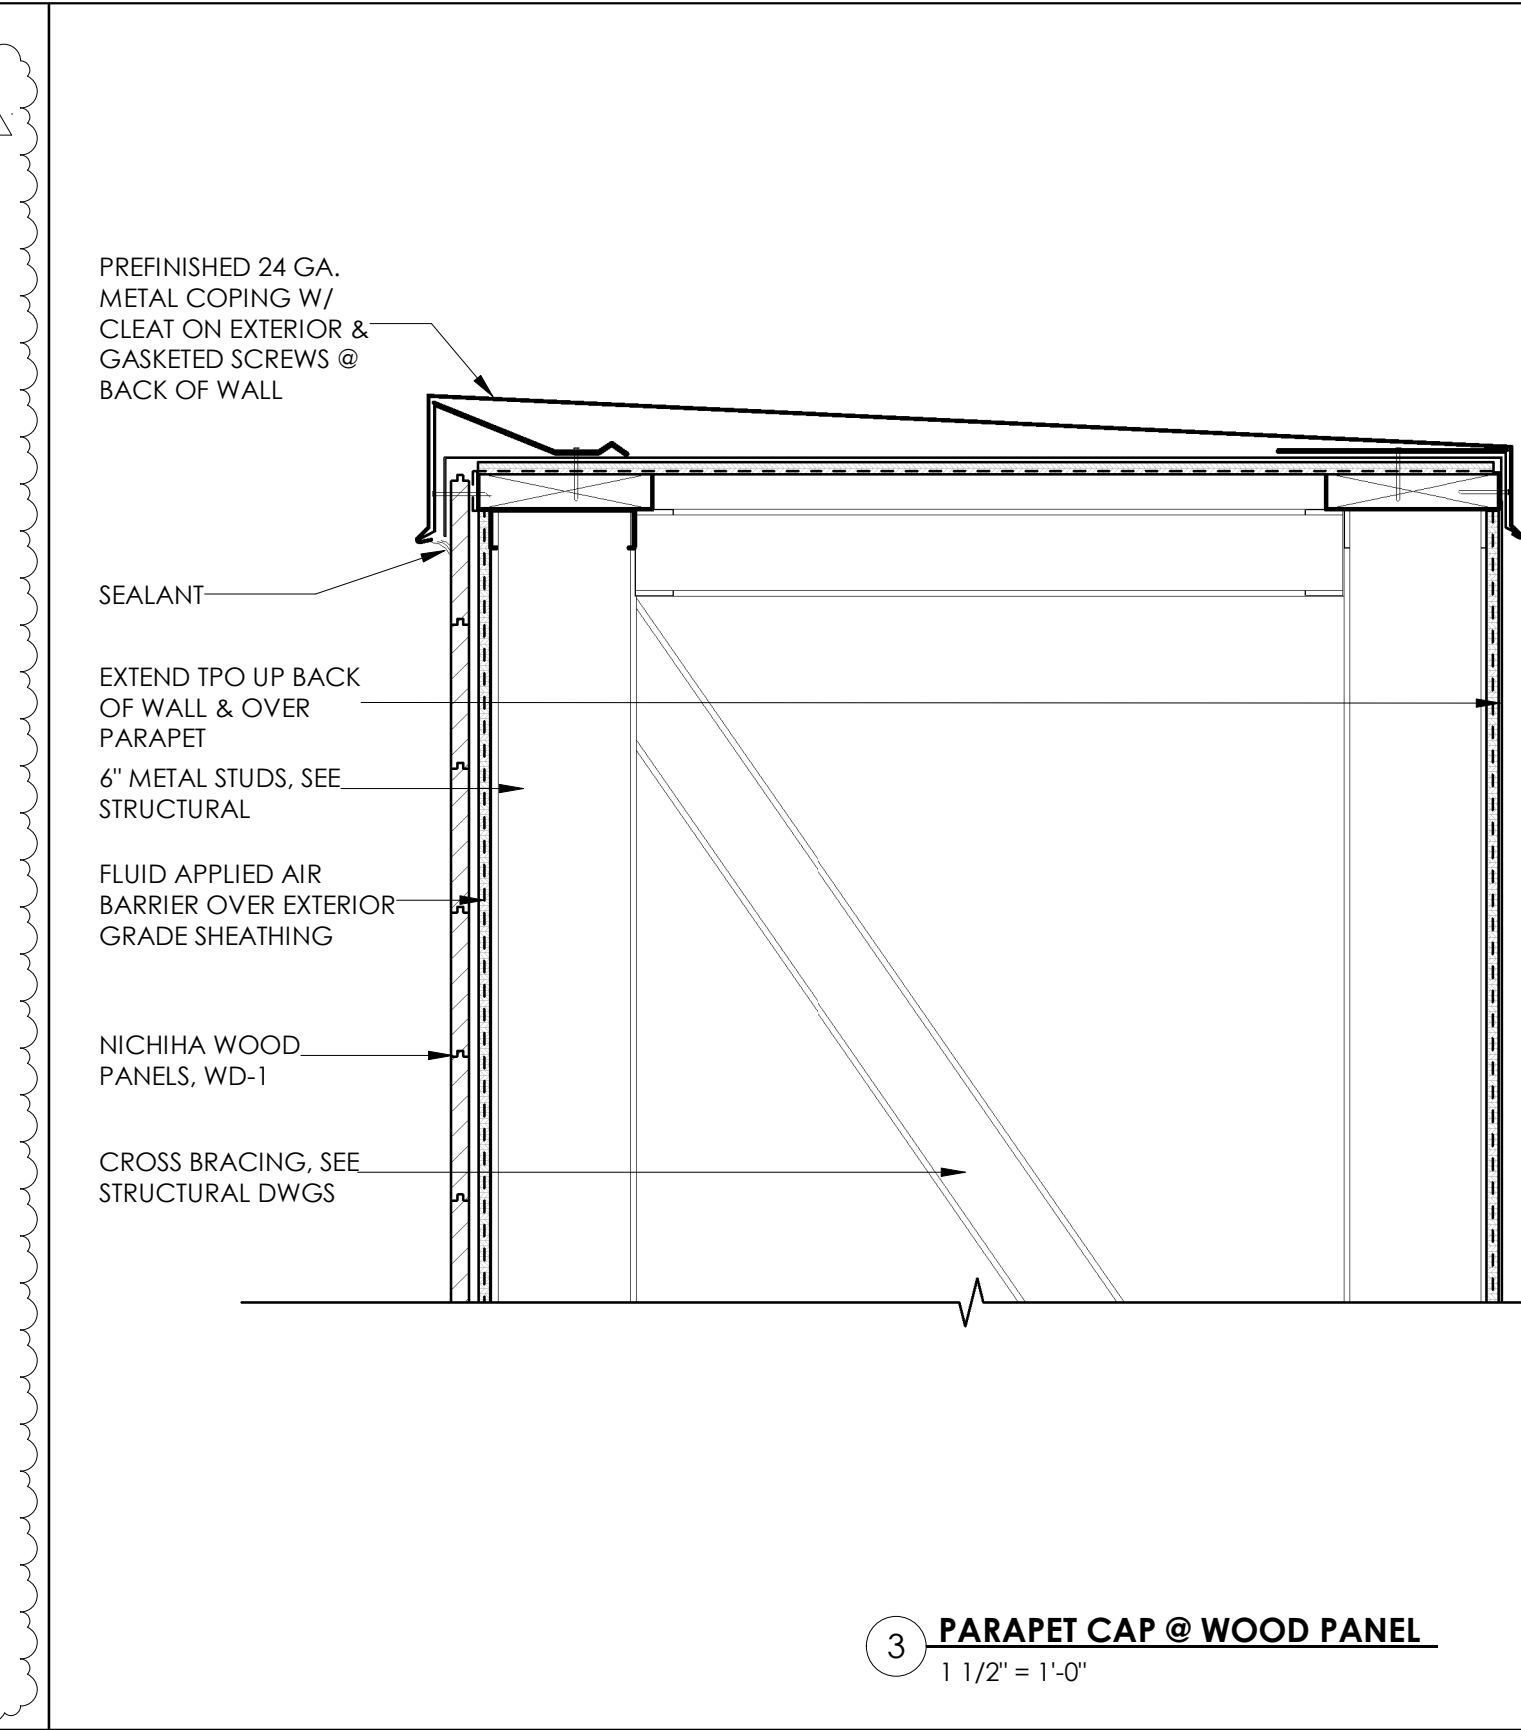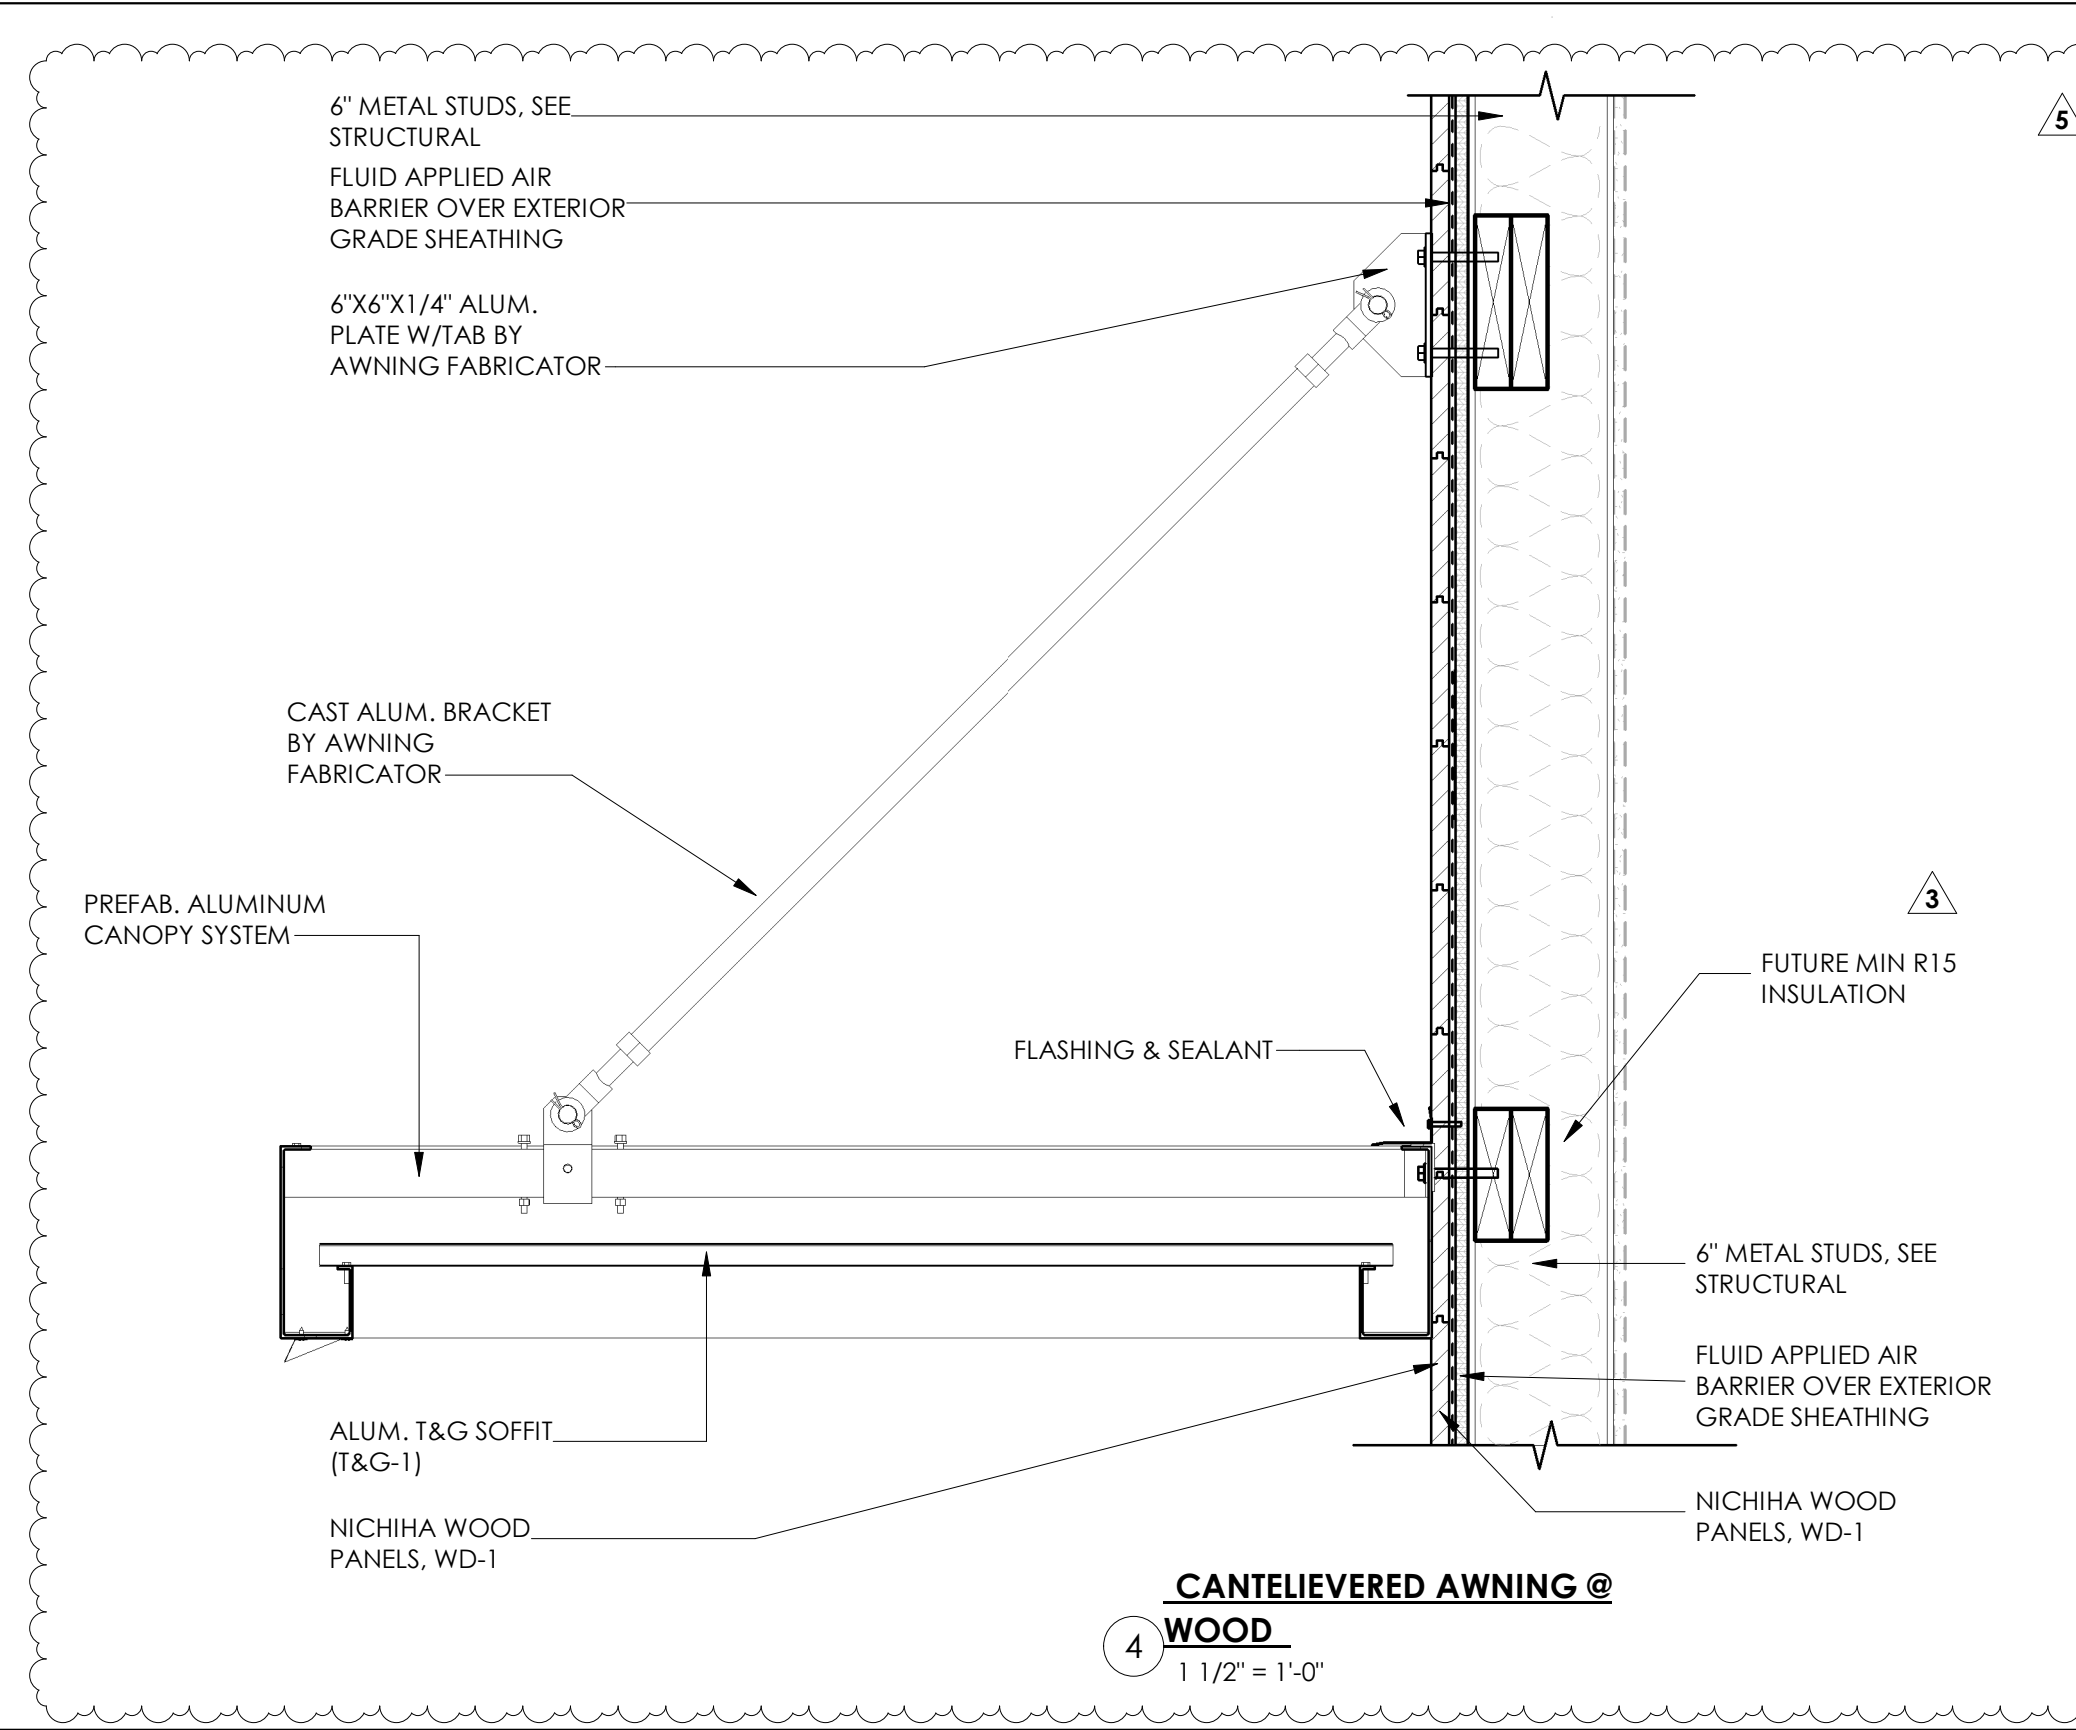

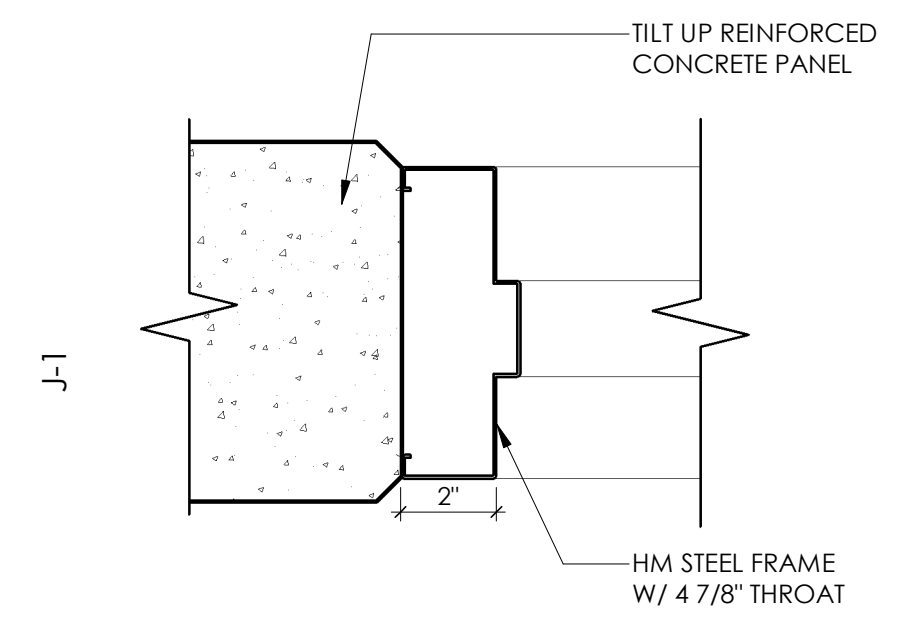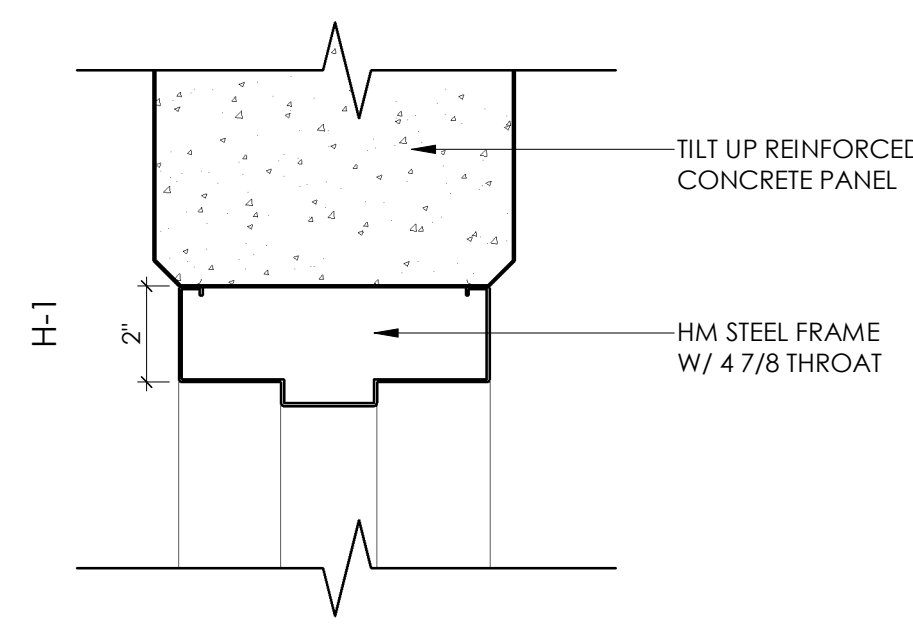

HM JAMB AND HEAD DETAIL


DOOR SCHEDULE

MARK	DOOR				FRAME		DETAIL		REMARK	HARDWARE	
	WIDTH	HEIGHT	THICKNESS	MATERIAL	TYPE	TYPE	MATERIAL	JAMB			HEAD
100	3'-0"	8'-0"	1 3/4"	AL	FG	SF-2	AL	MANUF	MANUF	1	1
101	3'-0"	8'-0"	1 3/4"	AL	FG	SF-1	AL	MANUF	MANUF	1	1
102	3'-0"	8'-0"	1 3/4"	AL	FG	SF-1	AL	MANUF	MANUF	1	1
103	3'-0"	8'-0"	1 3/4"	AL	FG	SF-1	AL	MANUF	MANUF	1	1
104	3'-0"	8'-0"	1 3/4"	AL	FG	SF-1	AL	MANUF	MANUF	1	1

REMARKS:
1. COORDINATE EXACT DOOR LOCATION WITH FUTURE TENANT

HARDWARE SCHEDULE

HARDWARE SET	QUALITY LEVEL	HINGES	LOCK FUNCTION, CYLINDERS & BOLTS	EXIT DEVICES	OPERATING TRIM	ACCESSORIES & PROTECT. TRIM	CLOSER & SILENCERS	STOPS & HOLDERS	GASKETS & THRESHOLDS	REMARKS																																
											STANDARD COMMERCIAL	HEAVY DUTY COMMERCIAL	CONTINUOUS HINGE	FULL SURFACE	WIDE THROW	PASSAGE	OFFICE	PRIVACY	DJAWAY	ENTRY	MORTISE SET	STOREROOM	ELECTRIFIED	INTERCHANGEABLE	HID DEADLATCH	DEADLATCH PADDLE	ACRITIS FIRE DEVICE	PANIC DEVICE	CONCEALED VERT. ROD EXIT DEVICE	LEVER	PUSH PLATE	PULL BAR	PUSH AND PULL BARS	KICKPLATE	ASTRAGAL	PEEP HOLE	LOCK GUARD	OVERHEAD SURFACE CLOSER	CONCLD. CLOSER (MORTISE)	CONCLD. CLOSER (FLOOR)	HINGE CLOSER	SILENCER
SET #1	X	X									CONTRACTOR TO COORDINATE ALL DOOR LOCKING SYSTEMS BETWEEN OWNER'S REQUIREMENTS, LIFE SAFETY, AND SUPPLIERS' PRODUCTS PRIOR TO ORDERING																															
											PERIMETER GASKETING BY DOOR MANUF.																															

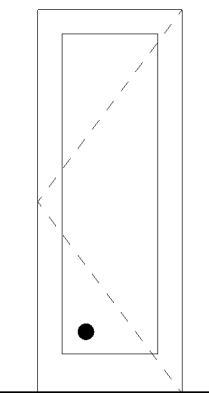


DOOR TYPE FG
FULL GLASS

WINDOW LEGEND

- 1" INSULATED, CLEAR, LOW-E GLAZING GL-1, EQUAL TO PPG SOLARBAN 90 XL CLEAR, ANNEALED
- 1" INSULATED, CLEAR, LOW-E GLAZING GL-1, EQUAL TO PPG SOLARBAN 90 XL CLEAR, TEMPERED

VITRO SOLARBAN 90 XL CLEAR
SHGC 0.23
VLT 51%
REFLECTANCE 12%MAX

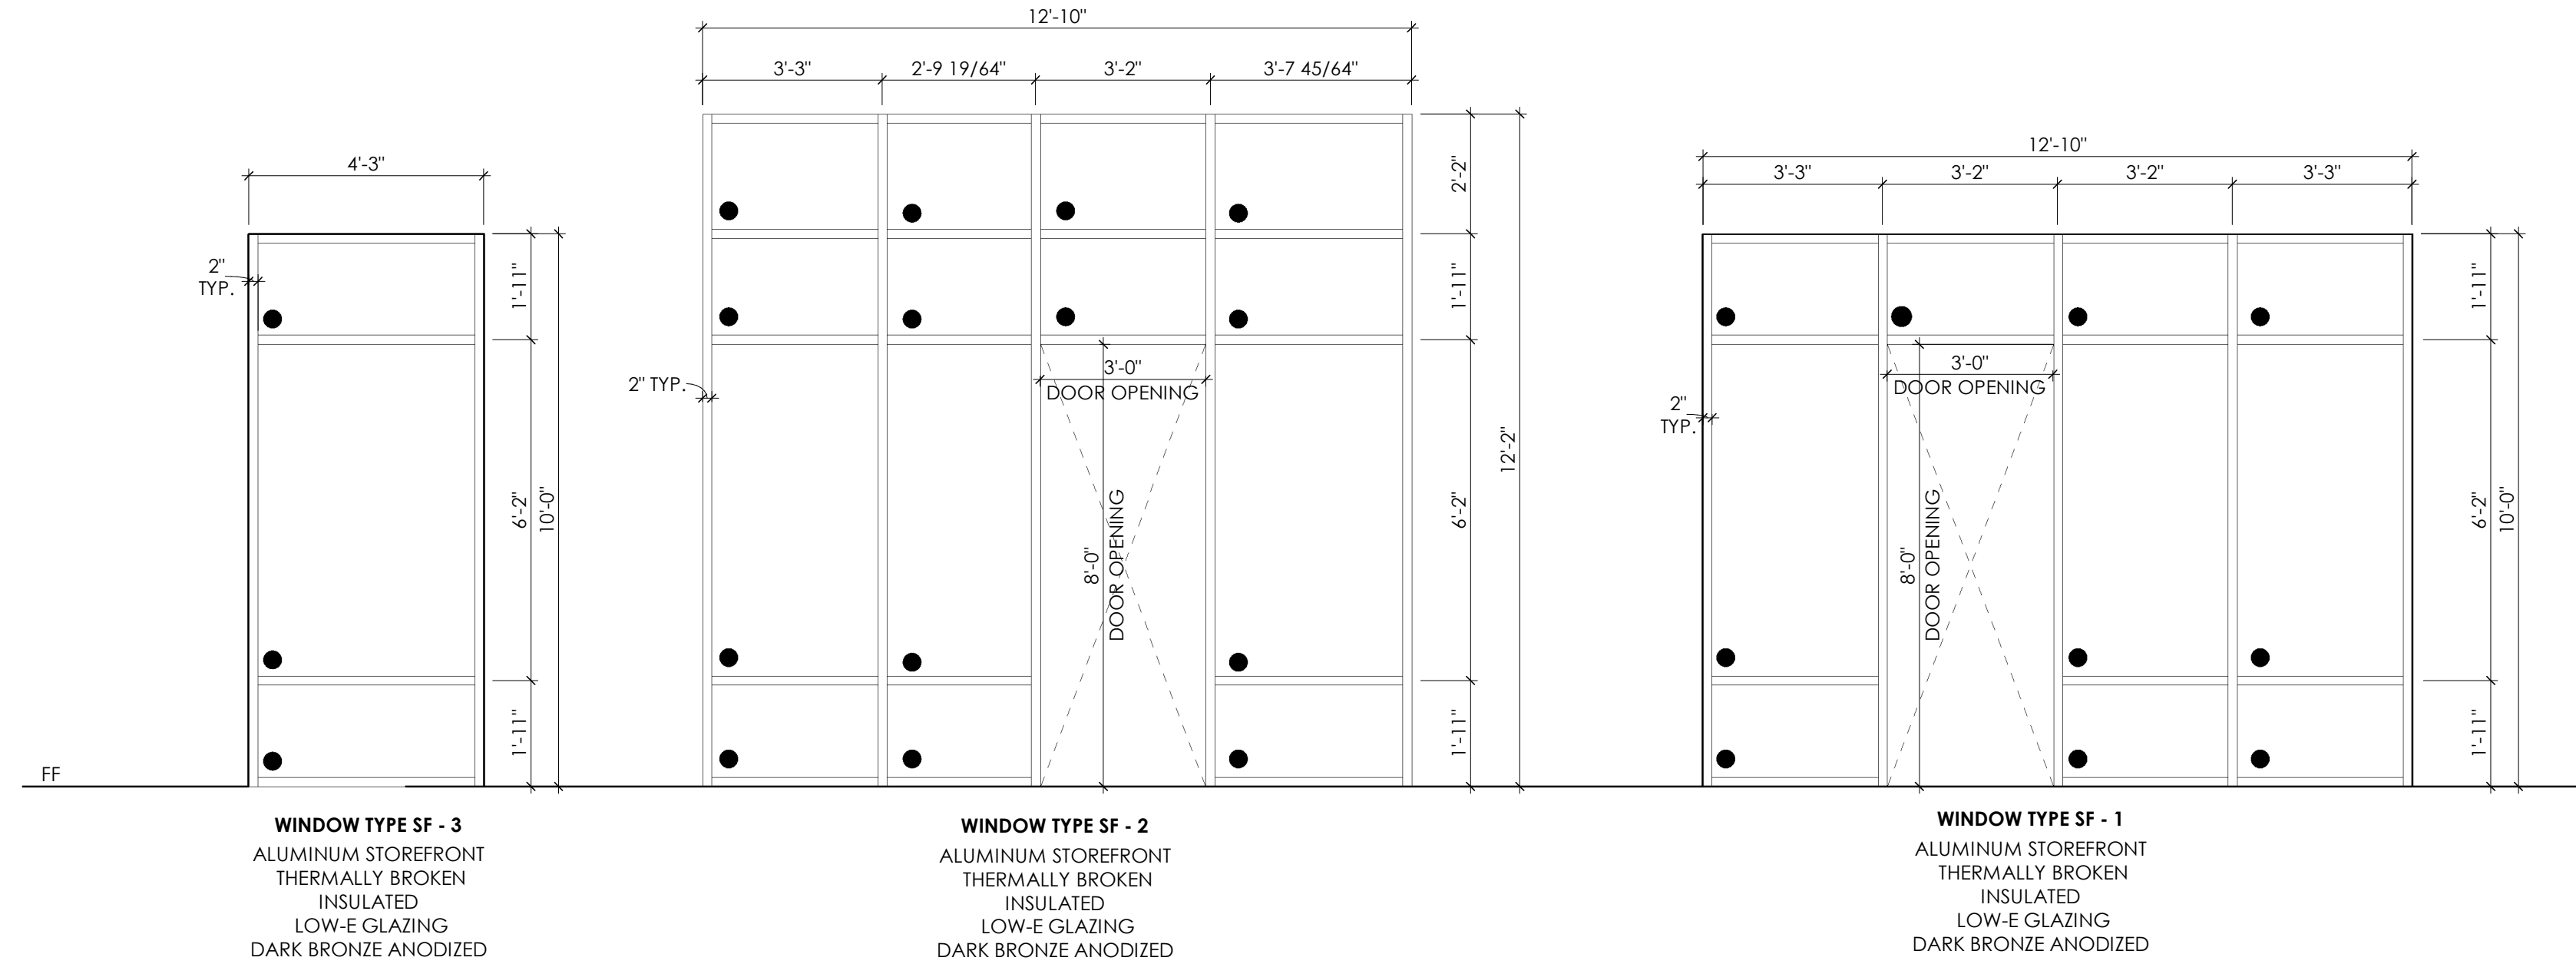

COPYRIGHT © 2024 ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

3 09.12.22 City Comments

NOT FOR REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.
THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF INTERIM REVIEW UNDER THE AUTHORITY OF RODNEY PALMER
01.23.2022 PERMIT SET

DOOR/WINDOW - SCHEDULES DETAILS

SHEET: **A501**

PROJECT NO: 21099
DRAWN BY: AG
DATE: 09.12.22
PROJECT MGR: KS

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
 THESE DESIGNS/DRAWINGS ARE THE SOLE
 PROPERTY OF ALIGN ARCHITECTS
 AND MAY NOT BE REPRODUCED IN ANY FORM
 BY ANY METHOD FOR ANY PURPOSE
 WITHOUT PREVIOUS WRITTEN PERMISSION.

3 09.12.22 City Comments
 5 08.XX.24 VE

**NOT FOR
 REGULATORY
 APPROVAL,
 PERMITTING, OR
 CONSTRUCTION.**


THIS DOCUMENT IS RELEASED FOR
 THE PURPOSE OF INTERIM REVIEW
 UNDER THE AUTHORITY OF
 RODNEY PALMER
 ARCHITECT

01.23.2022
 PERMIT SET

SHEET: **A601**

PROJECT NO: 21099
 DRAWN BY: AG
 DATE: 09.12.22
 PROJECT MGR: KS


RCP LEGEND

- ◊ RECESSED CAN
- DIRECTIONAL DOWNLIGHT
- ◻ WALL MOUNTED SECURITY
- WALL SCONCE A
- ⊕ WALL SCONCE B
-  ALUMINUM T&G SOFFIT, PER SELECTION

LIGHTING DETAIL



NOTE: ALL FIXTURES TO BE IN ACCORDANCE WITH CITY CODE SECTION 12: OUTDOOR LIGHTING.
 A. FIXTURES ARE NON-FLASHING AND SHIELDED SUCH THAT THE LIGHT SOURCE IS NOT VISIBLE FROM THE PUBLIC ROW OR ADJACENT RESIDENTIAL USES.
 B. THE LEVEL OF ILLUMINATION AS MEASURED IN FOOT CANDLES AT A HEIGHT OF 3'-0" AT THE PROPERTY LINE DOES NOT EXCEED 2 FOOT CANDLES.

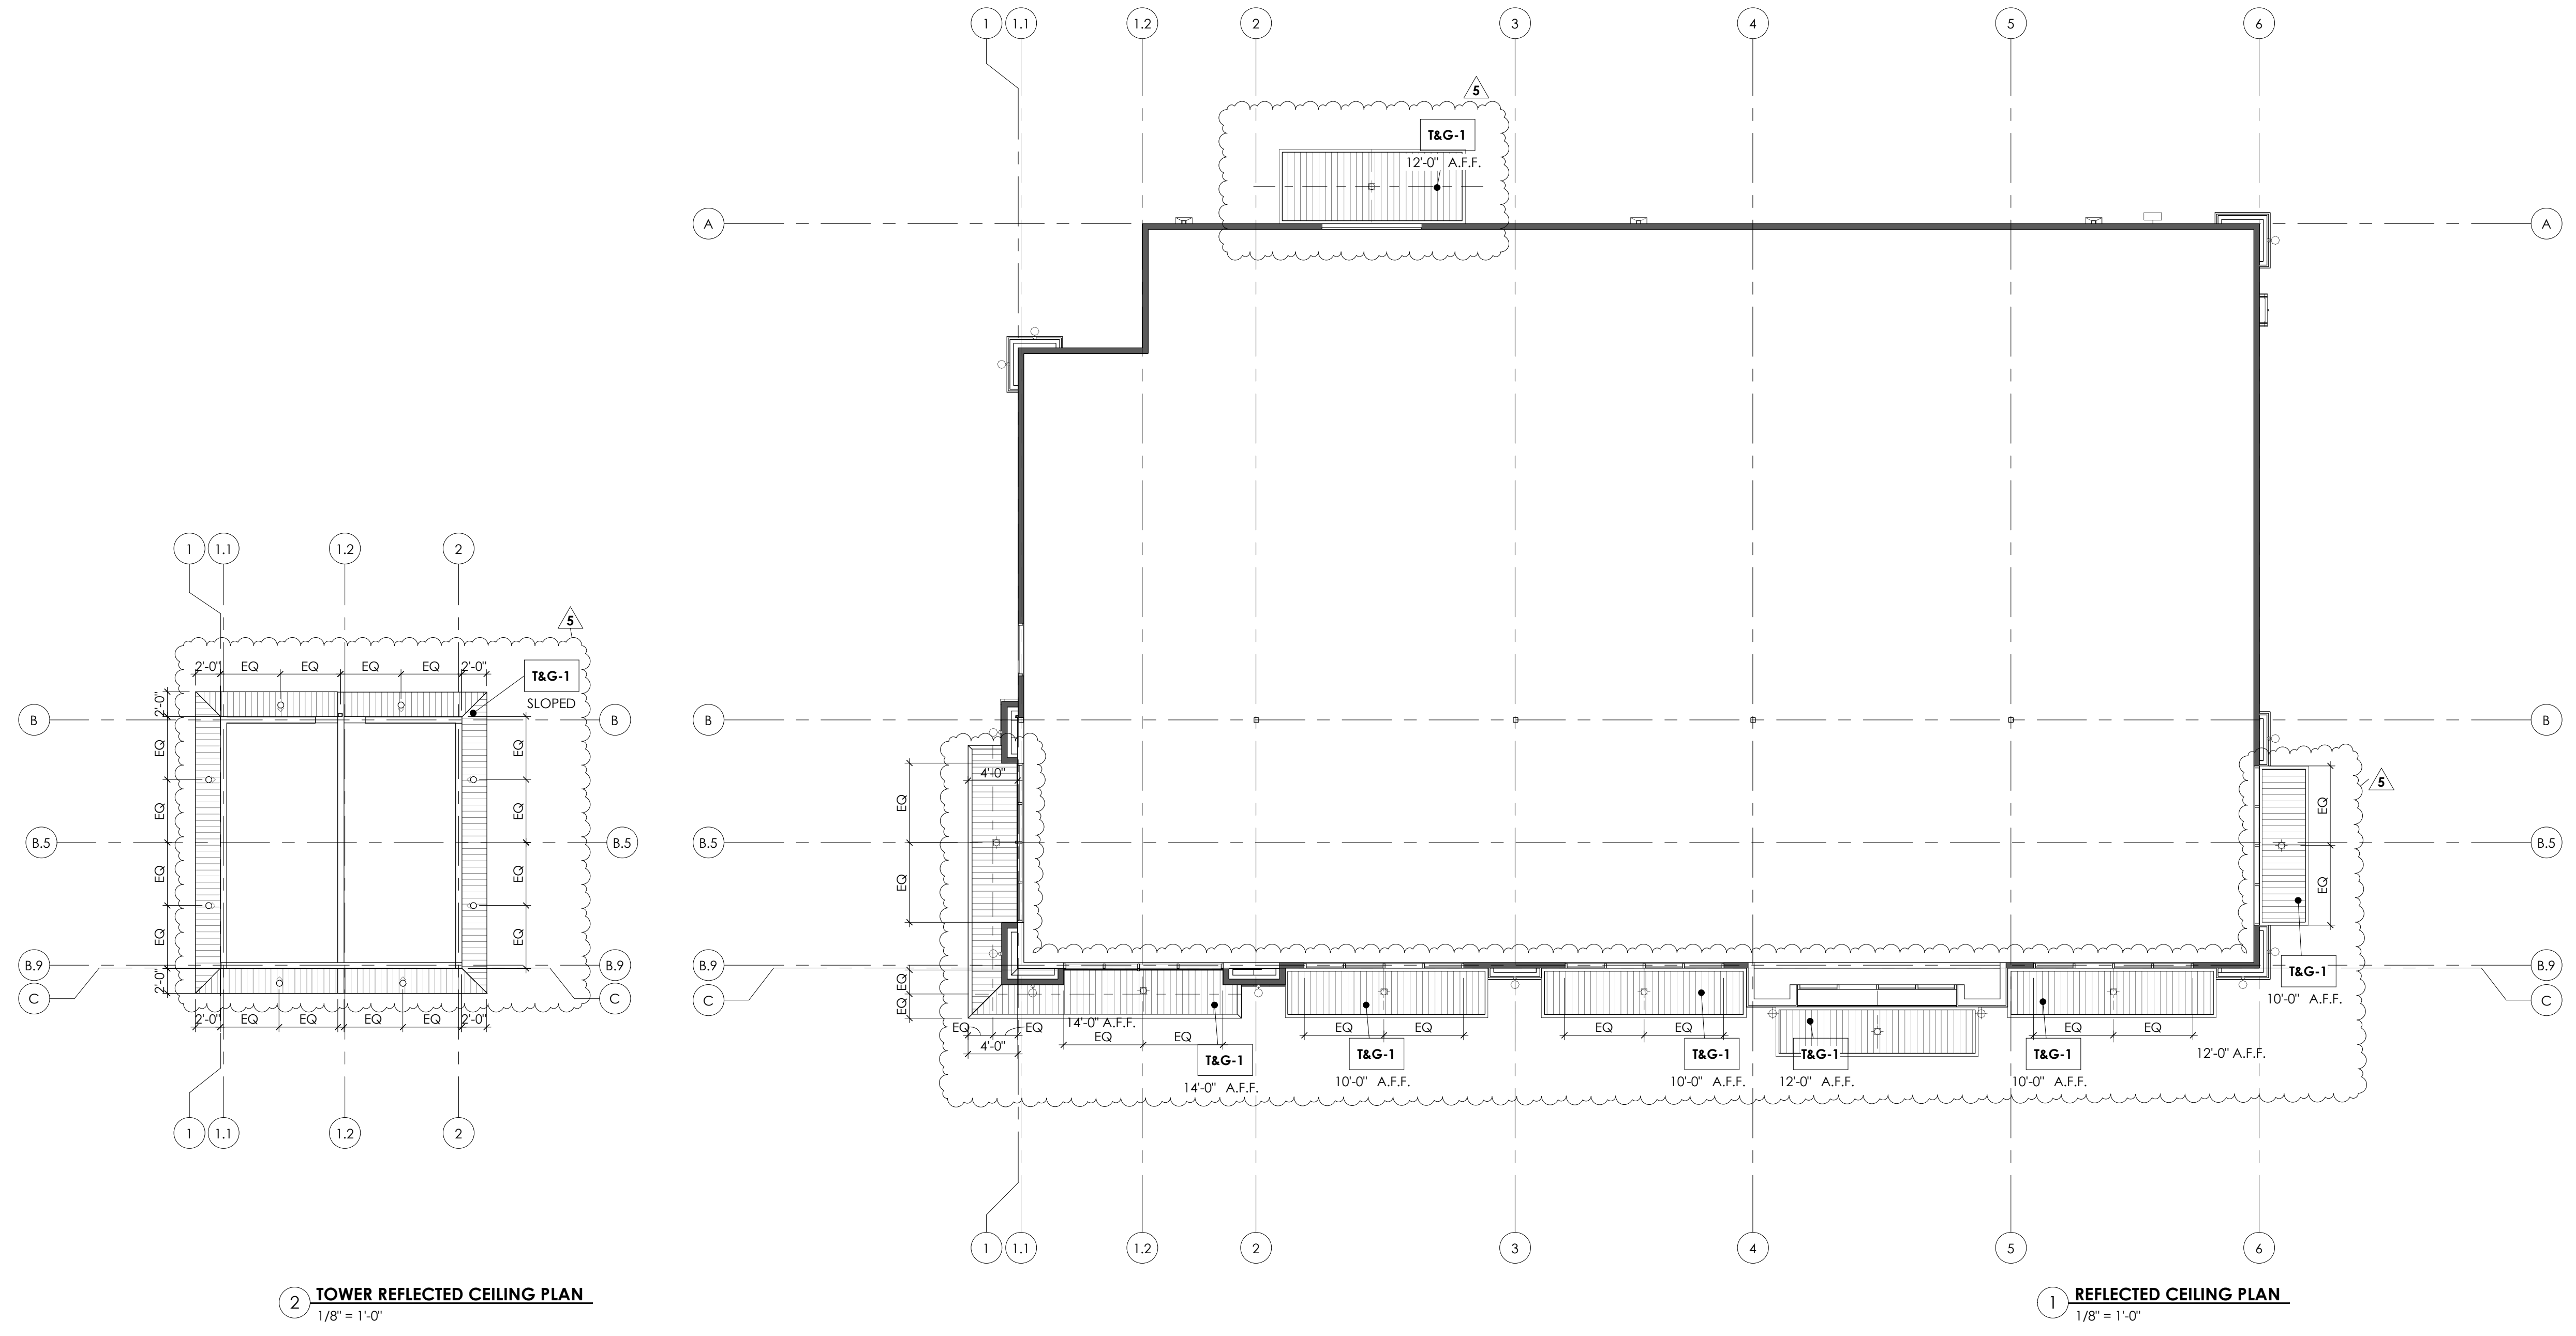

2 TOWER REFLECTED CEILING PLAN
 1/8" = 1'-0"

1 REFLECTED CEILING PLAN
 1/8" = 1'-0"

STRUCTURAL SUBMITTALS

- SUBMITTAL REVIEW**
- TEN WORKING DAYS PRIOR TO SUBMITTING SHOP DRAWINGS, THE CONTRACTOR SHALL SUBMIT FOR STRUCTURAL ENGINEER'S REVIEW A SCHEDULE WHICH DETAILS THE ESTIMATED QUANTITY OF SHOP DRAWINGS AND THE DATE THE SHOP DRAWINGS WILL BE RECEIVED BY THE STRUCTURAL ENGINEER. THE STRUCTURAL ENGINEER SHALL HAVE THE OPPORTUNITY TO REVIEW THE PROPOSED SCHEDULE AND SUBMIT COMMENTS TO THE CONTRACTOR. THE FINAL SHOP DRAWING SCHEDULE SHALL BE DEVELOPED AND SUBMITTED TO THE STRUCTURAL ENGINEER. IN ACCORDANCE WITH THE SHOP DRAWING SCHEDULE, THE STRUCTURAL ENGINEER WILL RETURN THE SHOP DRAWING ITEMS WITHIN TEN WORKING DAYS AFTER HAVING RECEIVED THE REPRODUCIBLE SHOP DRAWING.
 - THE CONTRACTOR IS TO REVIEW EACH SUBMITTAL PRIOR TO FORWARDING TO ARCHITECT AND STRUCTURAL ENGINEER. THE CONTRACTOR IS TO STAMP EACH SUBMITTAL VERIFYING THAT THE FOLLOWING IS ADDRESSED:
 - THE SHOP DRAWING IS REQUESTED.
 - THE SHOP DRAWING IS BASED ON THE LATEST DESIGN.
 - THE ARCHITECT'S AND STRUCTURAL ENGINEER'S COMMENTS FROM ANY PREVIOUS SUBMITTALS ARE ADDRESSED.
 - THE WORK IS COORDINATED AMONG ALL CONSTRUCTION TRADES.
 - REVISIONS FROM PREVIOUS SUBMITTALS ARE CLEARLY MARKED BY CIRCLING OR CLOUDS.
 - SUBMITTAL IS COMPLETE.
 - SUBMITTAL DOES NOT INCLUDE SUBSTITUTION REQUEST
 - SUBMITTAL SHALL INCLUDE A STAMP INDICATING PROJECT NAME AND LOCATION, SUBMITTAL NUMBER, SPECIFICATION SECTION NUMBER.
 - THE STRUCTURAL ENGINEER SHALL RETURN, WITHOUT COMMENT, SUBMITTALS WHICH THE CONTRACTOR HAS NOT STAMPED OR WHICH DO NOT MEET THE ABOVE REQUIREMENTS. THE STRUCTURAL ENGINEER'S REVIEW OF SUBMITTALS SHALL BE FOR GENERAL CONFORMANCE WITH THE DESIGN INTENT. NO WORK SHALL BE STARTED WITHOUT SUCH REVIEW.
 - FOR COMPONENTS THAT REQUIRE ENGINEERING BY THE CONTRACTOR, PROVIDE A NOTE ON EACH SHOP DRAWING, WRITTEN AND SIGNED BY THE SUPPLIER'S ENGINEER, INDICATING THAT THE SHOP DRAWING IS IN CONFORMANCE WITH THE CALCULATIONS OF THE CONTRACTOR'S ENGINEER.

REQUIRED SUBMITTALS

- THE FOLLOWING ITEMS REQUIRE SUBMITTALS FOR STRUCTURAL REVIEW AS OUTLINED IN THE SPECIFICATIONS:


- 03100 - CONCRETE FORMWORKCALC
- 03200 - CONCRETE REINFORCING LAYOUT
- 03300 - CONCRETE MIX DESIGNS
- 03300 - CONCRETE CONSTRUCTION JOINT LAYOUT
- 03400 - CONCRETE TILT UP WALL PANEL REINFORCING AND LIFTING AND BRACING
- 05100 - STRUCTURAL STEEL
- 05100 - STRUCTURAL STEEL CONNECTIONS.....CALC - S/S
- 05100 - STEEL STAIRSCALC - S/S
- 05200 - STEEL JOISTS
- 05300 - STEEL METAL DECK
- 05400 - COLD FORM STEELCALC - S/S

CALC = CALCULATIONS TO BE PROVIDED TO ENGINEER OF RECORD
S/S=SIGNED AND SEALED BY ENGINEER IN PROJECT STATE

DELEGATED DESIGNS

- THE ITEMS IN THIS SECTION REFER TO LOADS IMPOSED BY CONTRACTOR DESIGNED SYSTEMS, SPECIFICALLY:
 - PRE-ENGINEERED CANOPIES
 - METAL STAIRS
 - ARCHITECTURAL ORNAMENTATION (FLAGPOLES, BANNERS, MASTS, ETC.)
- WHERE CONTRACTOR LOADS IMPOSED DO NOT EXCEED AND/OR CONNECTION CONDITIONS DO NOT DIFFER FROM WHAT IS INDICATED IN THE STRUCTURAL DRAWINGS, SUBMIT FOR RECORD A LETTER SIGNED AND SEALED BY A LICENSED PROFESSIONAL ENGINEER IN THE STATE IN WHICH THE PROJECT IS LOCATED STATING THE FOLLOWING:
 - "THE CONTRACTOR DESIGNED SYSTEM HAS BEEN DESIGNED TO IMPOSE LOADS ON THE BASE BUILDING STRUCTURE THAT ARE WITHIN THE LOAD LIMITS AND AT THE LOCATIONS INDICATED ON THE STRUCTURAL DRAWINGS."
- WHERE CONTRACTOR LOADS IMPOSED FOR THE FOLLOWING ITEMS EXCEED AND/OR CONNECTION CONDITIONS DIFFER FROM WHAT IS SHOWN IN THE STRUCTURAL DRAWINGS, SUBMIT FOR APPROVAL TO SER LOADS IMPOSED ON THE PRIMARY STRUCTURAL FRAME DUE TO THE DEAD, LIVE, AND WIND/SEISMIC LOADS INDICATED ON THE CONTRACT DOCUMENTS.
 - SUBMITTAL SHALL LIST THE DESIGN LOADS USED AND BE SIGNED AND SEALED BY A LICENSED PROFESSIONAL ENGINEER IN THE STATE IN WHICH THE PROJECT IS LOCATED. SUBMITTAL SHALL INCLUDE LOCATION, MAGNITUDE AND DIRECTION OF UNFACTORED IMPOSED LOADS, GRAPHICALLY REPRESENTED IN THEIR APPROPRIATE LOCATIONS ON A COPY OF THE CONTRACT DOCUMENT STRUCTURAL FRAMING PLANS OR ELEVATIONS AS APPROPRIATE. DETAIL REFERENCES IN THE CONNECTIONS APPLICABLE AT EACH LOCATION SHALL BE NOTED ON THE SUBMITTAL DRAWINGS.
 - FOR EXTERIOR WALL ASSEMBLIES, THE LOADS IMPOSED SUBMITTAL SHALL BE COMPREHENSIVE INDICATING THE LOAD IMPOSED ON THE BASE BUILDING STRUCTURE AND SHALL BE THE REACTION BASED ON THE ACTUAL LOADS OF THE ENTIRE ASSEMBLY, INCLUDING BUT NOT LIMITED TO GLAZING, CLADDING, METAL STUD BACKUP, AND MULLIONS.
 - A SUBSTITUTION REQUEST MAY BE REQUIRED WHERE CONTRACTOR LOADS IMPOSED EXCEED AND/OR CONNECTION CONDITIONS DIFFER FROM THE BASIS OF DESIGN.

WIND LOADING DIAGRAMS

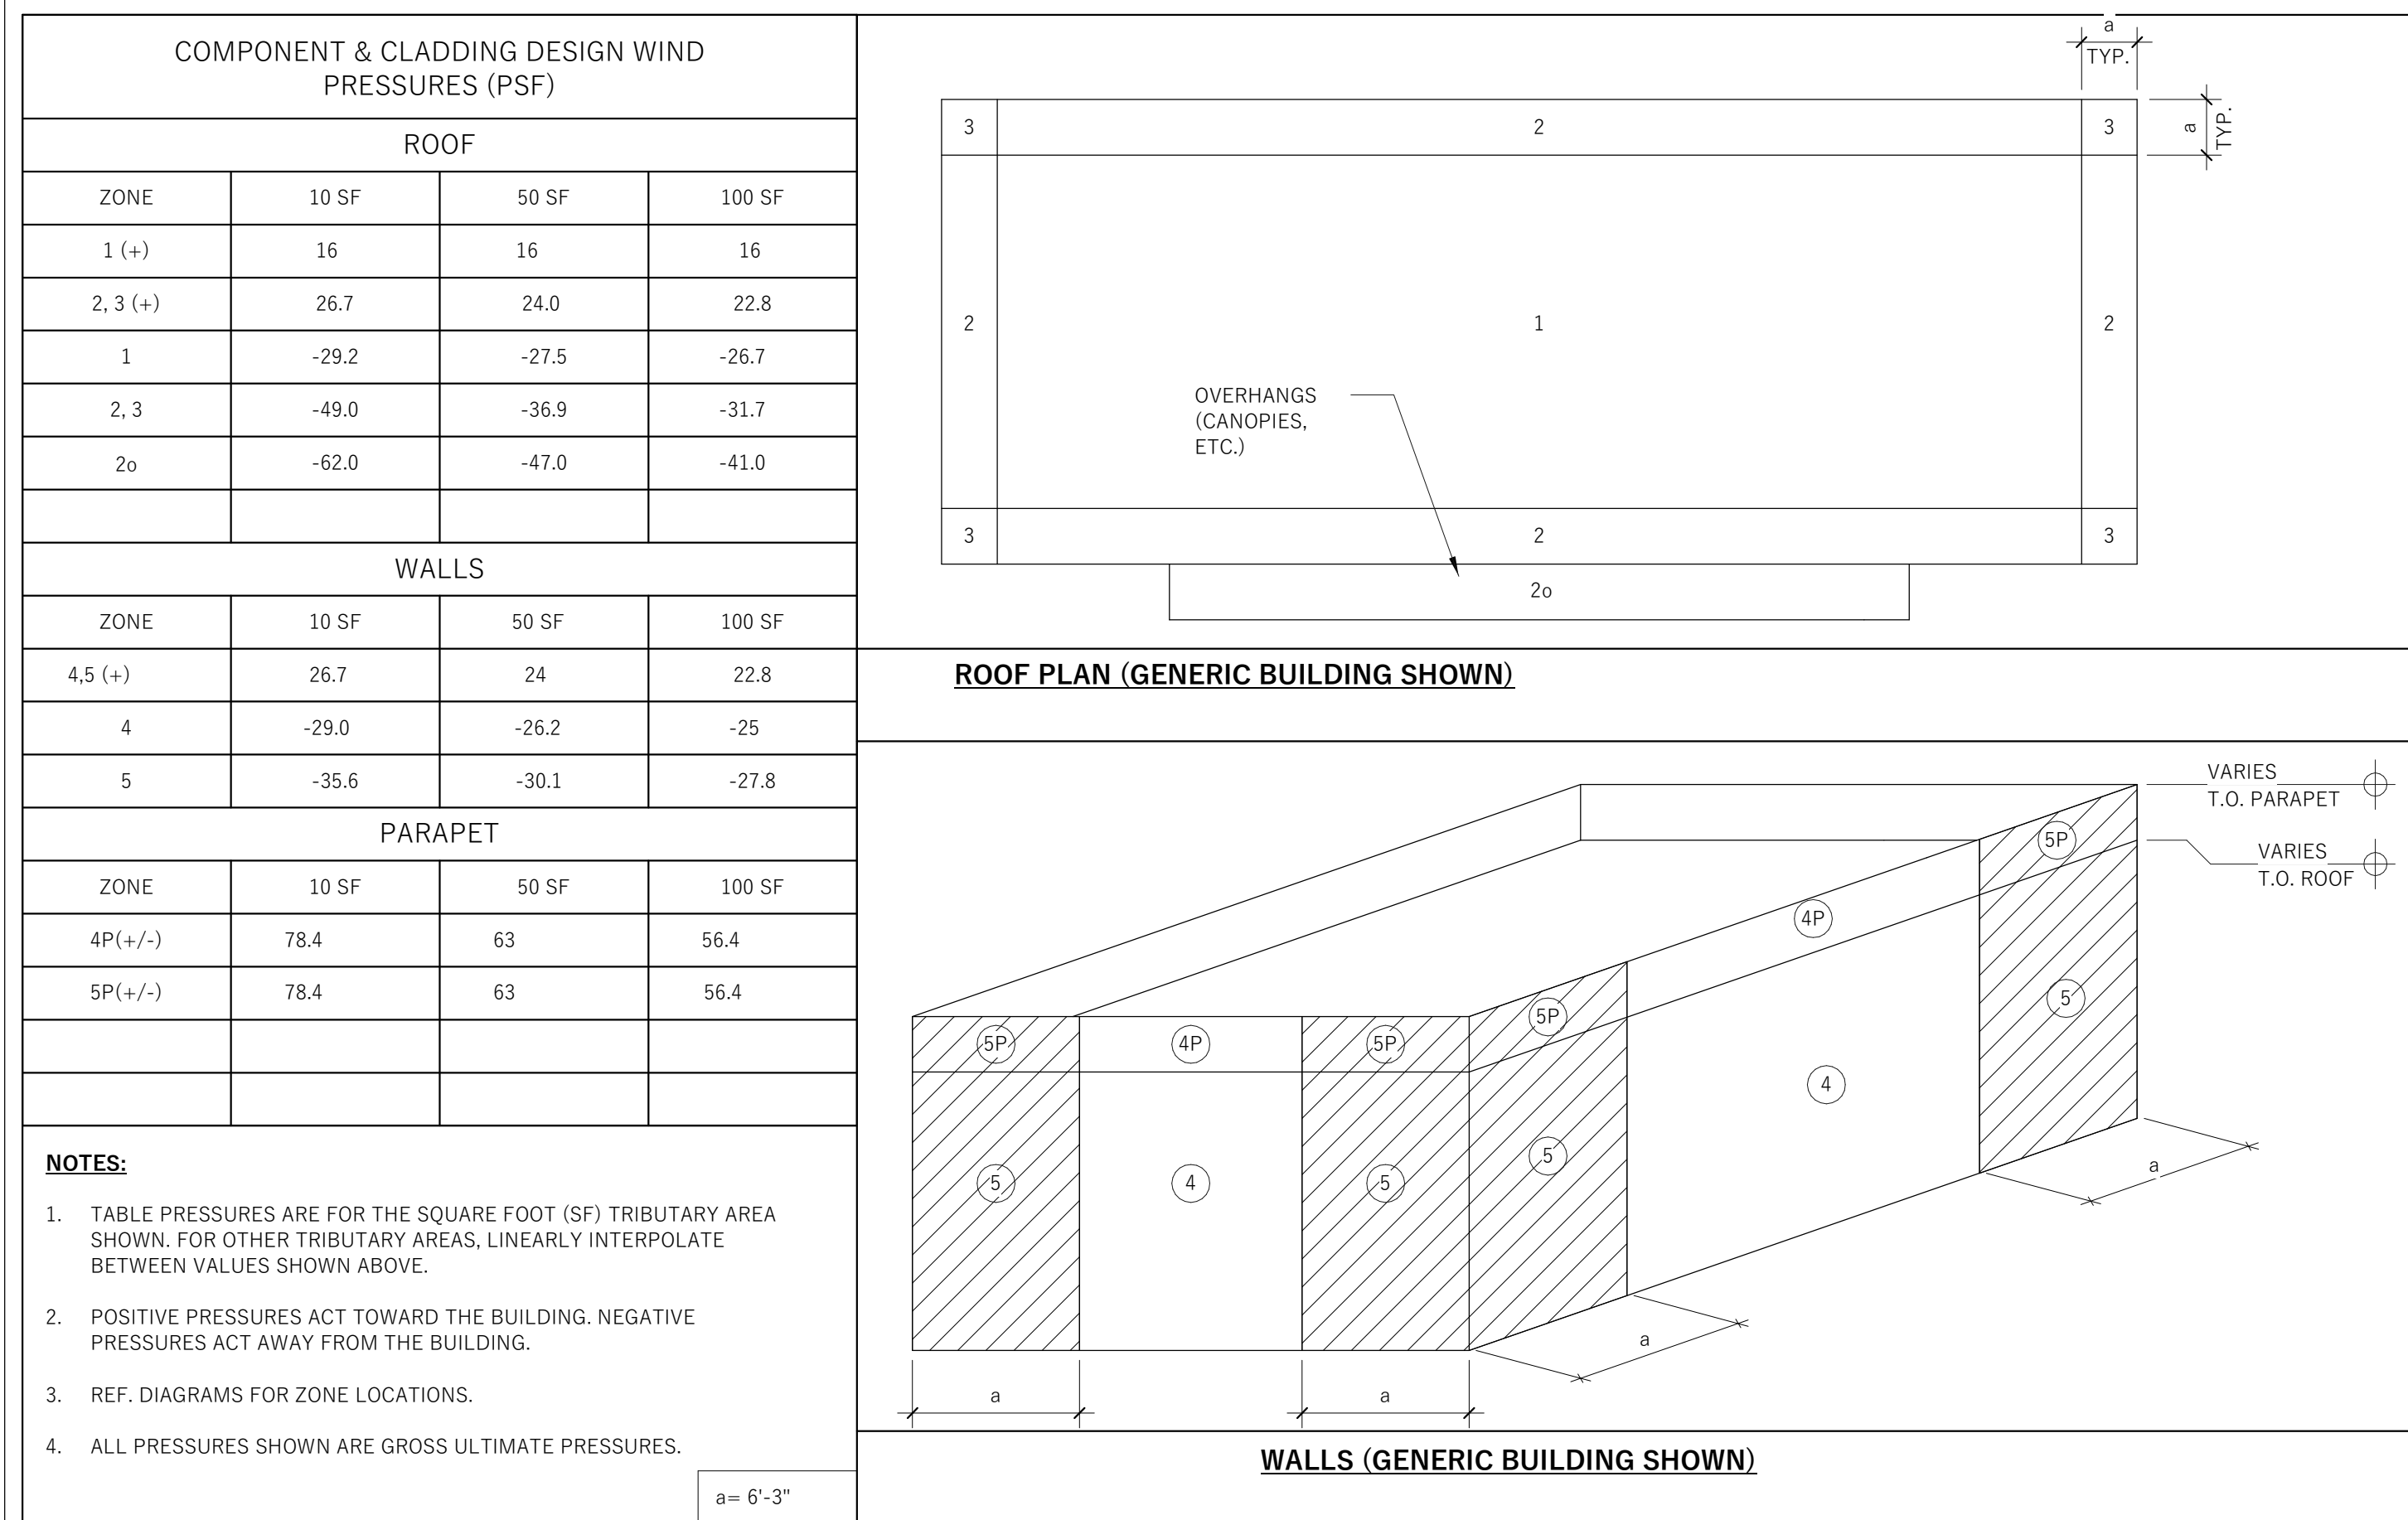

POST-INSTALLED ANCHORS NOTES

- EXCEPT WHERE INDICATED ON THE DRAWINGS, POST-INSTALLED ANCHORS SHALL CONSIST OF THE FOLLOWING ANCHOR TYPES AS PROVIDED BY HILTI, INC. CONTACT HILTI AT (800) 879-8000 FOR PRODUCT RELATED QUESTIONS.
 - ANCHORAGE TO CONCRETE**
 - ADHESIVE ANCHORS FOR CRACKED AND UNCRACKED CONCRETE USE:
 - HILTI HIT-HY 200 SAFE SET SYSTEM WITH THE HILTI HIT-Z ROD PER ICC ESR-3187
 - HILTI HIT-HY 200 SAFE SET SYSTEM WITH HILTI HOLLOW DRILL BIT AND VACUUM SYSTEM WITH HAS-E THREADED ROD PER ICC ESR-3187
 - HILTI HIT-RE 500v3 SAFE SET SYSTEM WITH HILTI HOLLOW DRILL BIT AND VACUUM WITH HAS-E THREADED ROD PER ICC ESR-3814
 - HILTI HIT-RE 500v3 SAFE SET SYSTEM WITH HILTI ROUGHENING TOOL (HIT RT) WITH HAS-E THREADED ROD PER ICC ESR-3814 FOR DIAMOND CORED HOLES
 - MEDIUM DUTY MECHANICAL ANCHORS FOR CRACKED AND UNCRACKED CONCRETE USE:
 - HILTI KWIK HUS EZ AND KWIK HUS EZ-I SCREW ANCHORS SAFE SET SYSTEM WITH HOLLOW DRILL BIT AND VACUUM SYSTEM PER ICC ESR-3027
 - HILTI KWIK BOLT-TZ EXPANSION ANCHORS SAFE SET SYSTEM WITH HOLLOW DRILL BIT AND VACUUM SYSTEM AND SI-AT-A22 WITH ADAPTIVE TORQUE PER ICC ESR-1917
 - HILTI KWIK BOLT 3 EXPANSION ANCHOR SAFE SET SYSTEM WITH HOLLOW DRILL BIT AND VACUUM SYSTEM AND SI-AT-A22 WITH ADAPTIVE TORQUE (UNCRACKED CONCRETE ONLY) PER ICC ESR-2302
 - HEAVY DUTY MECHANICAL ANCHORS FOR CRACKED AND UNCRACKED CONCRETE USE:
 - HILTI HDA UNDERCUT ANCHORS PER ICC ESR 1546
 - HILTI HSL-3 EXPANSION ANCHORS PER ICC ESR 1545
 - REBAR DOWELING INTO CONCRETE**
 - ADHESIVE ANCHORS FOR CRACKED AND UNCRACKED CONCRETE USE:
 - HILTI HIT-HY 200 SAFE SET SYSTEM WITH HILTI HOLLOW DRILL BIT AND VACUUM SYSTEM WITH CONTINUOUSLY DEFORMED REBAR PER ICC ESR-3187
 - HILTI HIT-HY 500v3 SAFE SET SYSTEM WITH HILTI HOLLOW DRILL BIT AND VACUUM SYSTEM WITH CONTINUOUSLY DEFORMED REBAR PER ICC ESR-3814
 - HILTI HIT-RE 500v3 SAFE SET SYSTEM WITH HILTI ROUGHENING TOOL (HIT RT) WITH CONTINUOUSLY DEFORMED REBAR PER ICC ESR-3814 IN DIAMOND CORED HOLES
 - ANCHORAGE TO SOLID GROUTED MASONRY**
 - ADHESIVE ANCHORS USE:
 - HILTI HIT-HY 270 SAFE SET SYSTEM WITH HILTI HOLLOW DRILL BIT AND VACUUM SYSTEM PER ICC ESR-4143
 - STEEL ANCHOR ELEMENT SHALL BE HILTI HAS-E CONTINUOUSLY THREADED ROD OR CONTINUOUSLY DEFORMED STEEL REBAR
 - MECHANICAL ANCHORS USE:
 - HILTI KWIK BOLT-3 EXPANSION ANCHORS WITH SI-AT-A22 WITH ADAPTIVE TORQUE PER ICC ESR 1385
 - ANCHORAGE TO HOLLOW / MULTI-WYTHE MASONRY (NOT ALLOWED UNLESS SPECIFICALLY DETAILS IN STRUCTURAL DRAWINGS)**
 - ADHESIVE ANCHORS USE:
 - HILTI HIT-HY 270 SAFE SET SYSTEM WITH HILTI HOLLOW DRILL BIT AND VACUUM SYSTEM PER ICC ESR-4143.
 - STEEL ANCHOR ELEMENT SHALL BE HILTI HAS-E CONTINUOUSLY THREADED ROD OR CONTINUOUSLY DEFORMED STEEL REBAR
 - THE APPROPRIATE SIZE SCREEN TUBE SHALL BE USED PER ADHESIVE MANUFACTURER'S RECOMMENDATION
 - ANCHOR CAPACITY USED IN DESIGN SHALL BE BASED ON THE TECHNICAL DATA PUBLISHED BY HILTI OR SUCH OTHER METHOD AS APPROVED BY THE STRUCTURAL ENGINEER OF RECORD. SUBSTITUTION REQUESTS FOR ALTERNATE PRODUCTS MUST BE APPROVED IN WRITING BY THE STRUCTURAL ENGINEER OF RECORD PRIOR TO USE. CONTRACTOR SHALL PROVIDE CALCULATIONS DEMONSTRATING THAT THE SUBSTITUTED PRODUCT IS CAPABLE OF ACHIEVING THE PERFORMANCE VALUES OF THE SPECIFIED PRODUCT. SUBSTITUTIONS WILL BE EVALUATED BY THEIR HAVING AN ICC ESR SHOWING COMPLIANCE WITH THE RELEVANT BUILDING CODE FOR SEISMIC USES, LOAD RESISTANCE, INSTALLATION CATEGORY, AND AVAILABILITY OF COMPREHENSIVE INSTALLATION INSTRUCTIONS. ADHESIVE ANCHOR EVALUATION WILL ALSO CONSIDER CREEP, IN-SERVICE TEMPERATURE AND INSTALLATION TEMPERATURE.
 - INSTALL ANCHORS PER THE MANUFACTURER INSTRUCTIONS, AS INCLUDED IN THE ANCHOR PACKAGING.
 - OVERHEAD ADHESIVE ANCHORS MUST BE INSTALLED USING THE HILTI PROFI SYSTEM.
 - THE CONTRACTOR SHALL ARRANGE AN ANCHOR MANUFACTURER'S REPRESENTATIVE TO PROVIDE ONSITE INSTALLATION TRAINING FOR ALL OF THEIR ANCHORING PRODUCTS SPECIFIED. THE STRUCTURAL ENGINEER OF RECORD MUST RECEIVE DOCUMENTED CONFIRMATION THAT ALL OF THE CONTRACTOR'S PERSONNEL WHO INSTALL ANCHORS ARE TRAINED PRIOR TO THE COMMENCEMENT OF INSTALLING ANCHORS.
 - ANCHOR CAPACITY IS DEPENDANT UPON SPACING BETWEEN ADJACENT ANCHORS AND PROXIMITY OF ANCHORS TO EDGE OF CONCRETE. INSTALL ANCHORS IN ACCORDANCE WITH SPACING AND EDGE CLEARANCES INDICATED ON THE DRAWINGS.
 - EXISTING REINFORCING BARS IN THE CONCRETE STRUCTURE MAY CONFLICT WITH SPECIFIC ANCHOR LOCATIONS. UNLESS NOTED ON THE DRAWINGS THAT THE BARS CAN BE CUT, THE CONTRACTOR SHALL REVIEW THE EXISTING STRUCTURAL DRAWINGS AND SHALL UNDERTAKE TO LOCATE THE POSITION OF THE REINFORCING BARS AT THE LOCATIONS OF THE CONCRETE ANCHORS, BY HILTI FERROSCAN, GPR, X-RAY, CHIPPING OR OTHER MEANS.

COLD-FORMED STEEL NOTES

- STRUCTURAL COLD-FORMED FRAMING NOTES
- THE DESIGN, INSTALLATION, AND CONSTRUCTION OF COLD-FORMED CARBON OR LOW-ALLOY STEEL SHALL BE IN ACCORDANCE WITH THE "STANDARD FOR COLD-FORMED STEEL FRAMING - GENERAL PROVISIONS, AMERICAN IRON AND STEEL INSTITUTE (AISI-GENERAL) AND AISI-NASPEC.
 - ALL FRAMING MEMBERS SHALL BE FORMED FROM CORROSION-RESISTANT STEEL, CORRESPONDING TO THE REQUIREMENTS OF ASTM A 653.
 - ALL COLD FORMED FRAMING SHALL BE DESIGNED BY A REGISTERED ENGINEER IN THE STATE OF TEXAS MEETING STRUCTURAL DESIGN CRITERIA ON THIS SHEET.
 - FABRICATION AND ERECTION OF MEMBERS SHALL BE IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
 - SECURE ALL CONTINUOUS TRACKS TO CONCRETE FOUNDATIONS WITH (2) HILTI X-U 27 P8 TH POWDER ACTUATED FASTENERS (OR APPROVED EQUAL) AT 16" O.C. AND TO STEEL FRAMING MEMBERS WITH (2) X-19 P8 TH POWDER ACTUATED FASTENERS (OR APPROVED EQUAL) AT 24" O.C. UNLESS NOTED OTHERWISE.
 - VERTICAL WALL STUDS ABOVE OPENINGS SHALL BE ANCHORED TO STEEL STRUCTURE AT EACH STUD LOCATION WITH LIGHT GAGE CLIP ANGLES CAPABLE OF SUSTAINING SELF WEIGHT OF WALL AND WIND LOAD PER WIND PRESSURE DIAGRAMS. FULL HEIGHT STUDS SHALL ALLOW FOR VERTICAL DEFLECTION OF STEEL STRUCTURE.
 - WELDED CONNECTIONS SHALL BE WIRE BRUSHED AND BRUSH-COATED WITH A GALVANIZED PAINT.
 - HORIZONTAL BRIDGING/STRAP BRACING SHALL BE ATTACHED TO LOAD BEARING AND EXTERIOR WALL STUDS AT 48" O.C. MAXIMUM.
 - ALL EXTERIOR WALL SIDING AND PLYWOOD DIAPHRAGMS SHALL BE SCREWED WITH A MINIMUM #8 SELF-DRILLING, SELF TAPPING WAFER HEAD OR BUGLE HEAD SCREW AT 6" O.C. EDGE AND 12" O.C. FIELD. SCREWS SHALL BE SUFFICIENT LENGTH TO ENSURE PENETRATION INTO THE STEEL STUD BY AT LEAST THREE FULL DIAMETER THREADS.
 - FASTENERS ALONG PANEL EDGES SHALL BE PLACED NO LESS THAN 3/8" FROM PANEL EDGES AND ARE TO BE SPACED AT 6" O.C. ALONG PANEL EDGES AND AT 12" O.C. AT ALL INTERMEDIATE SUPPORTS. ALL PANEL EDGES SHALL BE FULLY BLOCKED.

SPECIAL INSPECTIONS AND TESTING

- THE OWNER SHALL EMPLOY THE SERVICES OF ONE OR MORE SPECIAL INSPECTORS TO PROVIDE SPECIAL INSPECTIONS DURING CONSTRUCTION FOR THE FOLLOWING:
 - SHALLOW FOUNDATIONS:
 - INSPECT SOILS BELOW FOOTINGS FOR ADEQUATE BEARING CAPACITY AND CONSISTENCY WITH GEOTECHNICAL REPORT.
 - INSPECT REMOVAL OF UNSUITABLE MATERIAL AND PREPARATION OF SUBGRADE PRIOR TO PLACEMENT OF CONTROLLED FILL.
 - CONTROLLED STRUCTURAL FILL:
 - PERFORM SIEVE TESTS (ASTM D422 & D1140) AND MODIFIED PROCTOR TESTS (ASTM D1557) ON EACH SOURCE OF FILL MATERIAL.
 - INSPECT PLACEMENT, LIFT THICKNESS & COMPACTION OF CONTROLLED FILL.
 - TEST DENSITY OF EACH LIFT OF FILL BY NUCLEAR METHODS (ASTM D2922).
 - VERIFY EXTENT AND SLOPE OF FILL PLACEMENT.
 - STRUCTURAL STEEL:
 - REVIEW SHOP FABRICATION AND QUALITY CONTROL PROCEDURES.
 - REVIEW CERTIFIED MILL TEST REPORTS & IDENTIFICATION MARKINGS ON HSS SHAPES.
 - INSPECT INSTALLATION AND TIGHTENING OF HIGH-STRENGTH BOLTS. VERIFY THAT SPLINES HAVE SEPARATED FROM TENSION CONTROL BOLTS. VERIFY PROPER TIGHTENING SEQUENCE.
 - INSPECT STEEL FRAME FOR COMPLIANCE WITH STRUCTURAL DRAWINGS, INCLUDING BRACING, MEMBER CONFIGURATIONS AND CONNECTION DETAILS.
 - INSPECT WELDS IN ACCORDANCE WITH AWS D1.1.
- POST-INSTALLED ANCHOR BOLTS:
 - PERIODIC OR CONTINUOUS INSPECTIONS PER THE REQUIREMENTS OF THE ICC-ES REPORT FOR THE PRODUCT USED.
- THE INSPECTOR SHALL BE A QUALIFIED PERSON WHO SHALL DEMONSTRATE COMPETENCE, TO THE SATISFACTION OF THE BUILDING OFFICIAL, FOR INSPECTION OF THE PARTICULAR TYPE OF CONSTRUCTION OR OPERATION REQUIRING SPECIAL INSPECTION.
- DUTIES AND RESPONSIBILITIES OF THE SPECIAL INSPECTOR:
 - THE SPECIAL INSPECTOR SHALL OBSERVE THE WORK ASSIGNED FOR CONFORMANCE WITH THE APPROVED DESIGN DRAWINGS AND SPECIFICATIONS. THE INSPECTOR MAY NOT ALTER, MODIFY, ENLARGE OR WAIVE ANY OF THE REQUIREMENTS OF THE DOCUMENTS.
 - THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL, THE PROFESSIONAL OF RECORD, AND THE CONTRACTOR. ALL DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION. THEN, IF UNCORRECTED, SUBMIT A COMPLETE LIST OF ALL OUTSTANDING DISCREPANCIES ON A WEEKLY BASIS TO THE OWNER, THE BUILDING OFFICIAL, AND THE PROFESSIONAL OF RECORD UNTIL ALL CORRECTIONS HAVE BEEN COMPLETED. THE SPECIAL INSPECTOR SHALL SUBMIT A FINAL SIGNED REPORT STATING THE WORK REQUIRING SPECIAL INSPECTION WAS, TO THE BEST OF THE INSPECTOR'S KNOWLEDGE, IN CONFORMANCE WITH THE APPROVED PLANS AND SPECIFICATIONS AND THE APPLICABLE WORKMANSHIP PROVISIONS OF THE CODE.
 - STRUCTURAL OBSERVATION BY THE SEOR IS NOT REQUIRED.
 - WHERE INSPECTION REQUIREMENTS DUPLICATE THE REQUIREMENTS OF SPECIFIED QUALITY ASSURANCE TESTING, DUPLICATE INSPECTIONS SHALL NOT BE REQUIRED.

REQUIRED SPECIAL INSPECTIONS

IN ADDITION TO THE REGULAR INSPECTIONS REQUIRED BY SECTION 110 OF THE 2015 INTERNATIONAL BUILDING CODE, THE FOLLOWING ITEMS ALSO REQUIRE SPECIAL INSPECTION IN ACCORDANCE WITH SECTION 1705

ITEM	SECTION
STRUCTURAL STEEL	IBC 1705.2 / AISC 360 SECTION N5
FIELD WELDING	IBC 1705.5
STRUCTURAL CONCRETE	IBC 1705.3 / ACI 318 17.8, 26.13
ANCHOR BOLTS, POST INSTALLED ANCHORS IN CONC	ACI 318 17.8
SOILS COMPLIANCE PRIOR TO FOUNDATION INSPECTION	IBC 1705.6 / PER GEOTECH REQUIREMENTS
STRUCTURAL MASONRY	TMS 602 SPECIFICATION - TABLE 4 - LEVEL 2 FREQUENCY

- THE ARCHITECT IS THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE (RDP/IRC) FOR THIS PROJECT. SUBMIT ALL INSPECTION REPORTS DIRECTLY TO THE RDP/IRC FOR REVIEW. INDIVIDUAL INSPECTION REPORTS SHALL INDICATE IF WORK WAS COMPLETED IN CONFORMANCE WITH THE APPROVED CONSTRUCTION DOCUMENTS. DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE GC FOR CORRECTION. IF NOT CORRECTED, THE DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL AND RDP/IRC PRIOR TO COMPLETION OF THAT PHASE OF WORK.
- IN ORDER TO COMPLY WITH THE BUILDING CODE REQUIREMENTS, THE SPECIAL INSPECTORS AND TESTING TECHNICIANS MAY NOT BE EMPLOYED BY THE GENERAL CONTRACTOR (GC), SUBCONTRACTORS OR MATERIAL SUPPLIERS. IN THE CASE OF AN OWNER / CONTRACTOR, THE BUILDING OFFICIAL SHALL BE CONSULTED.
- THESE INSPECTIONS ARE IN ADDITION TO THE INSPECTIONS IDENTIFIED IN SECTION 110 OF THE IBC 2015. CONSTRUCTION SHALL REMAIN ACCESSIBLE AND EXPOSED FOR INSPECTION PURPOSES UNTIL APPROVED.
- SPECIAL INSPECTIONS REPORT REQUIREMENTS 1704.2.4: SPECIAL INSPECTORS SHALL KEEP RECORDS OF INSPECTIONS. THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL AND TO THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE. REPORTS SHALL INDICATE THAT WORK INSPECTED WAS OR WAS NOT COMPLETED IN CONFORMANCE TO APPROVED CONSTRUCTION DOCUMENTS. DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION. IF THEY ARE NOT CORRECTED, THE DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL AND TO THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO THE COMPLETION OF THAT PHASE OF WORK. A FINAL REPORT DOCUMENTING REQUIRED SPECIAL INSPECTIONS AND CORRECTION OF ANY DISCREPANCIES NOTED IN THE INSPECTIONS SHALL BE SUBMITTED AT A POINT IN TIME AGREED UPON PRIOR TO THE START OF WORK BY THE APPLICANT AND THE BUILDING OFFICIAL.

A	A.B. AC ABT ABV ADD'L ADJ. AISC ALT. AMP. AGGR. APPROX. ARCH.	F ANCHOR BOLT ALASKA CEDAR (WOOD) ABOUT ABOVE ADDITIONAL ADJACENT AMER. INST. OF STEEL CONSTR. ALTERNATE AMPLITUDE AGGREGATE APPROXIMATE(LY) ARCHITECT(URE)(URAL)	FB F.D. F.W. F.F. FIN. FLG. FLR F.N. F.O. F.O.C. F.O.S. F.P. F.PRF. FRMG FS FT FTG.	N FLAT BAR (STEEL SHAPE) FLOOR DRAIN FOUNDATION FAR FACE OR FIELD FASTENER FINISH(ED) FLANGE FLOOR FIELD NAIL FACE OF FACE OF CONCRETE FACE OF STUD OR FACE OF STEEL FULL PENETRATION (WELD) FIREPROOFING FRAMING FIELD SCREWS FEET OR FOOT FOOTING	N (N) N/A N.F. N.I.C. NO. NOM. N&FS N.T.S. NR N.S. N/W NWC	S NORTH NEW NOT APPLICABLE NEAR FACE NOT IN CONTRACT NUMBER NOMINAL NEAR & FAR SIDE NOT TO SCALE NEAR NEAR SIDE NORTH/SOUTH NORMAL WEIGHT NORMAL WEIGHT CONCRETE	SAD S.B. S.C.D. SCHED. SDS SECT. S.E.D. SEOR SEP. SFHCS SHT SHTG SIM. SIJ S.L.B.B. S.L.D. SIRS S.M.D. S.M.S. S.O.G. SP S.P.C. S.P.D. SPEC.(S) SQ. S.S. SSLT. S.T. STAG. STAGG. STD STFNR. STL STL.N. STRUC. SUP. SUSP. SYM. SYMM.	REF. ARCHITECTURAL DRAWINGS SOLID BLOCKING REF. CIVIL DRAWINGS SCHEDULE SIMPSON STRONG-DRIVE SCREW, INSTALLED PER ICC ESR-2236 SECTION REF. ELECTRICAL DRAWINGS STRUCTURAL ENGINEER OF RECORD SEPARATION SOCKET FLAT HEAD CAP SCREW SHEET SHEATHING SIMILAR STEEL JOIST INSTITUTE SHORT LEGS BACK TO BACK REF. LANDSCAPE DRAWINGS SEISMIC LOAD RESISTING SYSTEM REF. MECHANICAL DRAWINGS SHEET METAL SCREW SLAB ON GRADE SOUTHERN PINE (WOOD) SPAC (ESI)(NG) REF. PLUMBING DRAWINGS SPECIFICATIONS(S) SQUARE STAINLESS STEEL SHORT SLOTTED (HOLE) SHORT SLOTTED (HOLE) SUCH THAT STAGGER(ED) STAGGER(ED) STANDARD STIFFENER STEEL STRUCTURAL SUPPORT SUSPENDED SYMMETRICAL
----------	--	--	--	---	---	---	--	--

OTHER ABBREVIATIONS (PRODUCT ABBREVIATIONS):
 FOR POWDER-DRIVEN FASTENERS AND CONCRETE ANCHOR ABBREVIATIONS, REF. HILTI NORTH AMERICAN PRODUCT TECHNICAL GUIDE (available at www.us.hilti.com) AND SIMPSON STRONG-TIE ANCHOR SYSTEMS CATALOG (available at www.strongtie.com).
 FOR LIGHT-GAUGE STEEL CONNECTOR ABBREVIATIONS, REF. STEEL NETWORK LIGHT STEEL FRAMING CONNECTION CATALOG (available at www.steelnetwork.com) AND SIMPSON STRONG-TIE COLD-FORMED STEEL CONNECTORS CATALOG (available at www.strongtie.com).

REBAR OFFSET & LAP SPLICE REQUIREMENTS


CONCRETE STRENGTH	f _c = 3000 PSI				f _c = 4000 PSI			
	CLASS "A"		CLASS "B"		CLASS "A"		CLASS "B"	
CLASS OF LAP SPLICE	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS
#3	1'-10"	1'-5"	2'-4"	1'-10"	1'-7"	1'-3"	2'-1"	1'-7"
#4	2'-5"	1'-10"	3'-1"	2'-5"	2'-1"	1'-7"	2'-9"	2'-1"
#5	3'-0"	2'-4"	3'-11"	3'-0"	2'-7"	2'-0"	3'-5"	2'-7"
#6	3'-7"	2'-9"	4'-8"	3'-7"	3'-1"	2'-5"	4'-1"	3'-1"
#7	5'-3"	4'-0"	6'-9"	5'-2"	4'-6"	3'-6"	5'-11"	4'-6"
#8	6'-0"	4'-7"	7'-9"	6'-0"	5'-2"	4'-0"	6'-9"	5'-2"
#9	6'-9"	5'-2"	8'-9"	6'-9"	5'-10"	4'-6"	7'-7"	5'-10"
#10	7'-7"	5'-10"	9'-10"	7'-7"	6'-7"	5'-1"	8'-6"	6'-7"
#11	8'-5"	6'-6"	10'-11"	8'-5"	7'-3"	5'-7"	9'-5"	7'-3"

NOTES:
 1. UNLESS INDICATED OTHERWISE, USE CLASS "B" LAP SPLICE LENGTHS, MULTIPLIED BY THE APPLICABLE FACTOR(S) LISTED BELOW.
 2. WHERE THE CLEAR SPACING OF BARS BEING SPLICED IS LESS THAN 2 BAR DIAMETERS, INCREASE THE LAP LENGTH BY 50%.
 3. WHERE THE BAR COVER IS LESS THAN OR EQUAL TO THE BAR DIAMETER, INCREASE THE LAP LENGTH BY 50%.
 4. A CLASS "A" SPLICE MAY BE USED ONLY WHERE NOTED ON THE DRAWINGS, WHERE DEVELOPMENT LENGTH (L_d) IS REQUIRED OR CALLED OUT ON THE DRAWINGS, USE CLASS "A" LAP SPLICE LENGTH.
 5. TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 INCHES OF CONCRETE CAST BELOW THE BARS.
 6. LAP SPLICE LENGTHS IN TABLE ARE FOR NORMAL WEIGHT CONCRETE, WHERE LIGHTWEIGHT AGGREGATE CONCRETE IS USED, INCREASE LAP SPLICE LENGTH BY 30%.
 7. SPLICES OF HORIZONTAL REINFORCEMENT IN WALLS SHALL BE STAGGERED.
 8. SPLICES OF HORIZONTAL REINFORCEMENT IN WALLS CONTAINING TWO CURTAINS OF REINFORCEMENT SHALL NOT OCCUR IN THE SAME LOCATION.

REBAR STANDARD HOOKS & BENDS

BAR SIZE	MAIN REINFORCEMENT			STIRRUPS & TIES		
	90° HOOK LENGTH "L"	INSIDE DIA "D1"	180° HOOK LENGTH "L"	90° HOOK LENGTH "L"	INSIDE DIA "D2"	135° HOOK LENGTH "L"
#3	4 1/2"	2 1/4"	2 1/2"	3"	1 1/2"	3"
#4	6"	3"	2 1/2"	3"	2"	3"
#5	7 1/2"	3 3/4"	2 1/2"	3 3/4"	2 1/2"	3 3/4"
#6	9"	4 1/2"	3"	9"	4 1/2"	4 1/2"
#7	10 1/2"	5 1/4"	3 1/2"	10 1/2"	5 1/4"	5 1/4"
#8	1'-0"	6"	4"	1'-0"	6"	6"
#9	1'-1 1/2"	9 1/2"	4 1/2"	-	-	-
#10	1'-3 1/4"	10 3/4"	5 1/4"	-	-	-
#11	1'-5"	1'-0"	5 3/4"	-	-	-

STEEL BEAM LEGEND

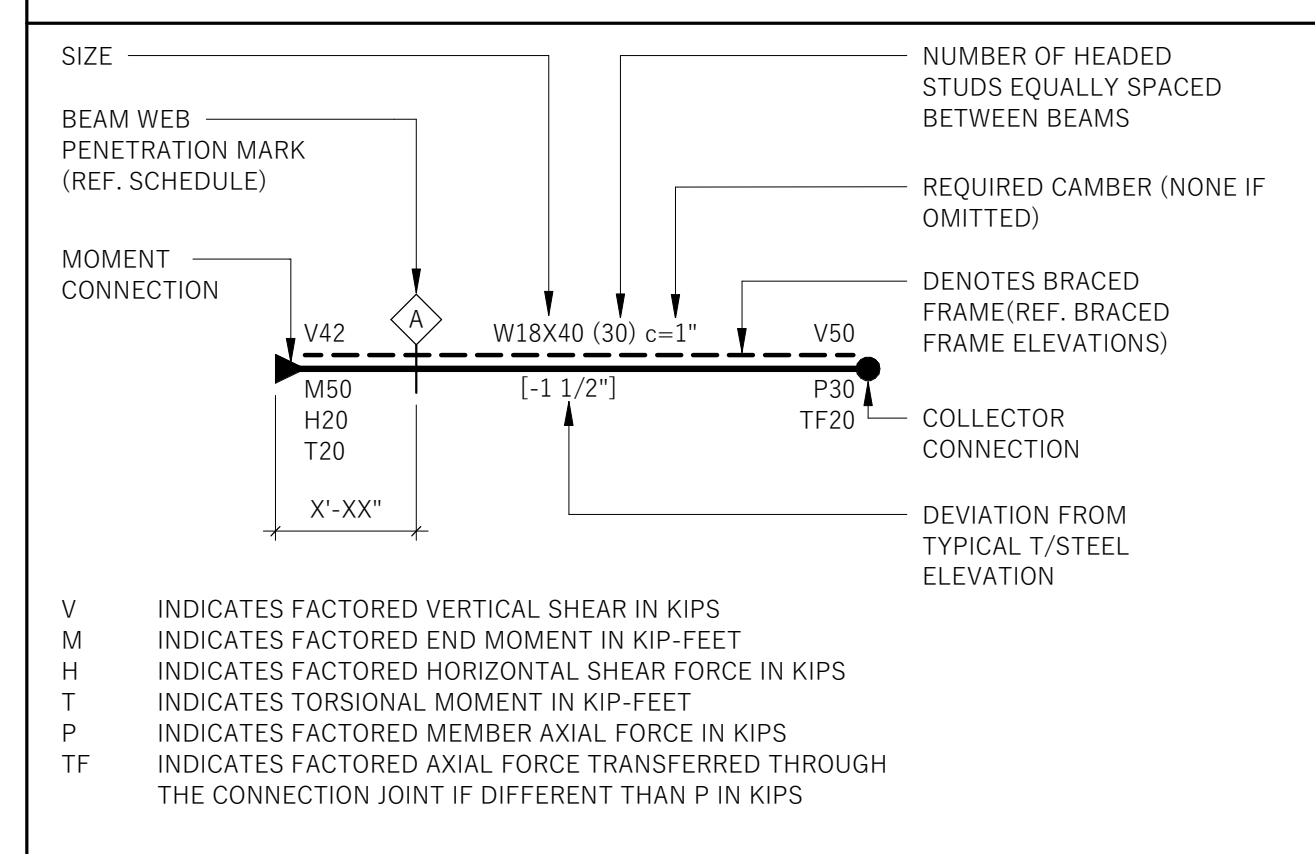

SYMBOLS LEGEND	
SYMBOL	DESCRIPTION
	FOOTING MARK SPREAD FOOTING, REF SCHEDULE ON S101
	COL. MARK STEEL COLUMN, REF. SCHEDULE ON S101
	SPAN DIRECTION SLAB OR DECK
	INDICATES TILT WALL REF. SHT. S101 FOR TILT WALL PLANS
	INDICATES COMPLETE PENETRATION MOMENT CONNECTIONS
	INDICATES VERTICAL BRACE ABOVE/ BELOW
	INDICATES RTU ZONE, REF. PLAN NOTE FOR ADD. LOADING INFORMATION


NOTE(S):
 1. ITEMS IN LEGEND MAY NOT APPEAR ON ALL PLANS

ALIGN
AUSTIN ARCHITECTS

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S BAGDAD ROAD BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
 THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
 2 06/20/22 REV 2

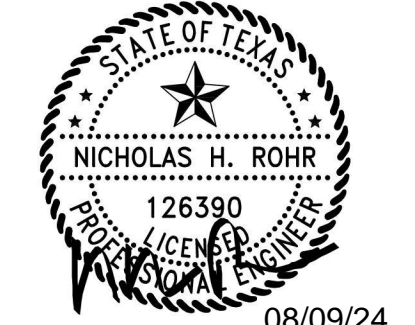

08/09/24
 09/09/2024
 100% CDS-REVISIONS
 STRUCTURAL LEGENDS AND SCHEDULES


SHEET: **S003**

JCA
 4100 Wadsworth Blvd
 Wheat Ridge, CO 80033
 p 303.985.3260
 TX F-14436
 JCAA
 #21134
 PROJECT NO: 21099
 DRAWN BY: BC
 DATE: 01/28/2022
 PROJECT MGR: NHR

COLUMN AND BASE PLATE SCHEDULE								
MARK	COLUMN SIZE	BASE PLATE TYPE	BASE PLATE					ANCHOR BOLTS
			L	D	A	B	t	
C4.4	HSS4X4X1/4	BP-A	10"	10"	3 1/2"	3 1/2"	3/4"	(4) 3/4" DIA X 16" EMBEDMENT
C5.5	HSS5 1/2X1 1/2X3/8	BP-A	11 1/2"	11 1/2"	4 1/4"	4 1/4"	3/4"	(4) 3/4" DIA X 16" EMBEDMENT

SPREAD FOOTING SCHEDULE								
MARK	FOOTING DIMENSIONS			REINFORCING				REMARKS
	WIDTH	LENGTH	THICKNESS	BOTTOM BARS - LONG	BOTTOM BARS - SHORT	TOP BARS - LONG	TOP BARS - SHORT	
F5.0A	5'-0"	5'-0"	1'-0"	(6) #5 BARS	(6) #5 BARS	(6) #5 BARS	(6) #5 BARS	
F5.0B	5'-0"	5'-0"	2'-6"	(6) #5 BARS	(6) #5 BARS	(6) #5 BARS	(6) #5 BARS	

CONTINUOUS WALL FOOTING SCHEDULE				
MARK	WIDTH	THICKNESS	REINFORCING	
WF24	2'-0"	1'-0"	(3) #5 BARS CONT. WITH #5 BARS AT 12" O.C. TRAVERSE	
WF36	3'-0"	1'-0"	(3) #5 BARS CONT. WITH #5 BARS AT 12" O.C. TRAVERSE	
WF42	3'-6"	1'-0"	(3) #5 BARS CONT. WITH #5 BARS AT 12" O.C. TRAVERSE	

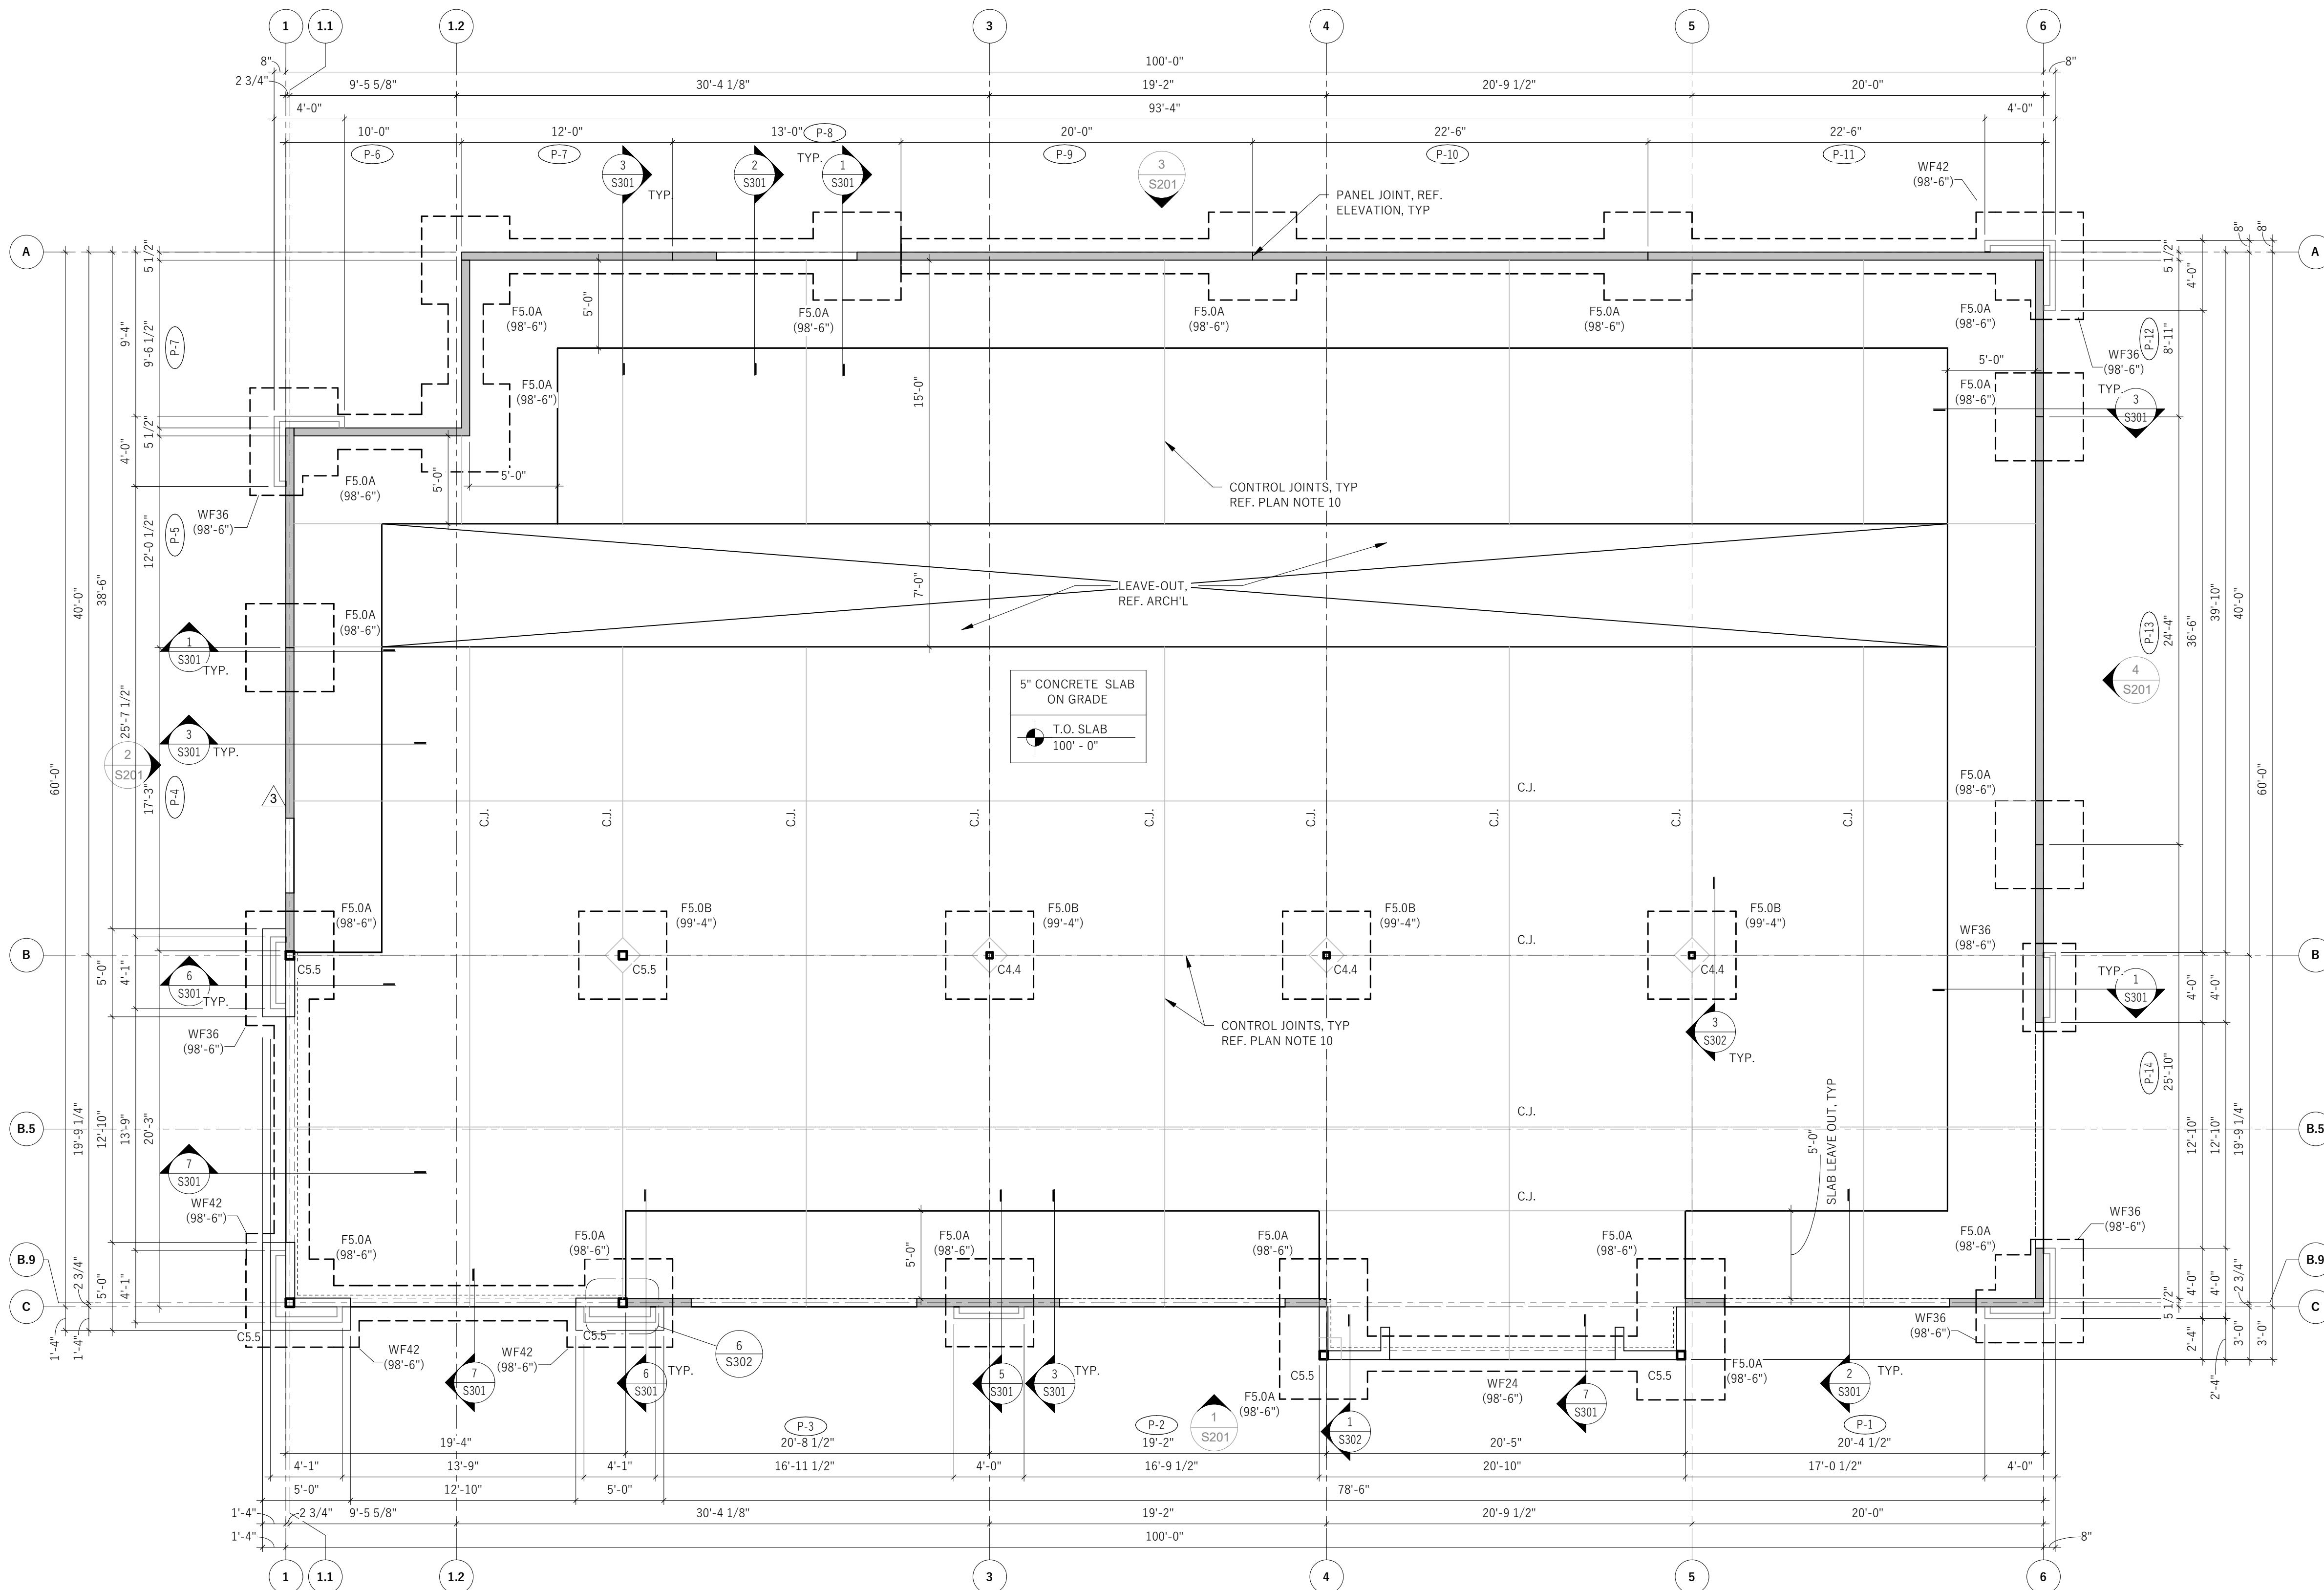

- FOUNDATION SHEET NOTES**
- REF. S0 SERIES FOR GENERAL NOTES, DESIGN CRITERIA.
 - REF. S3 SERIES FOR FOUNDATION TYPICAL DETAILS.
 - DO NOT SCALE WALL LENGTH ON PLAN. REF. ARCHITECTURAL DRAWINGS FOR DIMENSIONS.
 - REFERENCE ELEVATION - TOP OF CONCRETE SLAB ELEVATION = EL. 100'-0". SEE CIVIL FOR N.A.V.D.
 - WALL FOOTINGS (U.N.O.) = WF18, T.O. FOOTING = 98'-6"
 - SLAB-ON-GRADE SHALL BE 5" CONCRETE SLAB REINFORCED WITH #4 BARS AT 16" ON CENTER LOCATED 2" FROM TOP OF SLAB. PLACE VAPOR BARRIER (REF G.N.) IMMEDIATELY BELOW THE SLAB, OVER A 4 INCH (MINI) THICK BASE COURSE LAYER (REF GEOTECH) OVER THE PREPARED FILL AND SUBGRADE. REF. SHEET S001, AND THE GEOTECHNICAL REPORT FOR SUBGRADE PREPARATION AND SLAB-ON-GRADE NOTES.
 - REF. ARCHITECTURAL DRAWINGS FOR SIZE AND LOCATION OF ALL SLOPED SLABS AND SLAB DEPRESSIONS.
 - SLOPE SLAB AS REQUIRED WHILE MAINTAINING UNIFORM SLAB THICKNESS. SEE ARCH FOR SLAB SLOPES.
 - SEE APPROVED FINAL GRADING PLAN FOR GRADING INFORMATION. CONTRACTOR SHALL VERIFY THAT BOTTOM OF FOOTING ELEVATIONS MEET THE MINIMUM BEARING REQUIREMENTS GIVEN IN THE SOILS REPORT.
 - LOCATE CONTROL JOINTS AT A MAXIMUM OF 15'-0" O.C. REF. DETAIL 1/S303 AT CONTROL JOINTS OR CONSTRUCTION JOINTS AT CONTRACTOR'S OPTION.
 - REFERENCE ARCHITECTURAL AND PLUMBING DRAWINGS FOR ALL CONCRETE SLAB LEAVE OUTS, FLOOR DRAIN, AND SLAB PENETRATION LOCATIONS. REFER TO 8/S303
 - VERIFY ALL OPENING DIMENSIONS AND LOCATIONS WITH ARCHITECTURAL DRAWINGS.
 - REFERENCE CIVIL DRAWINGS FOR ALL EXTERIOR SIDEWALKS, RAMPS, AND DOOR STOOPS.

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
 1 05/24/22 REV 1
 2 06/20/22 REV 2
 3 09/06/22 REV 3

STATE OF TEXAS
 NICHOLAS H. ROHR
 126390
 LICENSED PROFESSIONAL ENGINEER
 08/09/24

09/09/2024
 100% CDS-REV 05-VE
 FOUNDATION PLANS

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:

1	05/24/22	REV 1
2	06/20/22	REV 2
3	09/06/22	REV 3
5	08/09/24	VE



08/09/2024
100% CDS-REV 05-VE
ROOF FRAMING PLAN



SHEET: **S102**

PROJECT NO: 21099
DRAWN BY: BC
DATE: 01/28/2022
PROJECT MGR: NHR

SHEARWALL SCHEDULE - HIGH ROOF


SHEAR WALL MARK	SHEARWALL COMPONENTS			HOLDOWNS		DRAG STRUT/TENSION TIE	SILL TO TOP PLATE BELOW
	SHEATHING	EDGE ATTACHMENT	LATERAL TRANSFER PLATE CONNECTORS	HOLDOWNS	END POST		
1	15/32" PLYWOOD	FASTENERS AT 6" O.C.	-	S/LTT20-33	(2) STUDS	-	PAF'S TO STEEL AT 8" O.C.

AT CFS DESIGNER OPTION - DESIGN FOR 276 PLF SHEAR TYPICAL IN LIEU OF SHEARWALL DESIGN

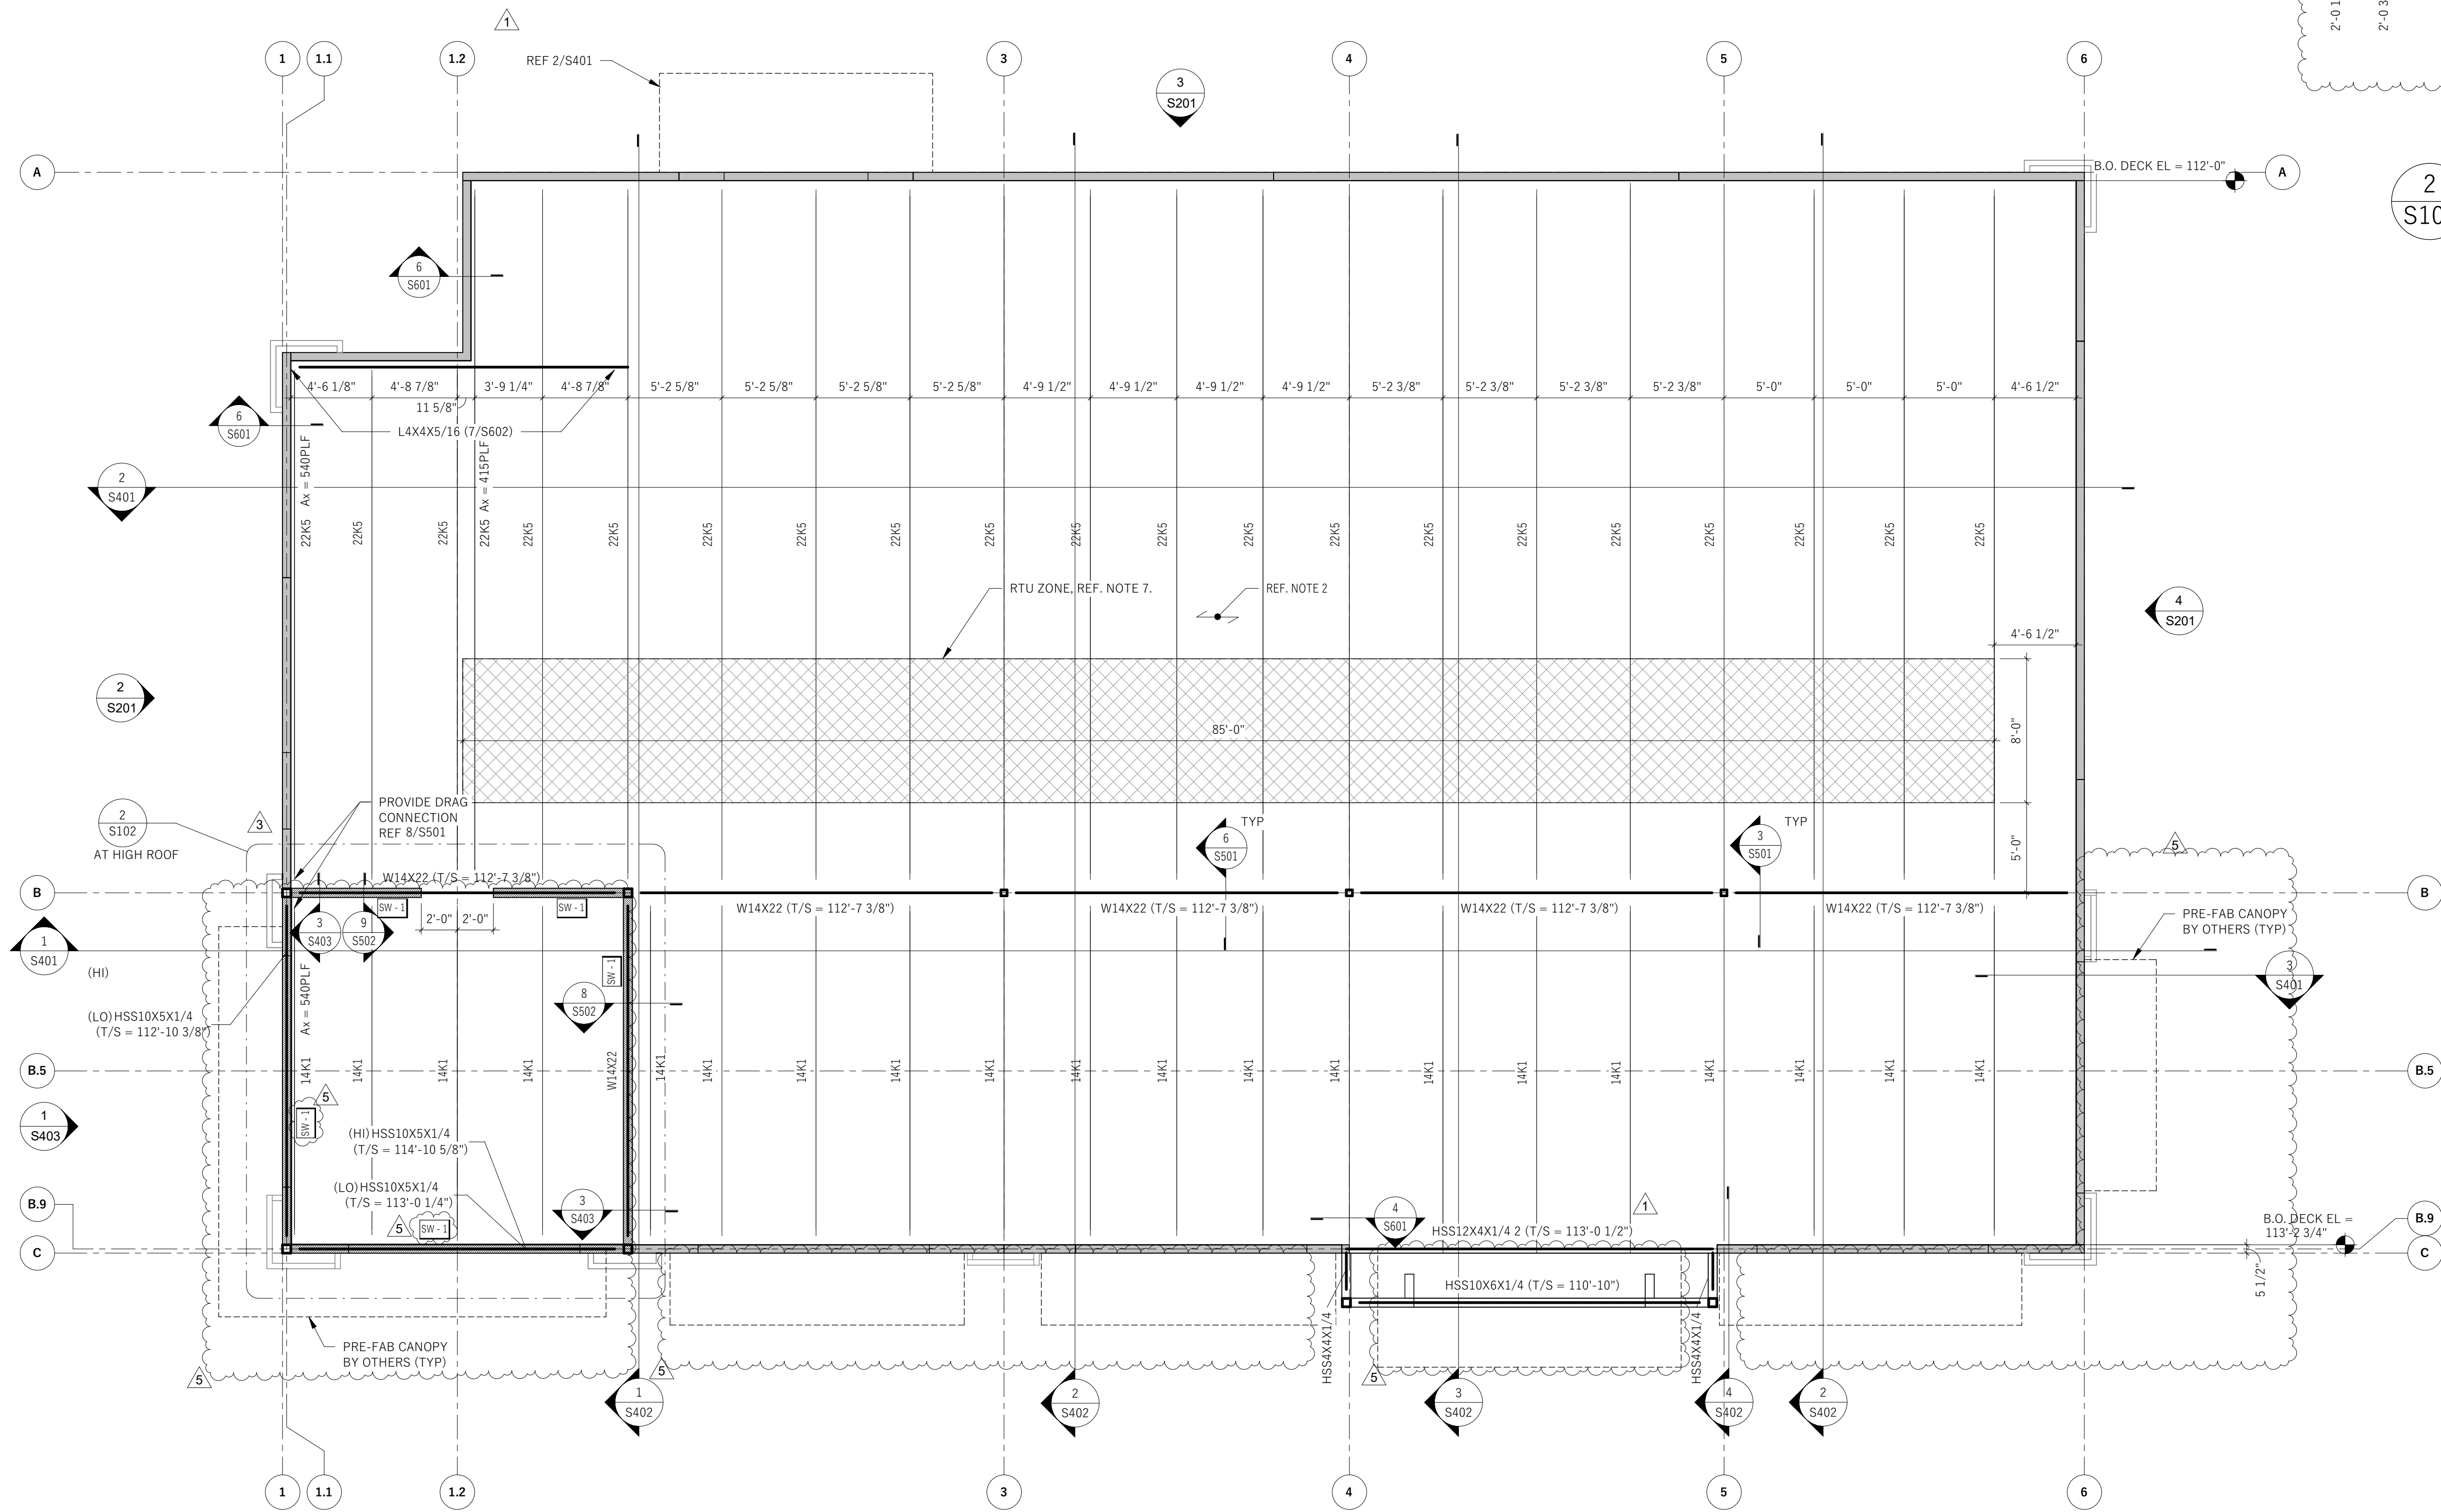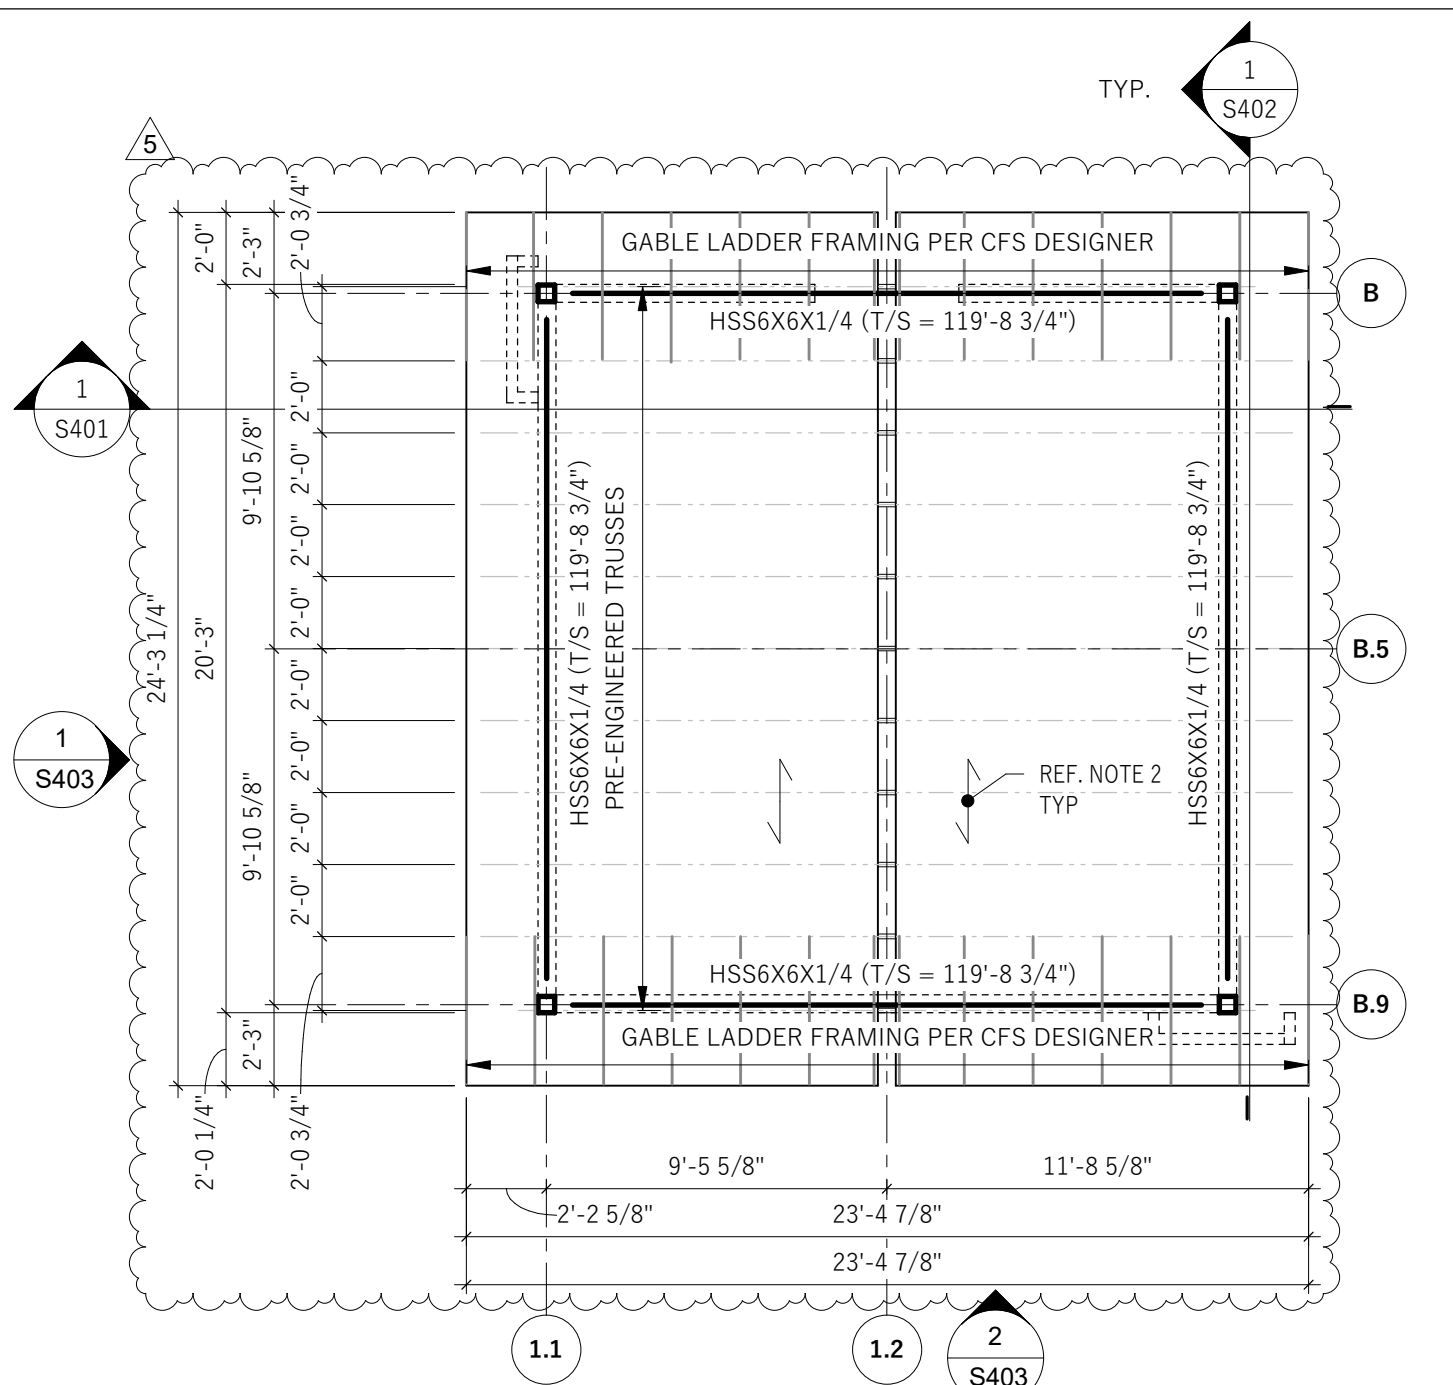


- ROOF FRAMING SHEET NOTES**
- DESIGN LIVE LOAD: SEE GENERAL NOTES
 - ROOF CONSTRUCTION: VULCRAFT 1.5 B 22 DECK OVER STEEL METAL JOISTS, REF. GENERAL NOTES
 - BOTTOM OF STEEL DECK NOTED ON PLAN. REFERENCE ELEVATION = FINISHED FLOOR EL. 100'-0"
 - SEE S0 SERIES FOR GENERAL STRUCTURAL NOTES.
 - COORDINATE SCUPPER OPENINGS & TILT PANEL PARAPETS WITH ARCHITECTURAL DRAWINGS.
 - JOIST MANUFACTURER SHALL DESIGN BRIDGING UPLIFT PER WIND PRESSURE DIAGRAMS ON S002.
 - AT RTU ZONE: JOIST DESIGNER TO DESIGN JOIST FOR AN ADDITIONAL 30 PSF LIVE LOAD.
 - AT HIGH ROOF FRAMING: WALL STUDS TO BE 600S162-33 STUDS AT 24" O.C. MINIMUM FOR LATERAL SHEAR DESIGN


JCA
4100 Wadsworth Blvd
Wheat Ridge, CO 80033
p 303.985.3260
TX F-14436 #21134

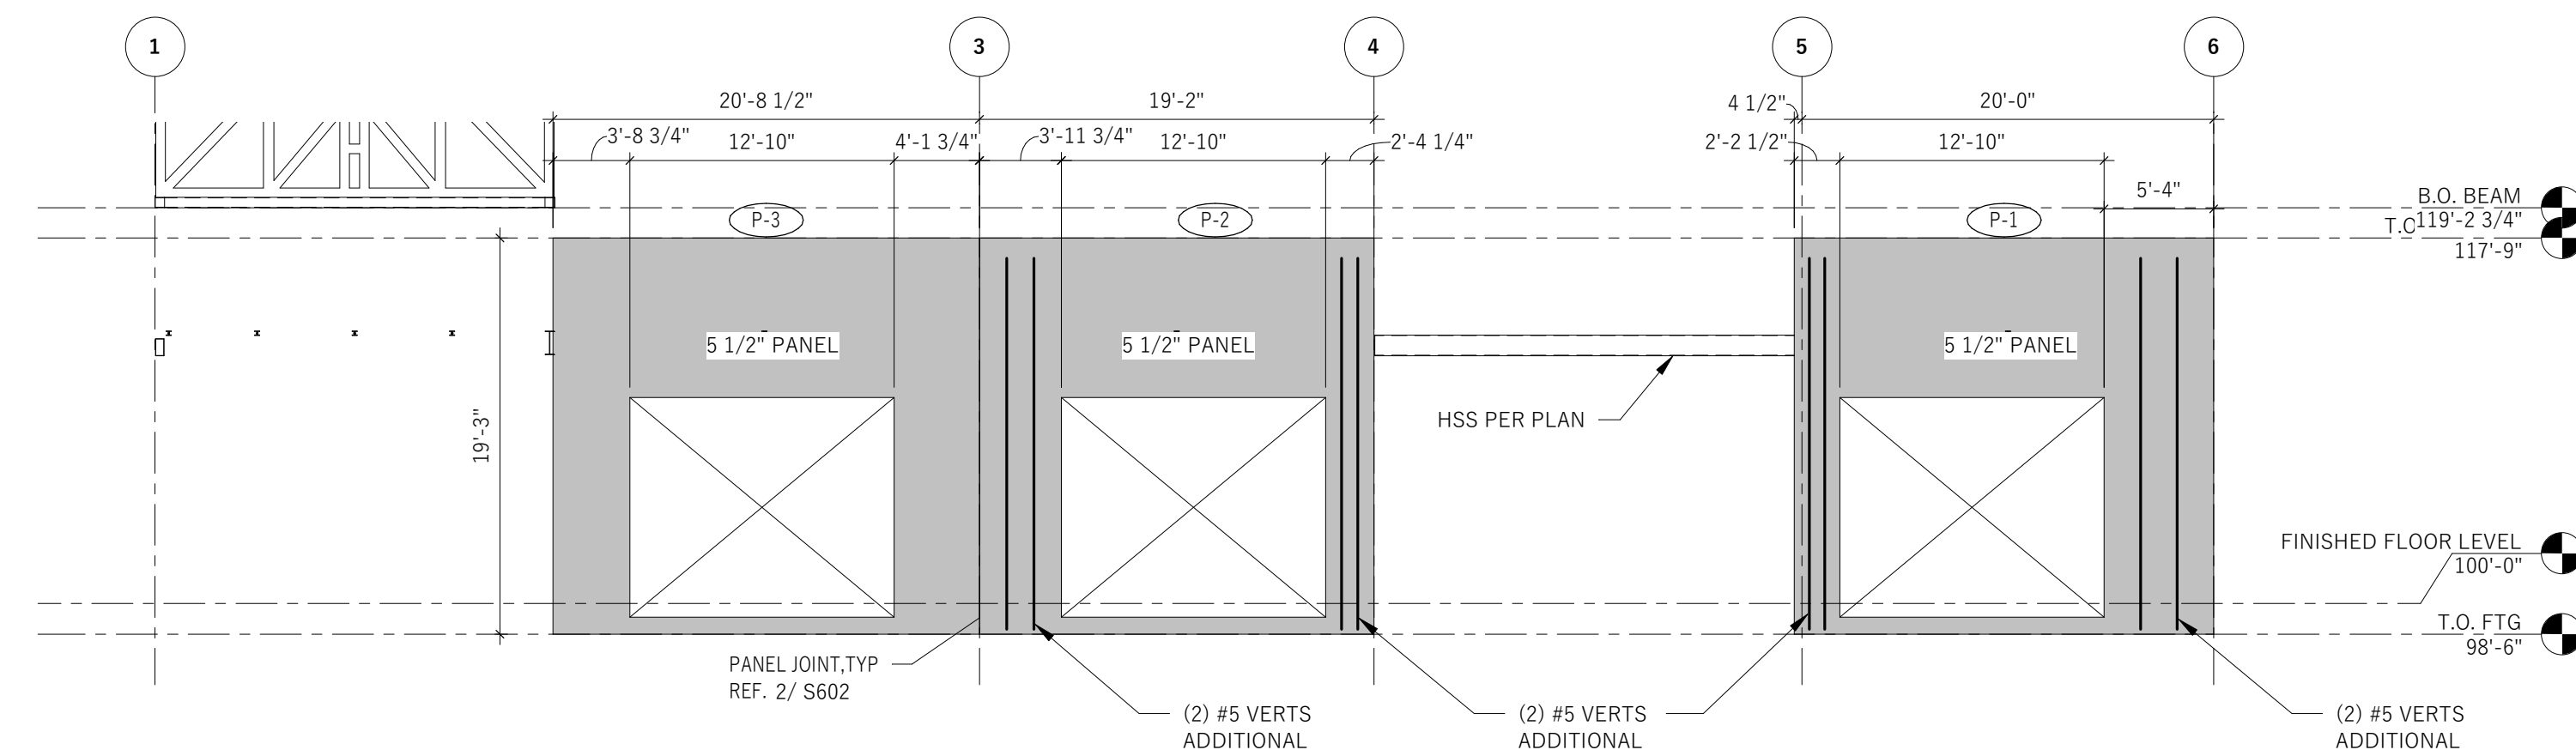


1
ELEVATION AT GRIDLINE C
S201 1/8" = 1'-0"

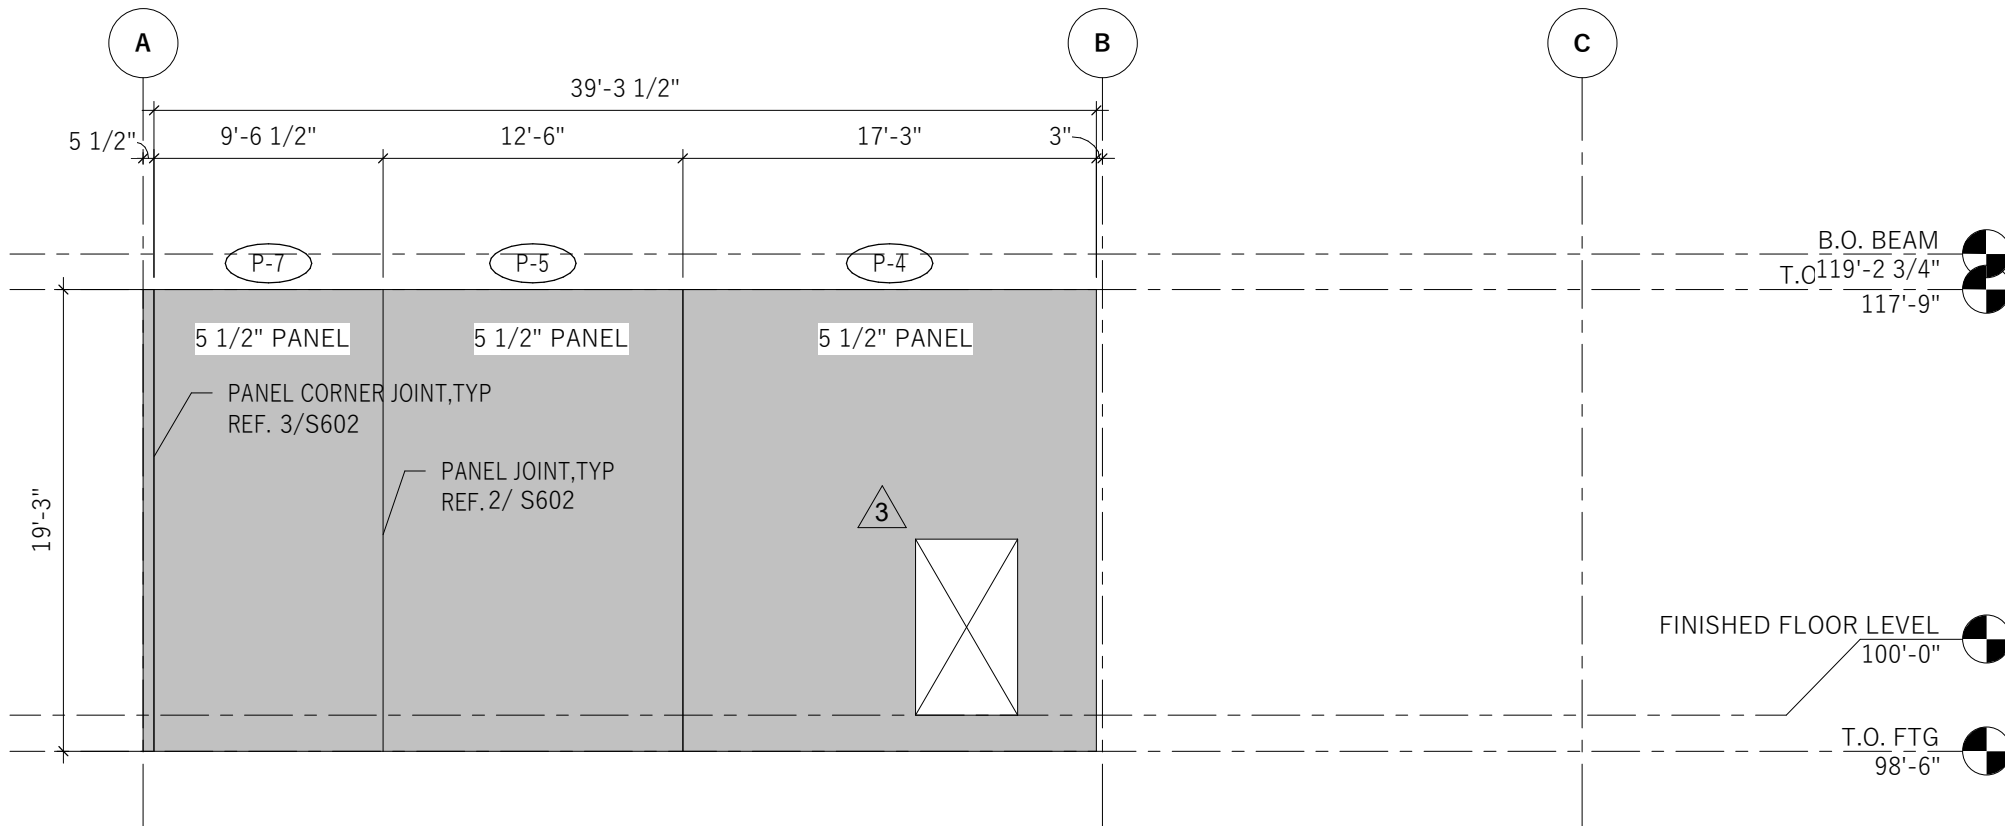

2
ELEVATION AT GRIDLINE 1 & GRIDLINE 1.2
S201 1/8" = 1'-0"

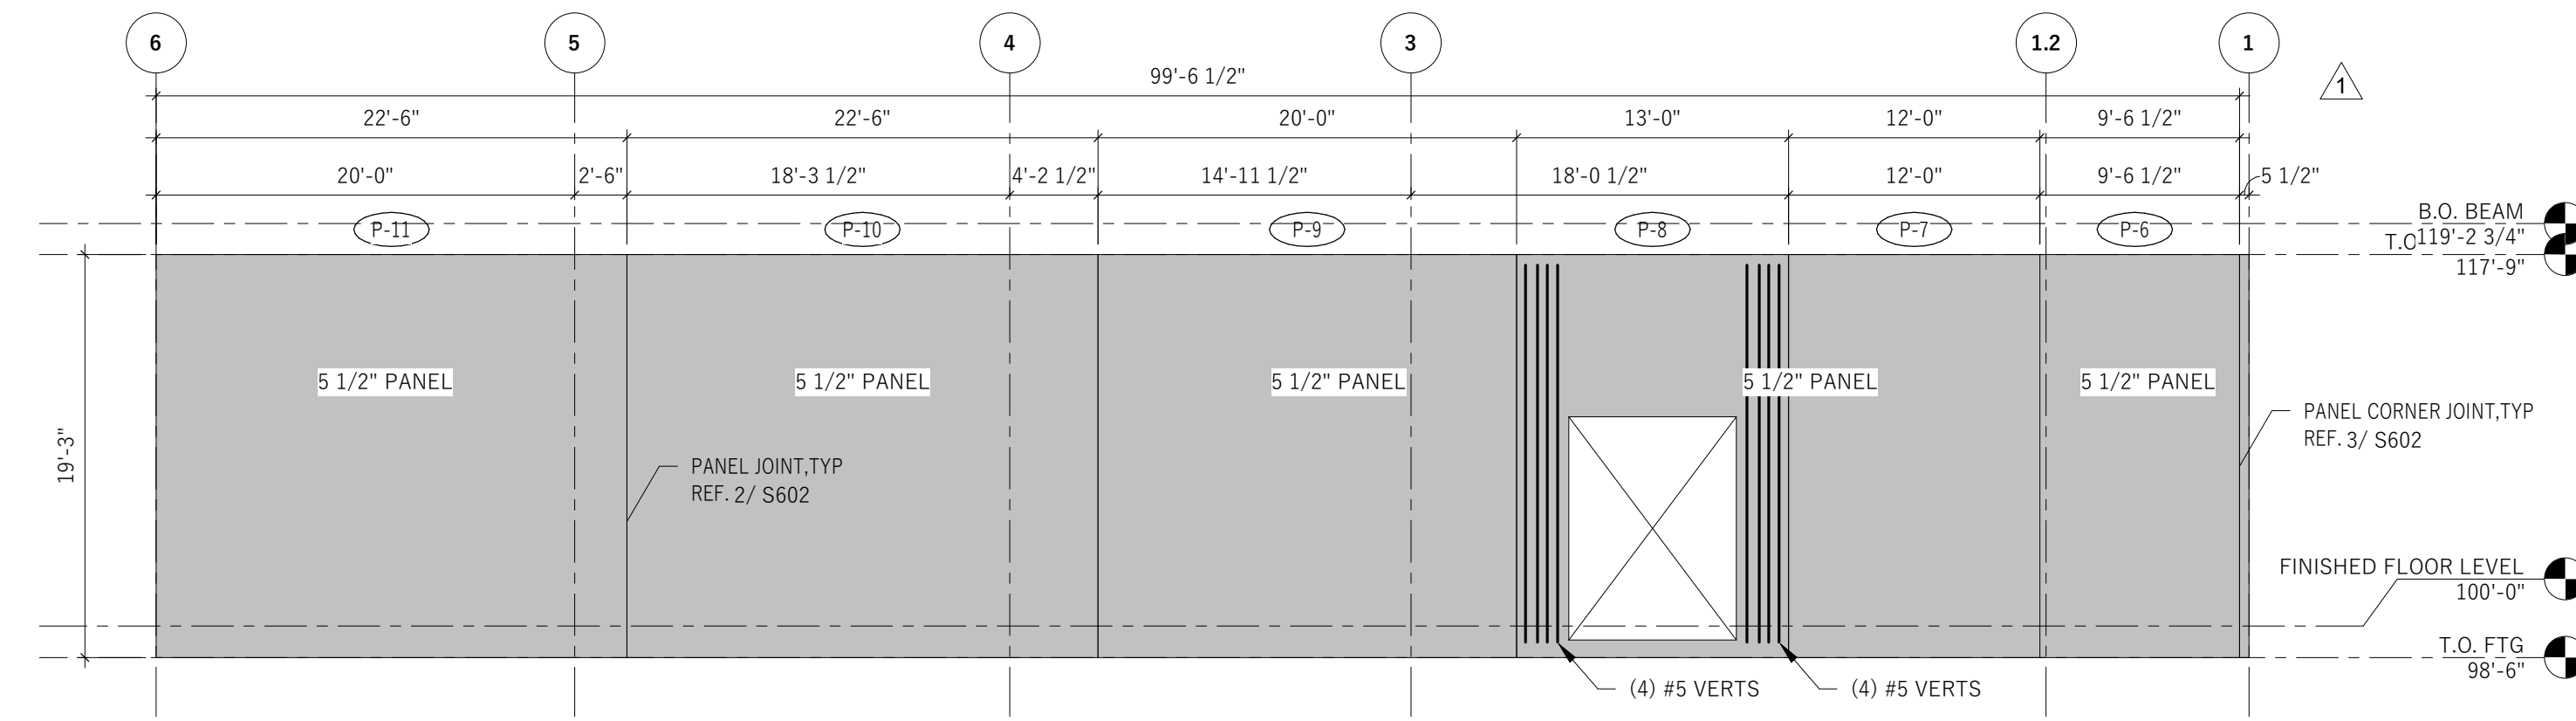

3
ELEVATION AT GRIDLINE A
S201 1/8" = 1'-0"

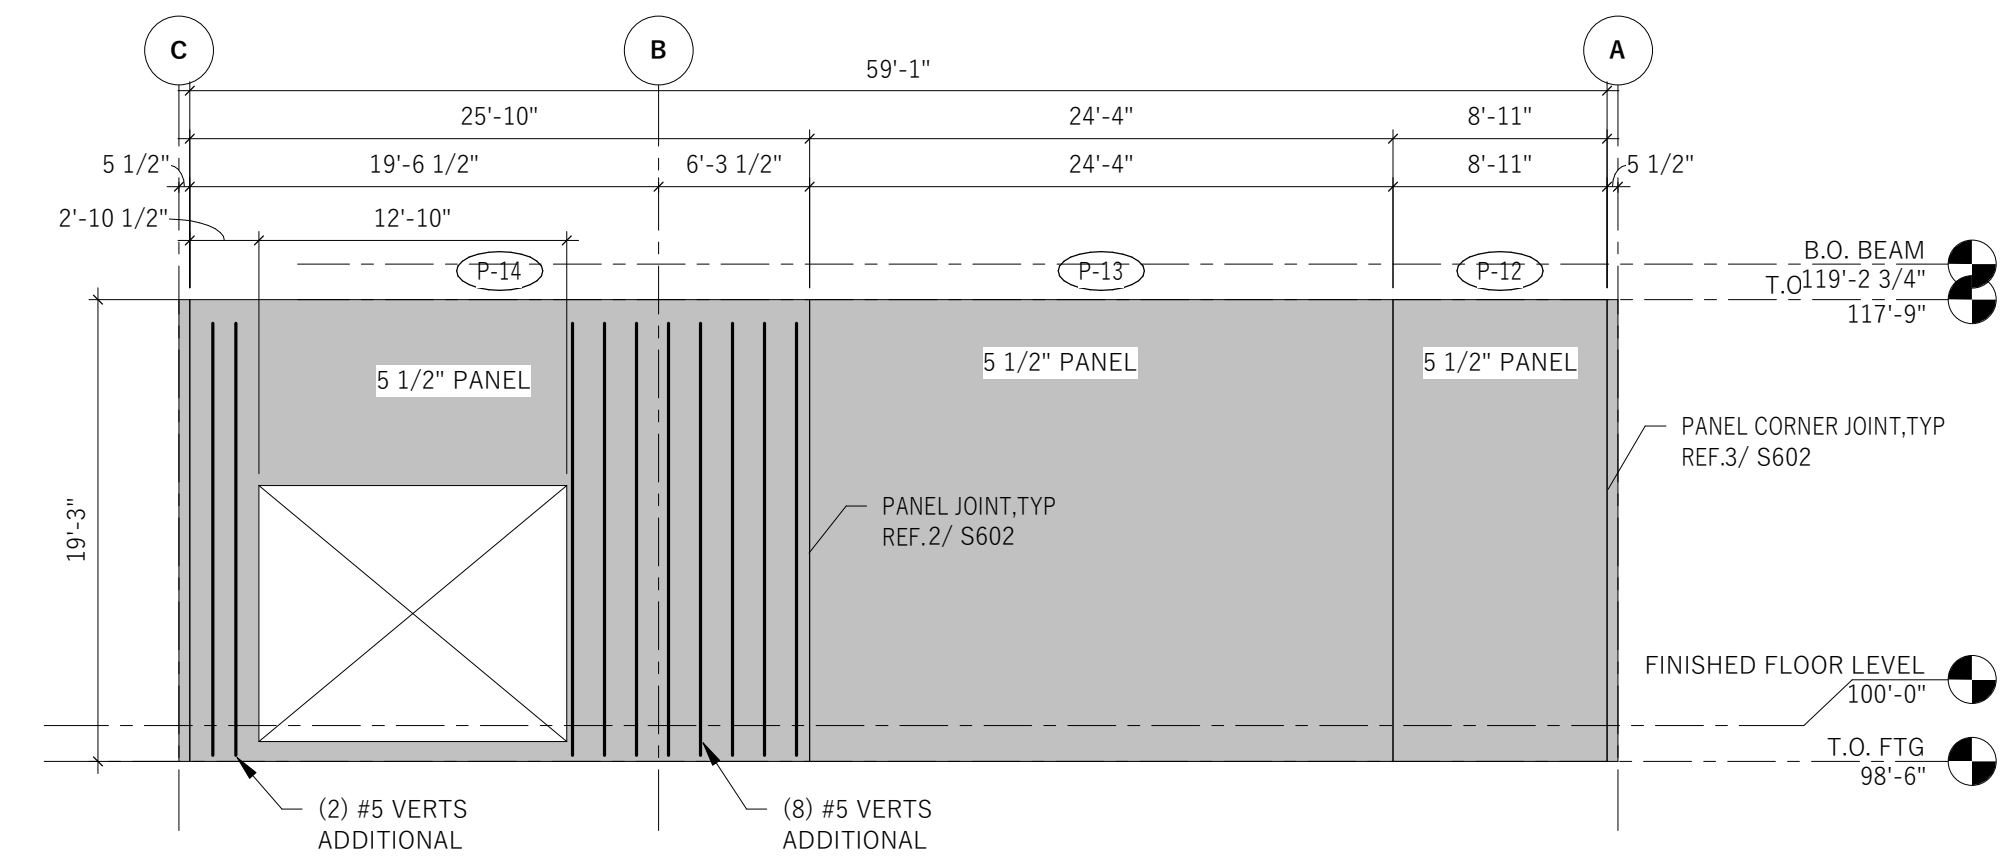

4
ELEVATION AT GRIDLINE 6
S201 1/8" = 1'-0"

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S BAGDAD ROAD BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE
PROPERTY OF ALIGN AUSTIN ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM,
BY ANY METHOD, FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
1 05/24/22 REV 1
2 06/20/22 REV 2
3 09/06/22 REV 3



09/09/2024
100% CDS-REVISED
TILT WALL ELEVATIONS

SHEET: **S201**

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
THESE DESIGN DRAWINGS ARE THE SOLE PROPERTY OF ALIGN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.


REVISION:
2 - 06/20/22 REV 2



09/09/2024
100% CDS-REV 05-VE
FOUNDATION DETAILS


SHEET: **S301**

PROJECT NO: 21099
DRAWN BY: BC
DATE: 01/28/2022
PROJECT MGR: NHR

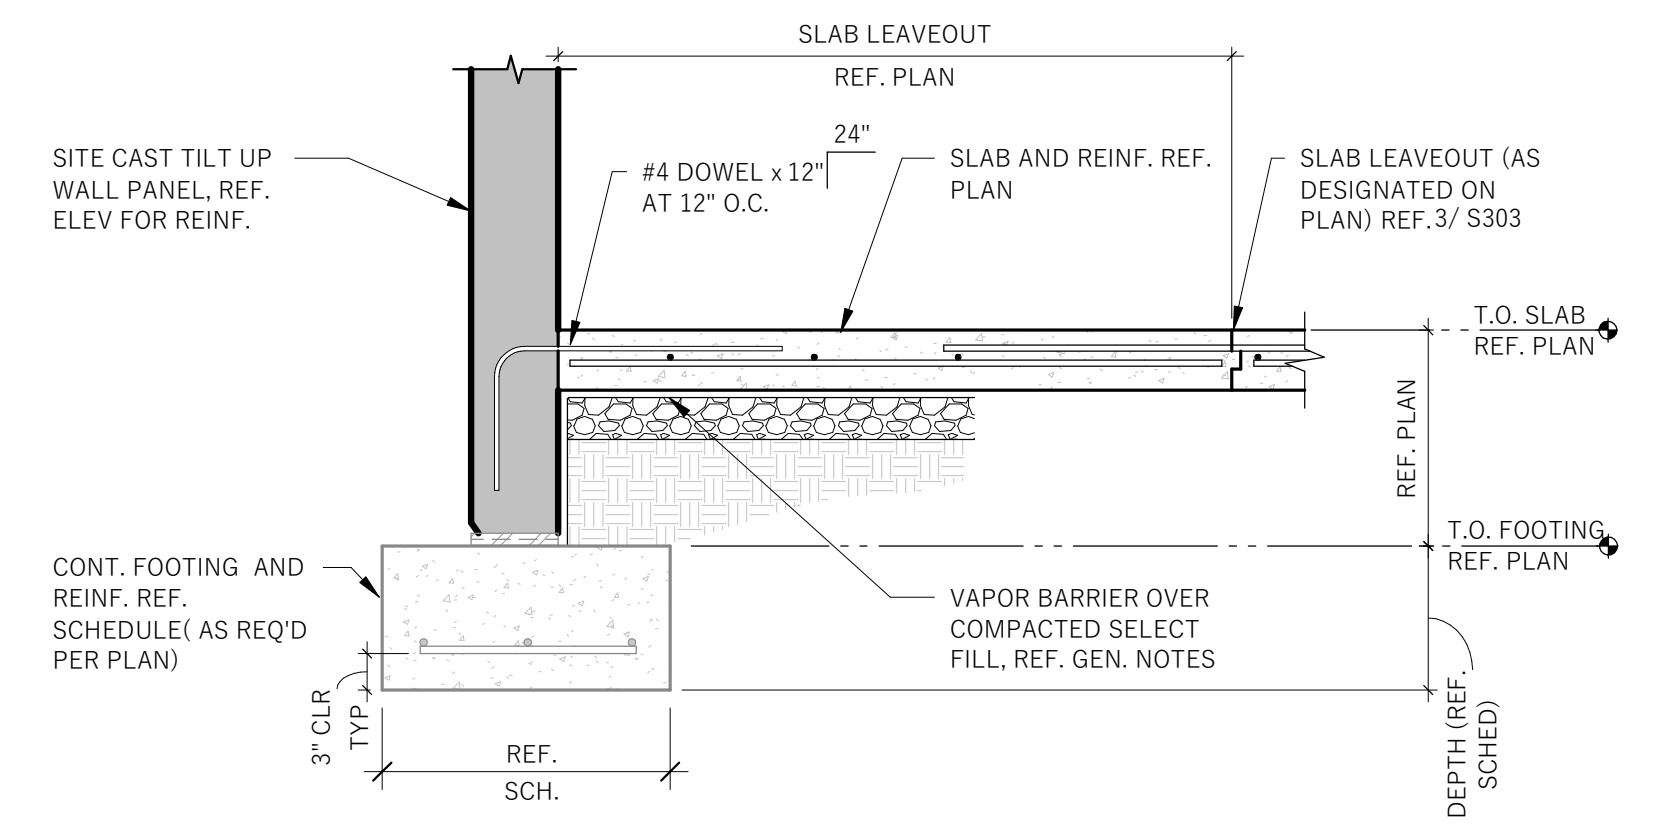


3
S301 3/4" = 1'-0"

SECTION AT TILT WALL PANEL SLAB LEAVOUT

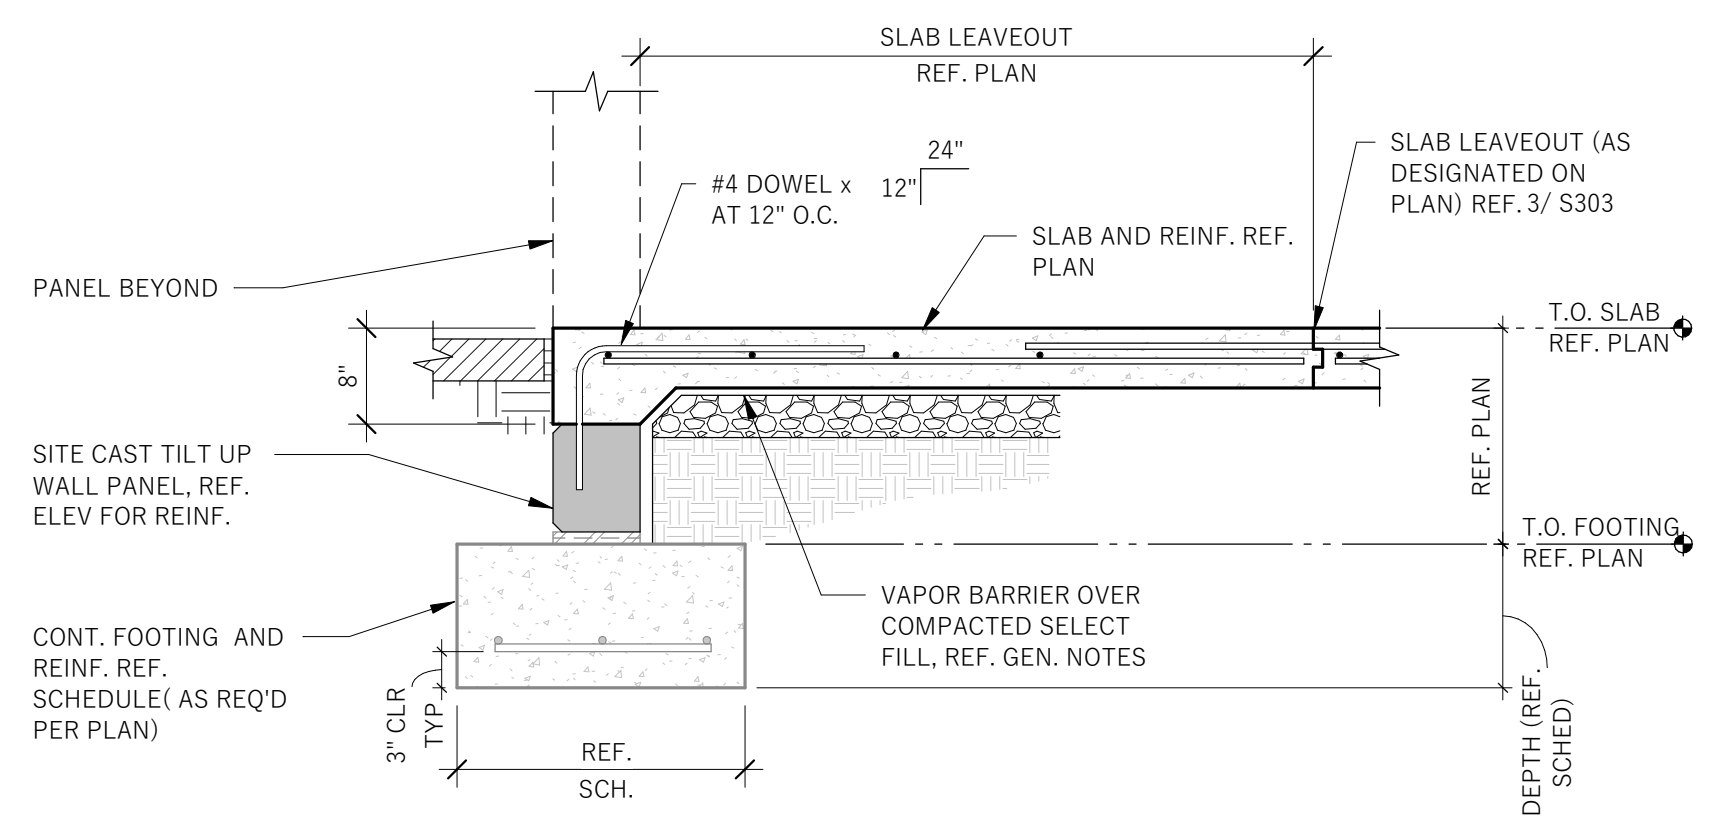



2
S301 3/4" = 1'-0"

TILT WALL PANEL AND DOOR

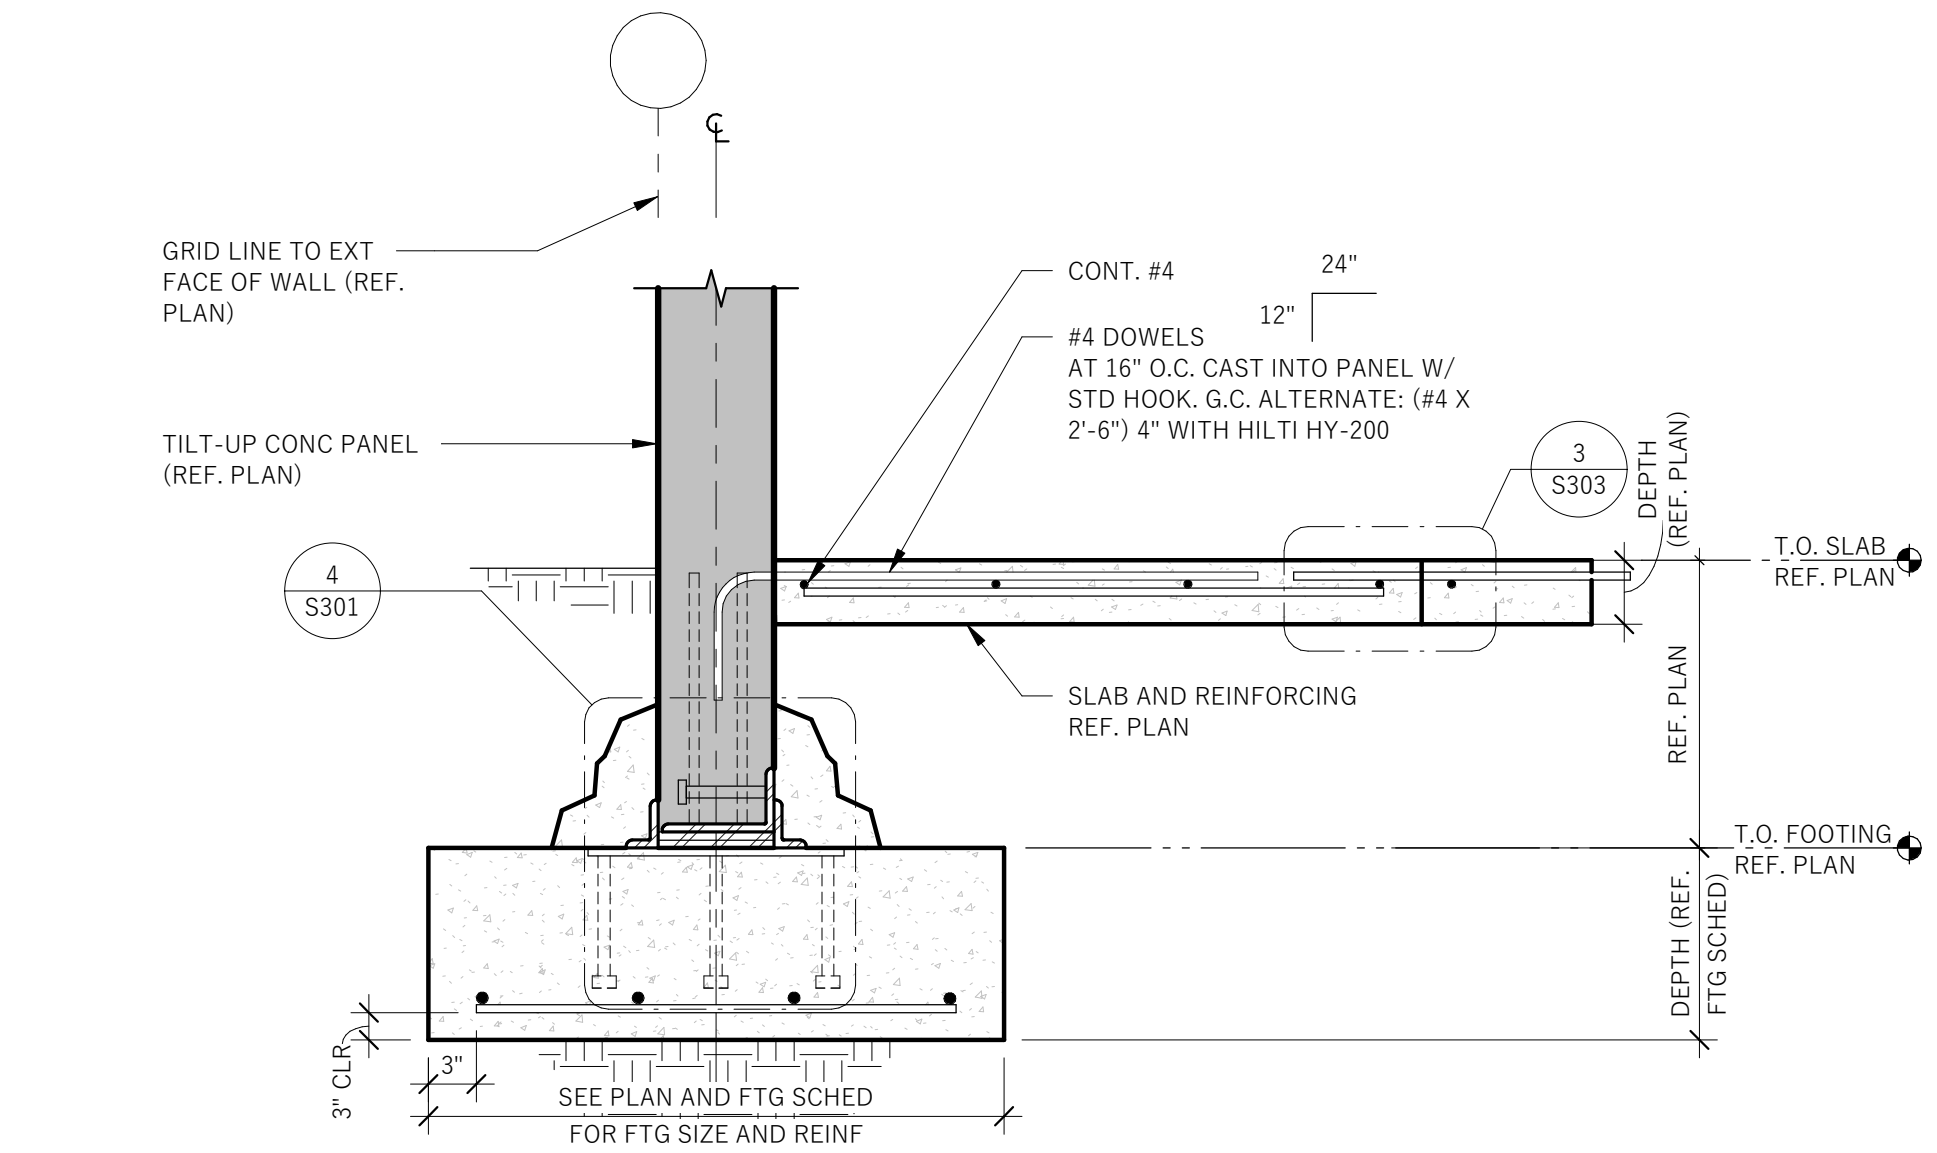


1
S301 1" = 1'-0"

SITE-CAST WALL TO FOOTING

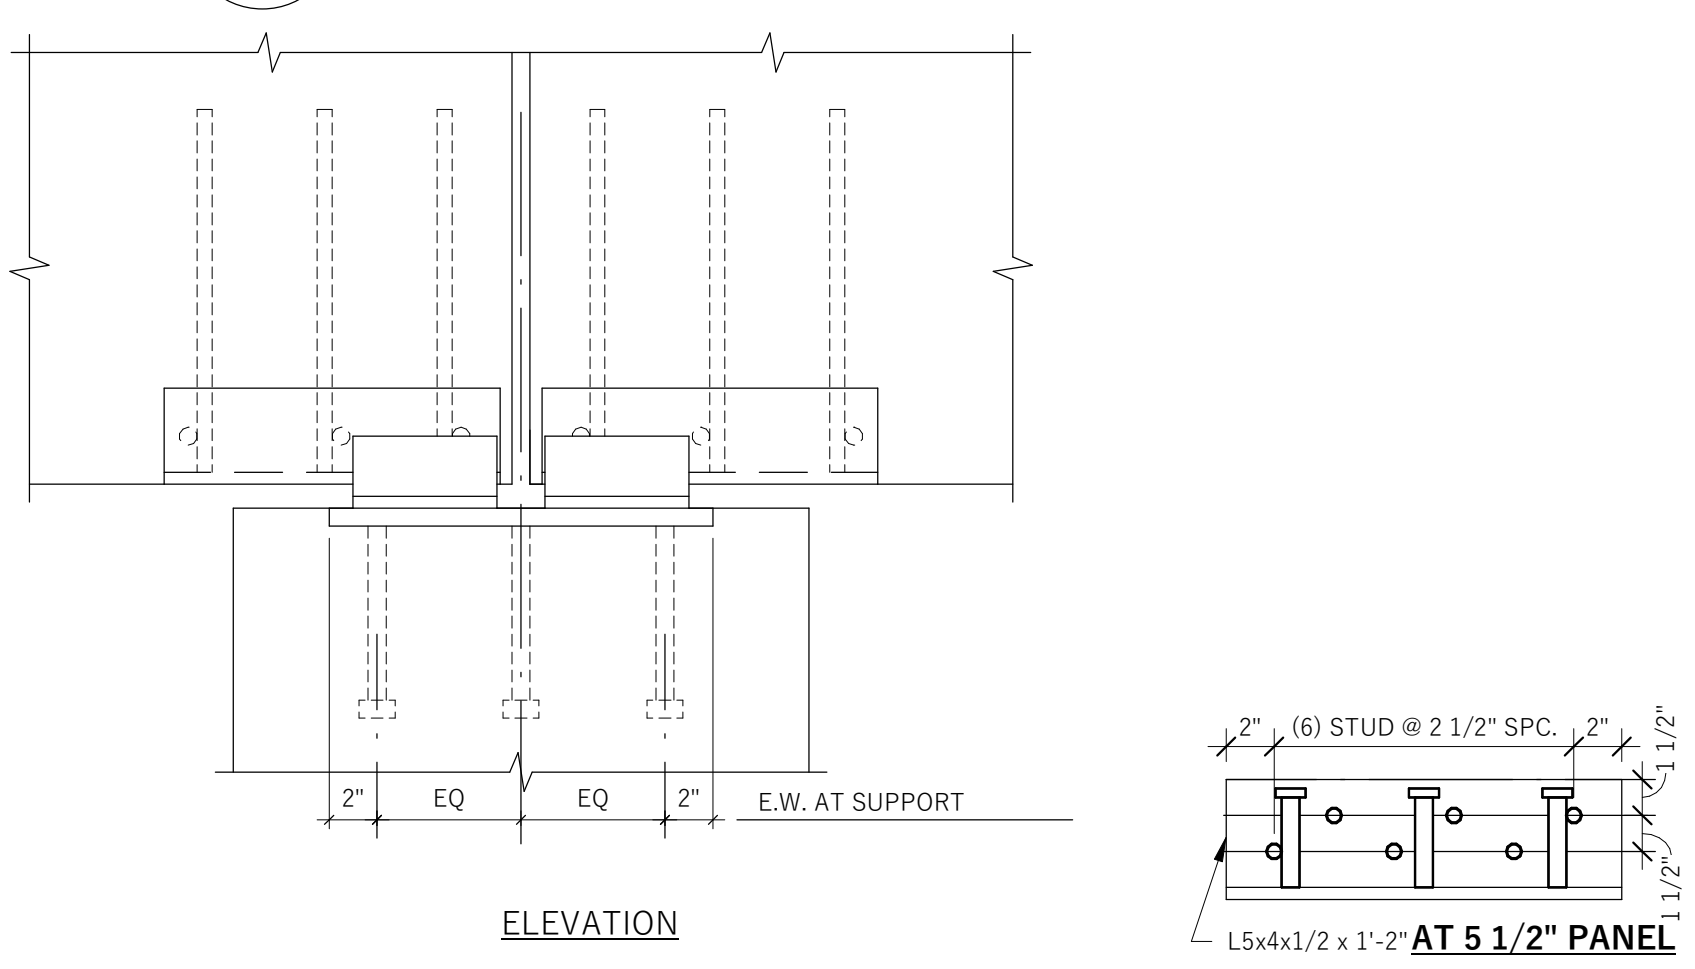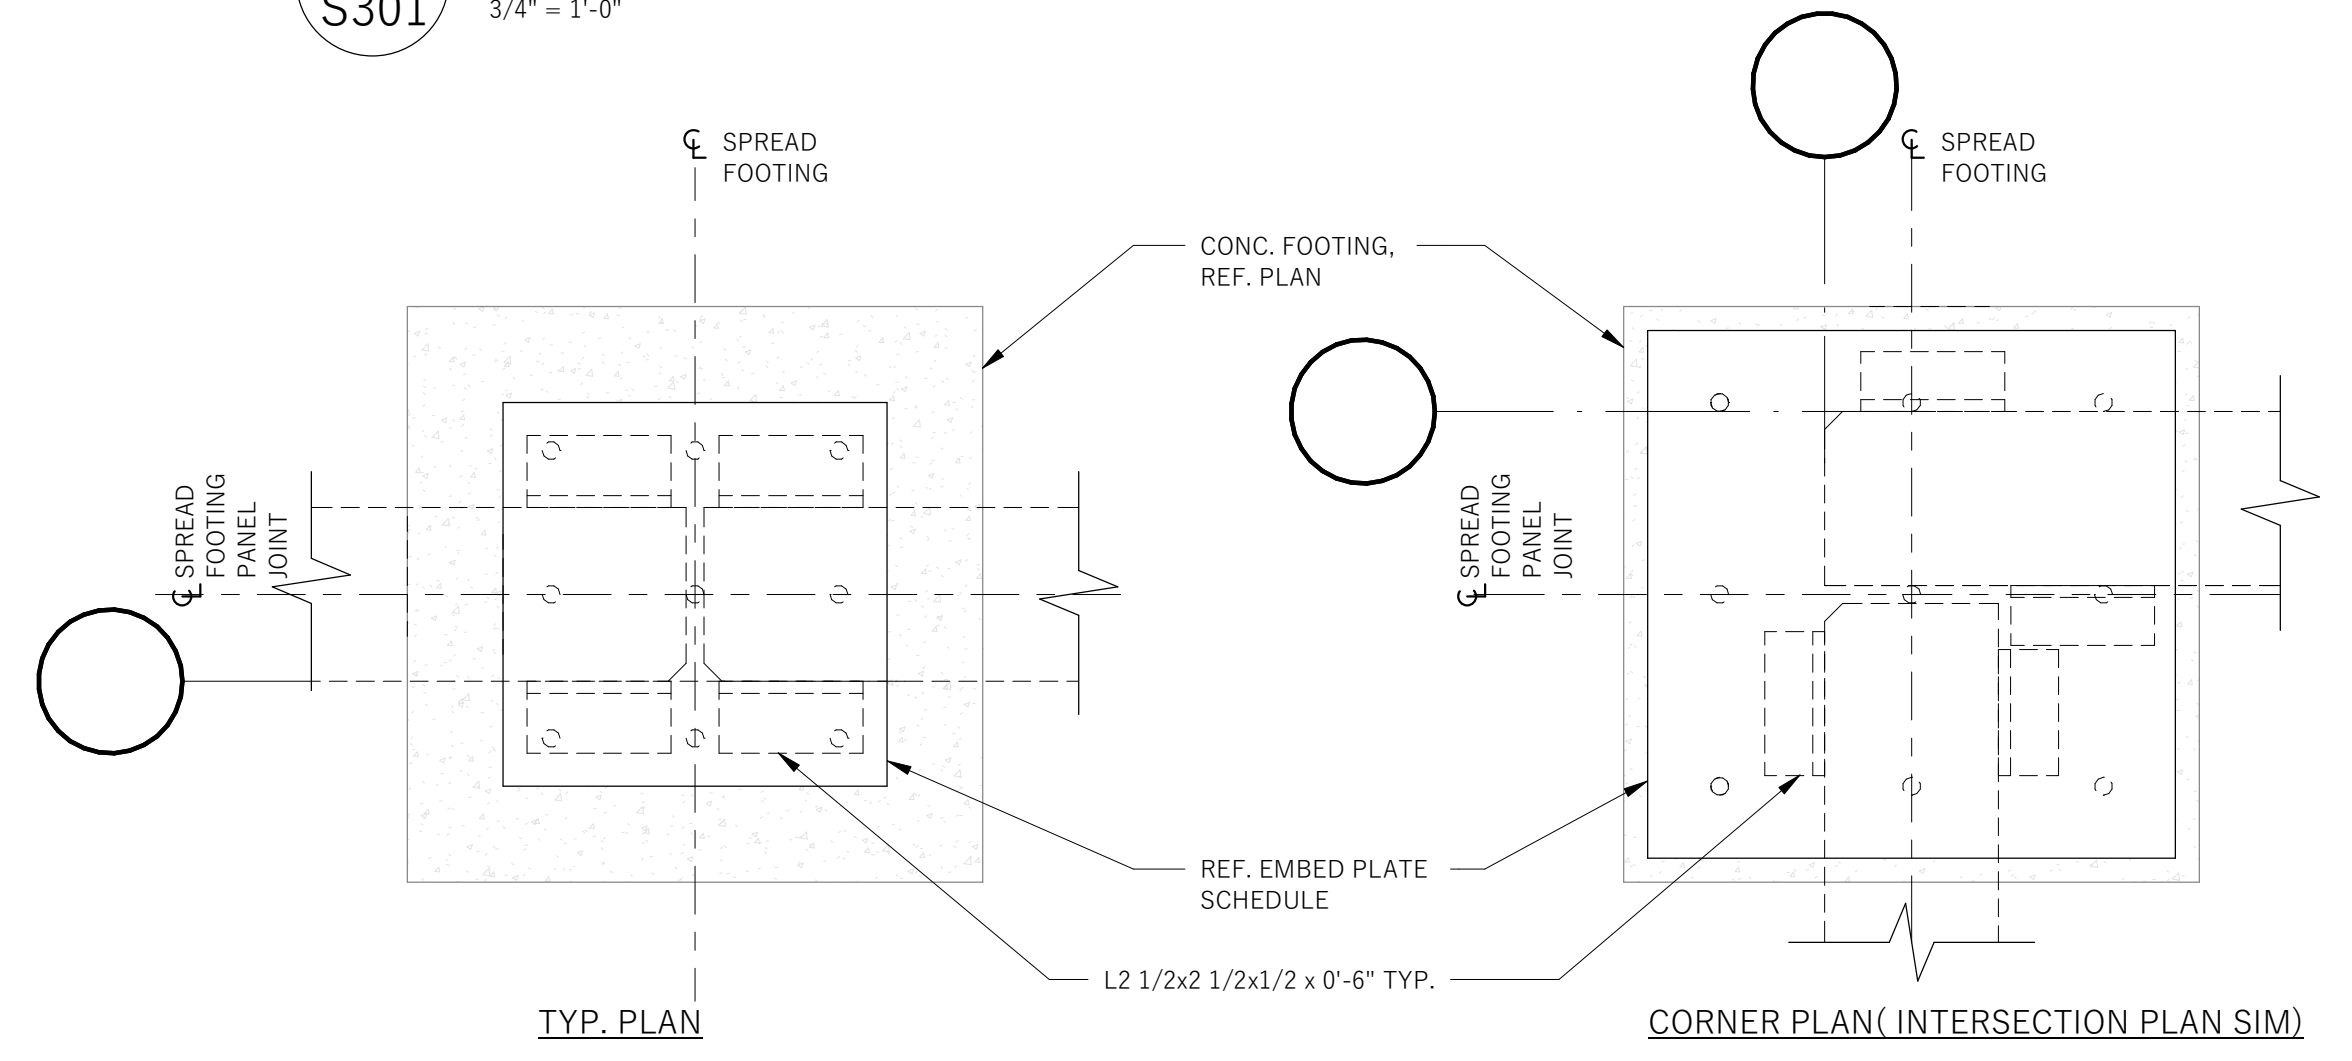


EMBED PLATE SCHED.			
LOCATION	NO. H.C.A.	PLATE SIZE (T=5 1/2" & 7 1/4")	PLATE SIZE (T=9 1/4")
TYPICAL	9	1/2" x 16" x 1'-4"	1/2" x 18" x 1'-6"
CORNER	9	3/4" x 22" x 1'-10"	3/4" x 24" x 2'-0"
INTERSECTION	9	3/4" x 22" x 1'-10"	3/4" x 24" x 2'-0"

- NOTES:
- PROVIDE 2-1"Ø AIR RELIEF HOLES IN CENTER OF PLATE.
 - H.C.A. ARE 3/4" DIA. x 0'-8"
 - H.D. GALV. AFTER FABRICATION.

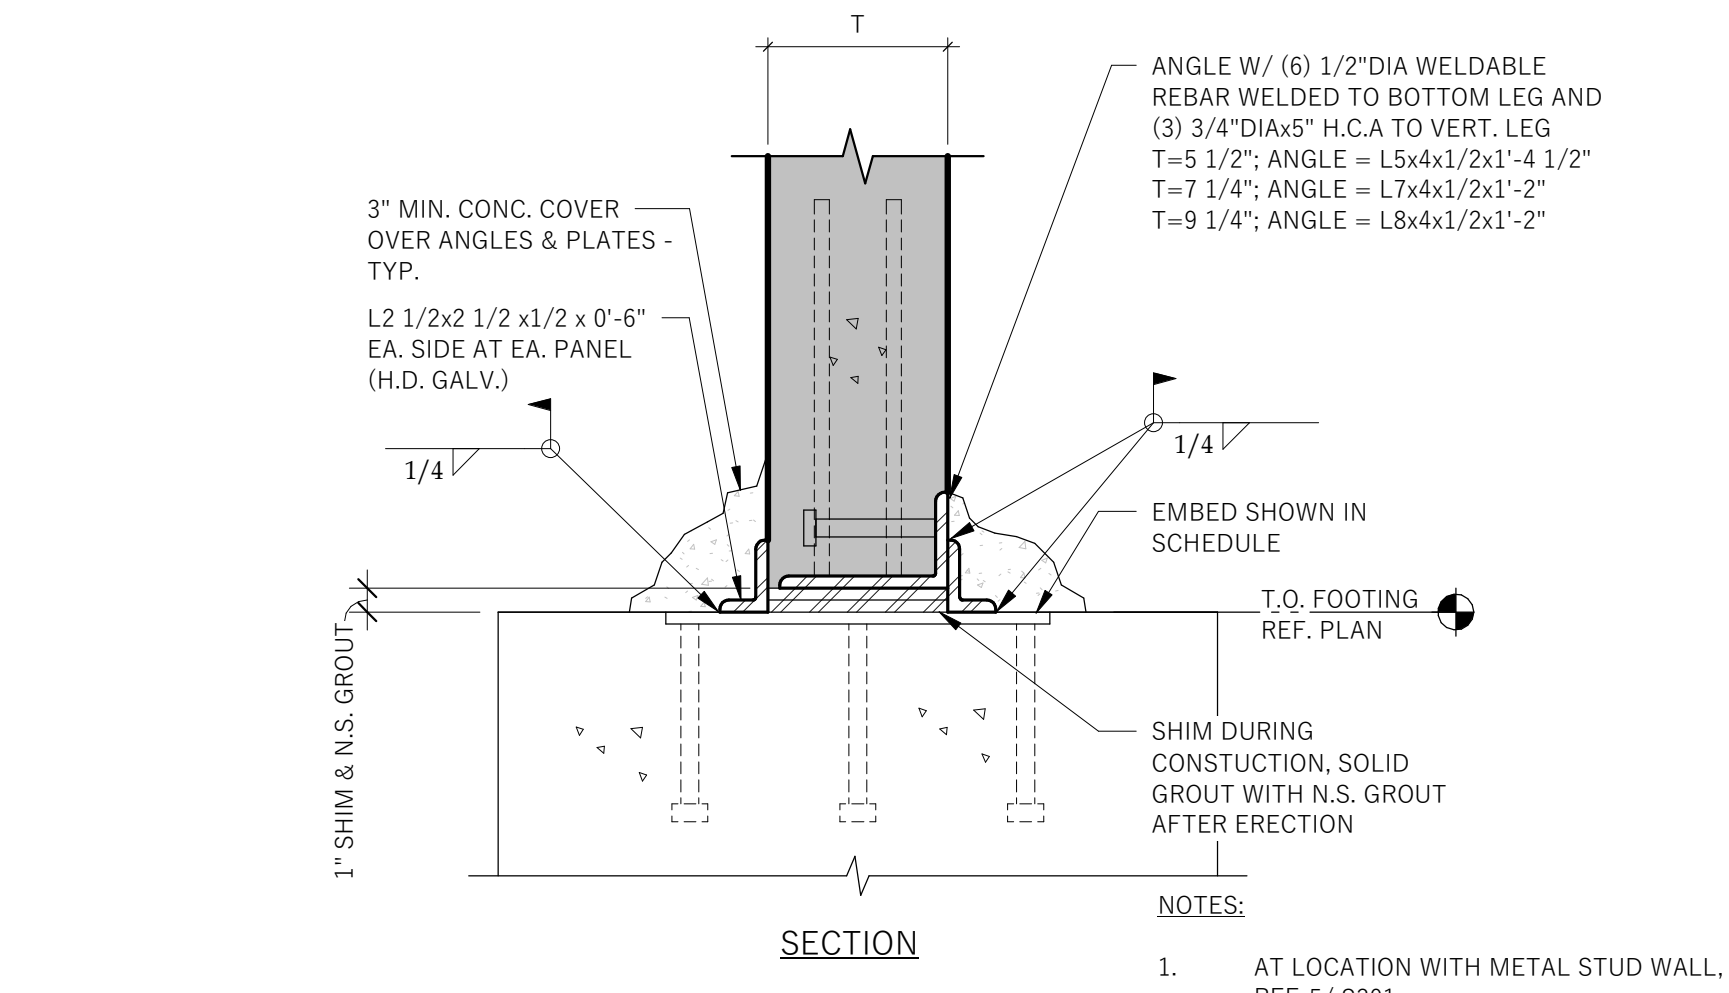


4
S301 1 1/2" = 1'-0"

TYPICAL TILT-UP WALL PANEL ANCHOR DETAIL

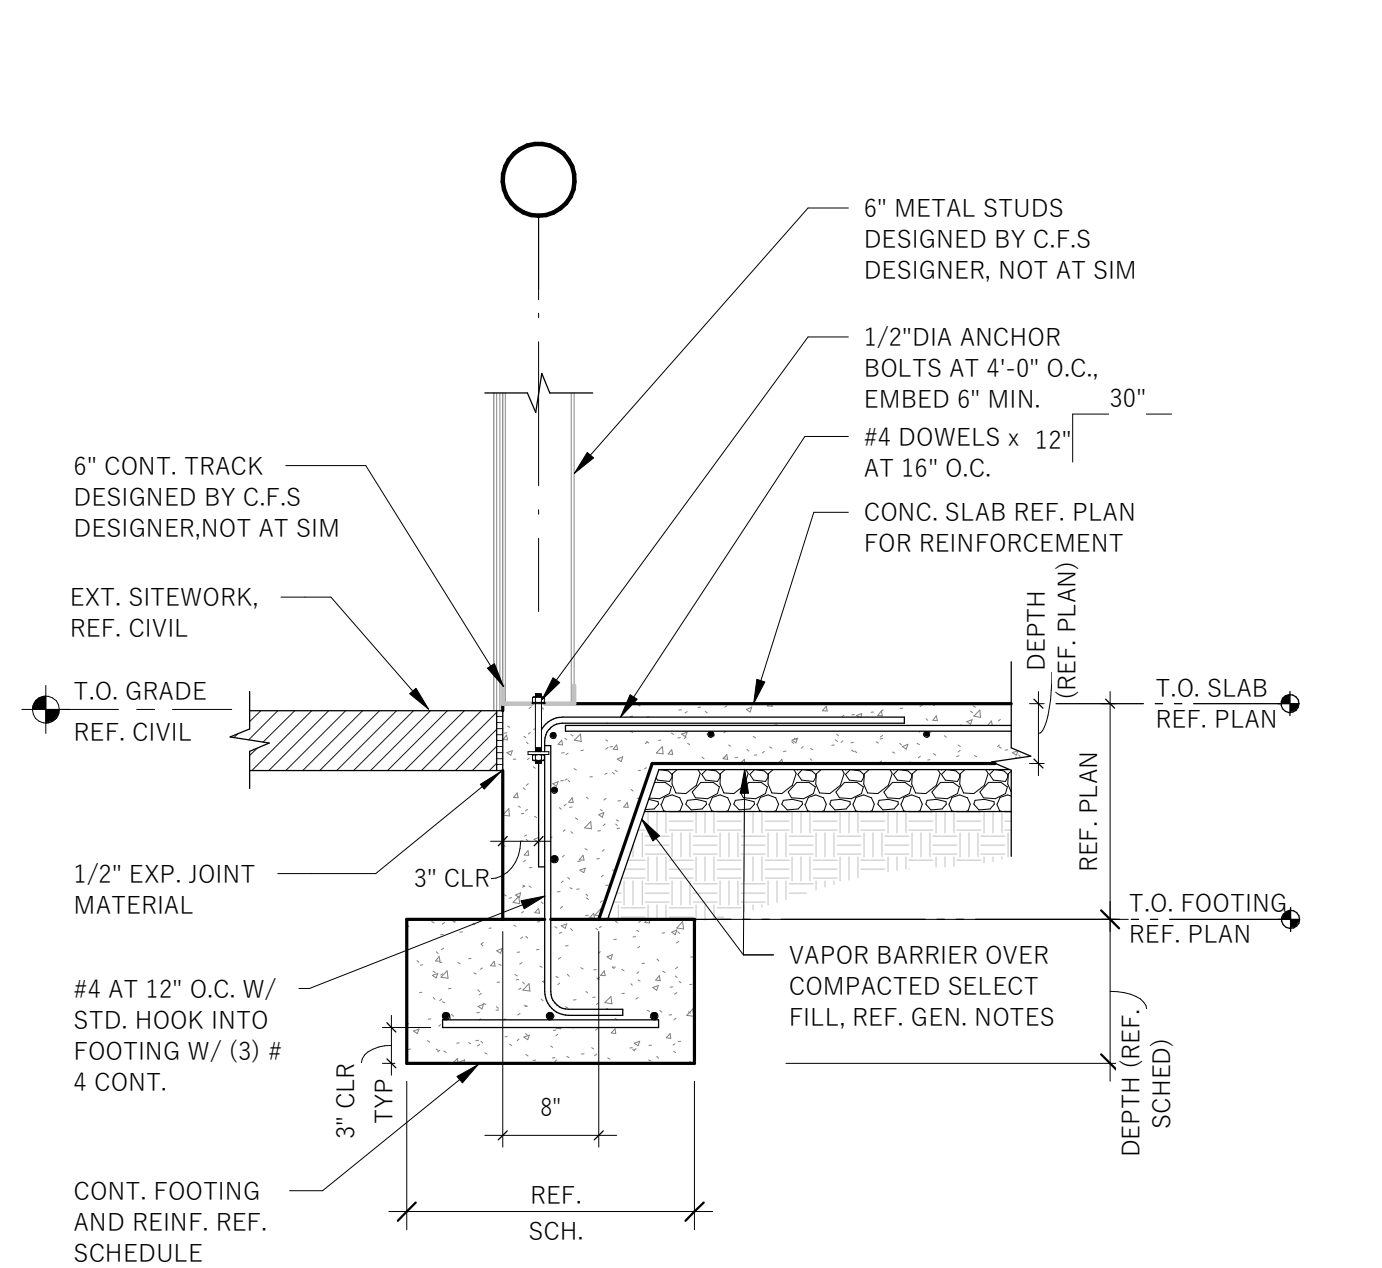


7
S301 3/4" = 1'-0"

EXTERIOR FOOTING SECTION

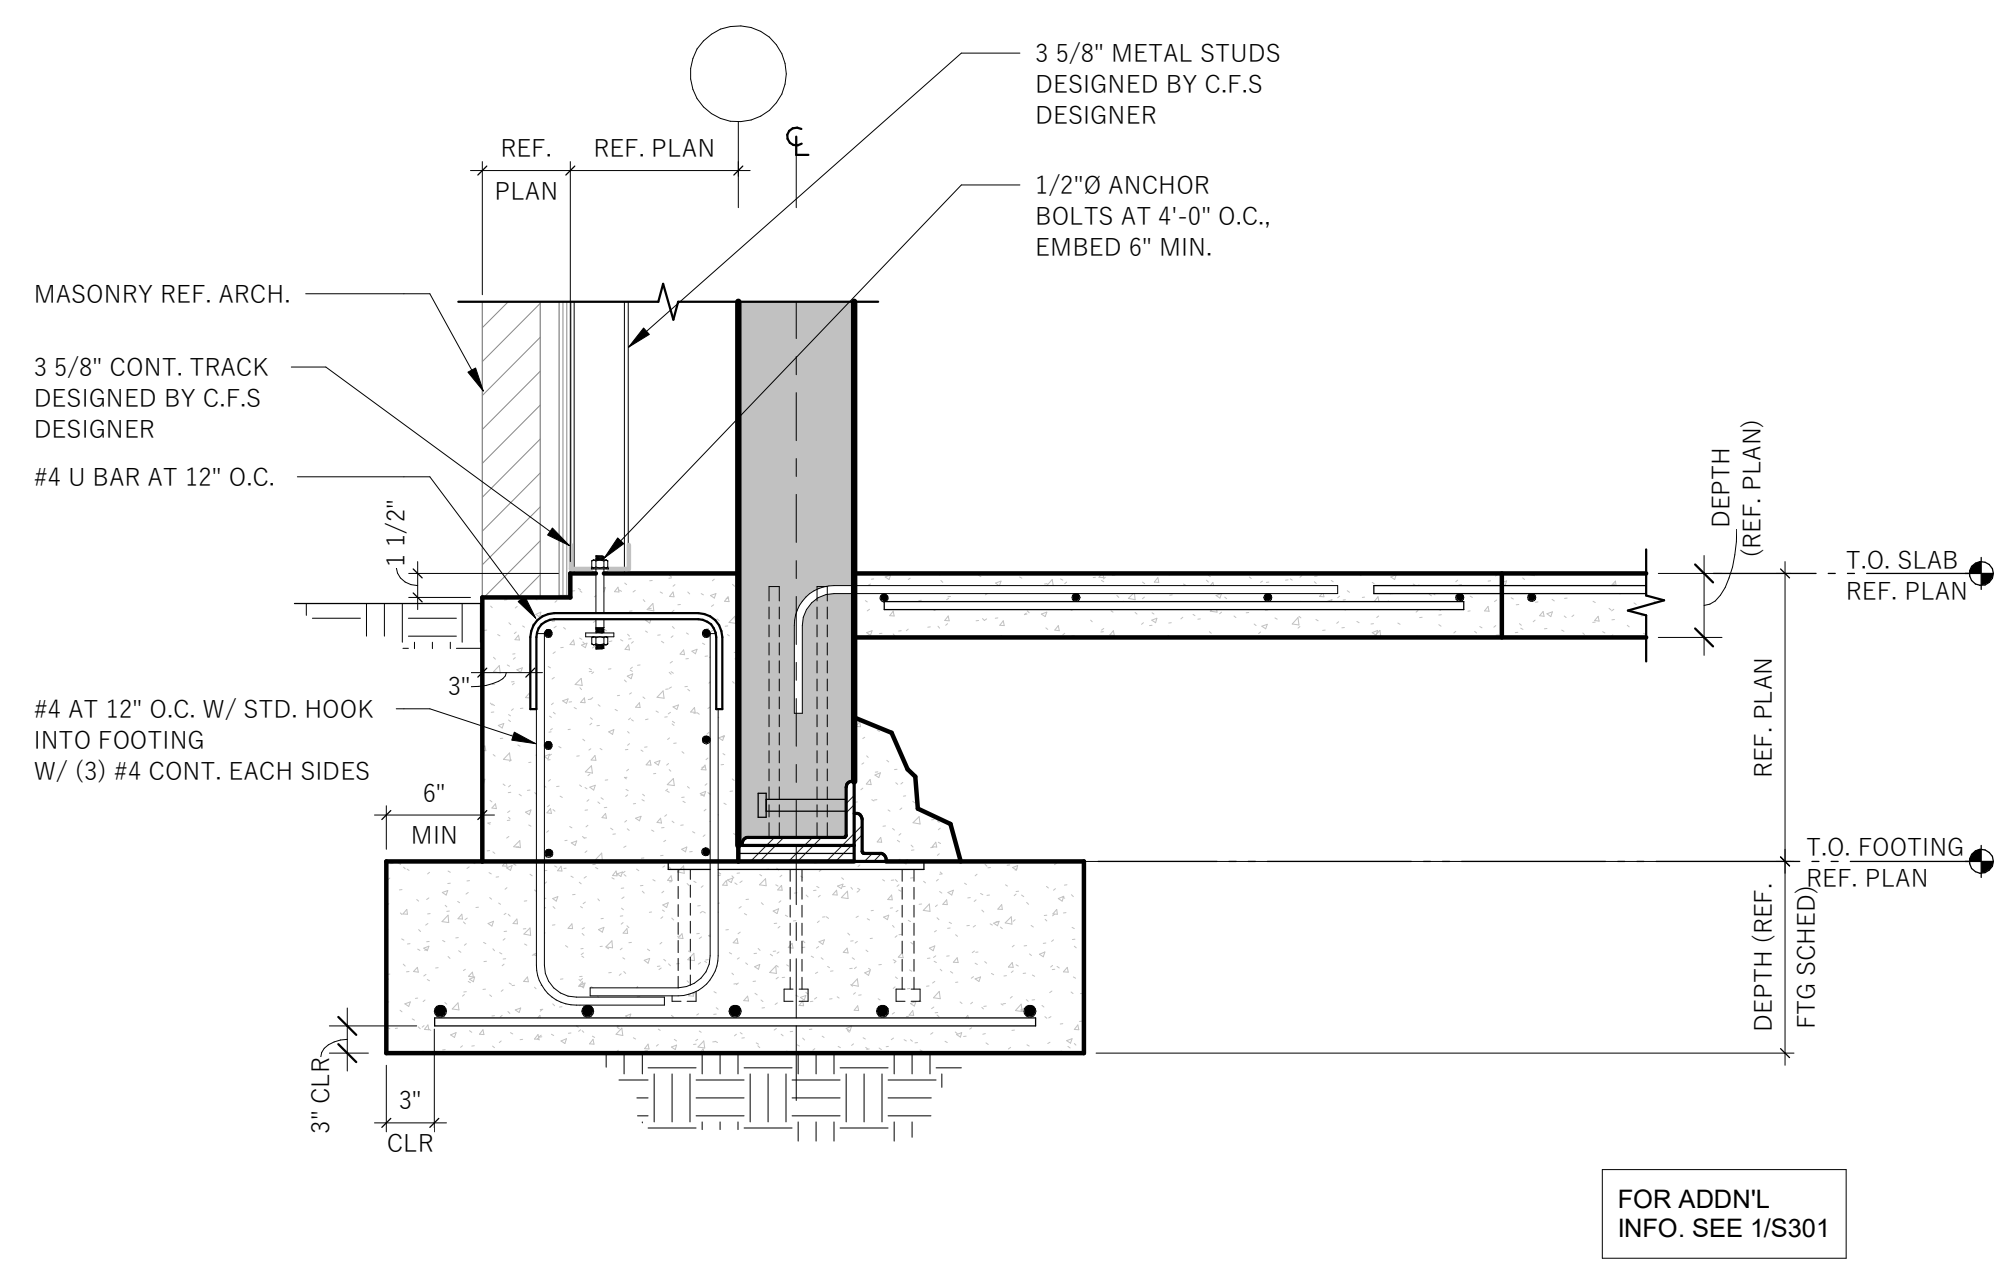


6
S301 1" = 1'-0"

SITE-CAST WALL TO FOOTING WITH MASONRY

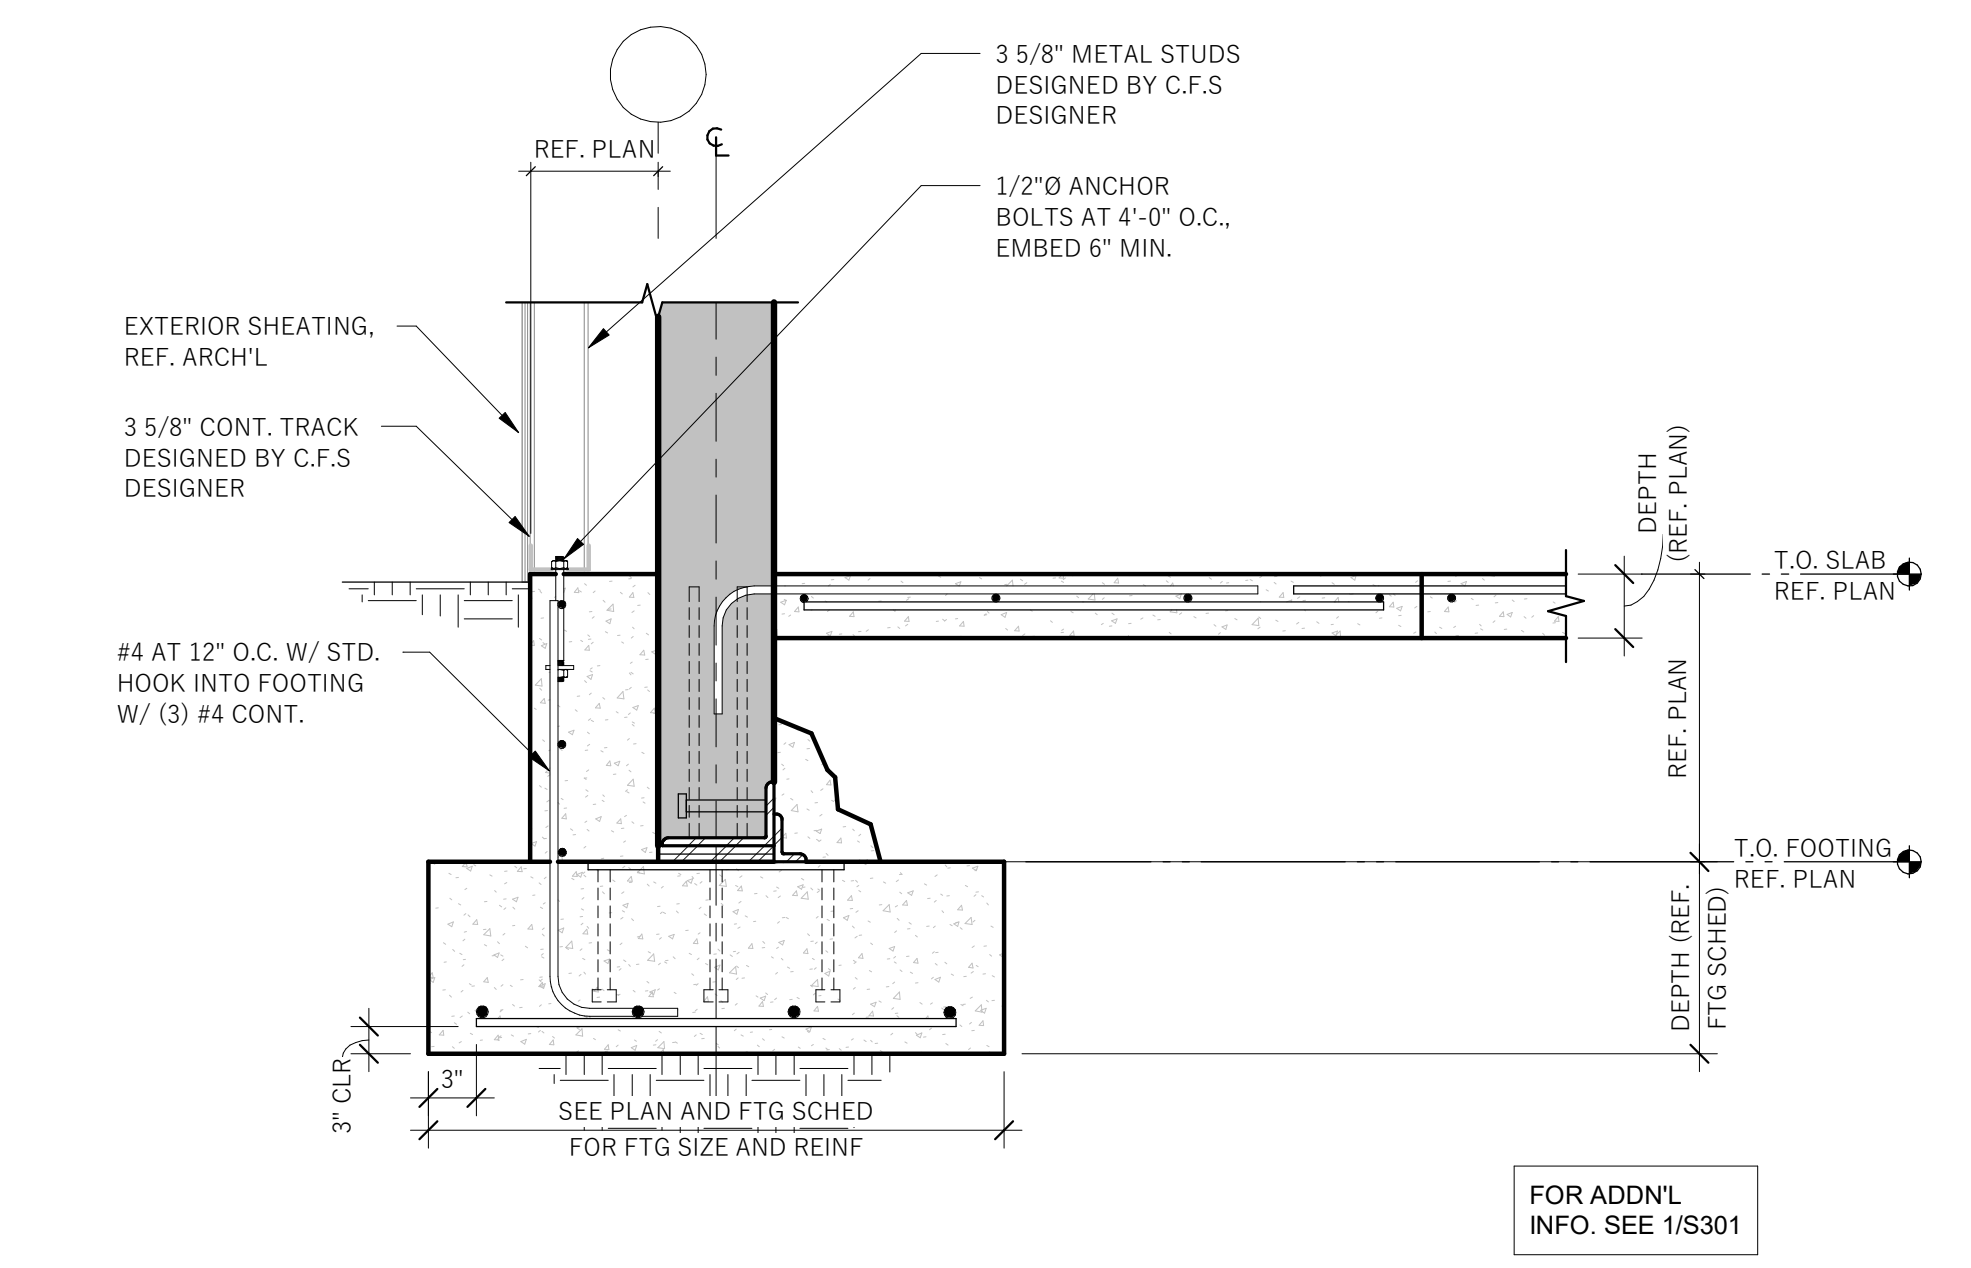


5
S301 1" = 1'-0"

SITE-CAST WALL TO FOOTING WITH C.F.S.

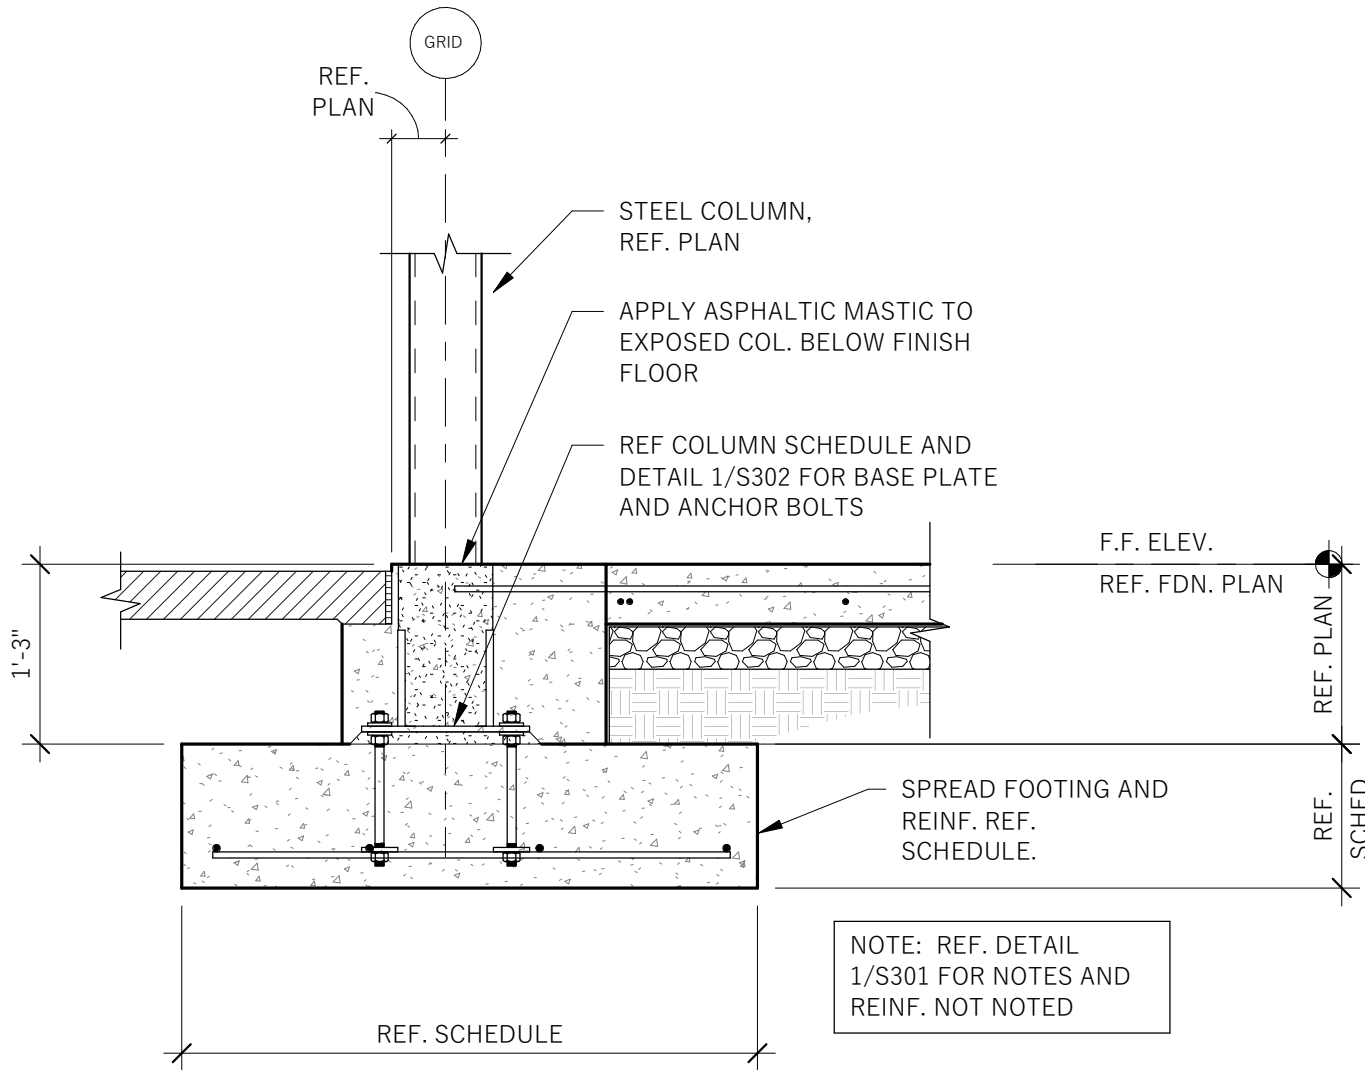


1 TYP PERIMETER COL.
S302 3/4" = 1'-0"

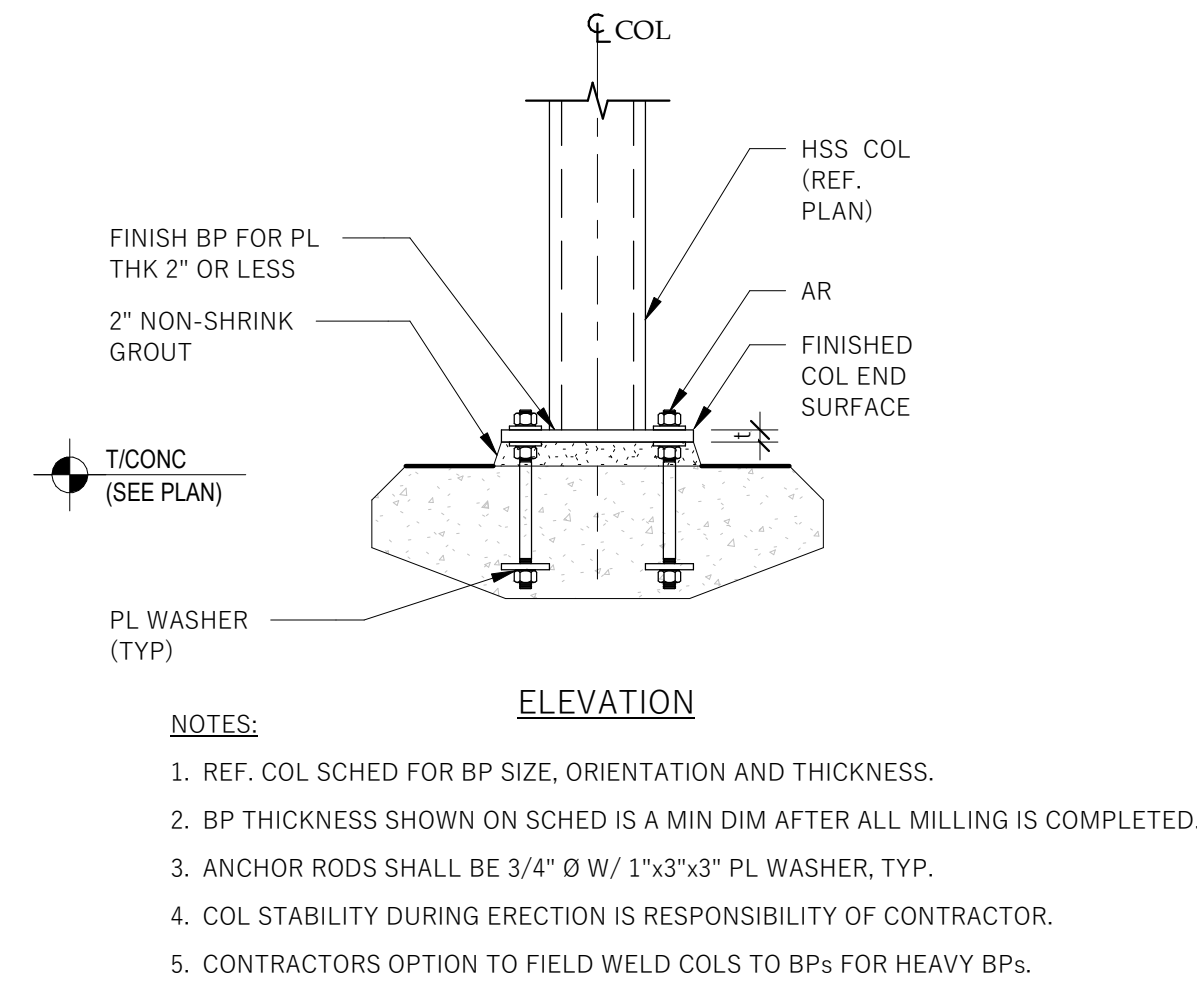


2 TYP BASE PLATE DETAIL
S302 1" = 1'-0"

- NOTES:
1. REF. COL SCHED FOR BP SIZE, ORIENTATION AND THICKNESS.
 2. BP THICKNESS SHOWN ON SCHED IS A MIN DIM AFTER ALL MILLING IS COMPLETED.
 3. ANCHOR RODS SHALL BE 3/4" Ø W/ 1"x3"x3" PL WASHER, TYP.
 4. COL STABILITY DURING ERECTION IS RESPONSIBILITY OF CONTRACTOR.
 5. CONTRACTORS OPTION TO FIELD WELD COLS TO BPs FOR HEAVY BPs.

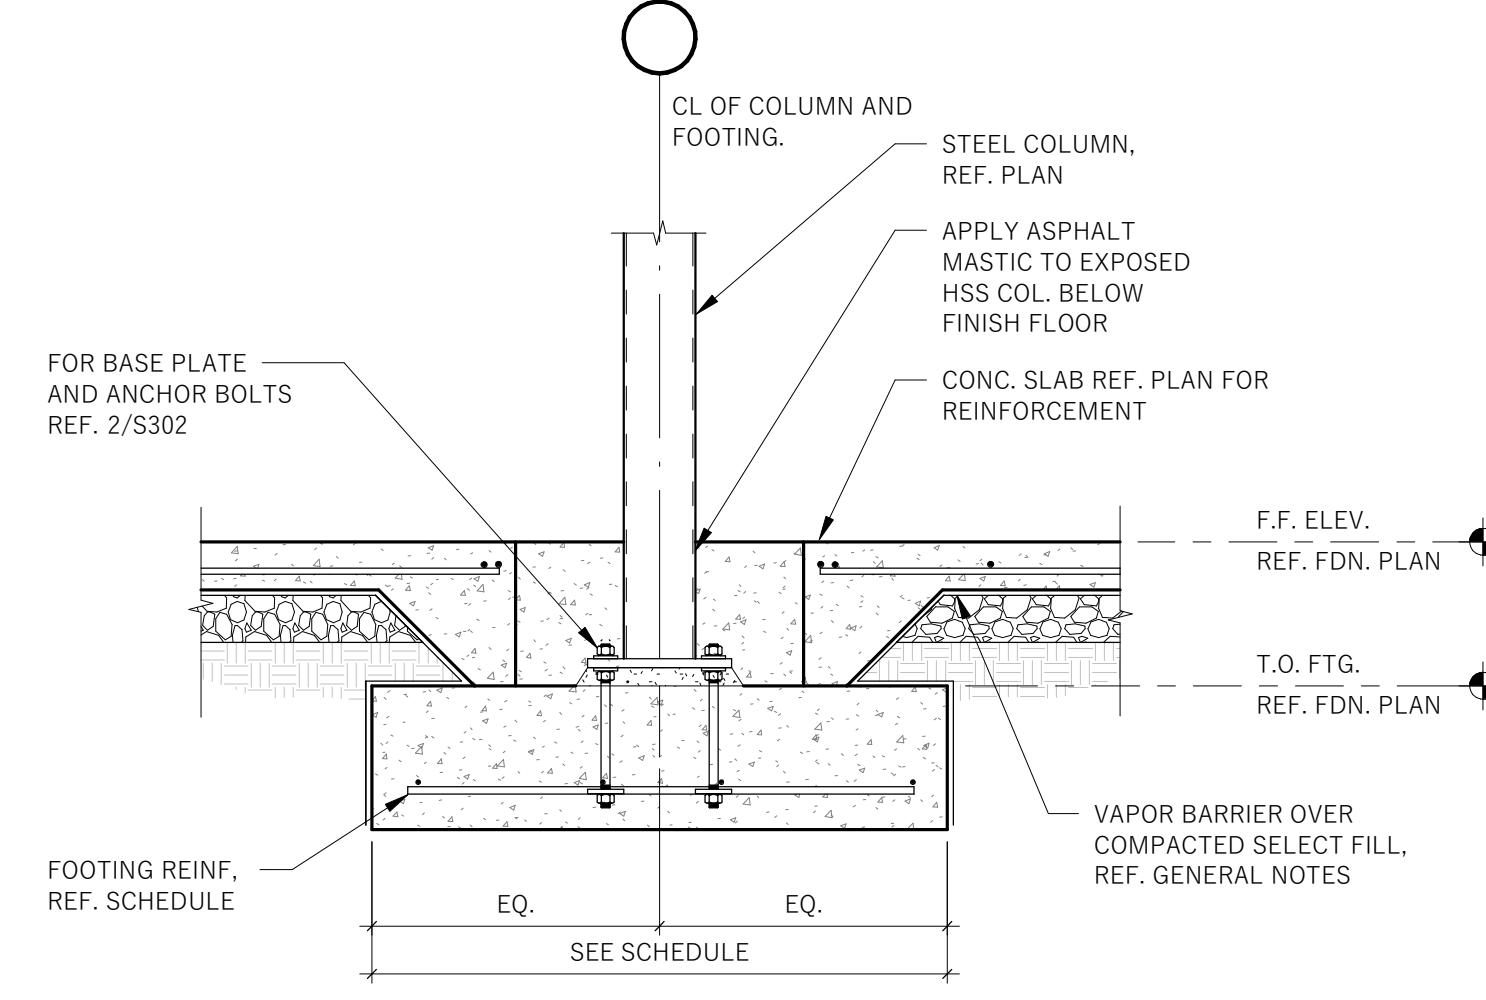


3 SECTION AT INTERIOR COLUMN FOOTING
S302 3/4" = 1'-0"

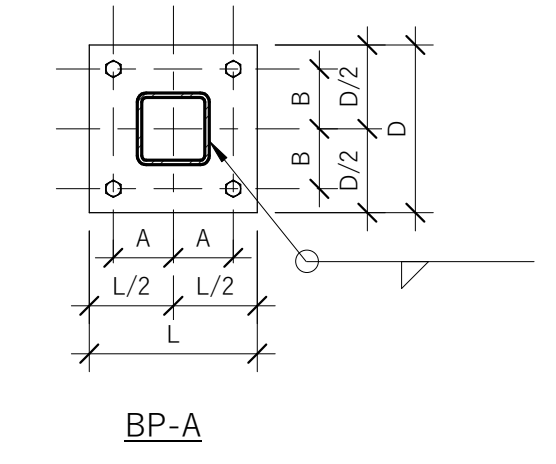


- NOTES:
1. WELD TO BE 1/16" SMALLER THAN THICKNESS OF TUBE.
 2. COLUMN STABILITY DURING ERECTION IS RESPONSIBILITY OF CONTRACTOR.
 3. BASE PLATE THICKNESS SHOWN ON SCHEDULE IS A MIN. DIMENSION AFTER ALL MILLING IS COMPLETED.
 4. ANCHOR RODS HAVE 1"x3"x3" PLATE WASHER, TYP.

4 BASE PLATE SCHEDULE
S302 3/4" = 1'-0"

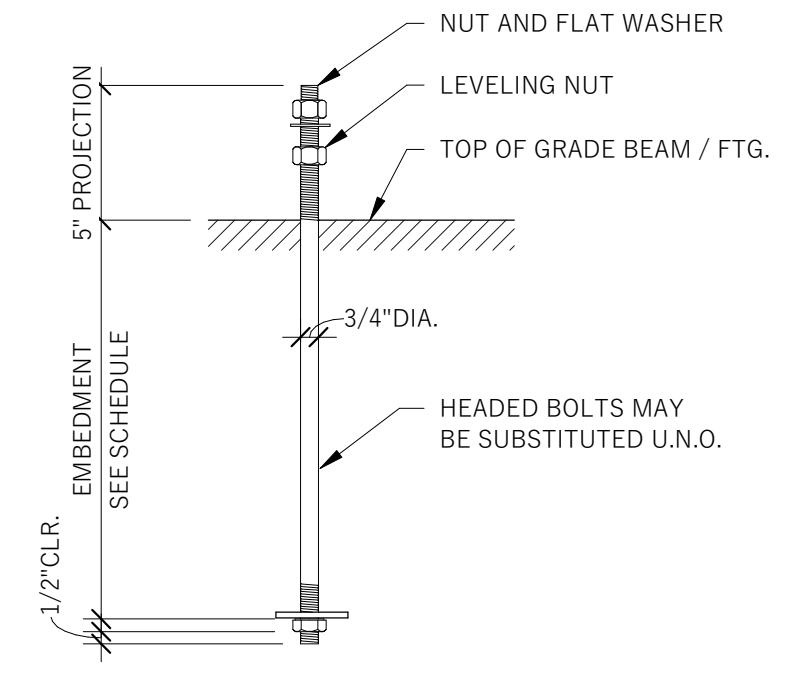

5 TYPICAL ANCHOR BOLT DIAGRAM
S302 1 1/2" = 1'-0"

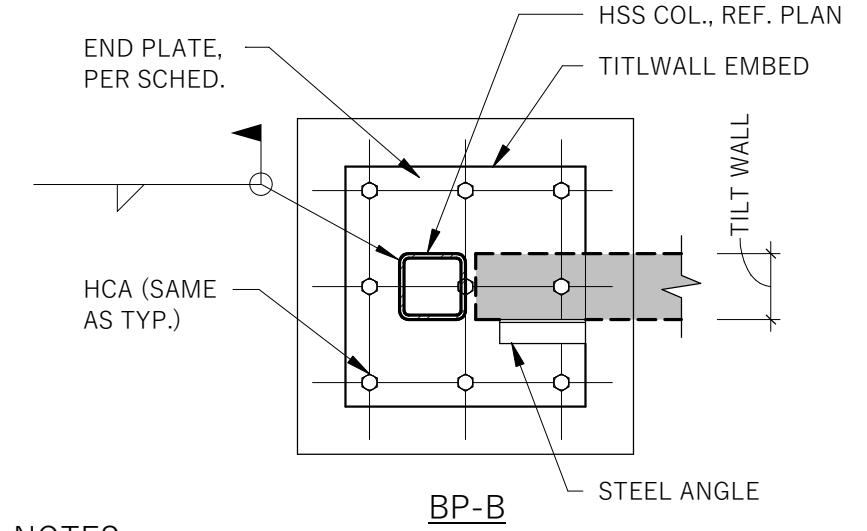


6 END PLATE DETAIL
S302 3/4" = 1'-0"

- NOTES:
1. WELD TO BE 1/16" SMALLER THAN THICKNESS OF TUBE.
 2. COLUMN STABILITY DURING ERECTION IS RESPONSIBILITY OF CONTRACTOR.
 3. BASE PLATE THICKNESS SHOWN ON SCHEDULE IS A MIN. DIMENSION AFTER ALL MILLING IS COMPLETED.
 4. ANCHOR RODS HAVE 1"x3"x3" PLATE WASHER, TYP.

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.


REVISION:
2 06/20/22 REV 2

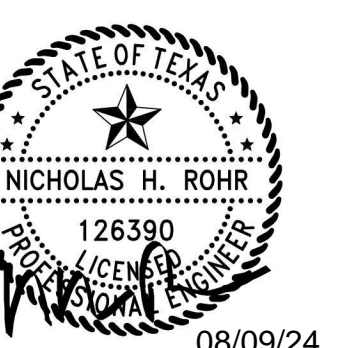


09/09/2024
100% CDS-REV 05-VE
FOUNDATION DETAILS

SHEET: **S302**

NOTE:
 PROVIDE ONE OF THE FOLLOWING SLIP DOWELS:
 - PNA CONSTRUCTION TECHNOLOGIES 1/4" x 4 1/2" x 4 1/2" "DIAMOND DOWEL"
 PLATE DOWEL SYSTEM.
 - GREENSTRAK 5/8" DIA. SMOOTH x 24" "SPEED DOWEL" SYSTEM.
 - 1/2" DIA. x 2'-0" A36 SMOOTH ROD.

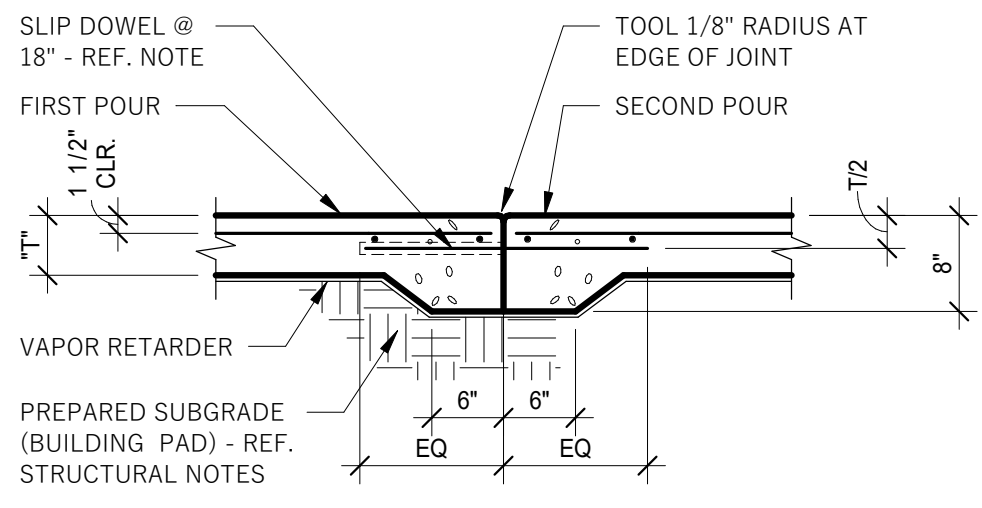


CONSTRUCTION JOINT

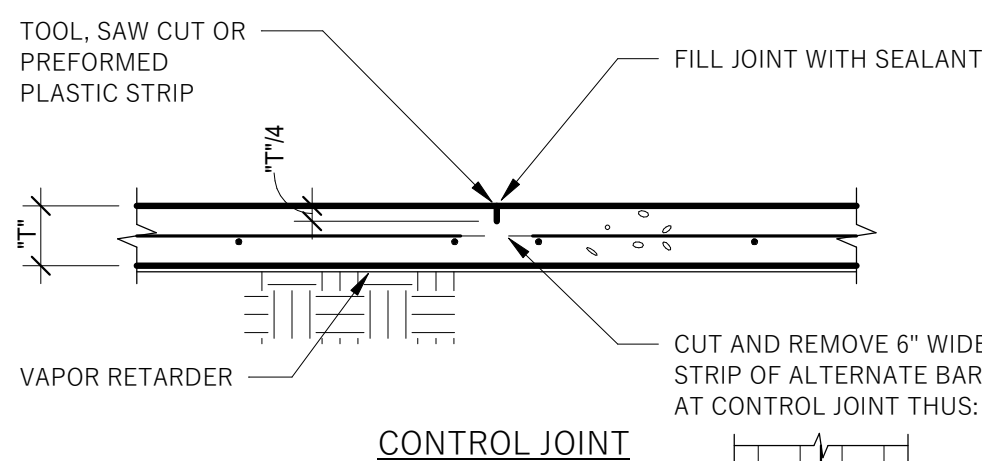


CONTROL JOINT

CONTROL JOINT

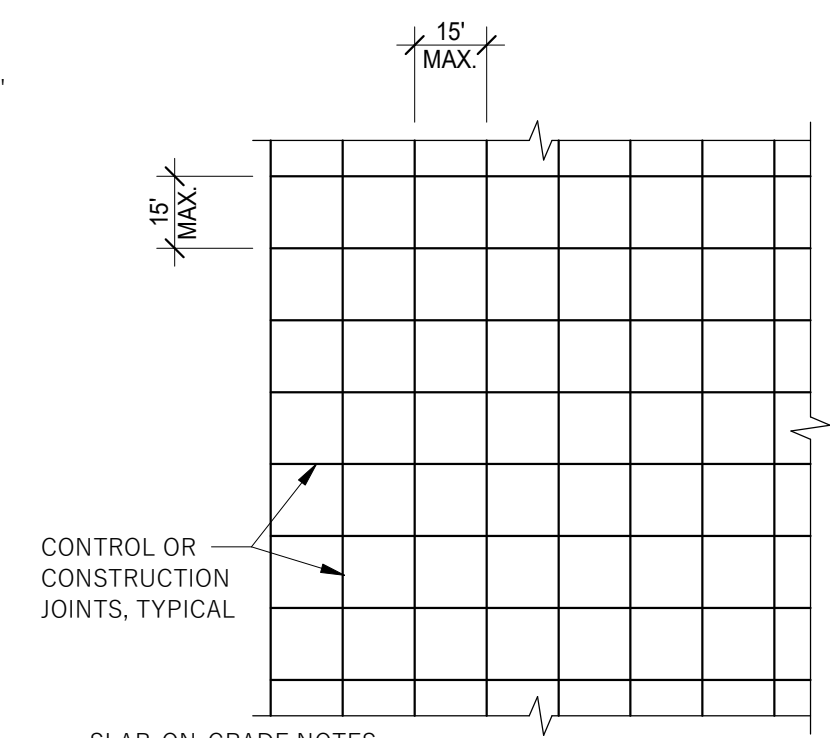


SLAB-ON-GRADE NOTES:


- REF. PLAN FOR THICKNESS OF SLAB (T) AND REINFORCING.
- SAWCUT JOINTS WITH IN THE TIME FRAME NOTED BELOW:
 - 12 HOURS FOR SLABS COVERED BY FINISHES OR NON-PUBLIC SPACES.
 - 4 HOUR FOR SLABS EXPOSED TO PUBLIC VIEW OR WHERE NOTED "SOFF-CUT" BRAND SAW SHALL BE USED.
- IF METAL FORMS ARE USED, REMOVE THEM BEFORE PLACING ADJACENT SLAB.
- FOR SLABS WITH THICKNESS (T) GREATER THAN 6", THICKENED EDGES ARE NOT REQUIRED AT JOINTS.
- PROVIDE A CONSTRUCTION OR A CONTROL JOINT ON THE CENTERLINES OF COLUMNS.
- LAP REINFORCING 38 BAR DIAMETER MINIMUM.

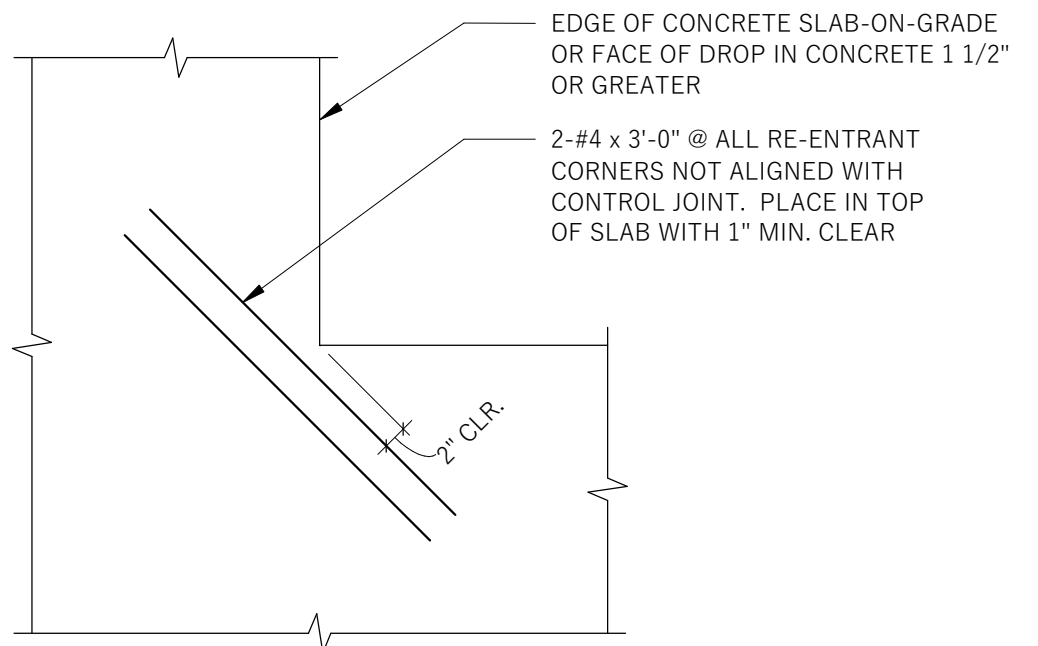


TYPICAL RE-ENTRANT CORNER REINF. DETAIL

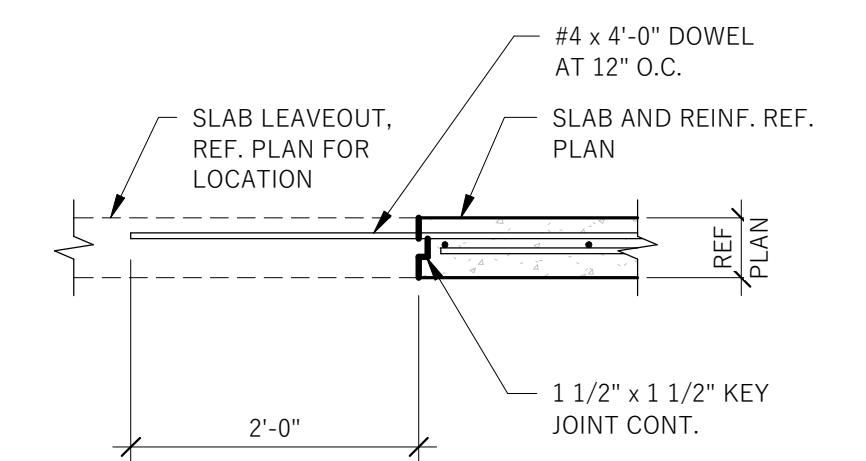

SLAB LEAVE OUT DETAIL

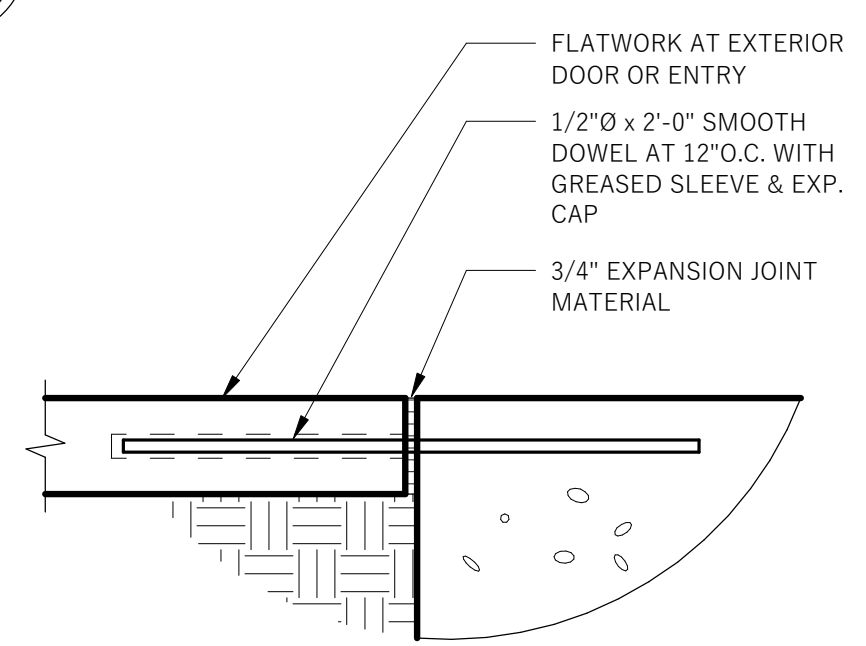

TYP FLATWORK AT EXTERIOR DOORS AND ENTRIES DETAIL

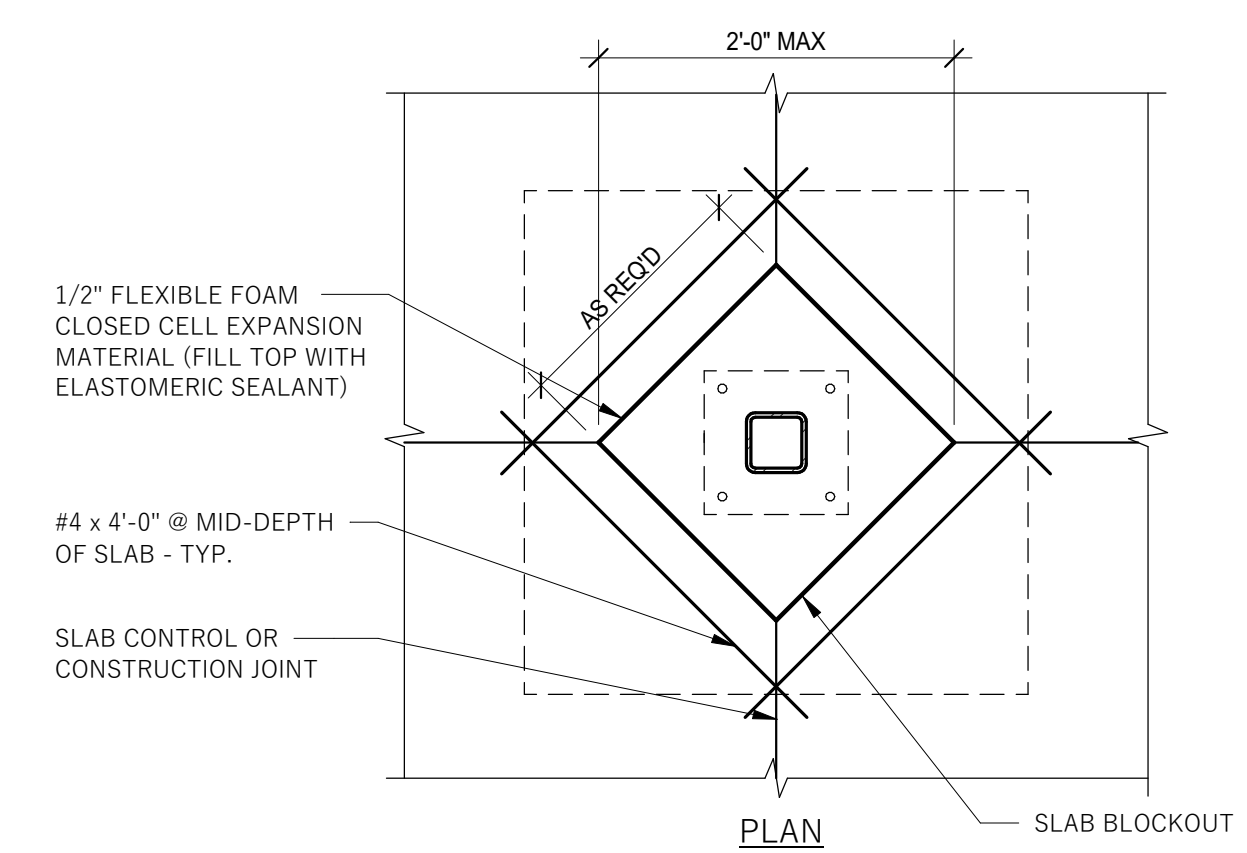


TYPICAL INTERIOR COLUMN BLOCKOUT DETAIL

1 TYPICAL SLAB-ON-GRADE DETAIL
S303 3/4" = 1'-0"

2 TYPICAL RE-ENTRANT CORNER REINF. DETAIL
S303 3/4" = 1'-0"

4 TYP FLATWORK AT EXTERIOR DOORS AND ENTRIES DETAIL
S303 1 1/2" = 1'-0"


5 TYPICAL INTERIOR COLUMN BLOCKOUT DETAIL
S303 3/4" = 1'-0"

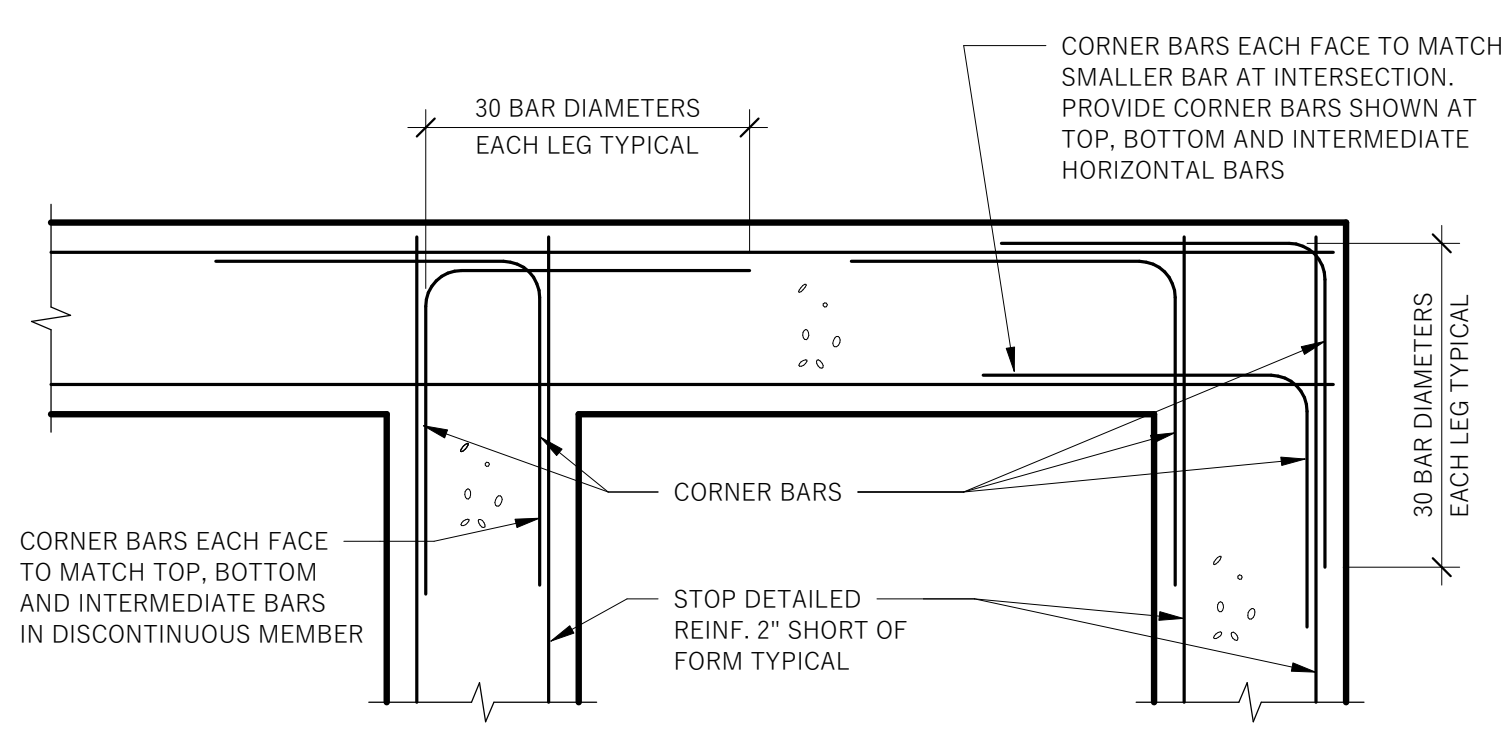


NOTES:

- MATCH SIZE, LOCATION AND NUMBER OF HORIZONTAL BEAM AND WALL BARS, EXCEPT THAT WHERE THERE ARE MORE THAN 2 TOP OR BOTTOM BARS, ONLY THE INSIDE AND OUTSIDE BARS MUST BE MATCHED.
- WHERE 90 DEGREE HOOKS ARE PROVIDED FOR TOP BARS CORNER BARS MAY BE OMITTED AT TOP. WHERE 90 DEGREE HOOKS ARE PROVIDED FOR BOTTOM BARS, CORNER BARS MAY BE OMITTED AT BOTTOM.


6 TYPICAL CORNER BARS AT WALL OR GRADE BEAM INTERSECTION DETAIL
S303 3/4" = 1'-0"

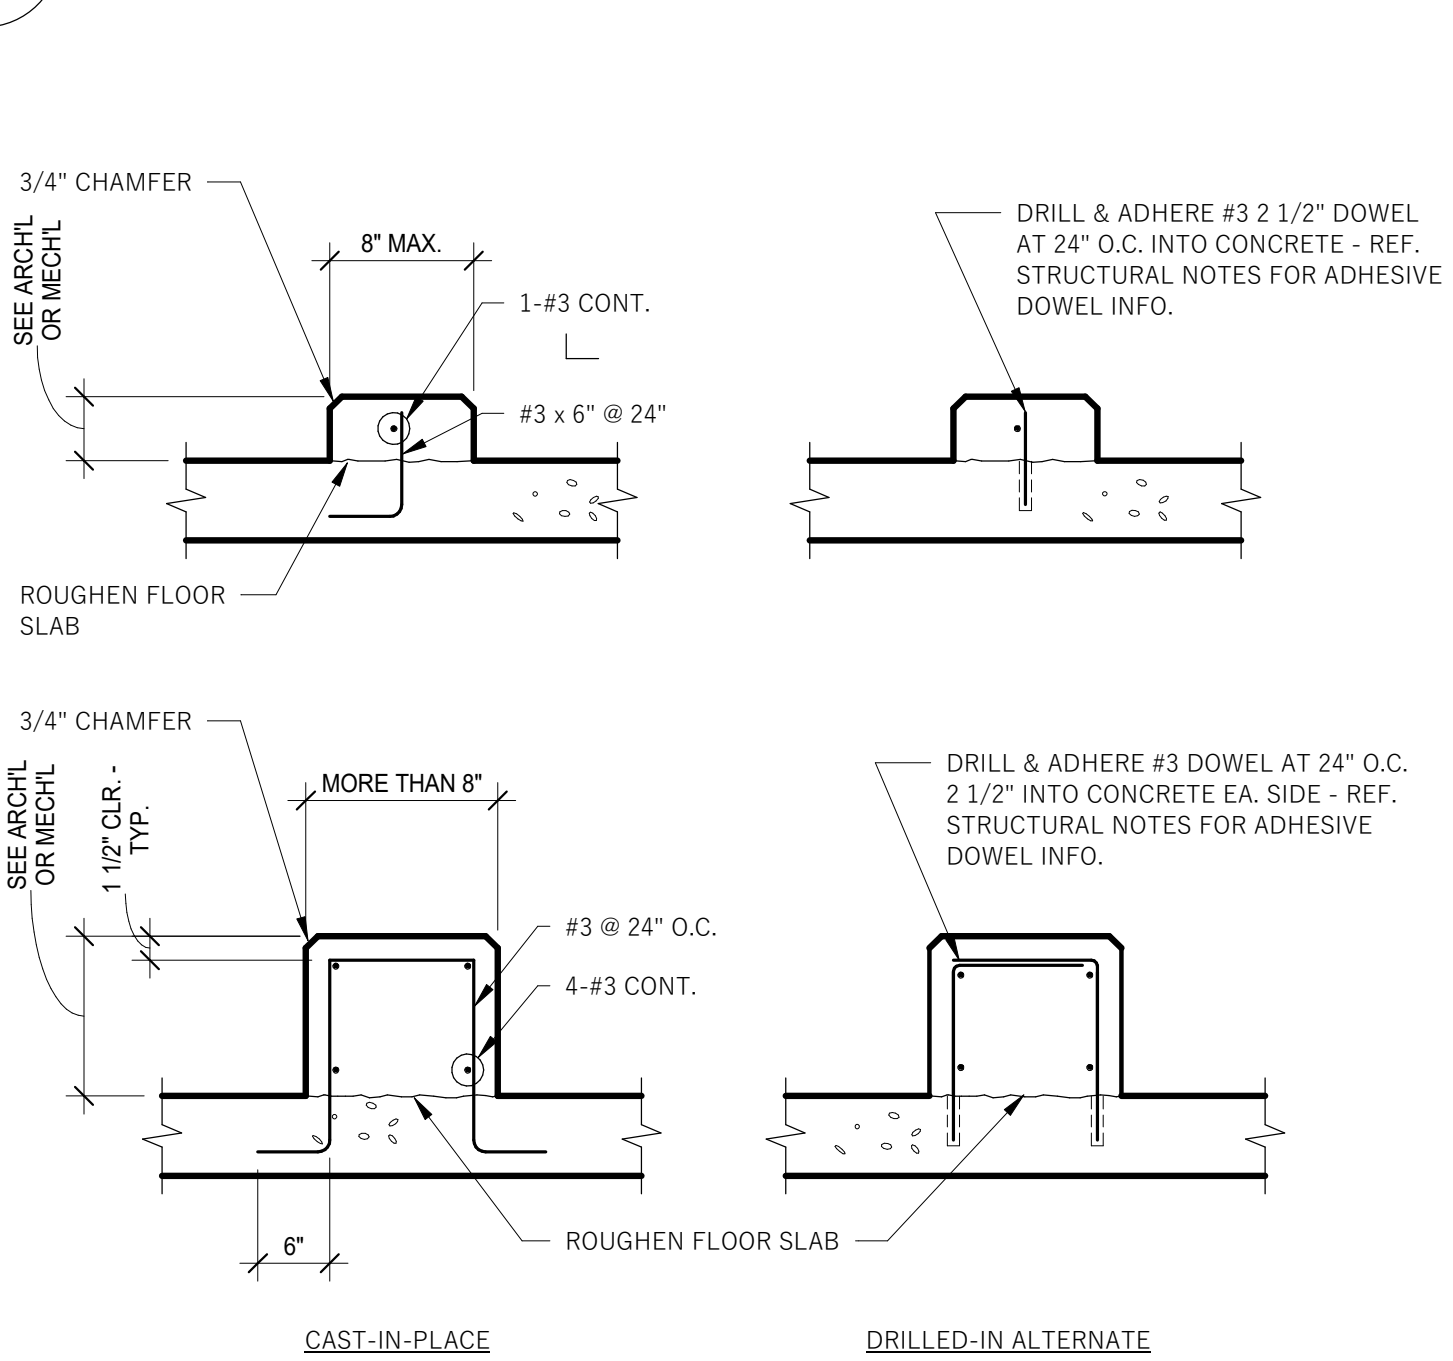


7 TYPICAL CONCRETE CURB DETAILS
S303 3/4" = 1'-0"

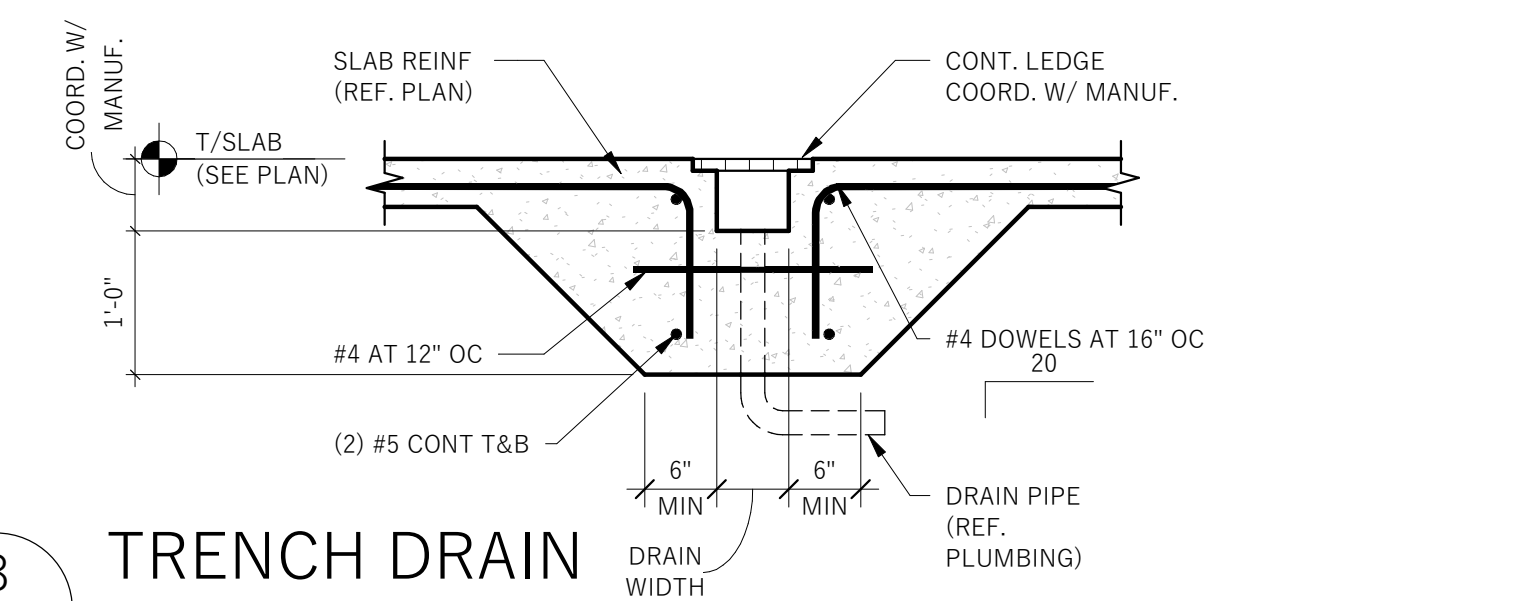

8 TRENCH DRAIN
S303 3/4" = 1'-0"

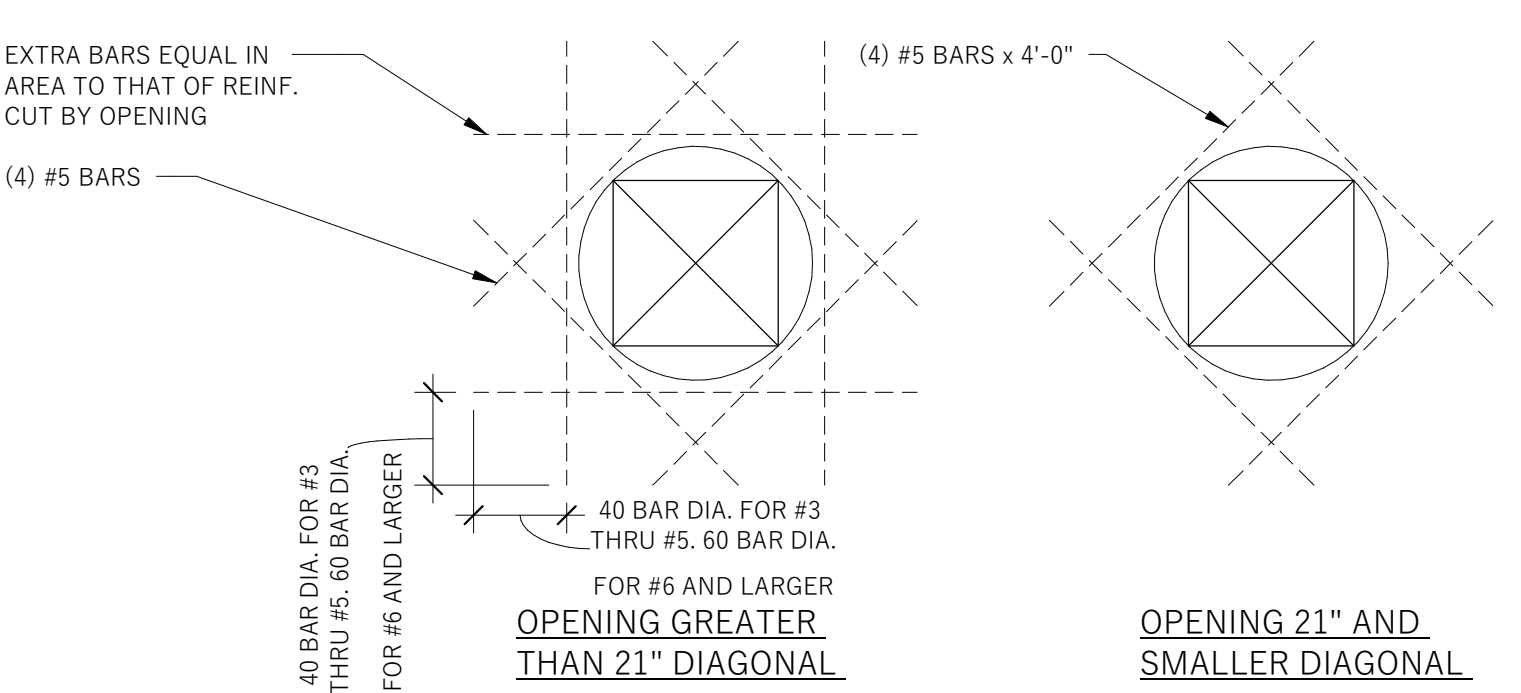

9 TYP. REINFORCING AT CONCRETE OPENINGS
S303 3/4" = 1'-0"

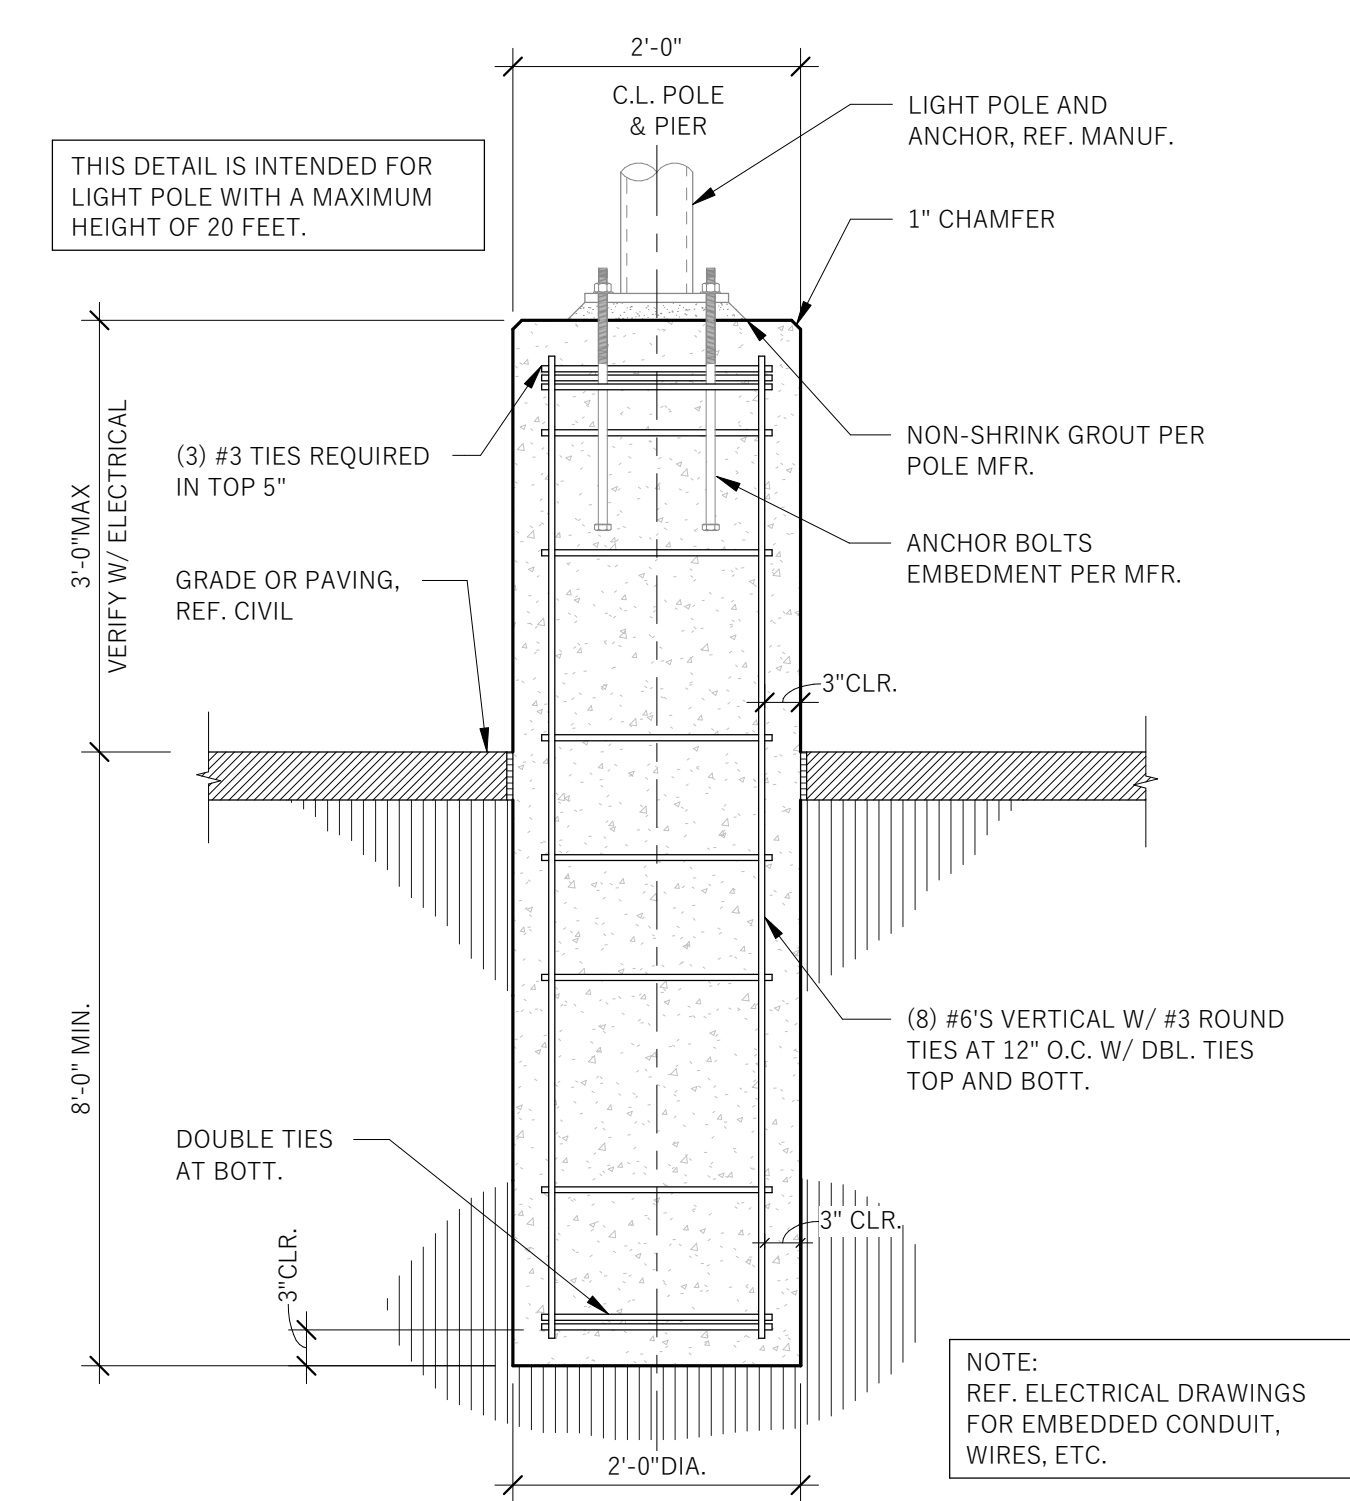

10 TYP. LIGHT STANDARD DETAIL
S303 3/4" = 1'-0"

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
THESE DESIGN DRAWINGS ARE THE SOLE
PROPERTY OF ALIGN ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM,
BY ANY METHOD, FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
2 06/20/22 REV 2
5 08/09/24 VE




08/09/2024
100% CDS-REV05-VE
BUILDING SECTIONS


SHEET: **S401**

PROJECT NO: 21099
DRAWN BY: BC
DATE: 01/28/2022
PROJECT MGR: NHR


JCA
4100 Wadsworth Blvd
Wheat Ridge, CO 80033
p 303.985.3260
TX F-14436 #21134

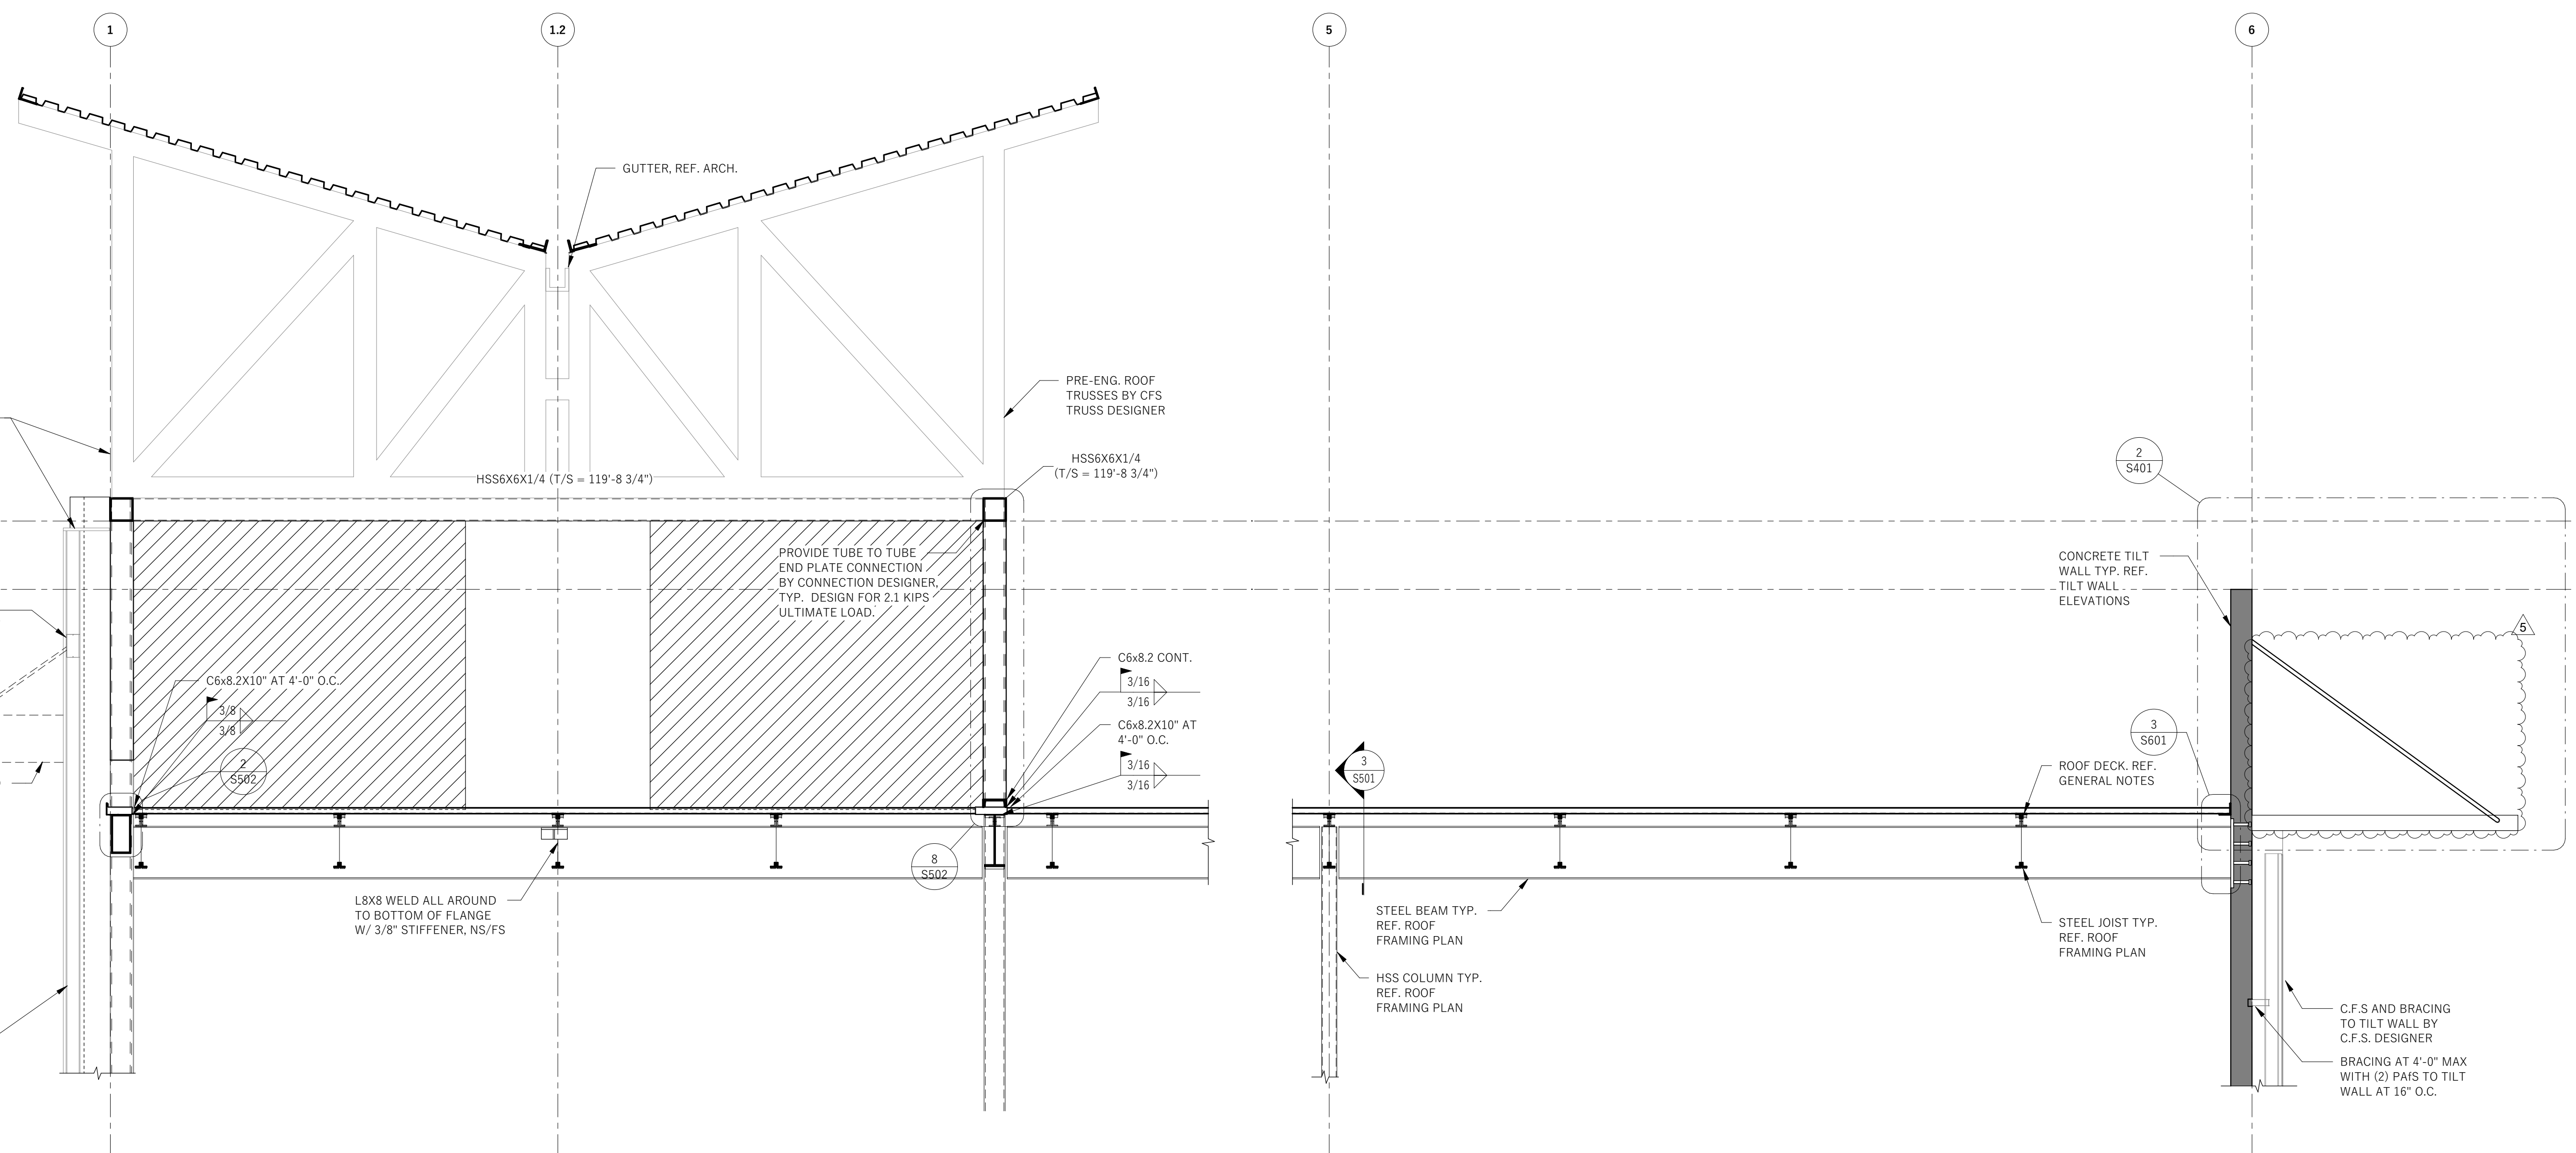


1
S401
1/2" = 1'-0"

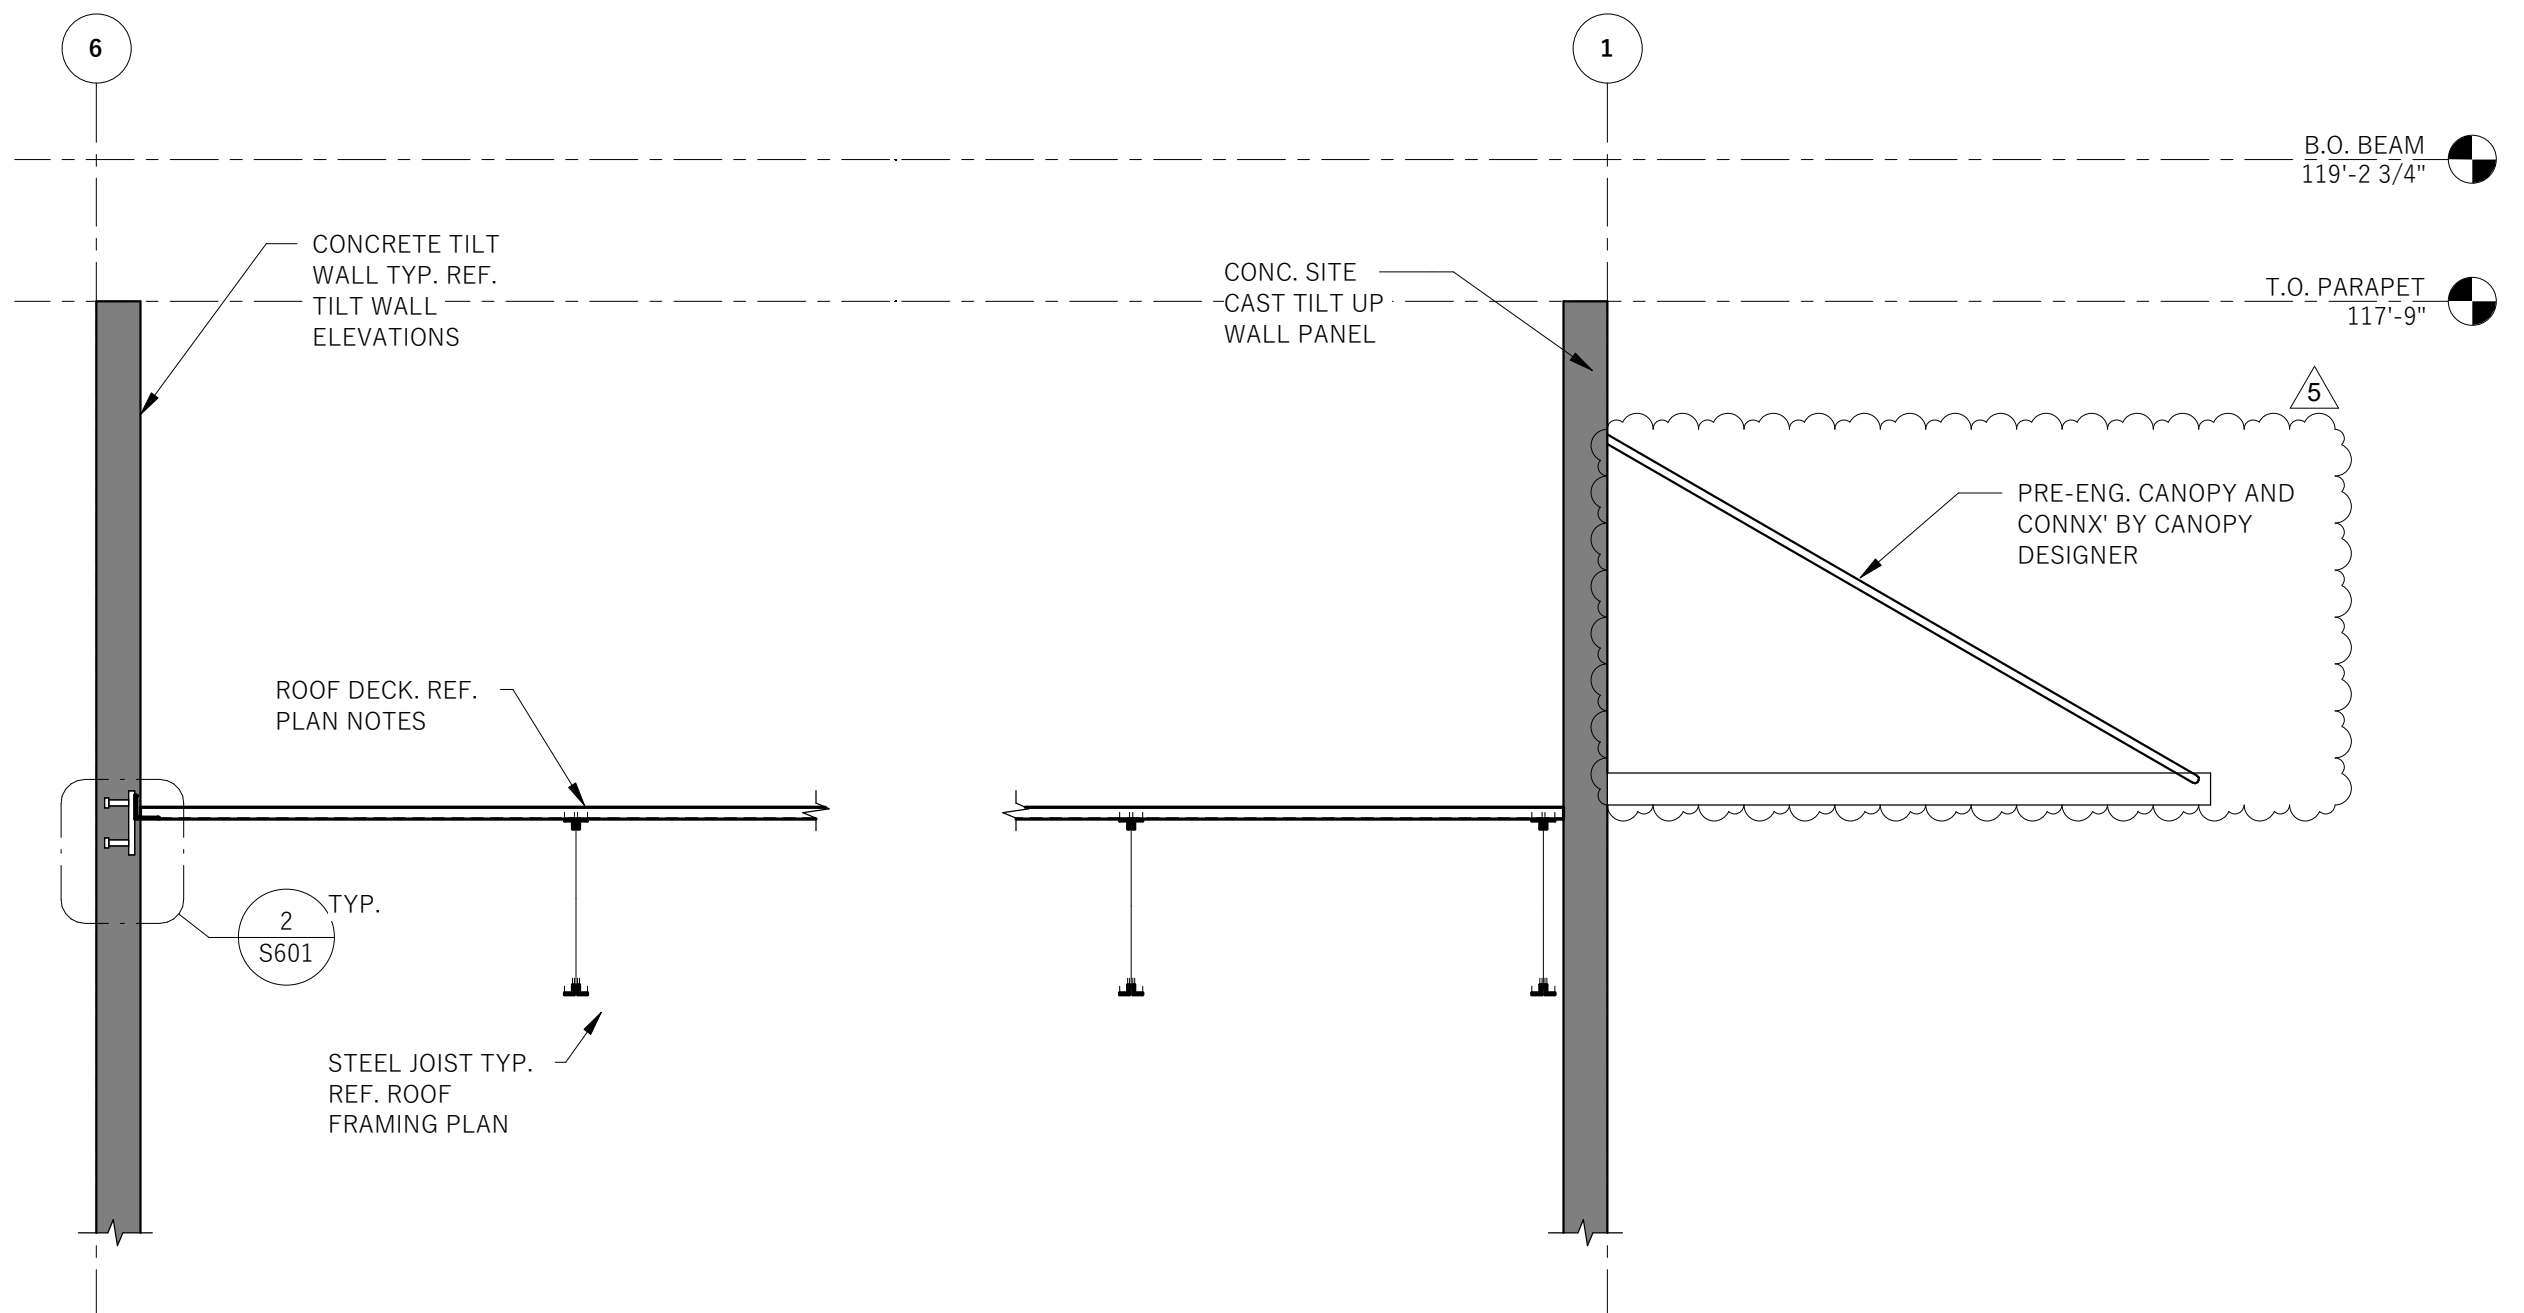


2
S401
1/2" = 1'-0"

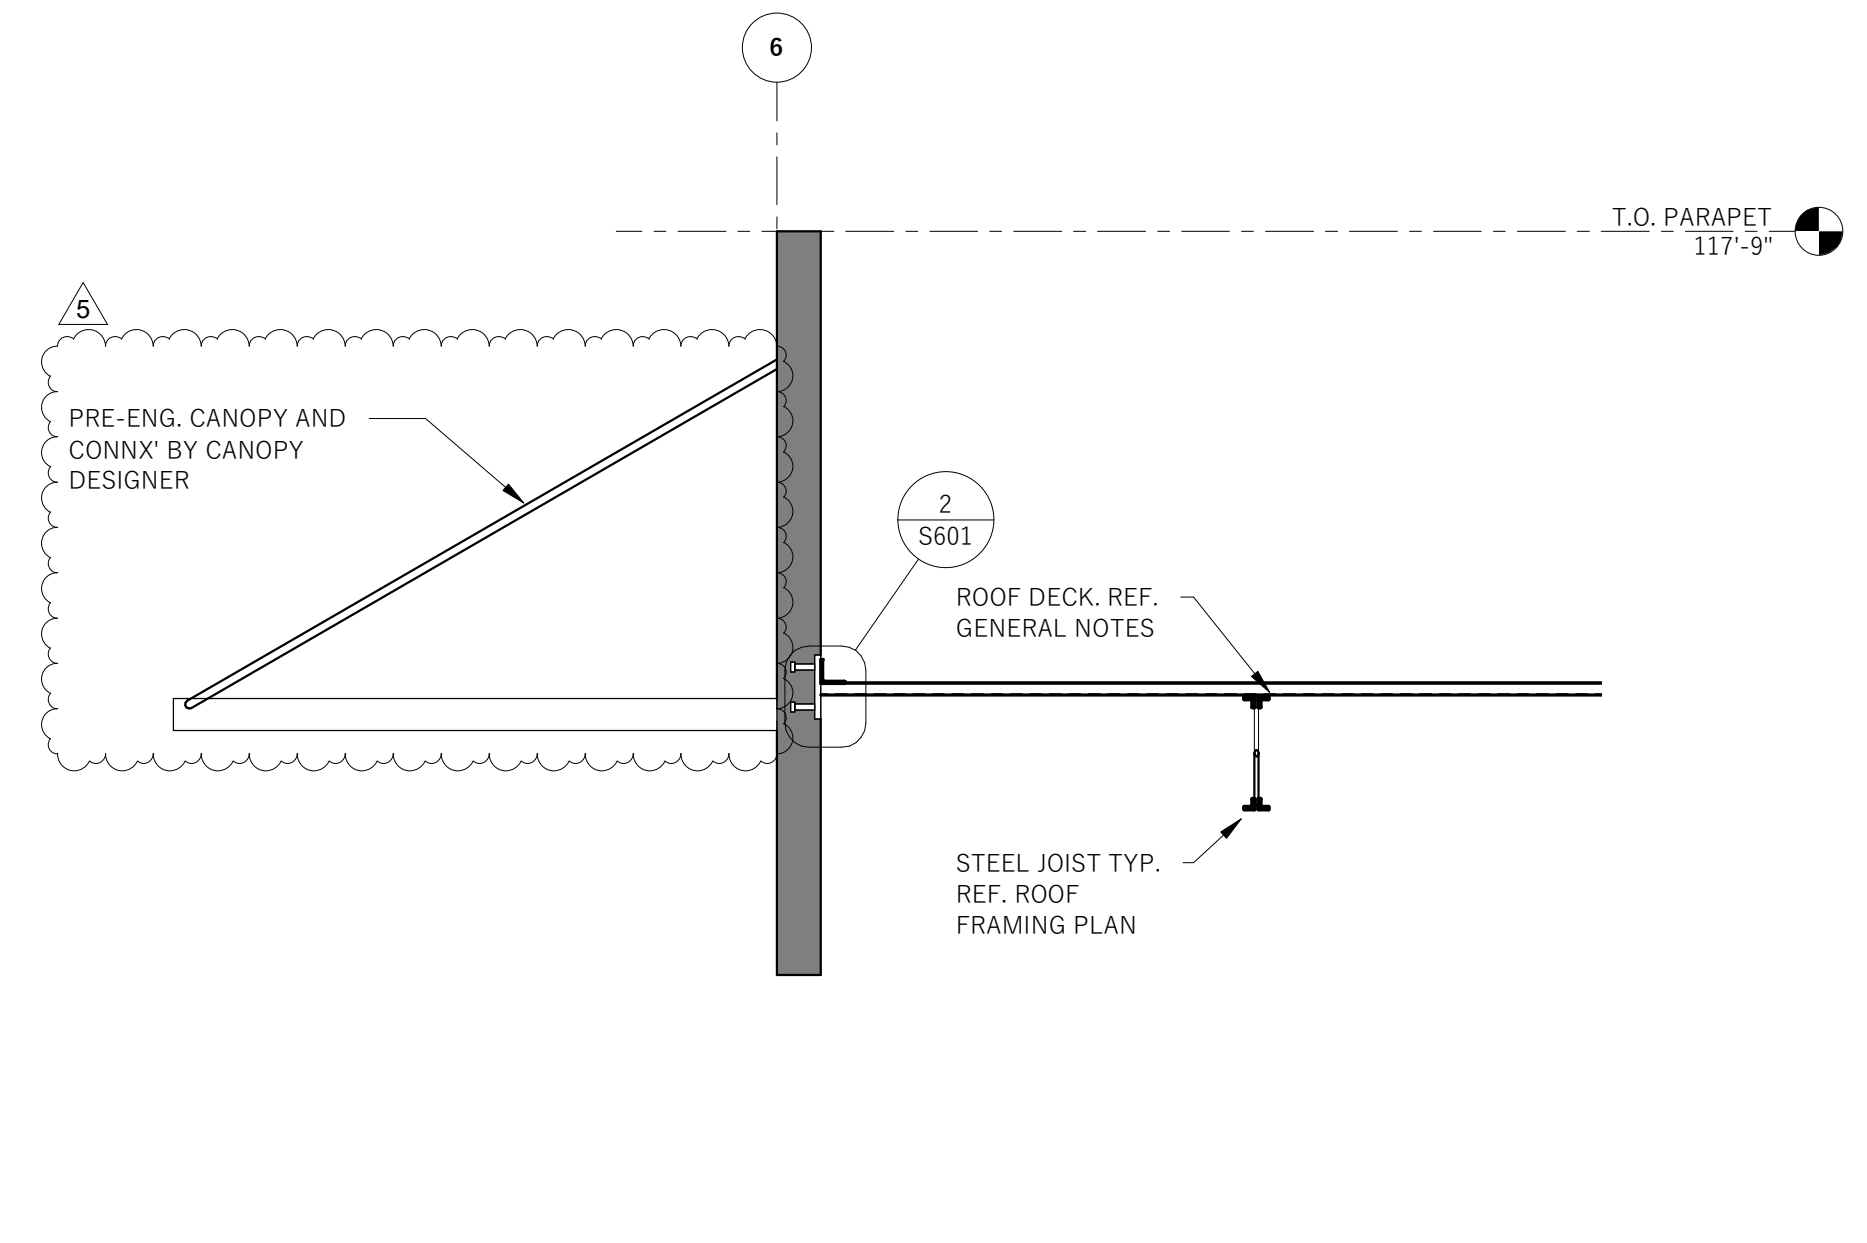


3
S401
1/2" = 1'-0"

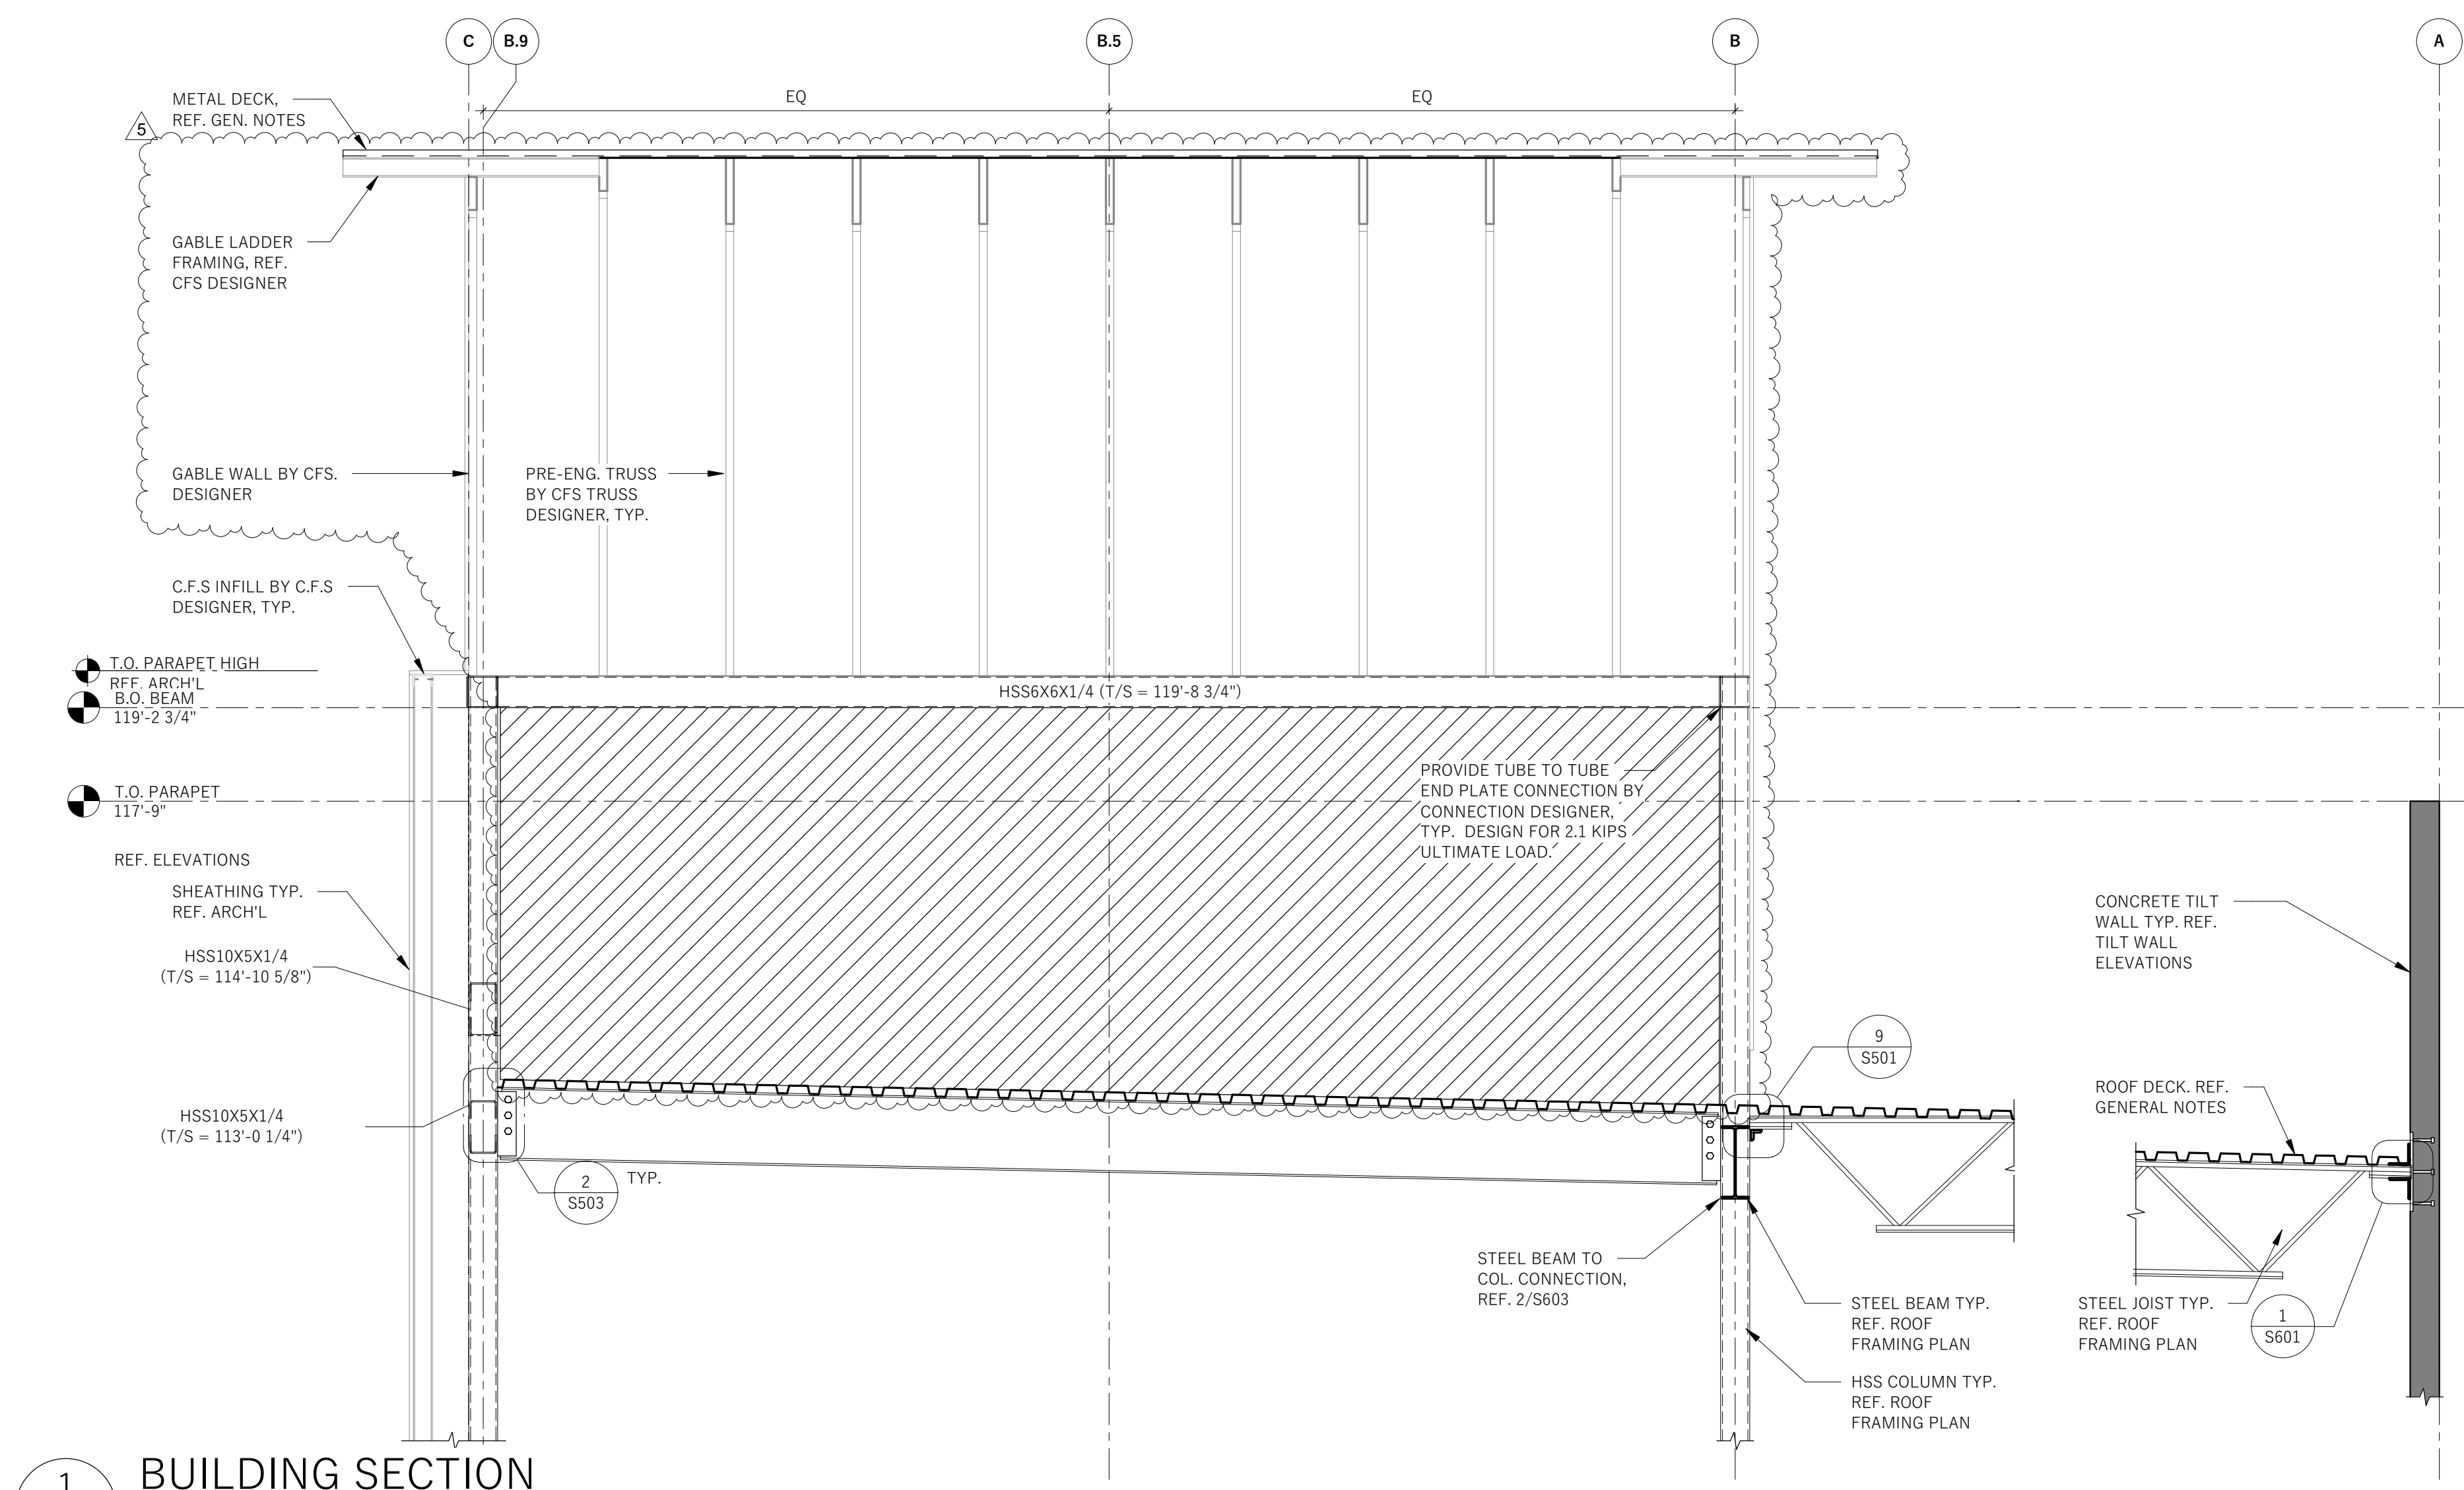


1 BUILDING SECTION
S402 1/2" = 1'-0"

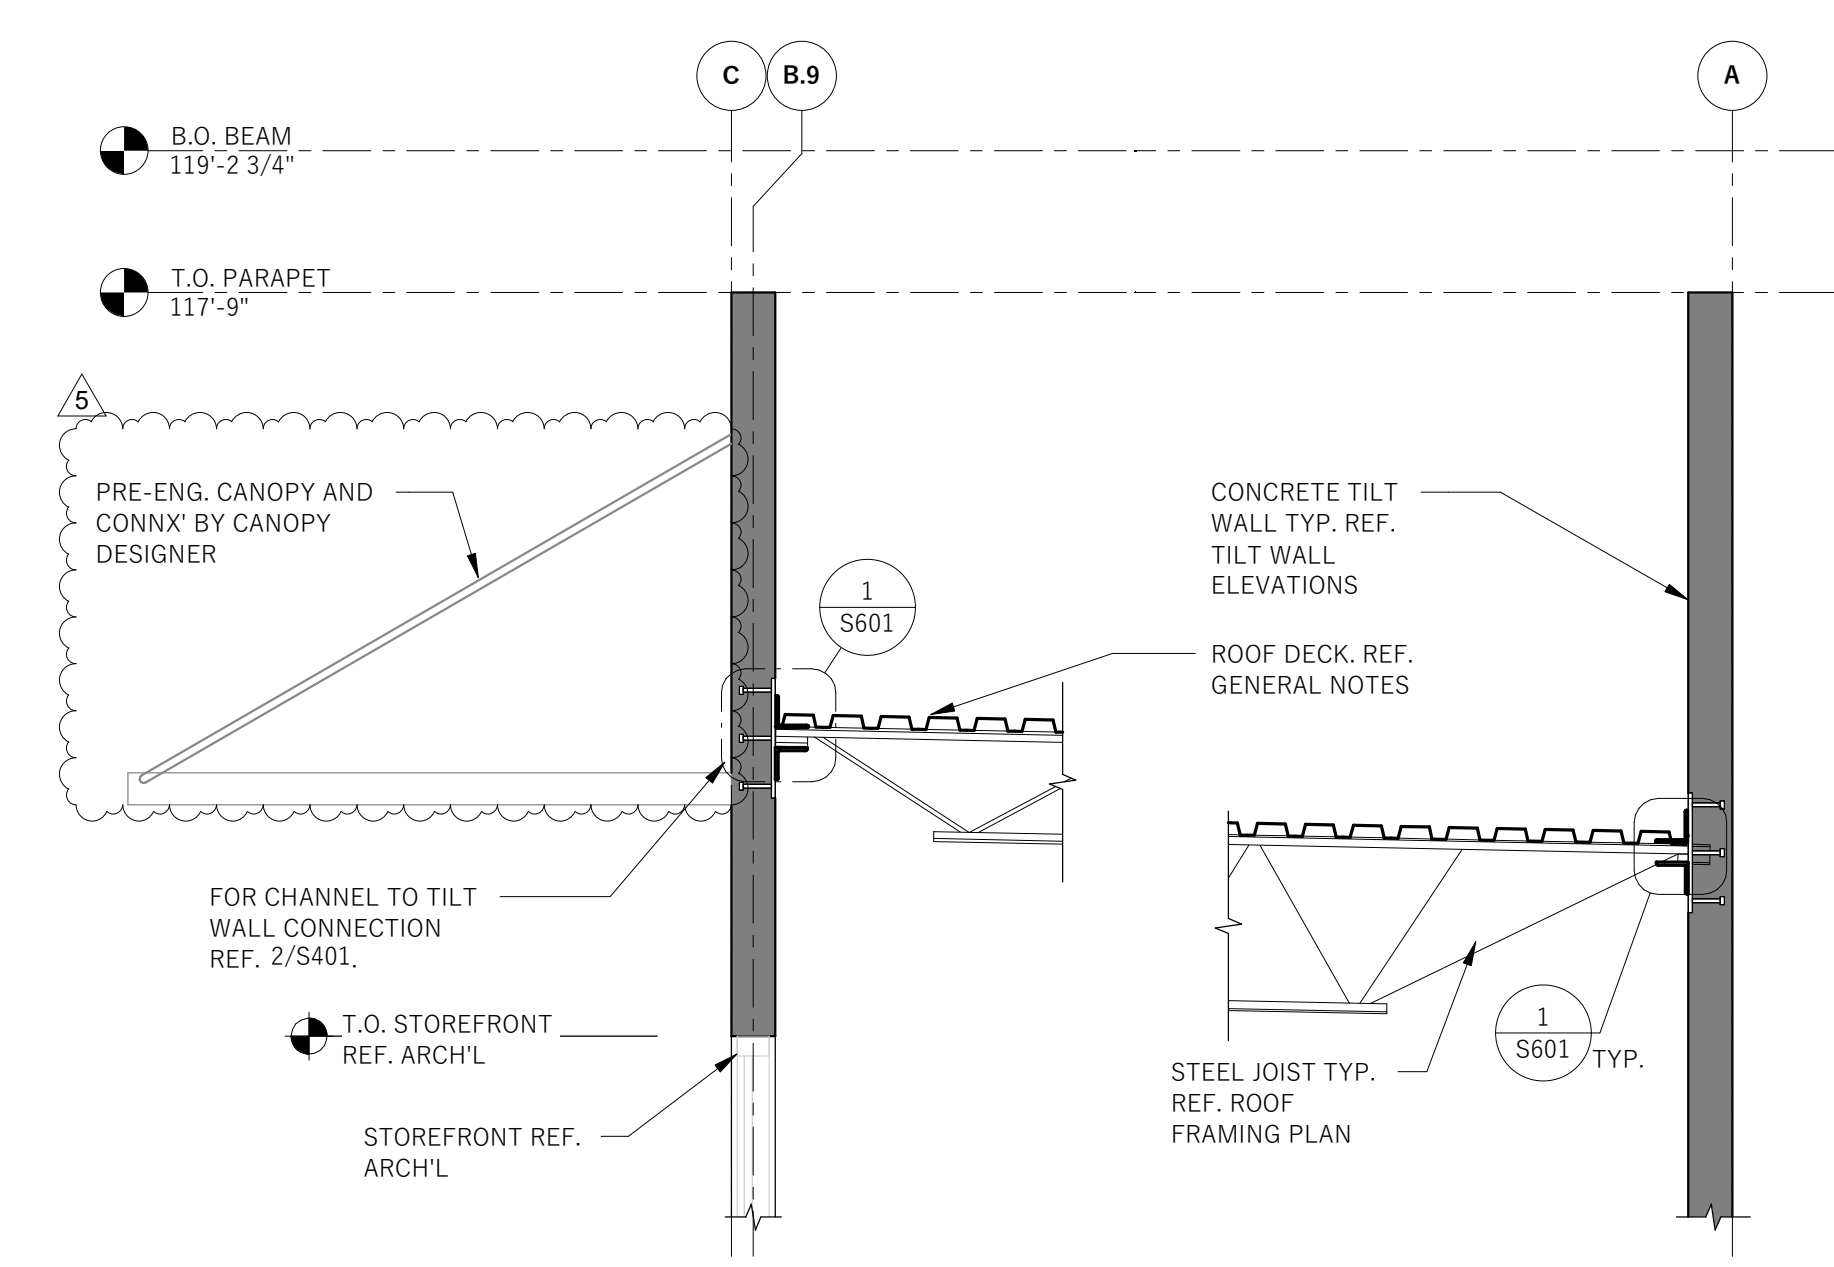

2 BUILDING SECTION
S402 1/2" = 1'-0"

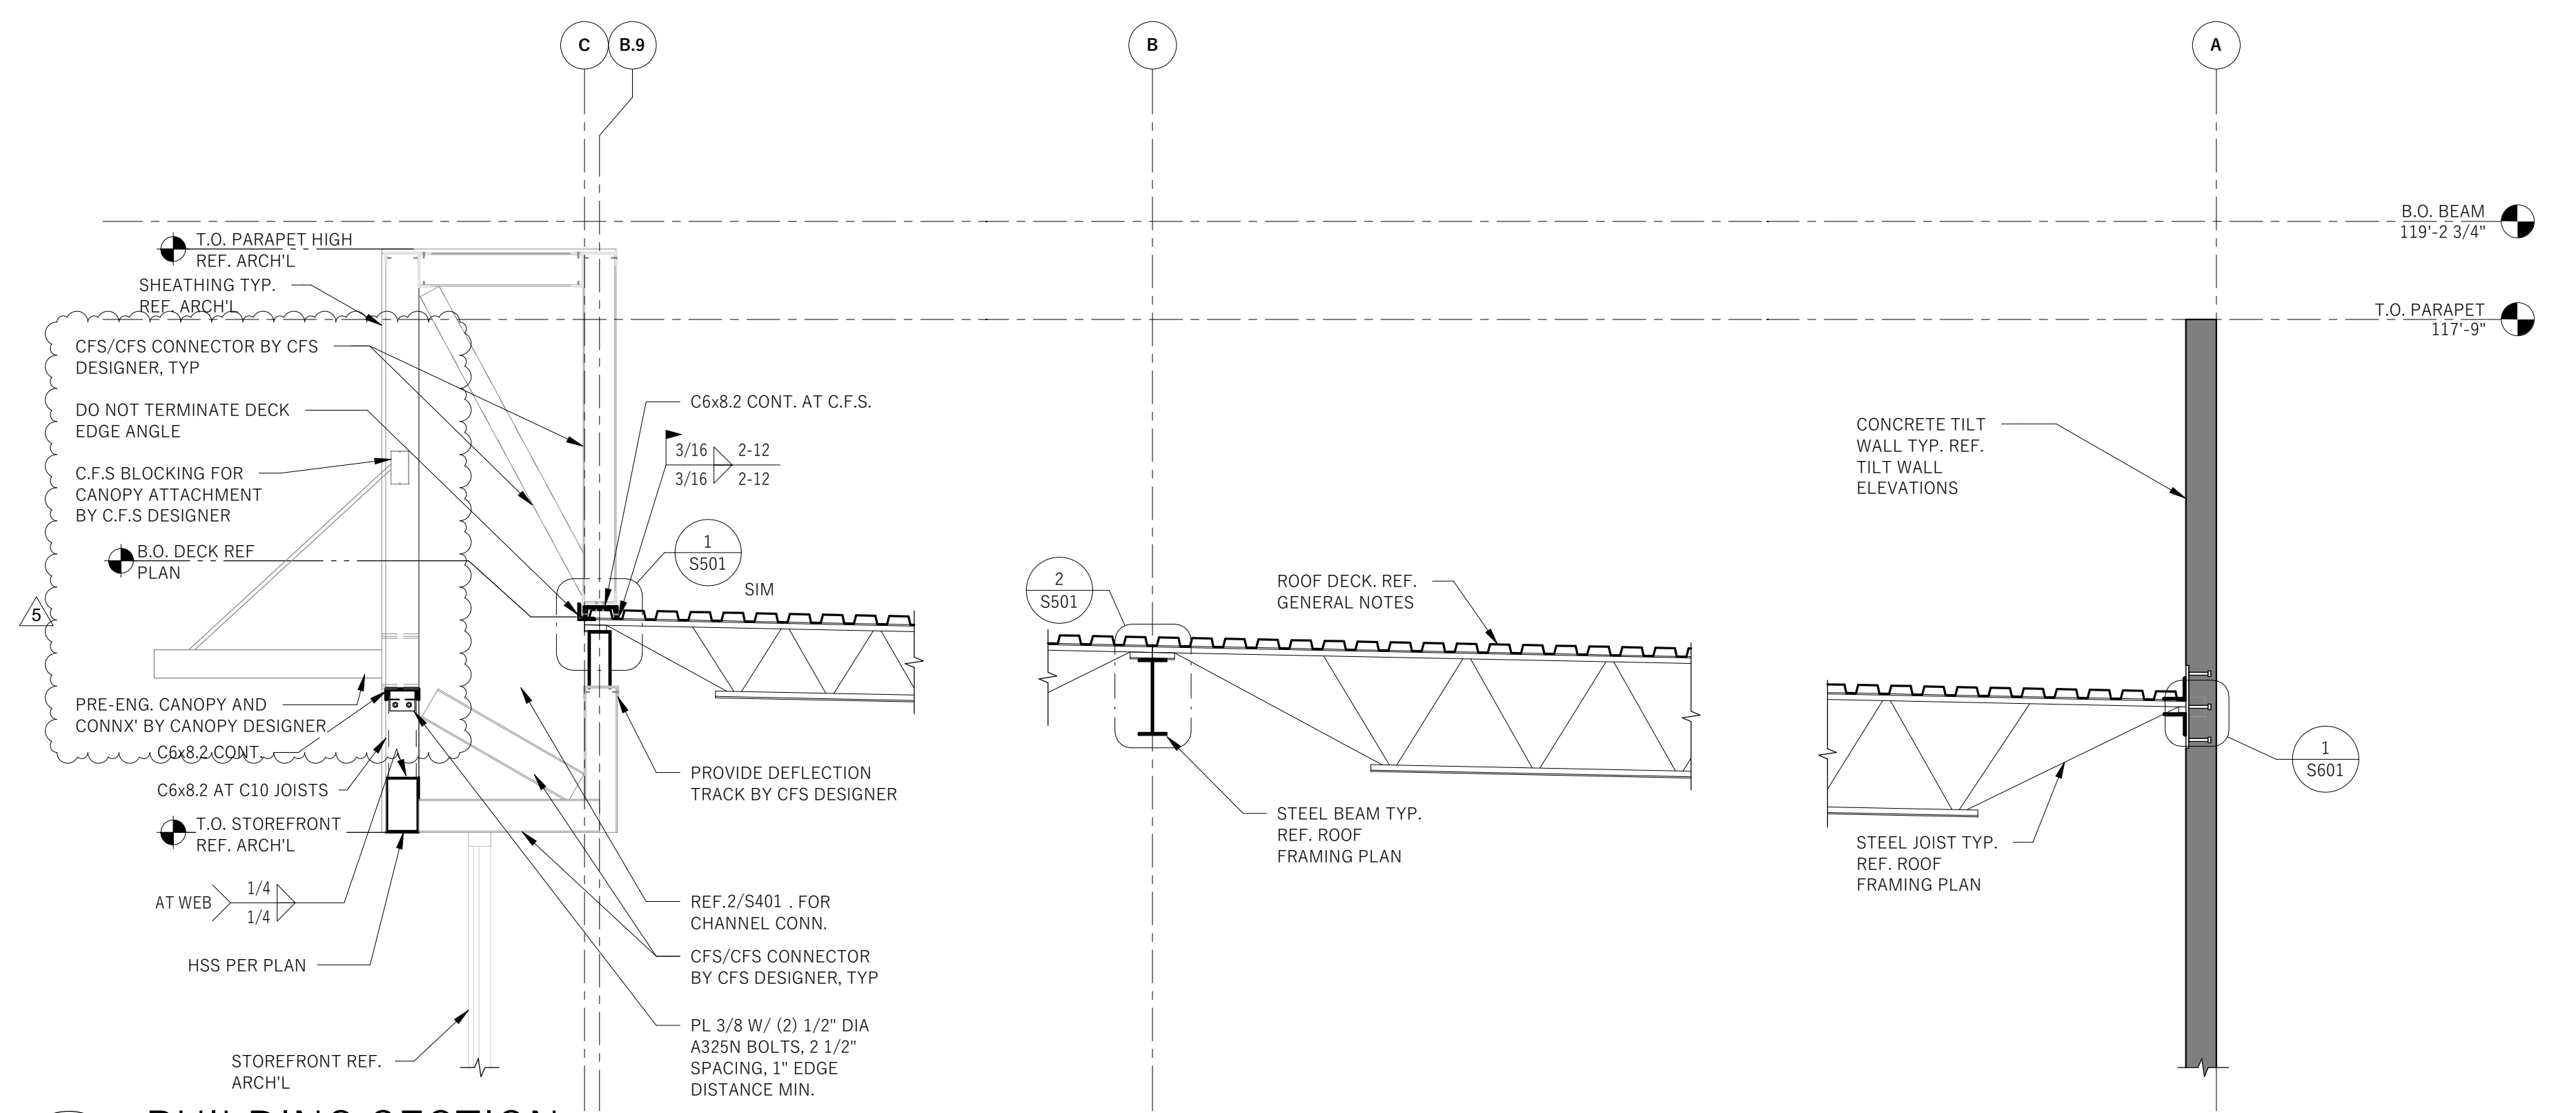

3 BUILDING SECTION
S402 1/2" = 1'-0"

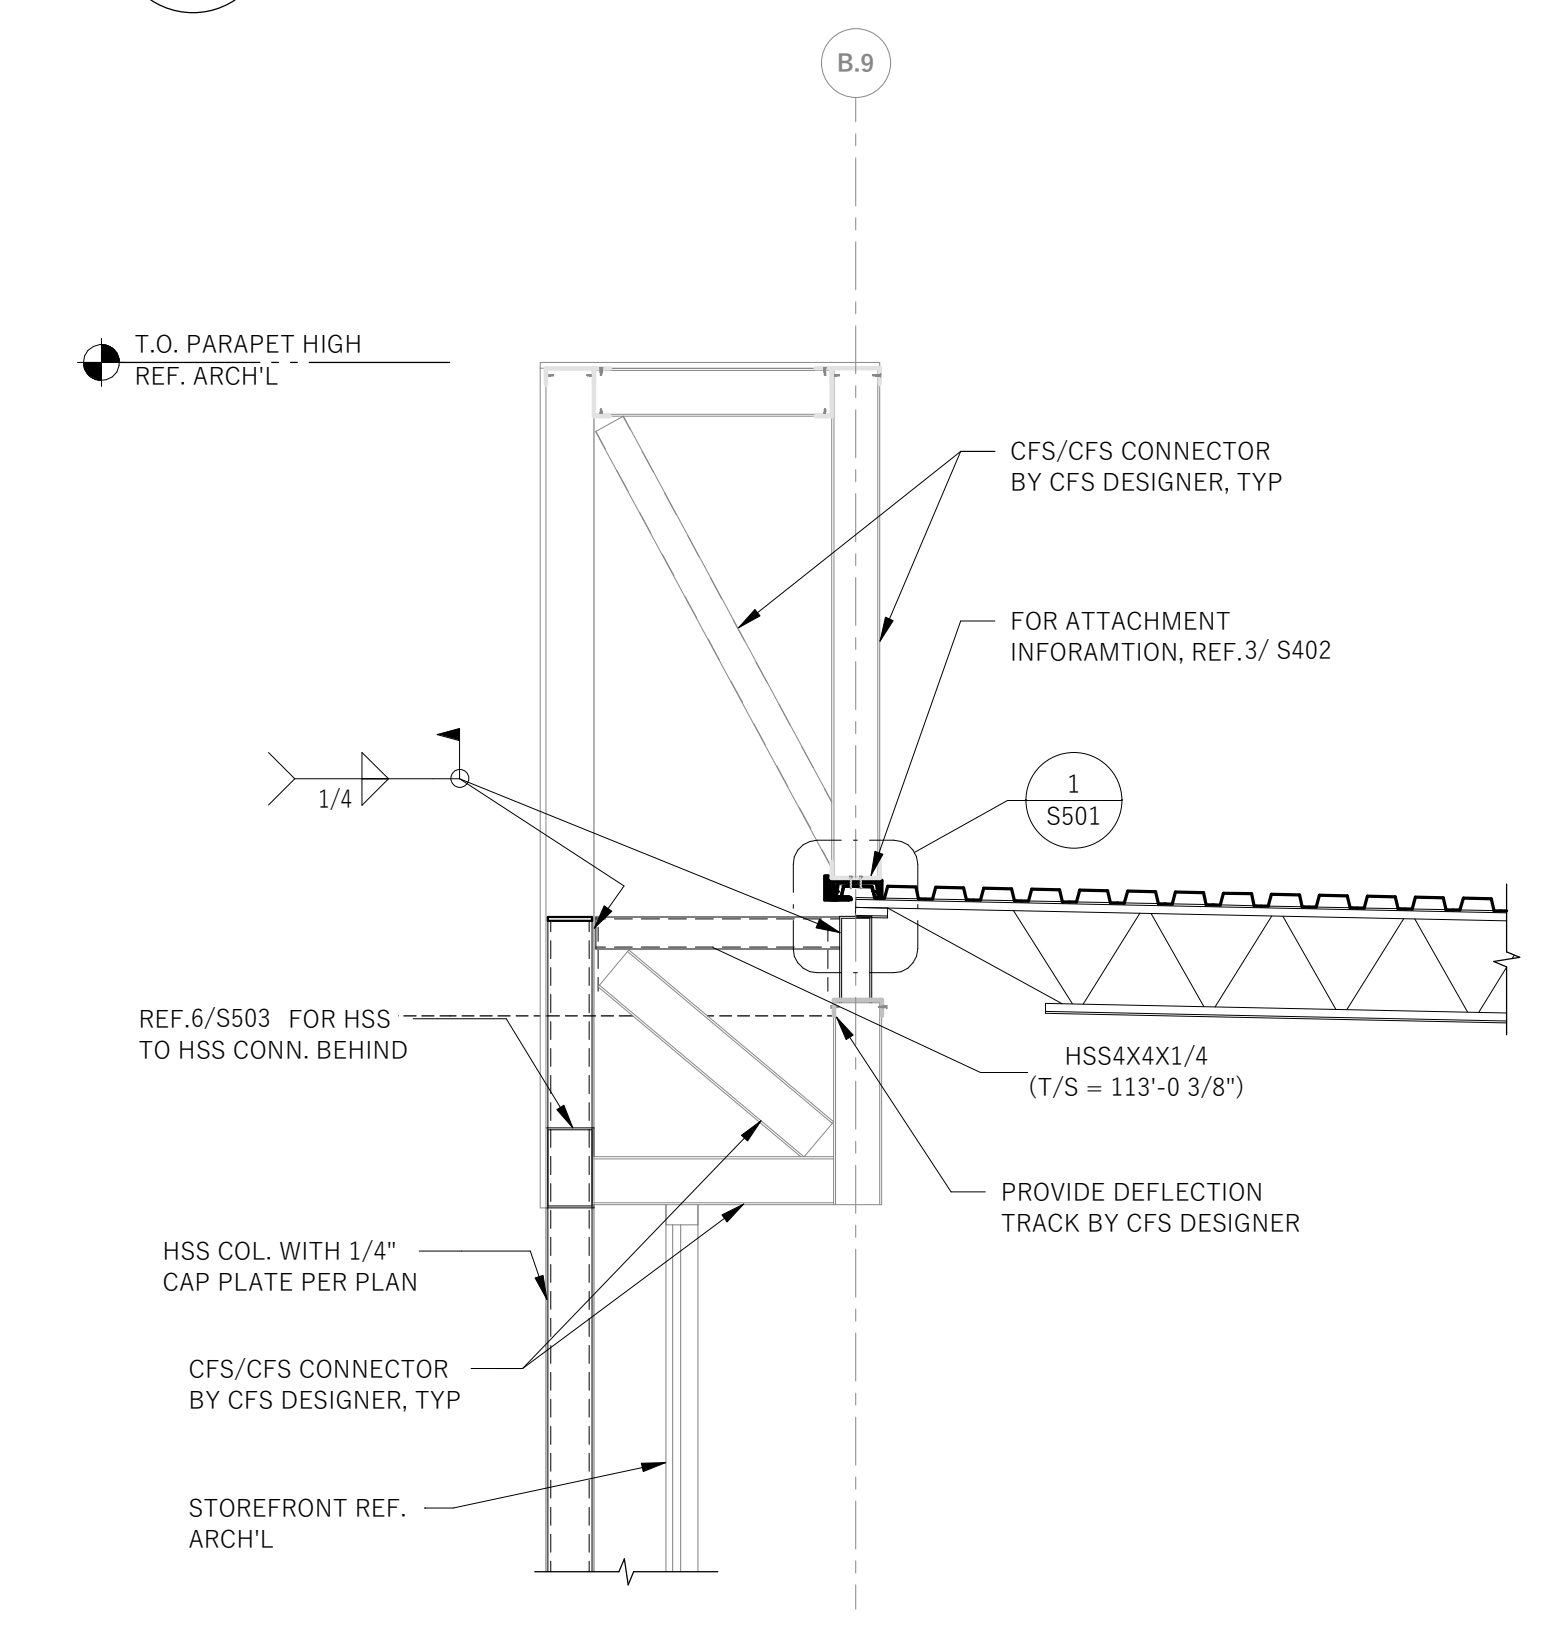

4 BUILDING SECTION
S402 1/2" = 1'-0"

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S BAGDAD ROAD BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE
PROPERTY OF ALIGN ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM,
BY ANY METHOD, FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
2 06/20/22 REV 2
5 08/09/24 VE



08/09/2024
100% CDS-REV/05-VE
BUILDING SECTIONS

SHEET: **S402**

COPYRIGHT © 2024. ALL RIGHTS RESERVED.
 THESE DESIGNS/DRAWINGS ARE THE SOLE
 PROPERTY OF ALIGN AUSTIN ARCHITECTS
 AND MAY NOT BE REPRODUCED IN ANY FORM,
 BY ANY METHOD, FOR ANY PURPOSE
 WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:



2	06/20/22	REV 2
5	08/09/24	VE




08/09/2024
 100% CDS-REV 05-VE
 HIGH ROOF SECTIONS

SHEET: **S403**


PROJECT NO: 21099
 DRAWN BY: BC
 DATE: 01/28/2022
 PROJECT MGR: NHR

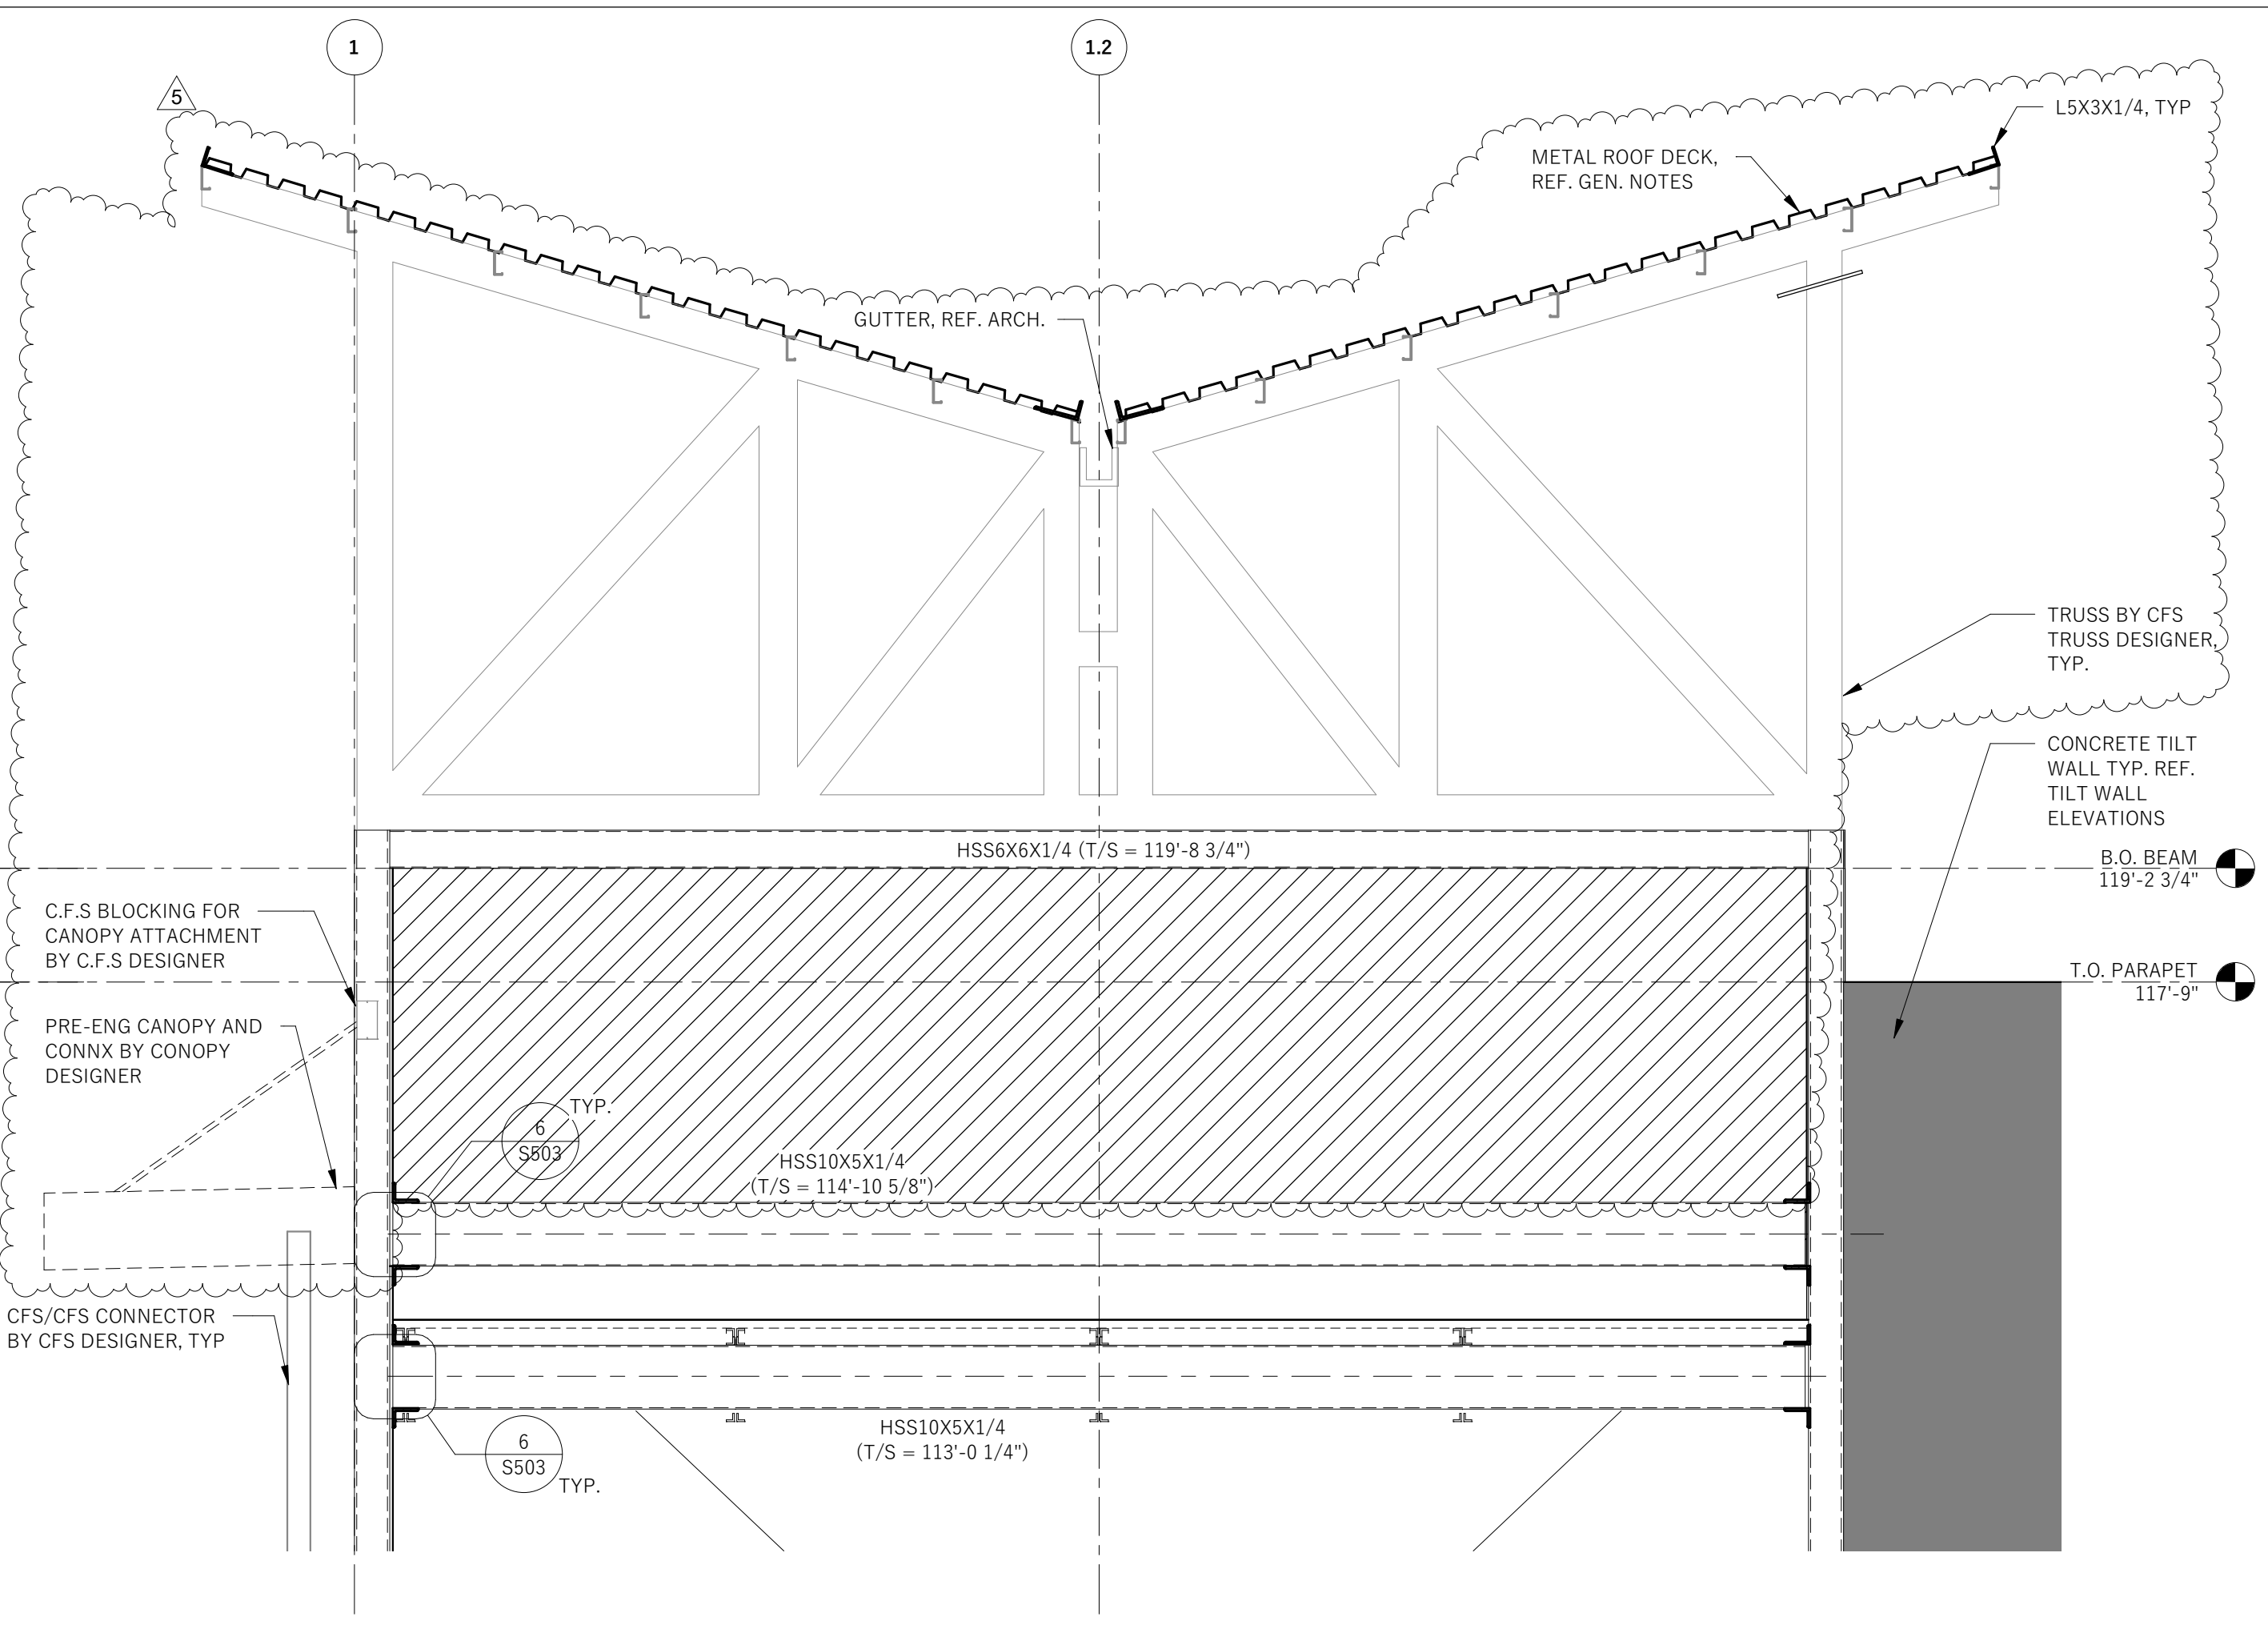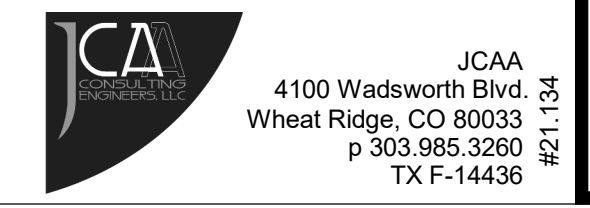


2 HIGH ROOF SECTIONS
 S403 1/2" = 1'-0"

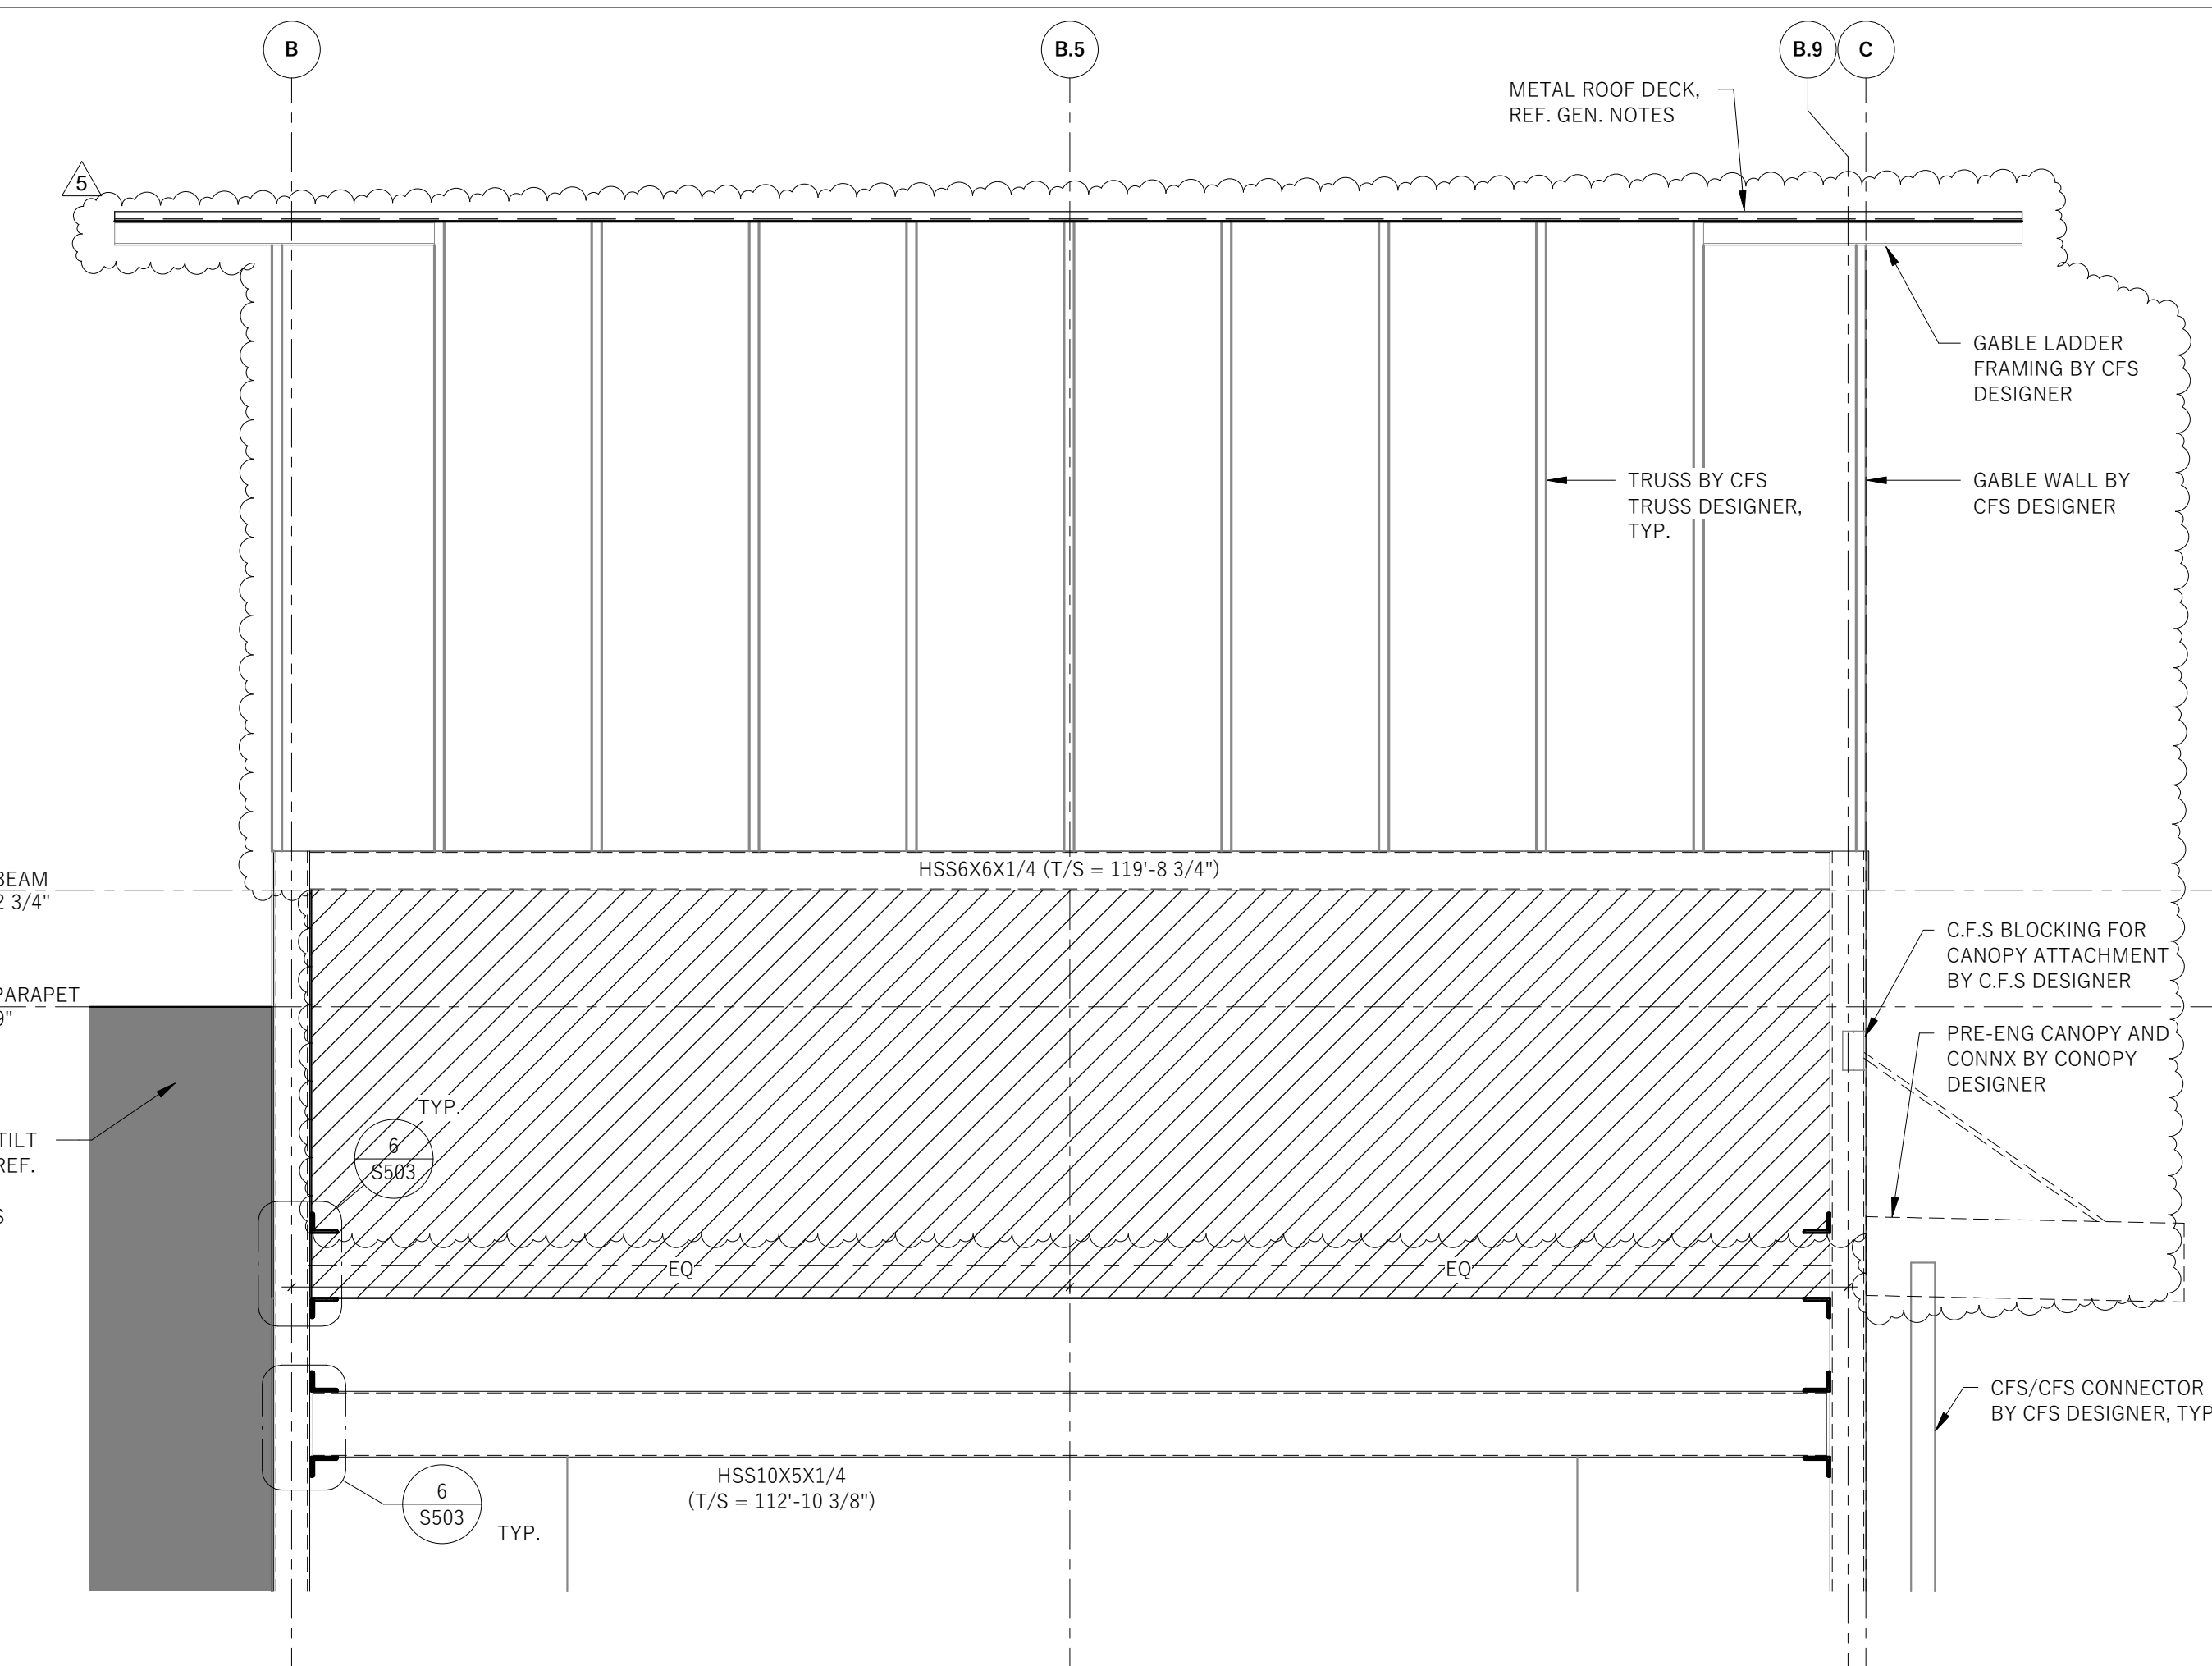


1 HIGH ROOF SECTIONS
 S403 1/2" = 1'-0"

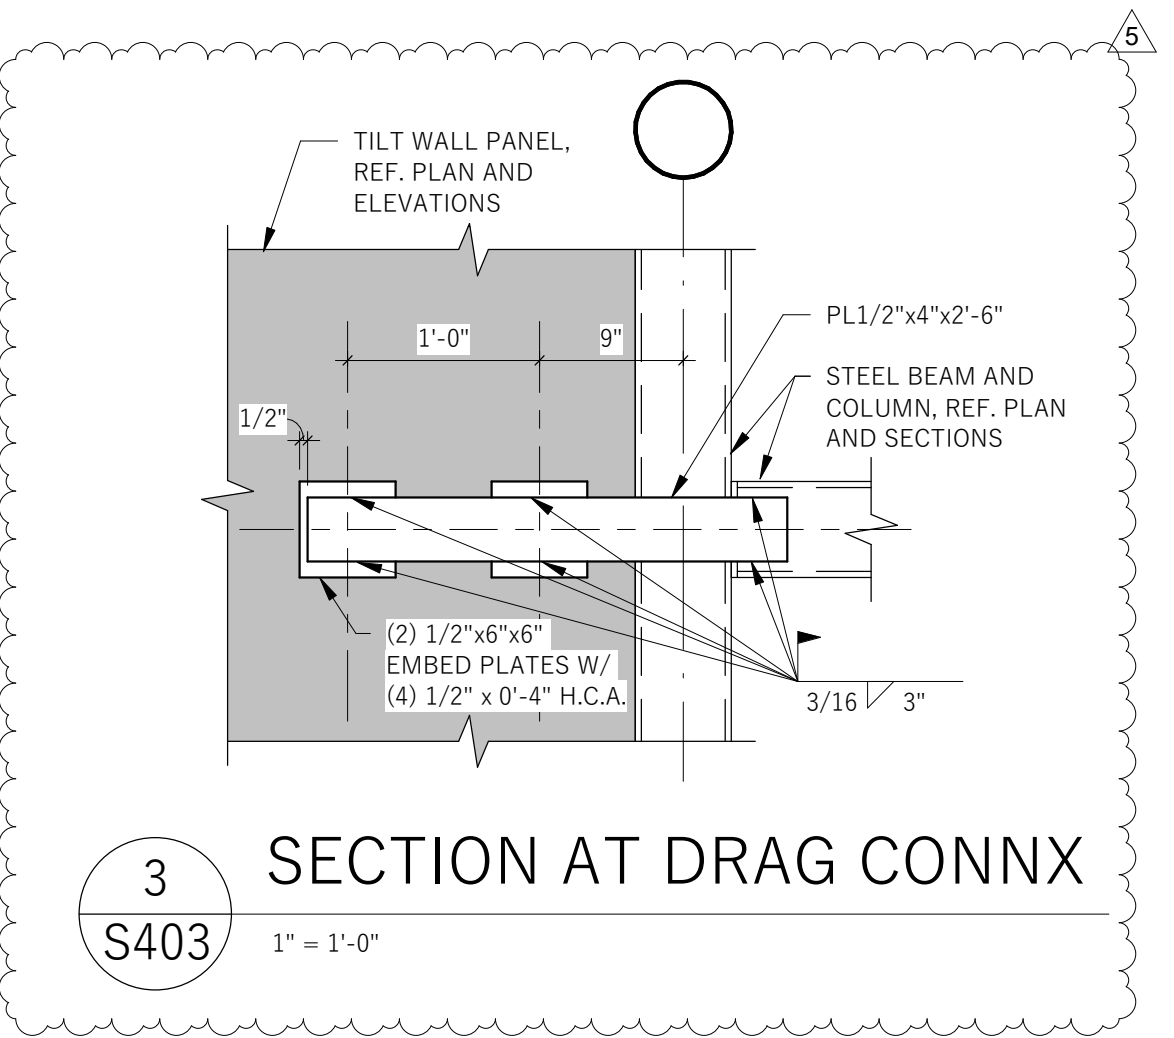


3 SECTION AT DRAG CONNX
 S403 1" = 1'-0"

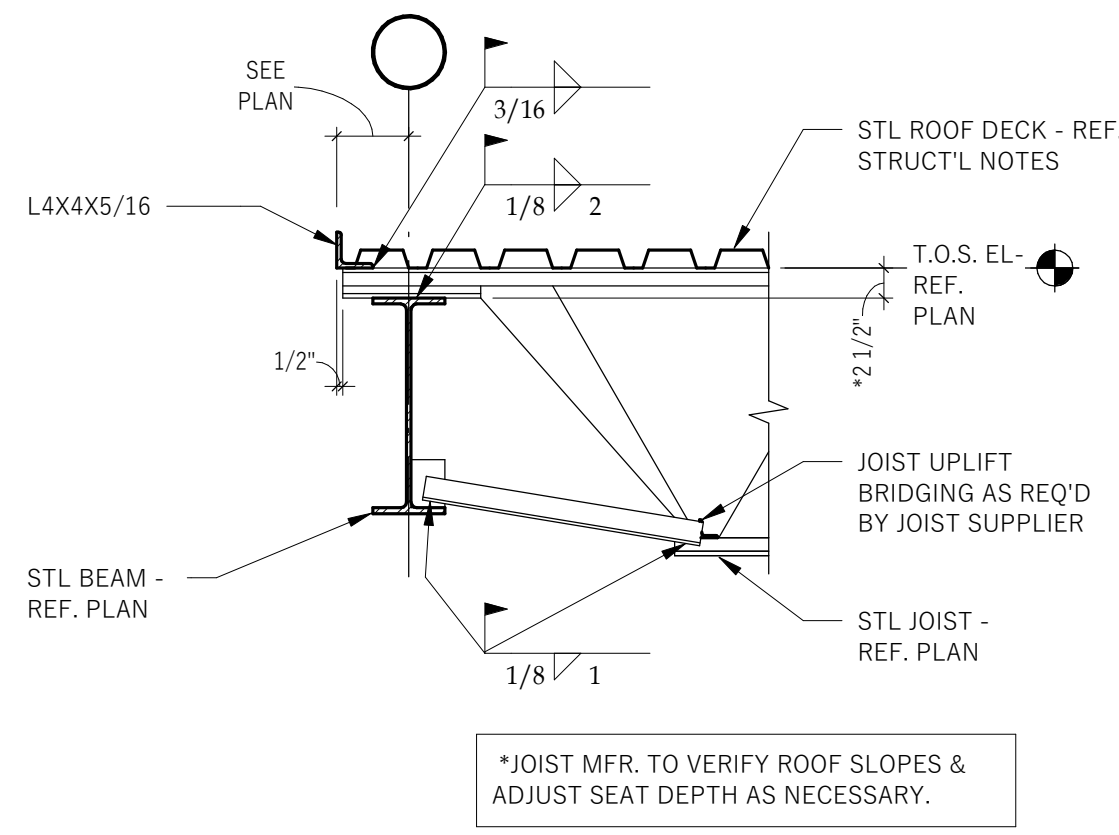


1
S501
TYPICAL KCS OR K SERIES STEEL JOIST BEARING ON PERIMETER BEAM
NO SCALE

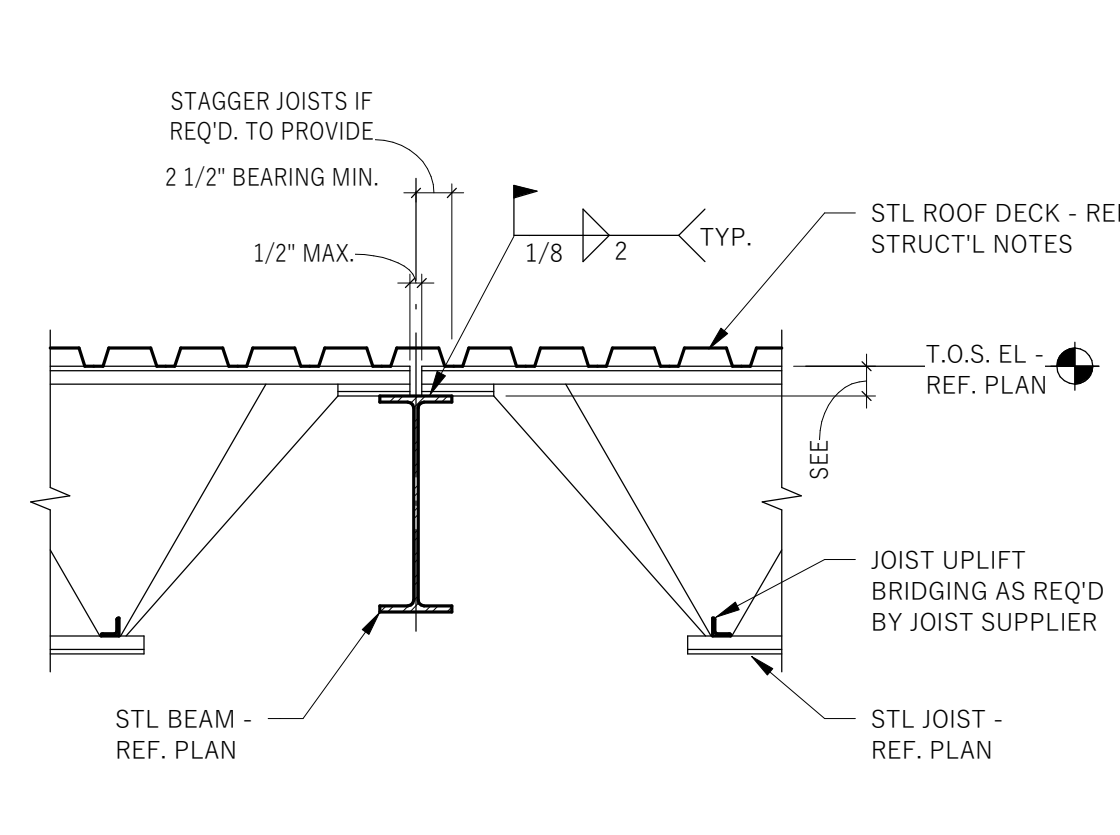


2
S501
TYPICAL KCS OR K SERIES STEEL JOIST BEARING ON INTERIOR BEAM
NO SCALE

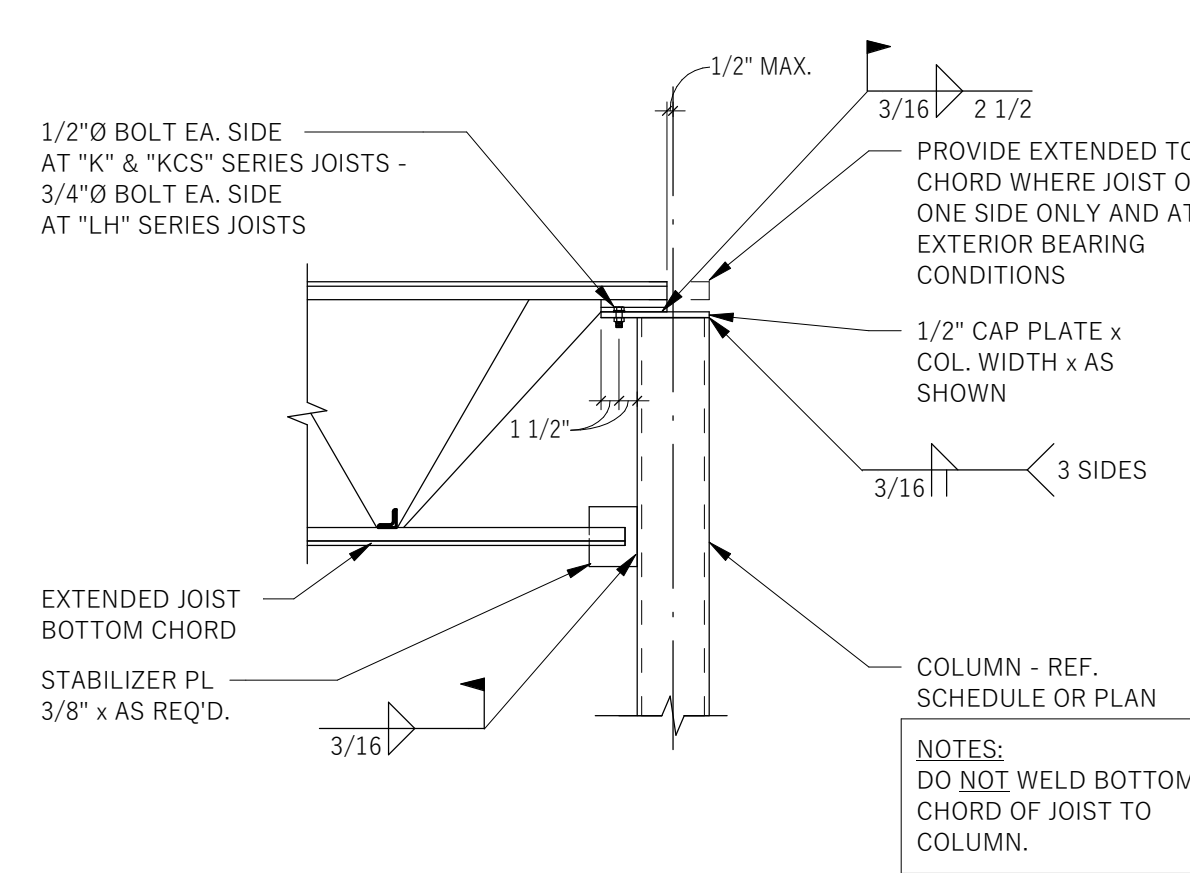


3
S501
JOIST WITH EXTENDED BOTTOM CHORD CONNECTION TO COLUMN
3/4" = 1'-0"

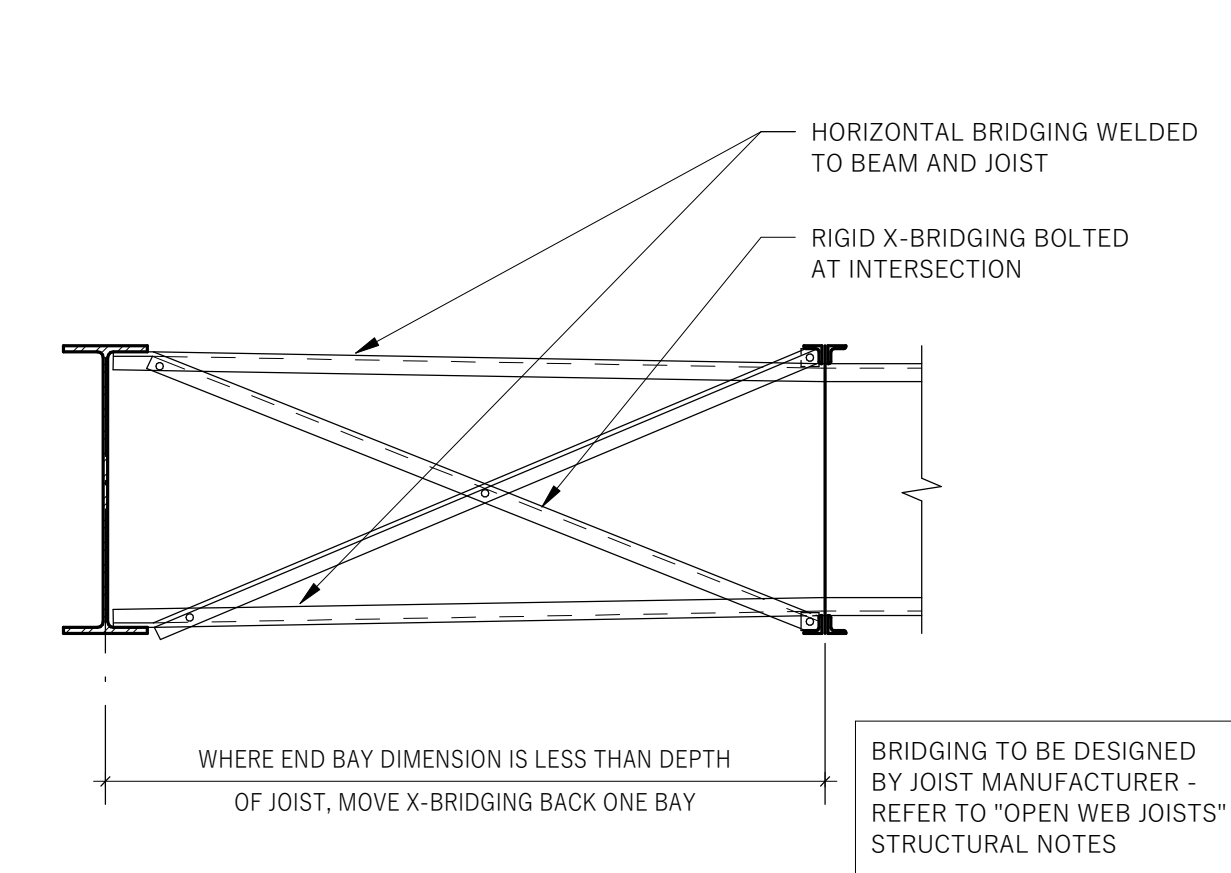


4
S501
TYP. CROSS-BRIDGING AT END BAY FOR K AND KCS SERIES JOISTS
3/4" = 1'-0"

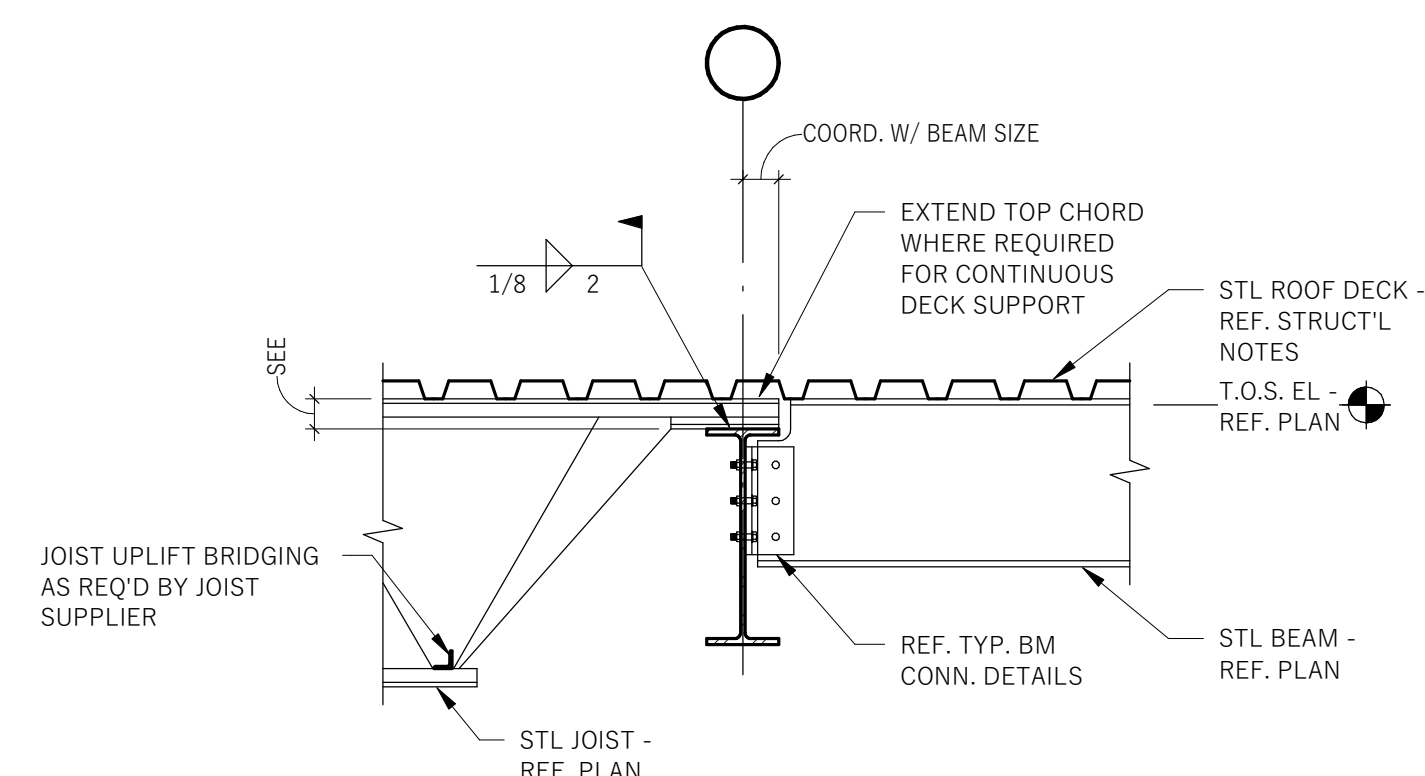


5
S501
TYPICAL EXTENDED TOP CHORD FOR DECK SUPPORT DETAIL
NO SCALE

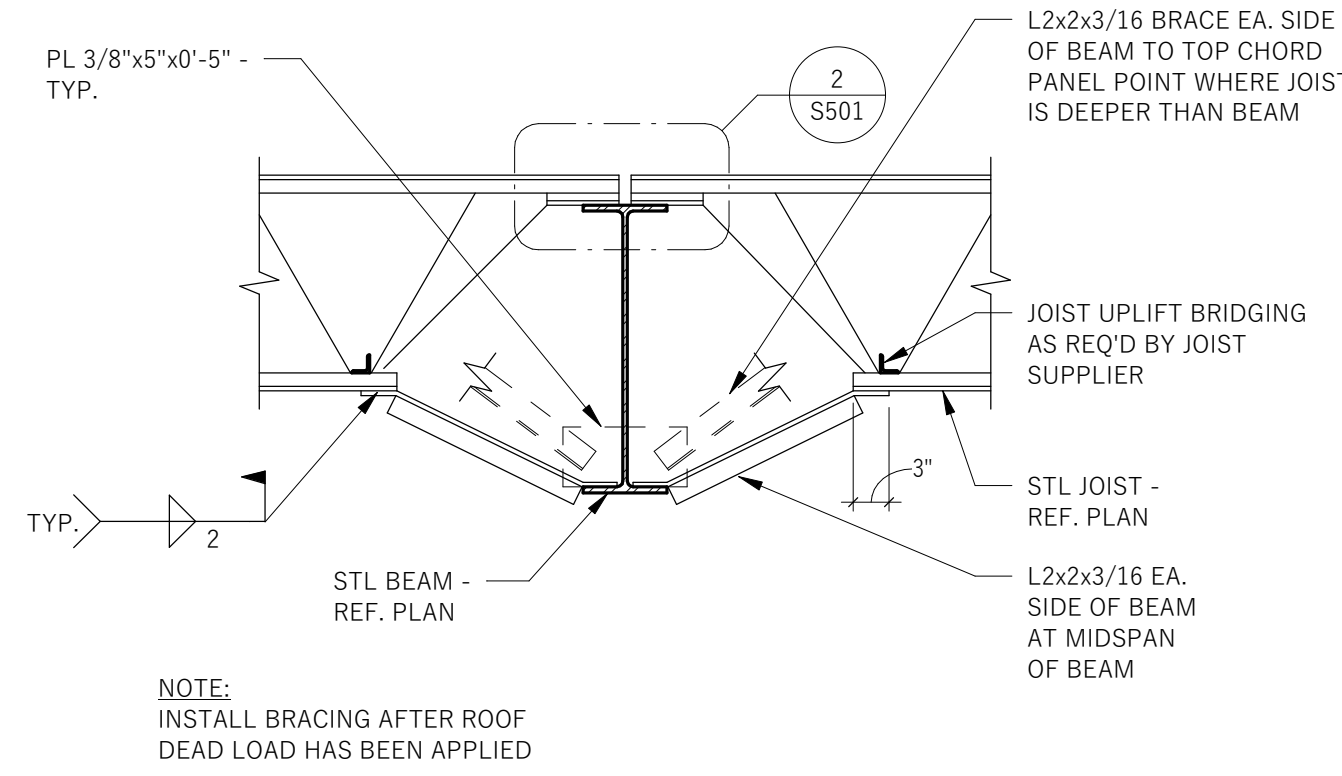


6
S501
TYPICAL JOIST CONNECTION TO BOTTOM FLANGE OF BEAM DETAIL
3/4" = 1'-0"

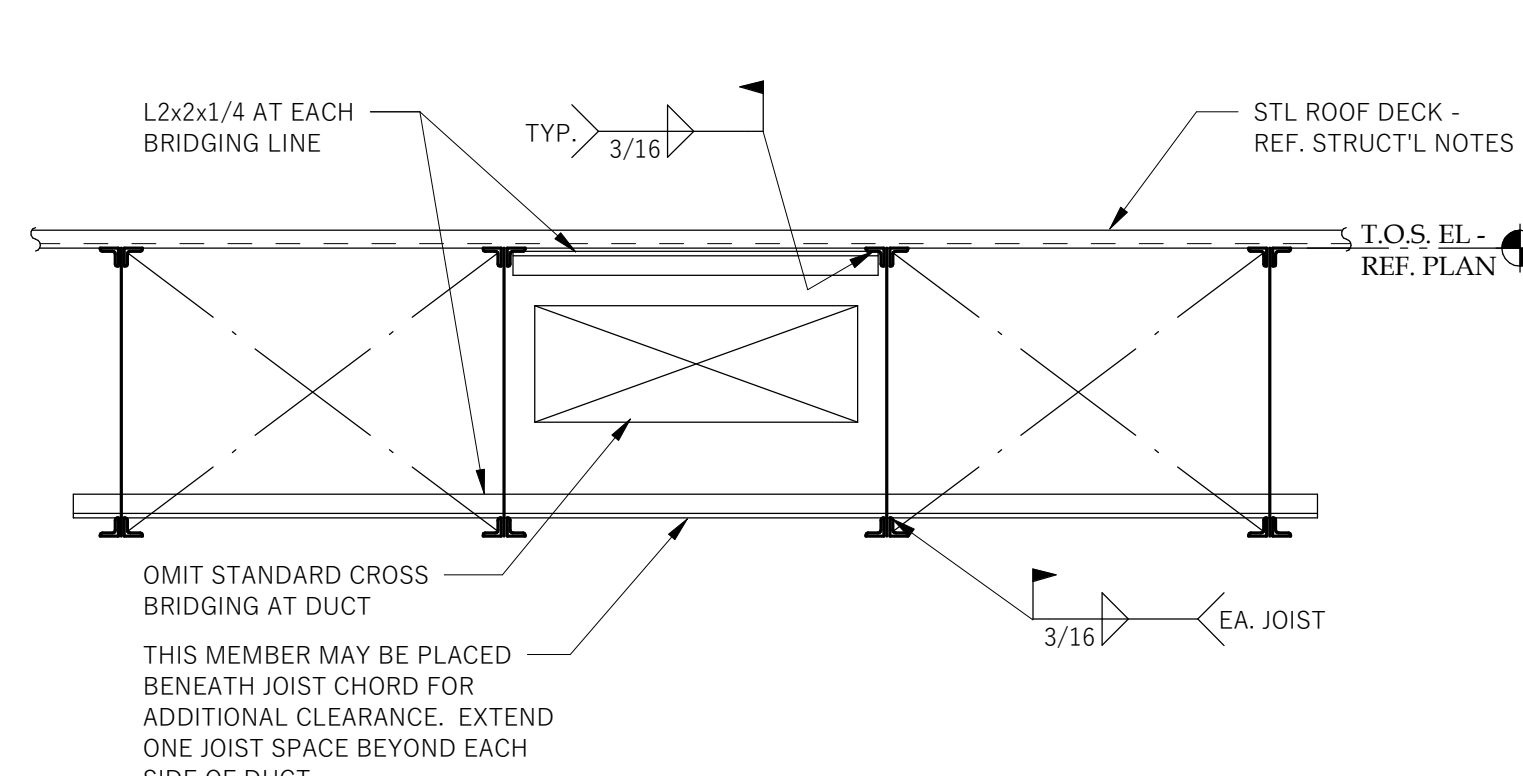


7
S501
TYPICAL DUCT OPENING AT CROSS BRIDGING DETAIL
3/4" = 1'-0"

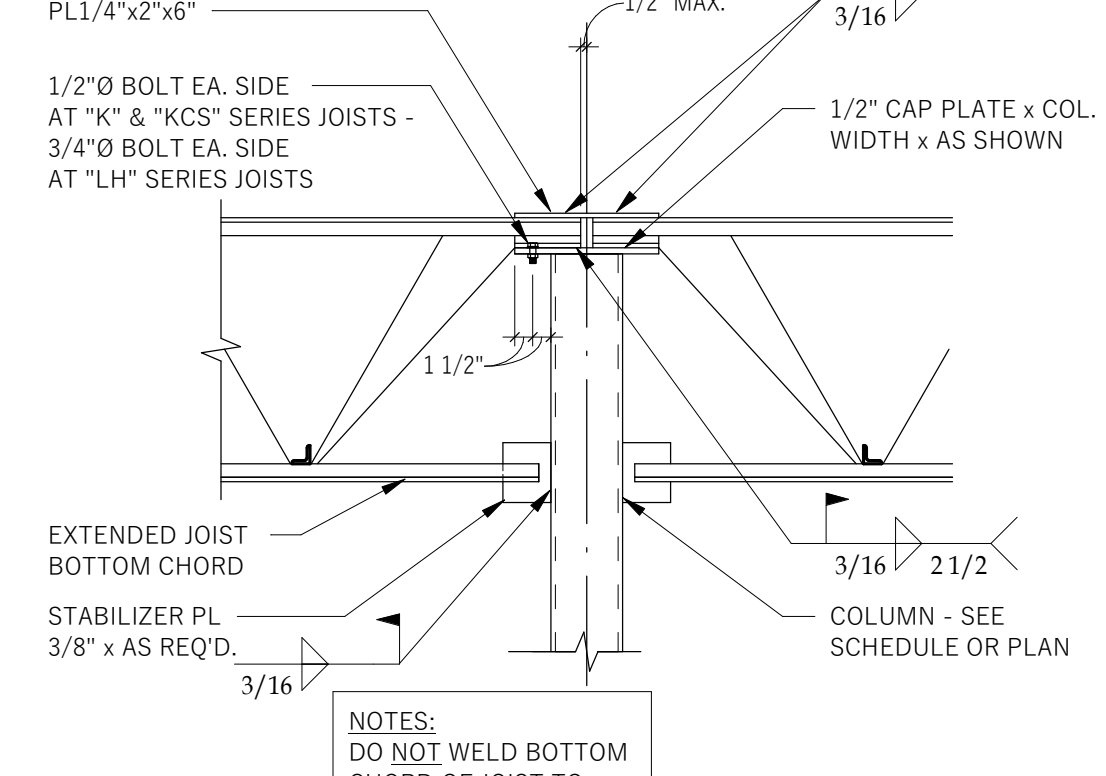


8
S501
COLLECTOR CONNECTOR
3/4" = 1'-0"

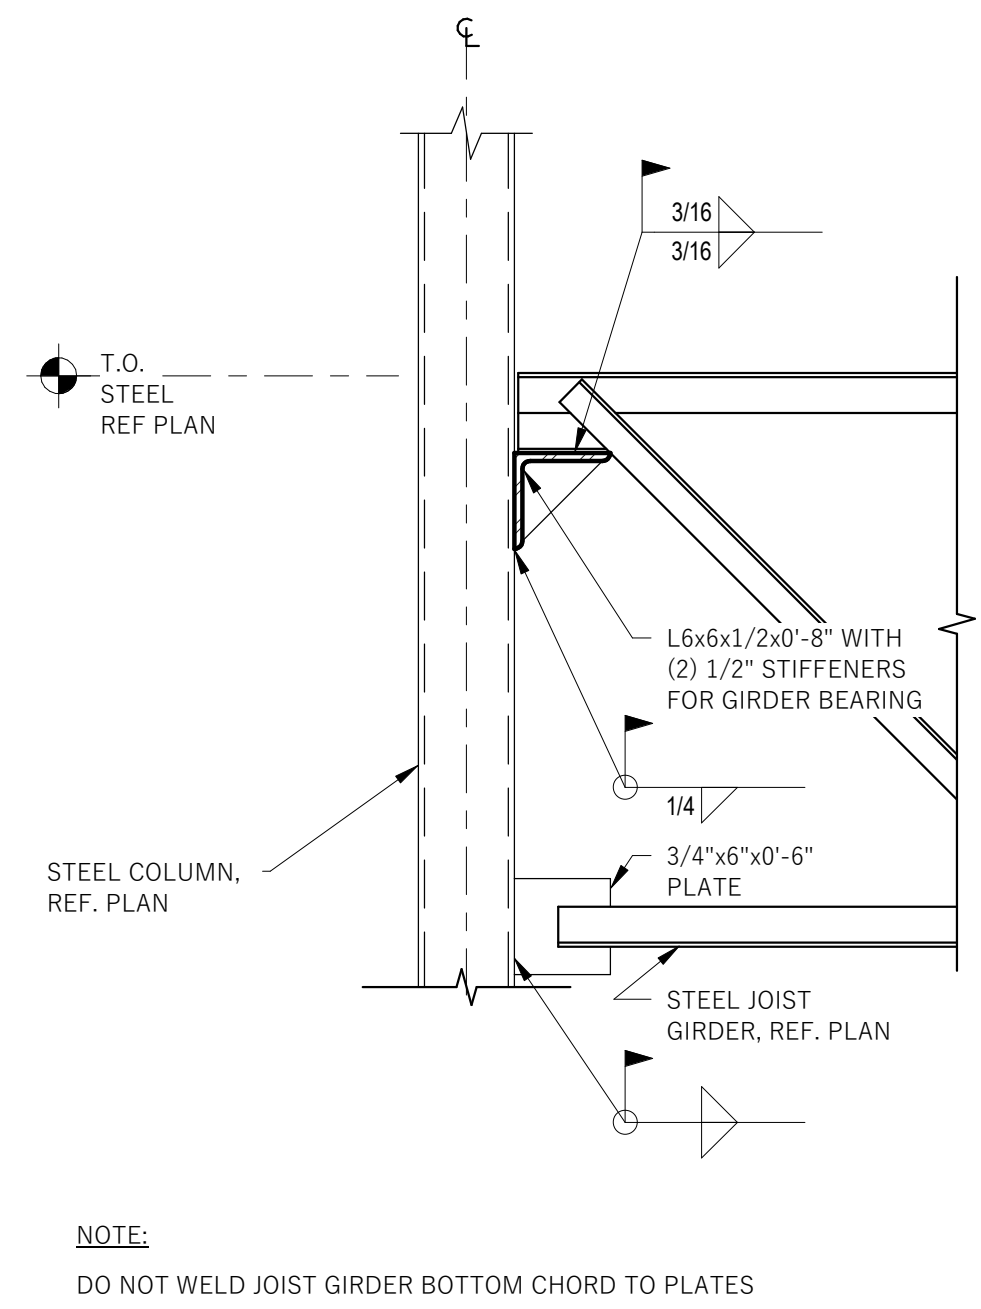


9
S501
STEEL GIRDER TO COLUMN CONNECTION
1" = 1'-0"

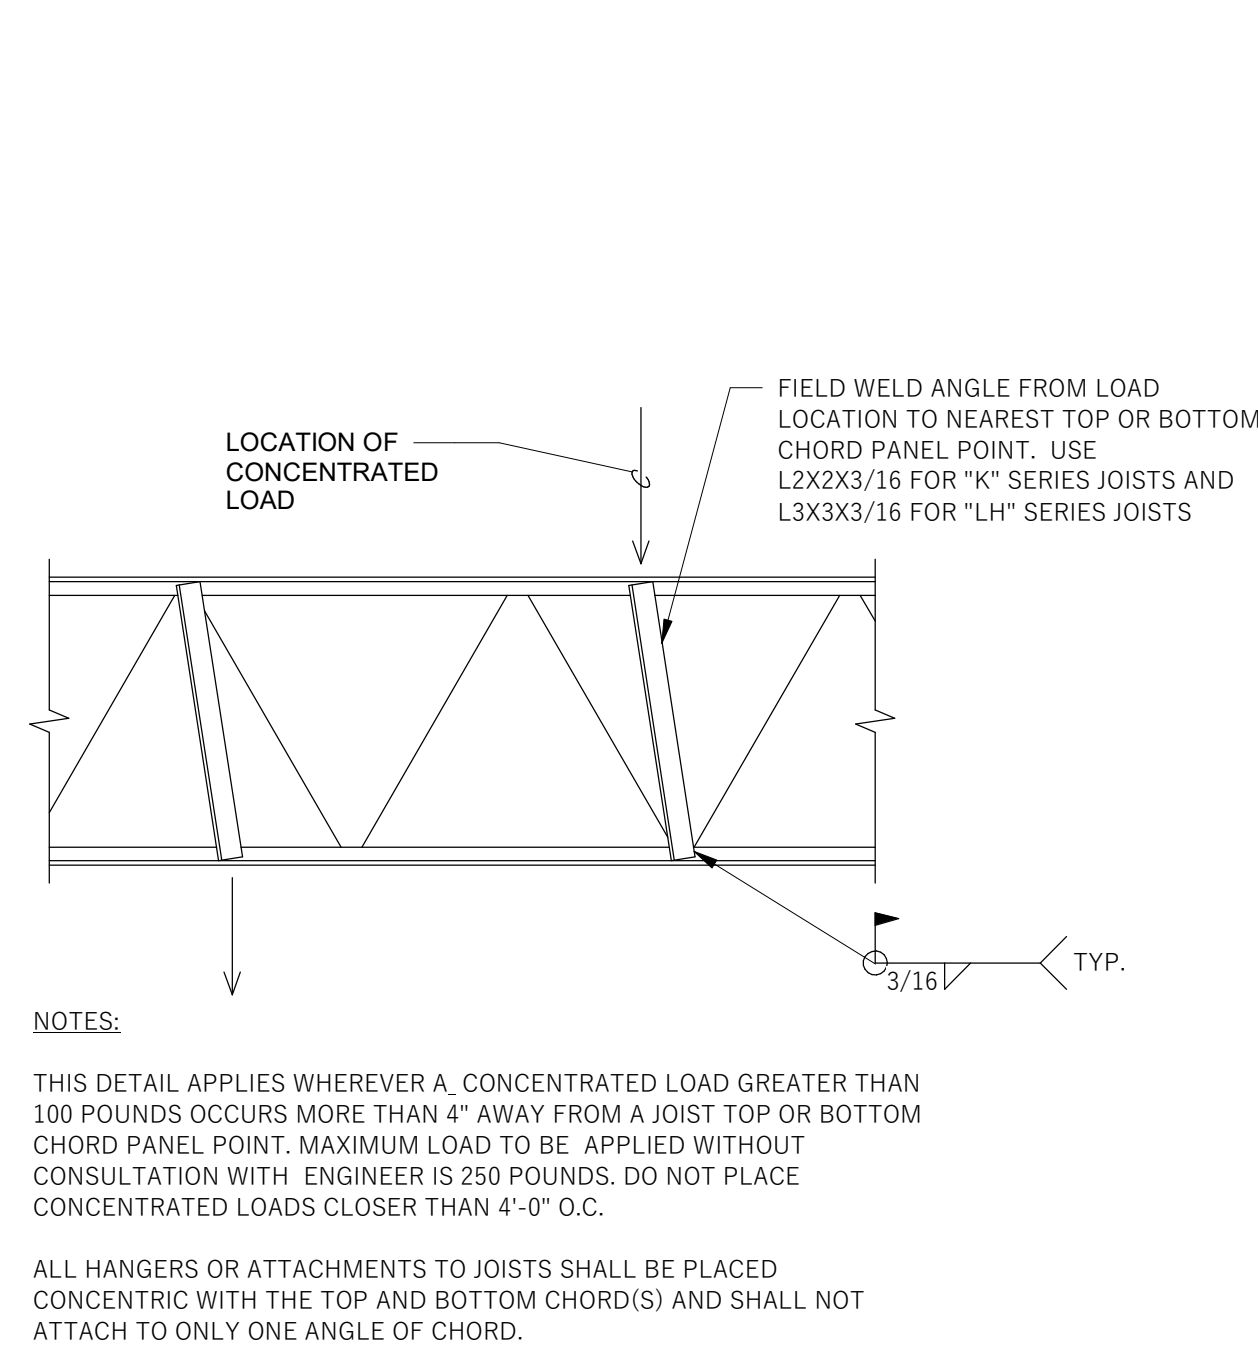


10
S501
JOIST CHORD REINFORCEMENT
3/4" = 1'-0"

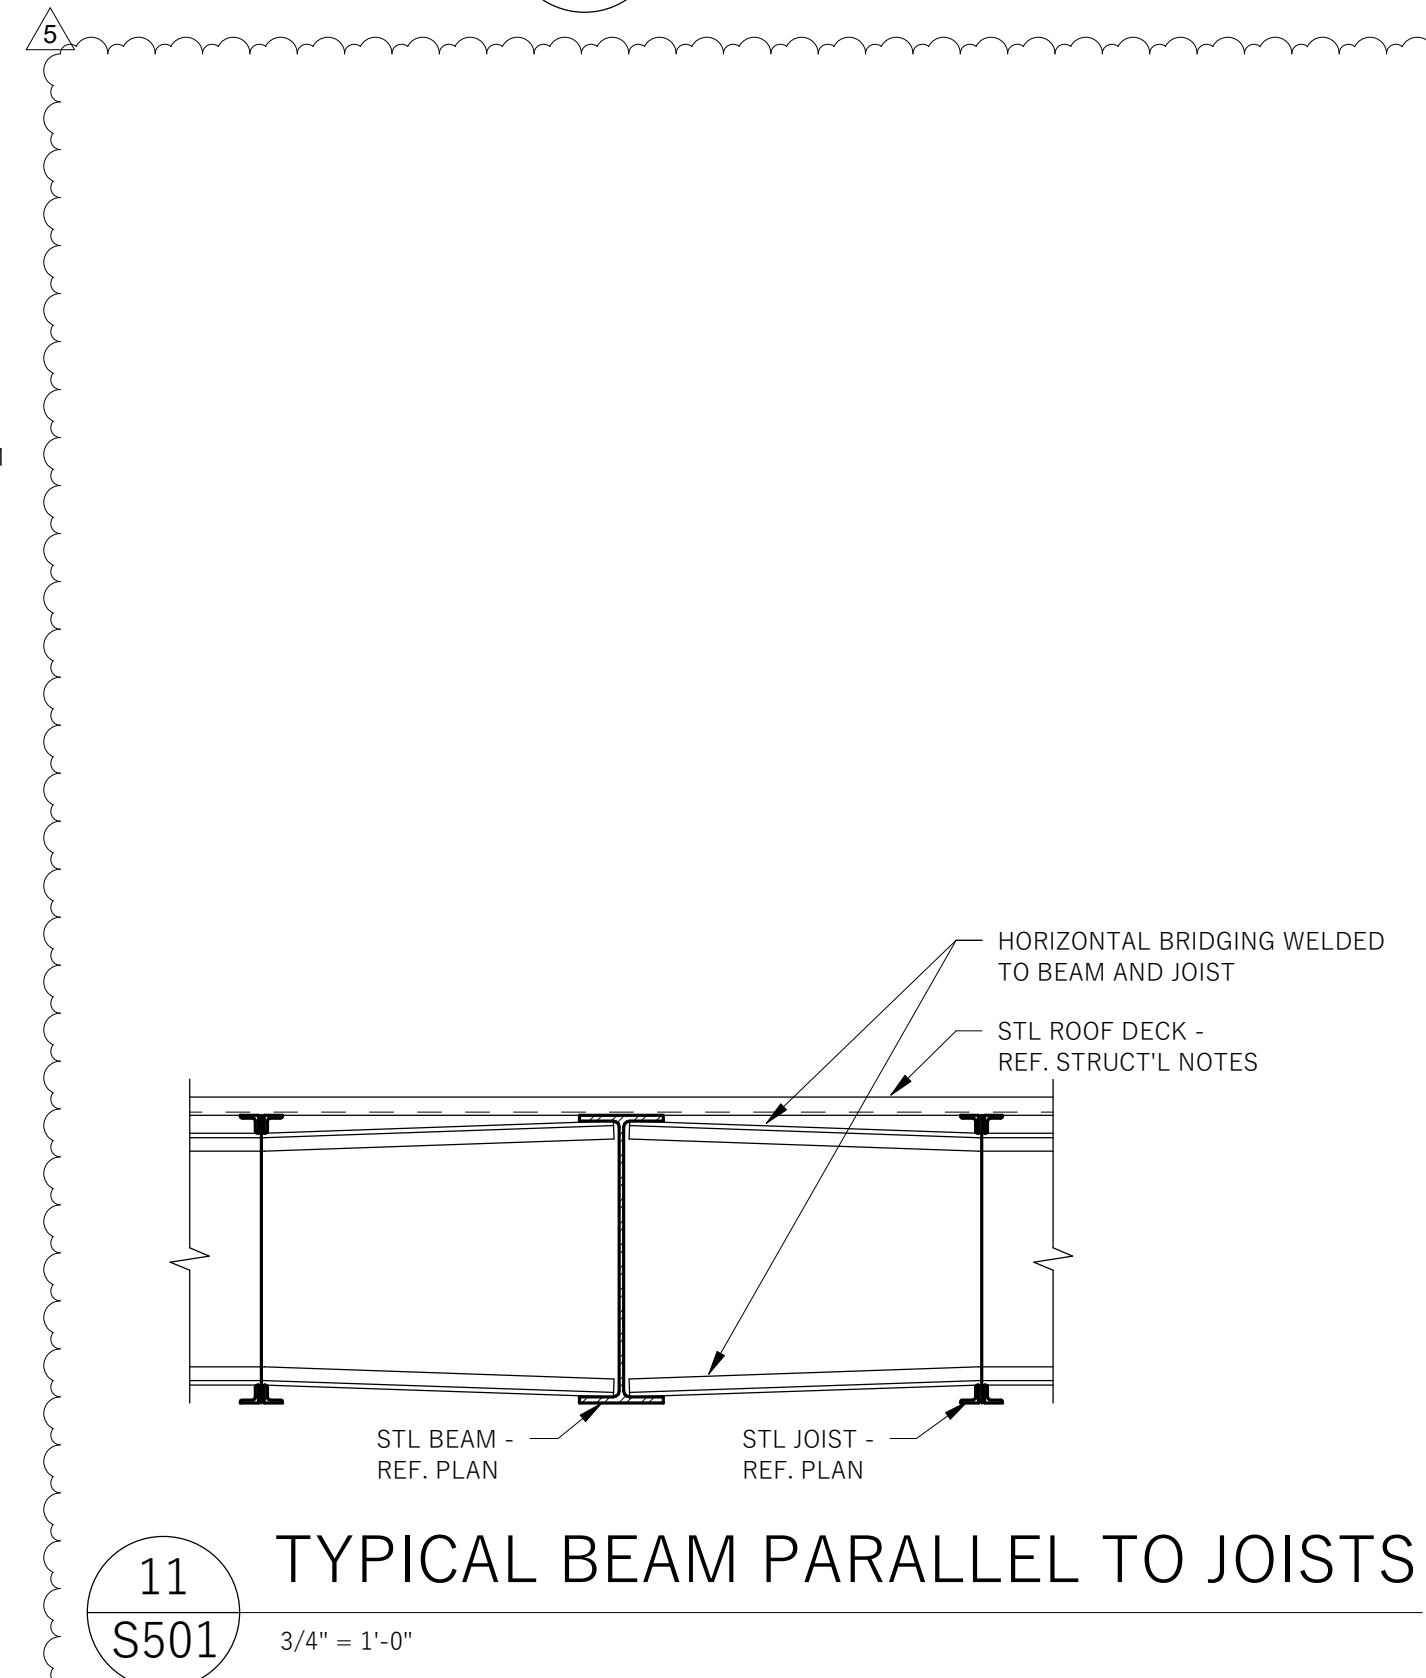


11
S501
TYPICAL BEAM PARALLEL TO JOISTS
3/4" = 1'-0"

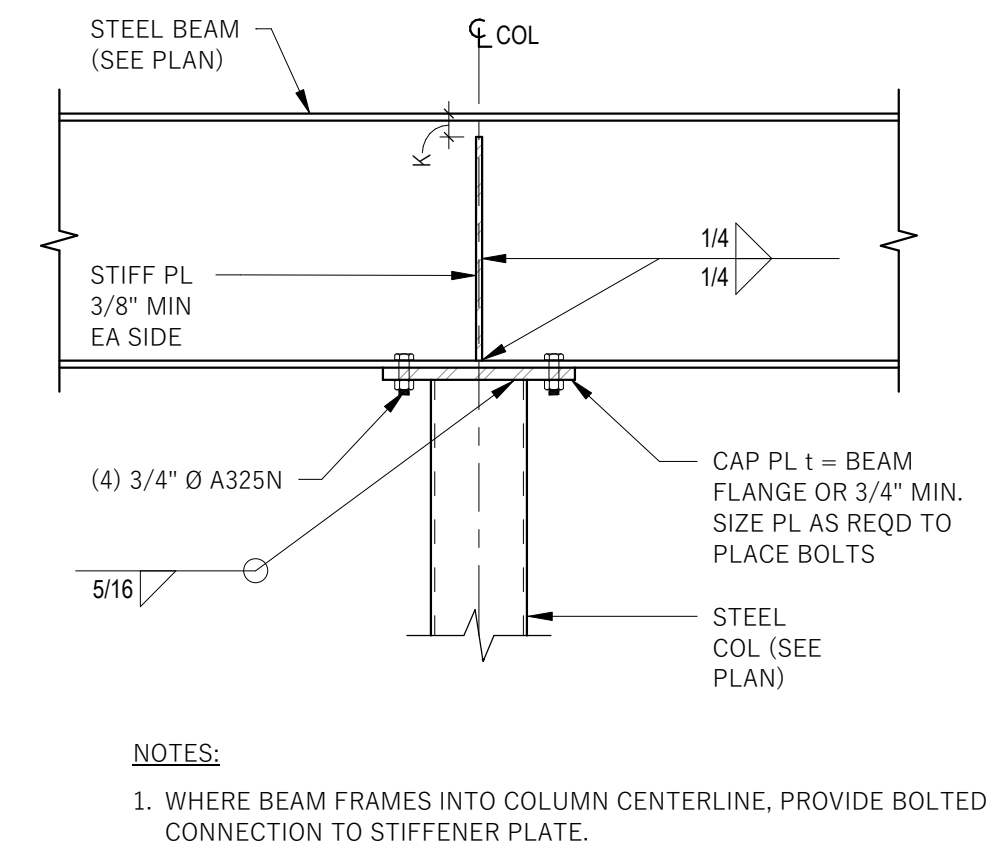

12
S501
'W' BEAM OVER HSS COLUMN
1" = 1'-0"

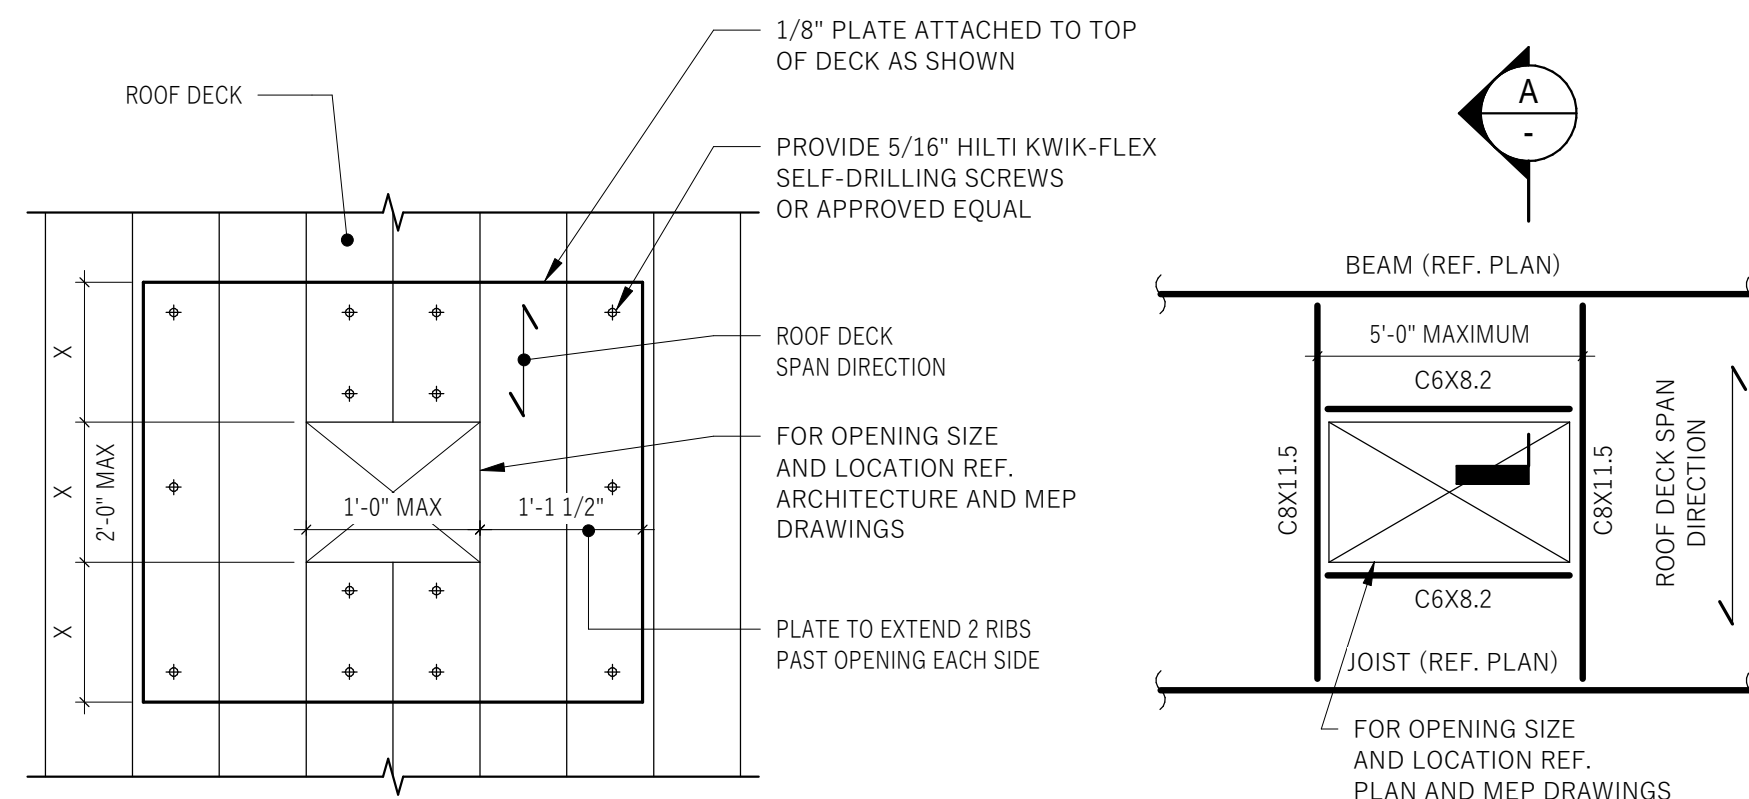


TYPE D

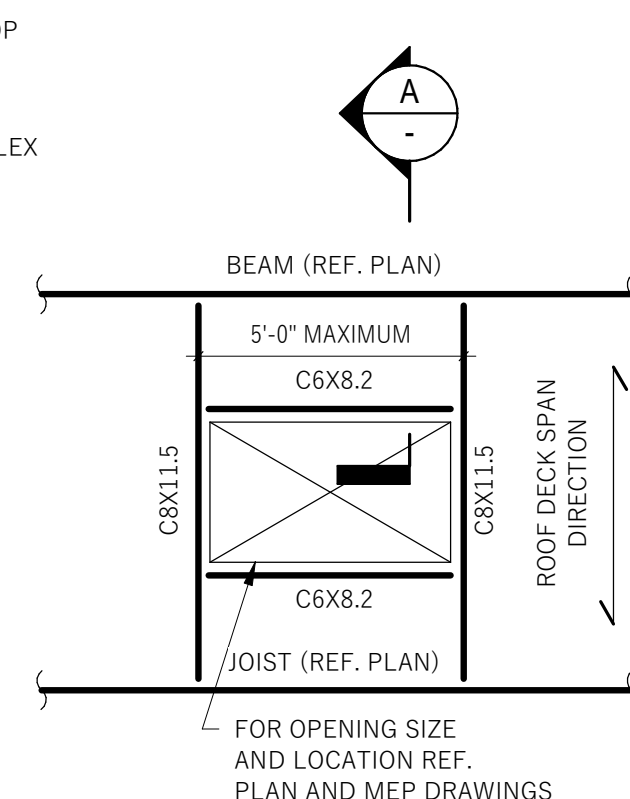


TYPE F

NOTES:


1. NO REINFORCEMENT REQUIRED IF OPENING IS 6" x 6" OR SMALLER PROVIDED ONLY ONE RIB IS INTERRUPTED
2. CLUSTERED OPENINGS WITH CLEAR SPACE LESS THAN 1'-0" SHALL BE TREATED AS ONE LARGE OPENING AND PROVIDE THE REINFORCEMENT OR CHANNEL FRAMING AS PER DETAIL ABOVE
3. ATTACH DECK TO CHANNELS TYPICAL
4. TYPE D SHALL NOT BE USED TO SUPPORT MECHANICAL EQUIPMENT
5. TYPE F FRAMING SHALL BE COORDINATED WITH EQUIPMENT SUPPORT FRAMING

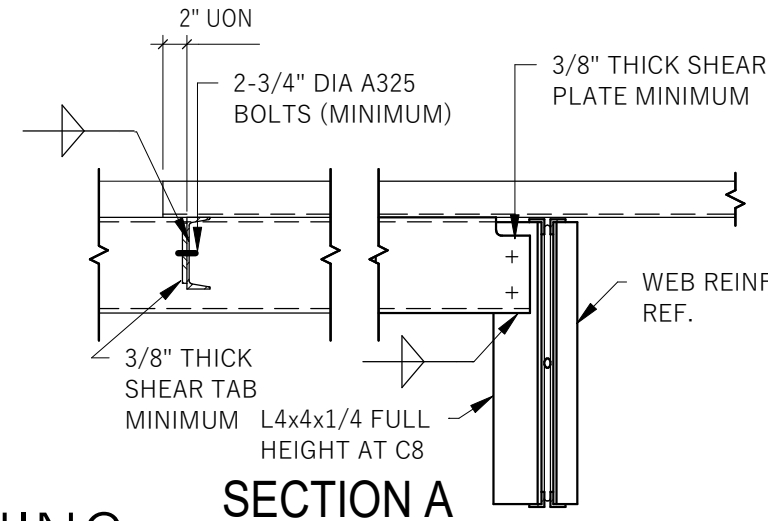

SECTION A

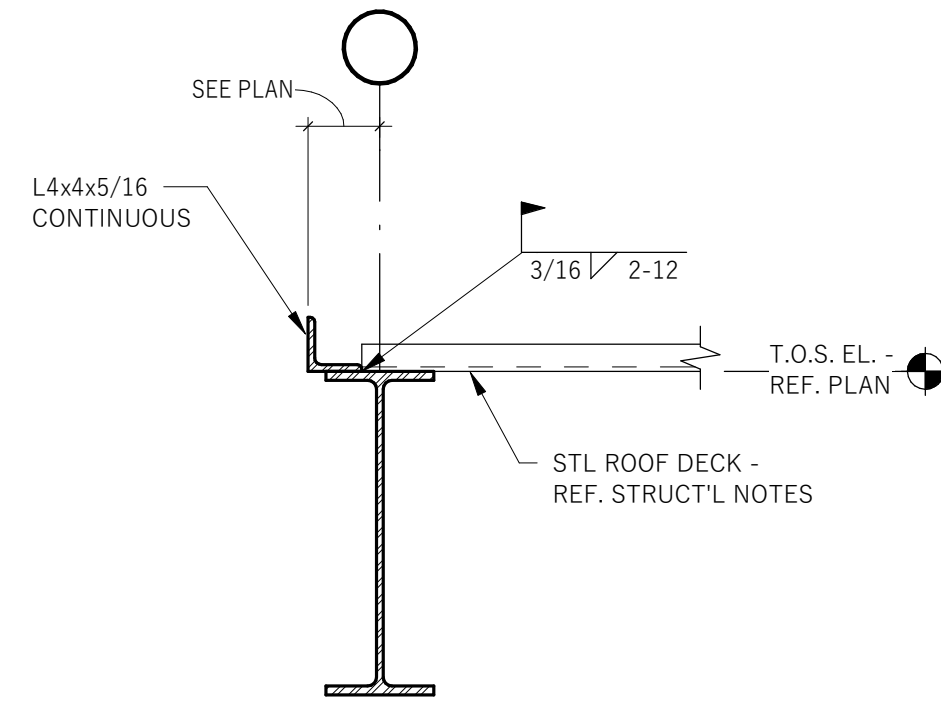

EXTERIOR BEAM PARALLEL TO JOISTS

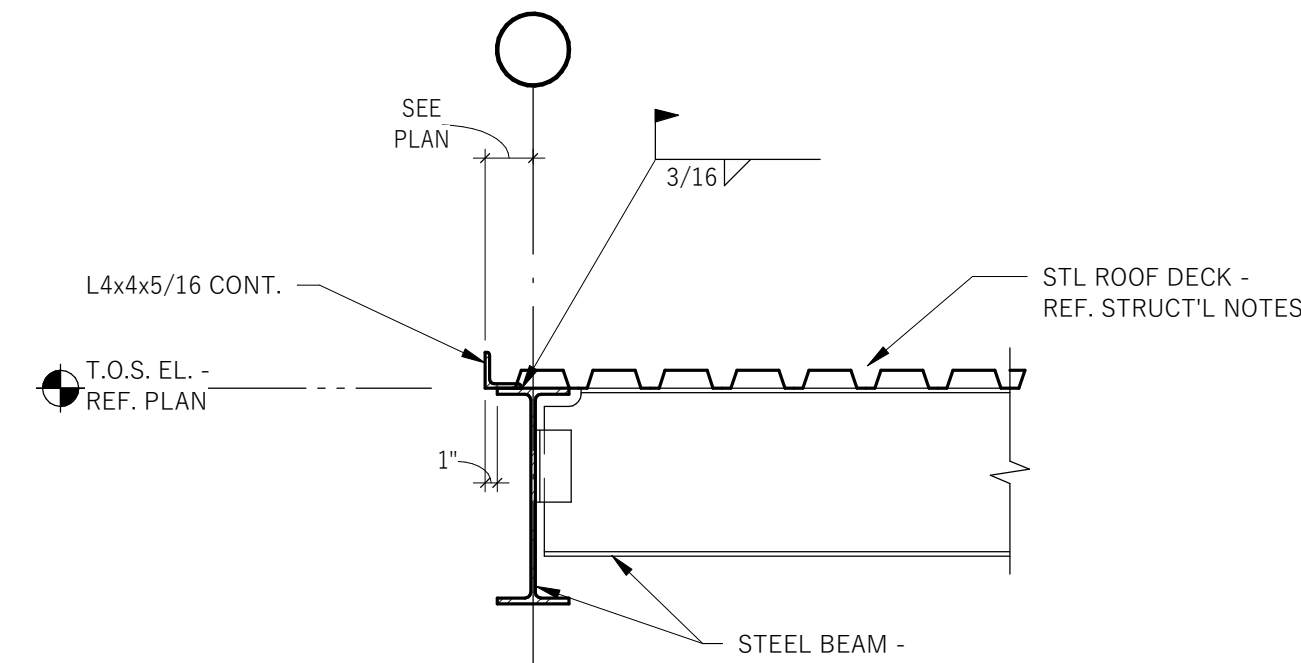

TYPICAL ROOF EDGE ANGLE

1 TYPICAL ROOF DECK AT OPENING


S502 3/4" = 1'-0"

2 TYPICAL ROOF DECK AT OPENING

S502 3/4" = 1'-0"

3 TYPICAL ROOF EDGE ANGLE


S502 3/4" = 1'-0"

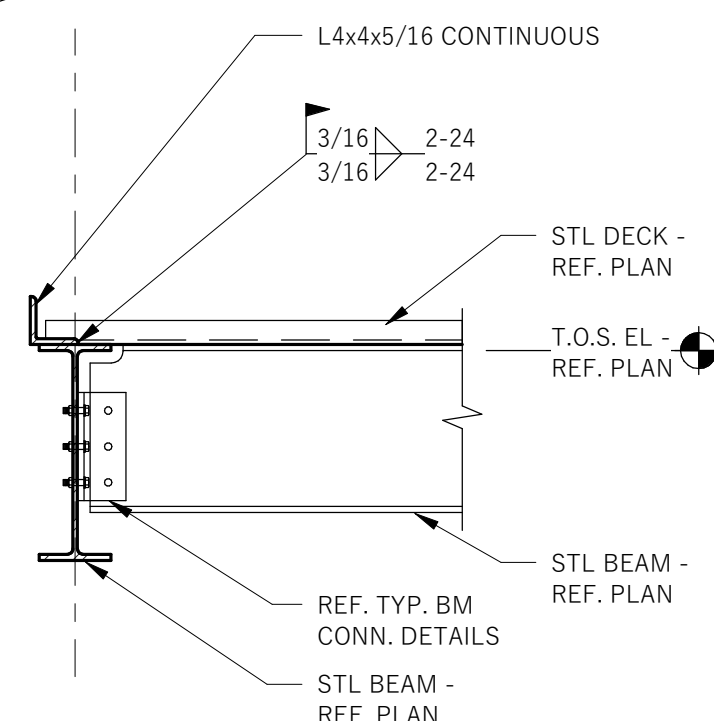

PERIMETER GIRDER AT STL FRAMING

4


S502 3/4" = 1'-0"

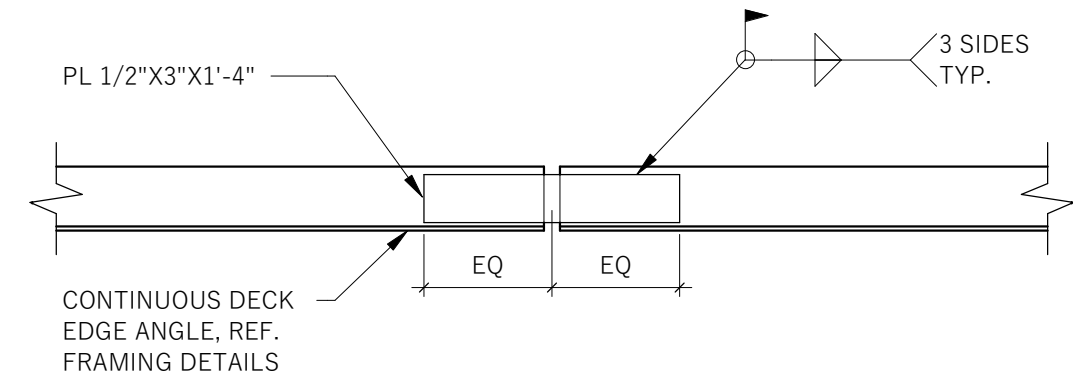

TYP. DECK ANGLE SPLICE DETAIL

5

S502 1" = 1'-0"

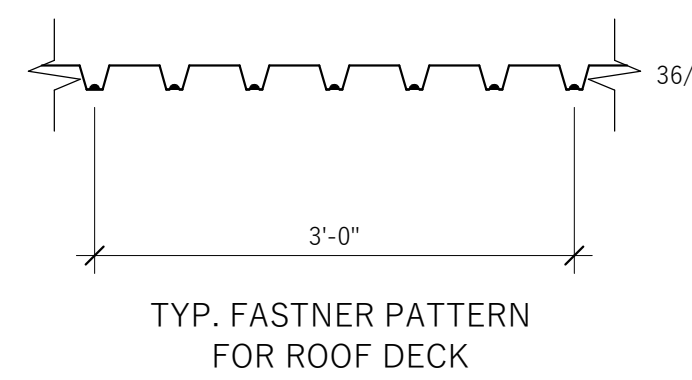


TYP. ROOF ATTACHMENT DETAIL

6

S502 1" = 1'-0"

ROOF DECK ATTACHMENT NOTES:


1. ATTACHMENT AT SUPPORTS SHALL BE 5/8" PUDDLE WELDS
2. ATTACHMENT AT SIDE LAPS SHALL BE #10 TEKS
3. ATTACHMENT AROUND OPENINGS SHALL BE WELDS AT 6" O.C.
4. ATTACHMENTS AT SIDE SUPPORTS ALONG PERIMETER SHALL BE WELDS AT 36" O.C.
5. MINIMUM SHEET LAP SHALL BE 3" TYP.
6. PROVIDE (2) SIDELAPS PER SPAN AT (3) EQUAL SPACES.

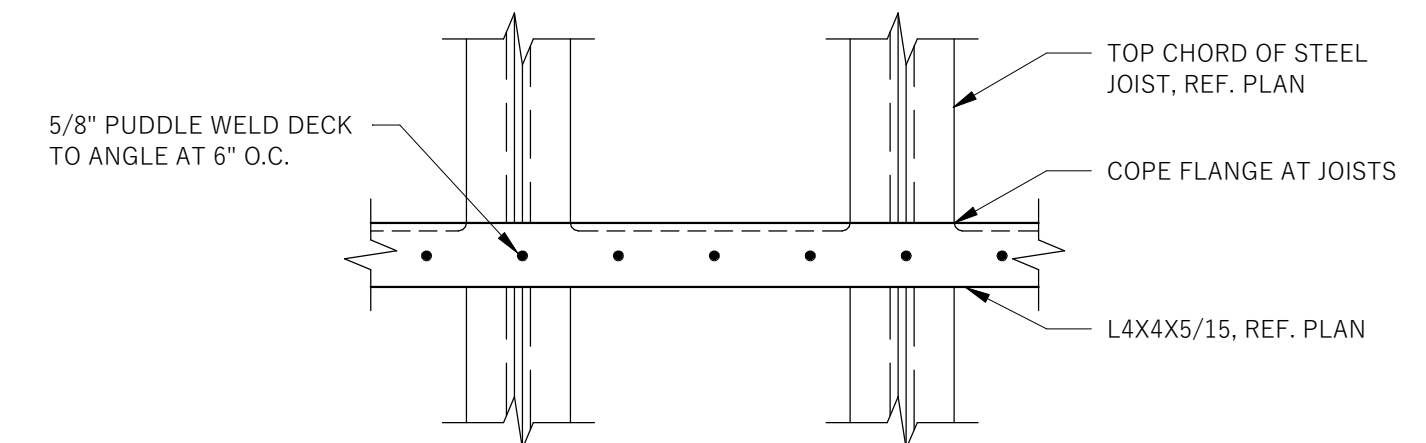

PLAN VIEW AT COLLECTOR

7

S502 1" = 1'-0"

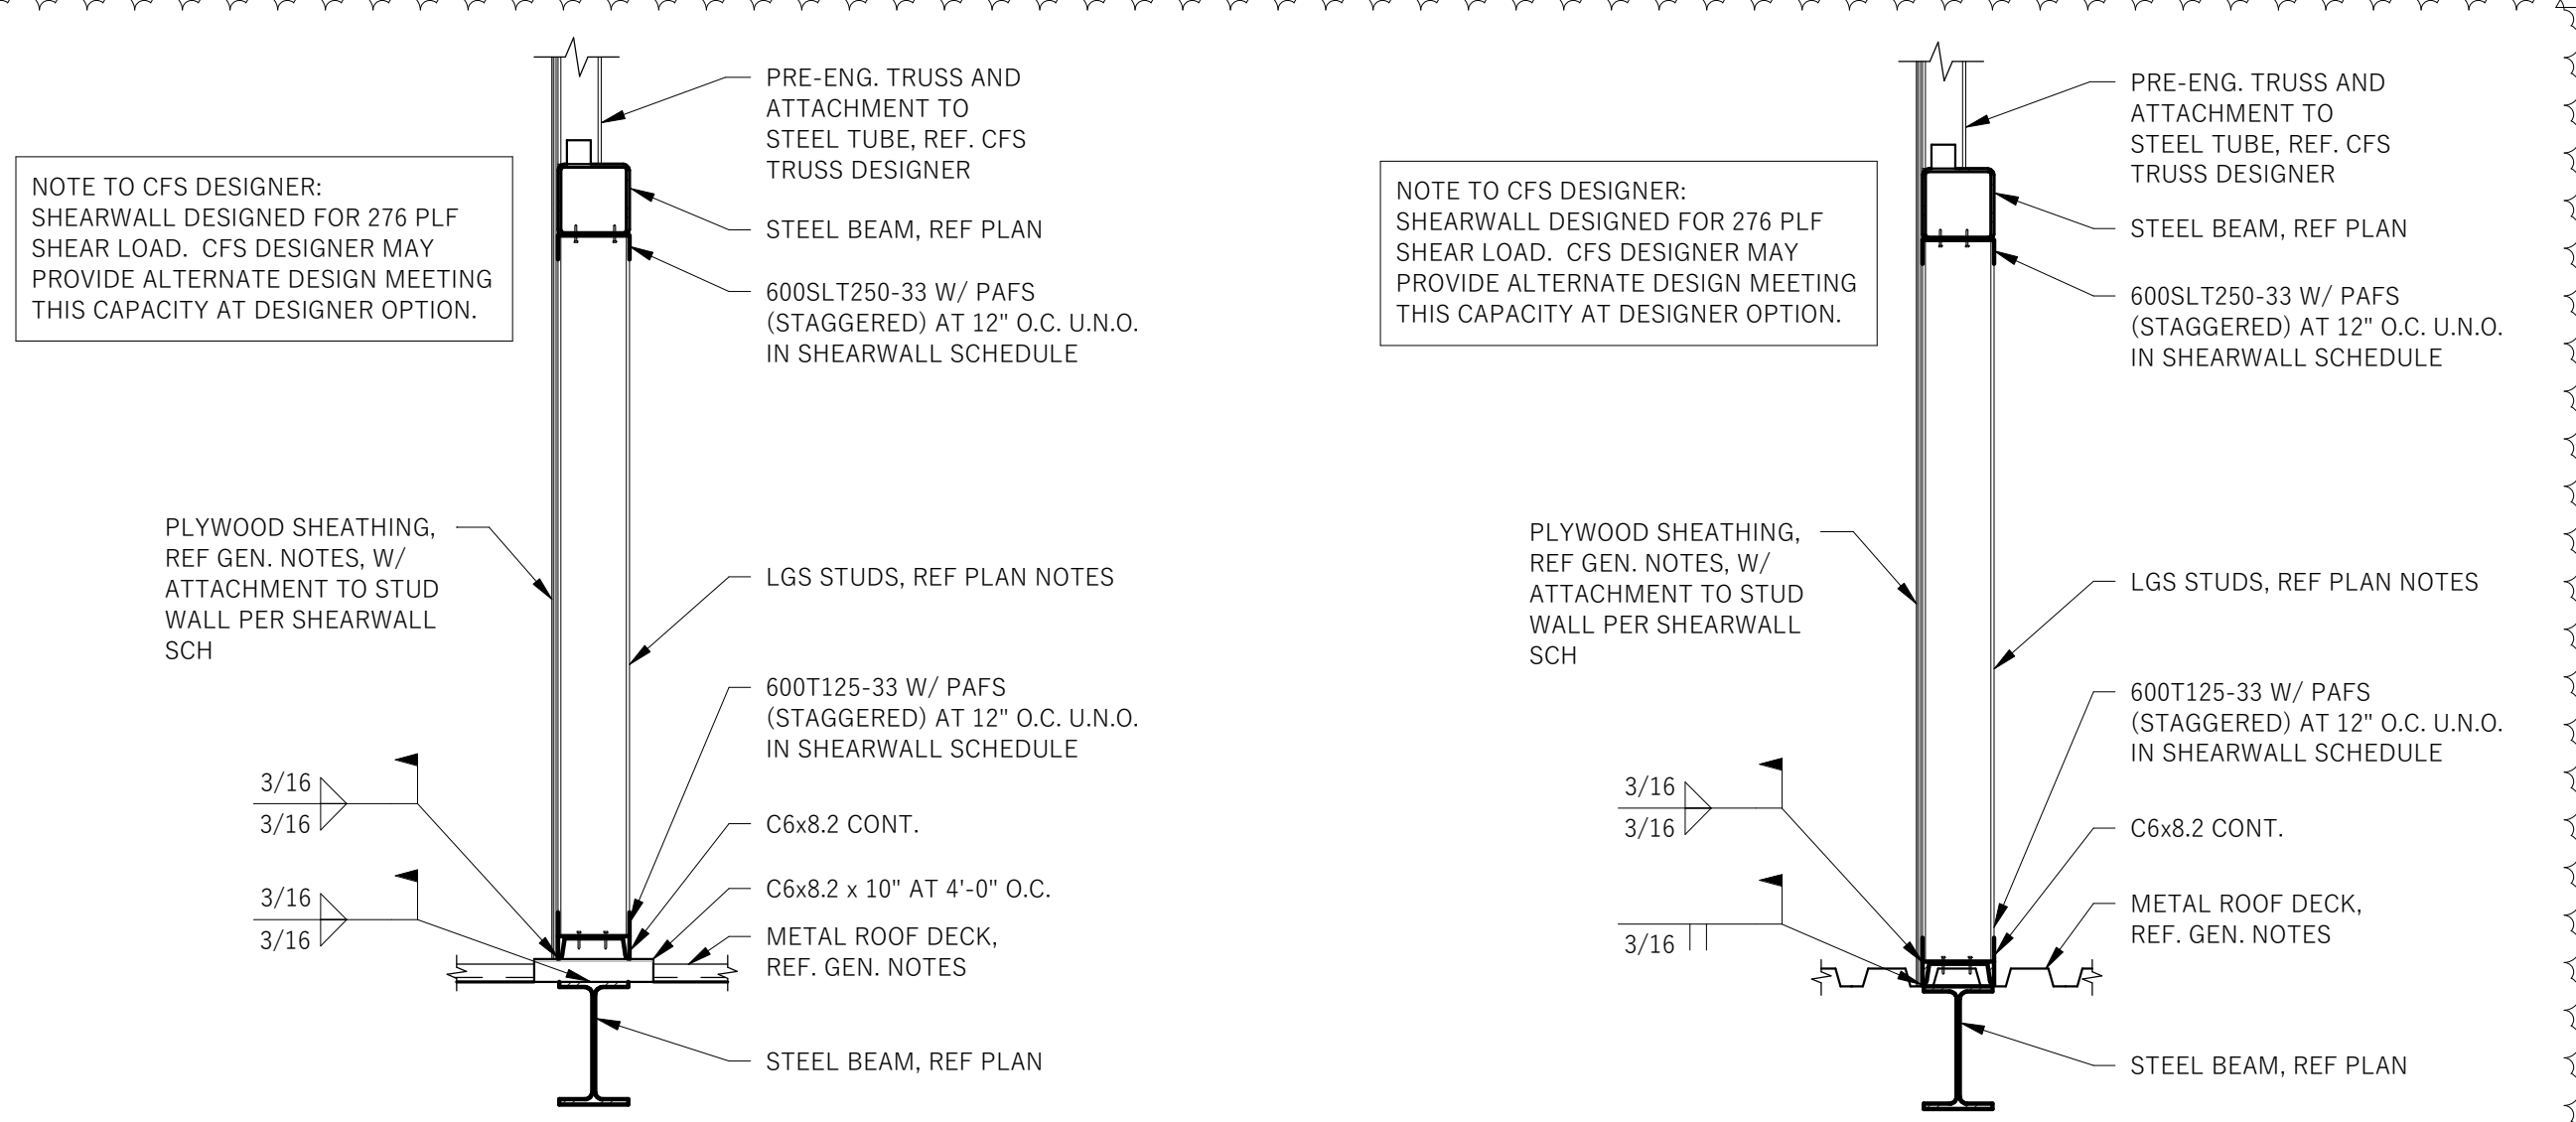

SECTION AT CFS WALL

S502 3/4" = 1'-0"

SECTION AT CFS WALL

S502 3/4" = 1'-0"

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S BAGDAD ROAD BLDG. 1
LEANDER, TEXAS 78641


COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
2 06/20/22 REV 2
5 08/09/24 VE



08/09/2024
100% CDS-REV05-VE
STEEL DECK AT JOIST FRAMING

SHEET: S502

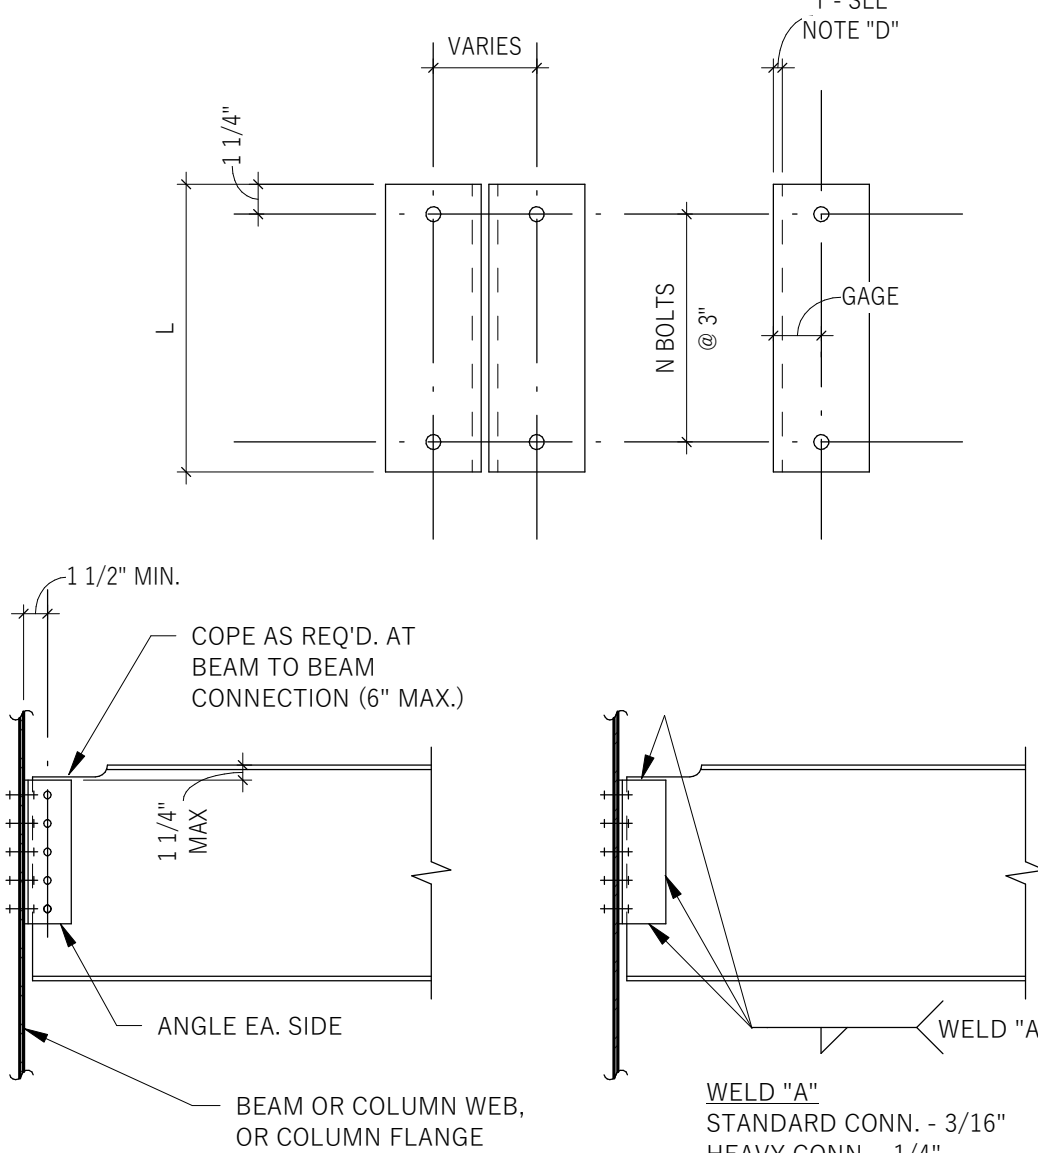


BOLTED/WELDED
BOLTED/WELDED
AISC TYPE 2 SIMPLE FRAMING CONNECTIONS

1
 S503
 3/4" = 1'-0"

BEAM SIZE	STANDARD			HEAVY		
	ANGLE LENGTH (L)	NO. OF ROWS OF BOLTS (N)	MAX. BEAM REACTION (KIPS)	ANGLE LENGTH (L)	NO. OF ROWS OF BOLTS (N)	MAX. BEAM REACTION (KIPS)
W8	5 1/2"	2	17	-	-	N.A.
W10	5 1/2"	2	19	-	-	N.A.
W12	5 1/2"	2	20	8 1/2"	3	28
W14	8 1/2"	3	32	11 1/2"	4	42
W16	8 1/2"	3	35	11 1/2"	4	46
W18	11 1/2"	4	55	14 1/2"	5	68
W21	11 1/2"	4	64	17 1/2"	5	94
W24	14 1/2"	5	89	20 1/2"	7	123
W27	14 1/2"	5	89	23 1/2"	8	148
W30	17 1/2"	6	104	26 1/2"	9	167
W33	20 1/2"	7	119	29 1/2"	10	186
W36	23 1/2"	8	133	29 1/2"	10	186
W40	26 1/2"	9	147	29 1/2"	10	213
W44	29 1/2"	10	160	29 1/2"	10	213

- NOTES:
- RIGHT ANGLE CONNECTIONS SHALL BE DOUBLE ANGLE AS SCHEDULED.
 - NOTED REACTIONS ARE FOR SERVICE LOADS
 - REFER TO "STRUCTURAL STEEL CONNECTIONS" IN STRUCTURAL NOTES FOR ADD'L INFO.
 - MINIMUM CONNECTION: ANGLE THICKNESS IS 1/4" TYPICAL AND 5/16" AT W33 AND DEEPER "HEAVY" CONNECTIONS.
 - BOLTS ARE 3/4" DIA. TYP. AND 7/8" DIA. AT W40 & W44 "HEAVY CONNECTIONS". BOLTS ARE A325N.
 - BEAM CONNECTIONS ARE "STANDARD" U.N.O. ON PLAN.
 - CONTRACTOR SHALL CHECK DESIGN OF ALL BEAMS REQUIRING COPES GREATER THAN SHOWN IN DETAIL BASED ON REACTIONS SHOWN IN TABLE. CONNECTION ANGLES, BOLTS AND WELDS SHALL NOT BE LESS THAN THAT SHOWN
 - ANY REACTIONS NOTED ON PLAN WHICH EXCEED MAX. BEAM REACTIONS NOTED IN TABLE ABOVE SHALL BE DESIGNED BY GENERAL CONTRACTOR. REF. STRUCTURAL NOTES FOR ADDITIONAL INFO.

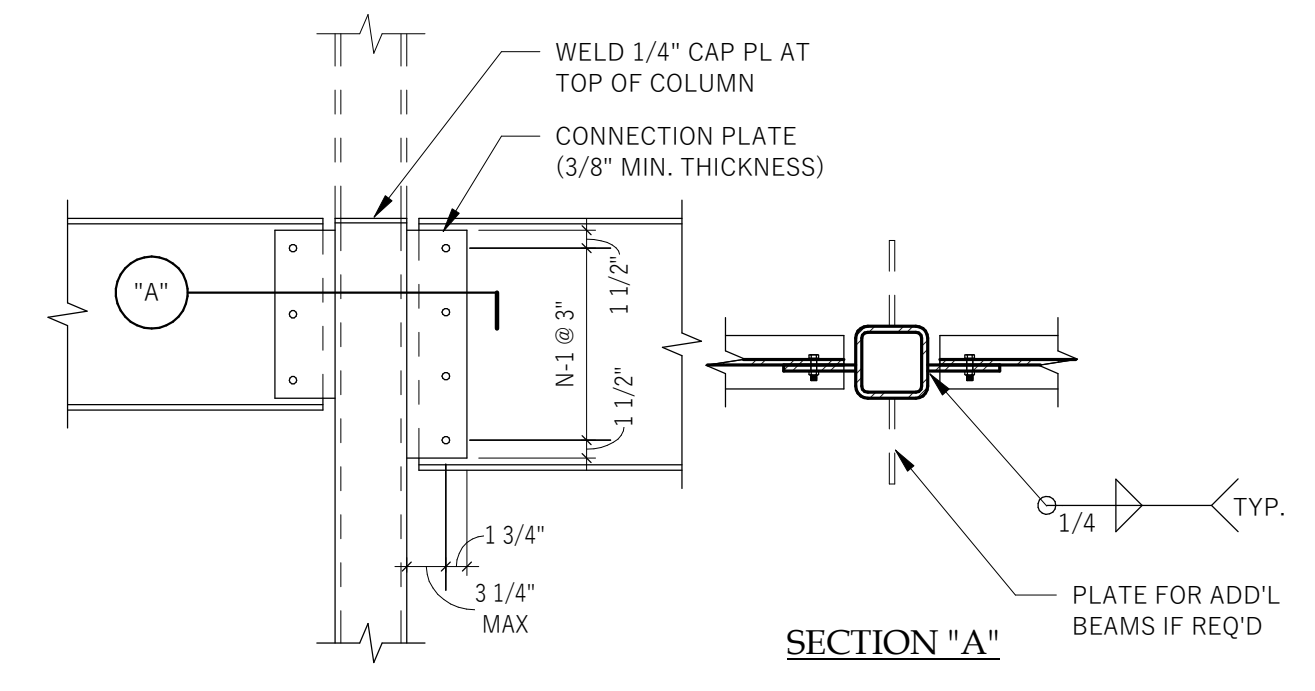


TYPICAL BEAM WEB TO TUBE COLUMN CONNECTION

2
 S503
 3/4" = 1'-0"


BEAM SIZE	PLATE LENGTH (L)	NO. OF BOLTS (N)	MAX BEAM REACTIONS (KIPS)	
			3/4" DIA	7/8" DIA
W8	6	2	21.2	25.6
W10	6	2	21.2	25.6
W12	9	3	31.8	38.4
W14	9	3	31.87	39.2
W16	12	4	42.4	52.2
W18	15	5	53	65.3
W21	18	6	63.6	78.3
W24	18	6	63.6	78.3
W27	21	7	74.2	91.3
W30	24	8	84.8	103.5
W33	27	9	95.4	115.6
W36	30	10	106	127.8
W40	33	11	116.6	139.9
W44	36	12	127.2	152.1

- NOTES:
- CONNECTIONS SHALL BE BASED ON REACTIONS SHOWN ON PLANS AND MAXIMUM BEAM REACTION IN ABOVE TABLE. U.N.O.
 - NOTED REACTIONS ARE FOR SERVICE LOADS.
 - REF. "STRUCTURAL STEEL CONNECTIONS" IN STRUCTURAL NOTES FOR ADD'L INFO.
 - MINIMUM CONNECTION: PLATE THICKNESS IS 3/8" TYPICAL AND 7/16" AT W33 AND DEEPER "HEAVY" CONNECTIONS.
 - BOLTS ARE A325N, TYPICAL.
 - BEAM CONNECTIONS ARE "STANDARD" U.N.O. ON PLAN.
 - ANY REACTIONS NOTED ON PLAN WHICH EXCEED MAX. BEAM REACTIONS NOTED IN TABLE ABOVE SHALL BE DESIGNED BY GENERAL CONTRACTOR. REF. STRUCTURAL NOTES FOR ADDITIONAL INFO.

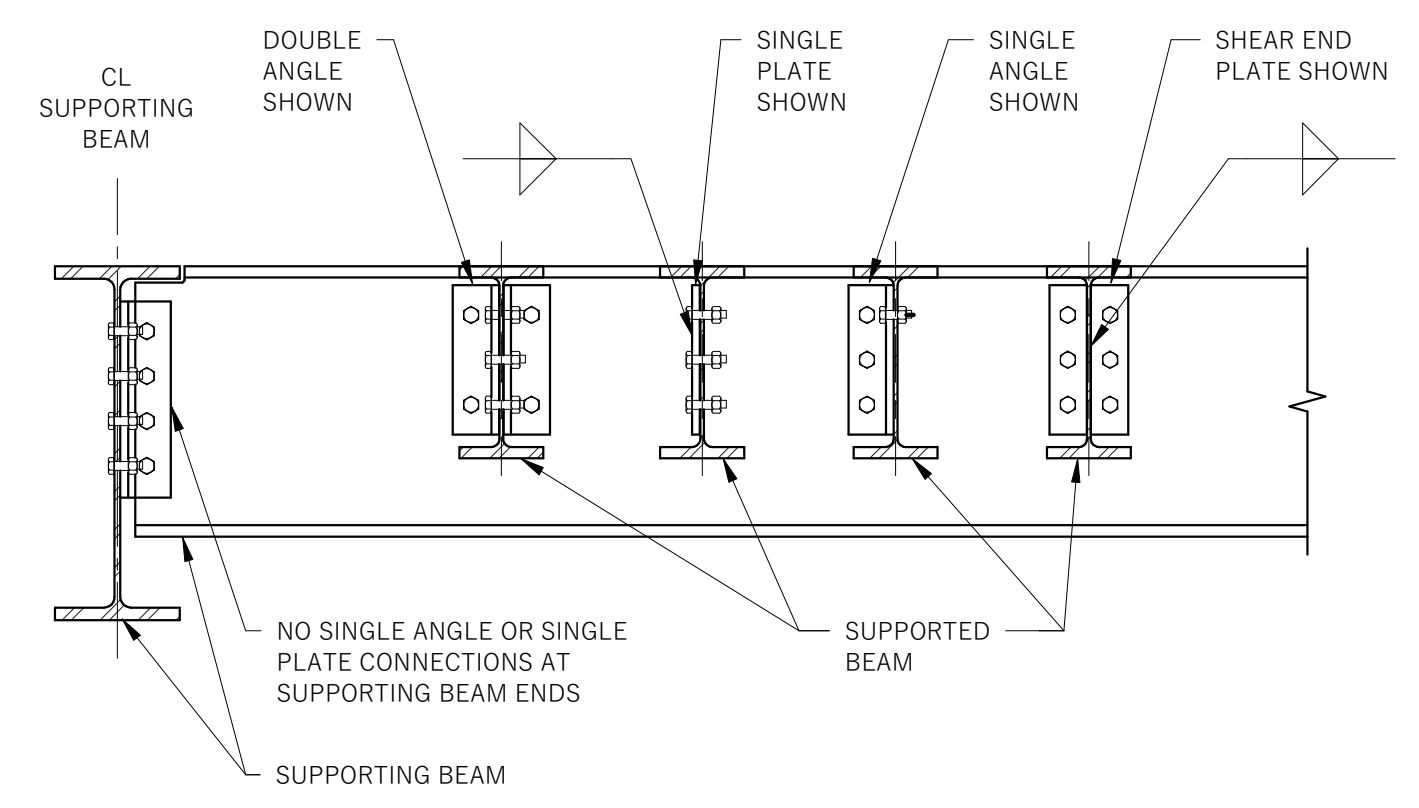


- NOTES:
- SUPPORTED BEAMS PRIMARILY SUPPORT DISTRIBUTED LOADS FROM SLABS OR DECKING
 - SUPPORTING BEAMS SUPPORT SIGNIFICANT POINT LOADS FROM ONE OR MORE SUPPORTED BEAMS OR FROM COLUMNS BEING TRANSFERRED. SUPPORTING BEAMS MAY BE SUPPORTED BY COLUMNS OR BY OTHER SUPPORTING BEAMS
 - FOR AISC SIMPLE SHEAR CONNECTIONS AT SUPPORTED BEAM ENDS, DOUBLE ANGLE, SINGLE PLATE, SINGLE ANGLE, OR SHEAR END PLATE MAY BE USED UNO
 - WELDED/BOLTED OR BOLTED/BOLTED CONNECTIONS PER AISC ARE PERMITTED

3
 S503
 3/4" = 1'-0"

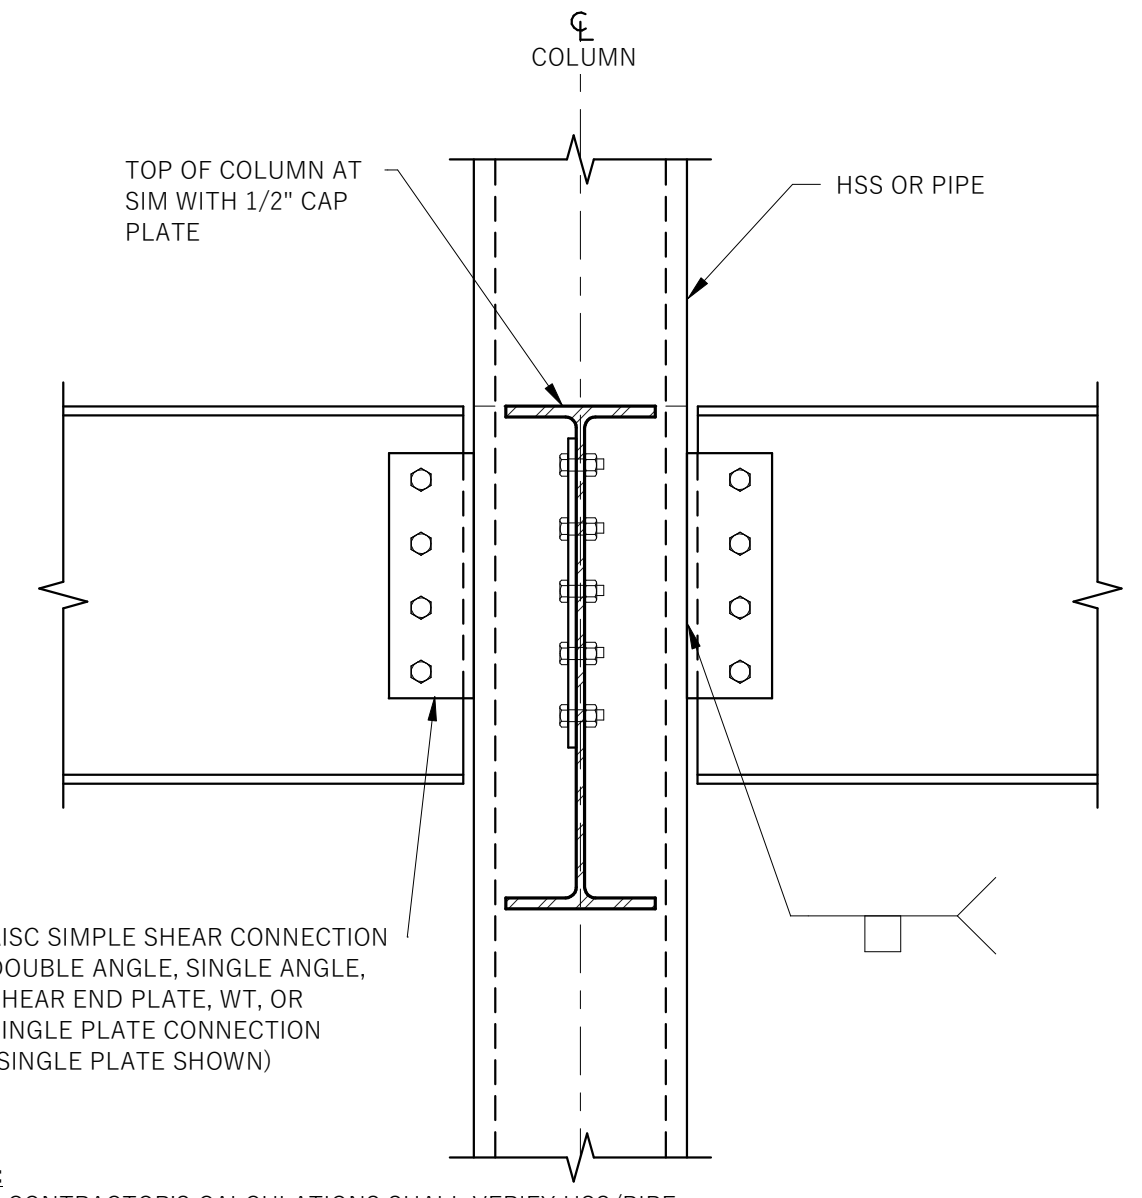


- NOTES:
- CONTRACTOR'S CALCULATIONS SHALL VERIFY HSS/PIPE WALL THICKNESS IS ADEQUATE FOR CONNECTION TYPE CHOSEN PER AISC.

4
 S503
 1" = 1'-0"

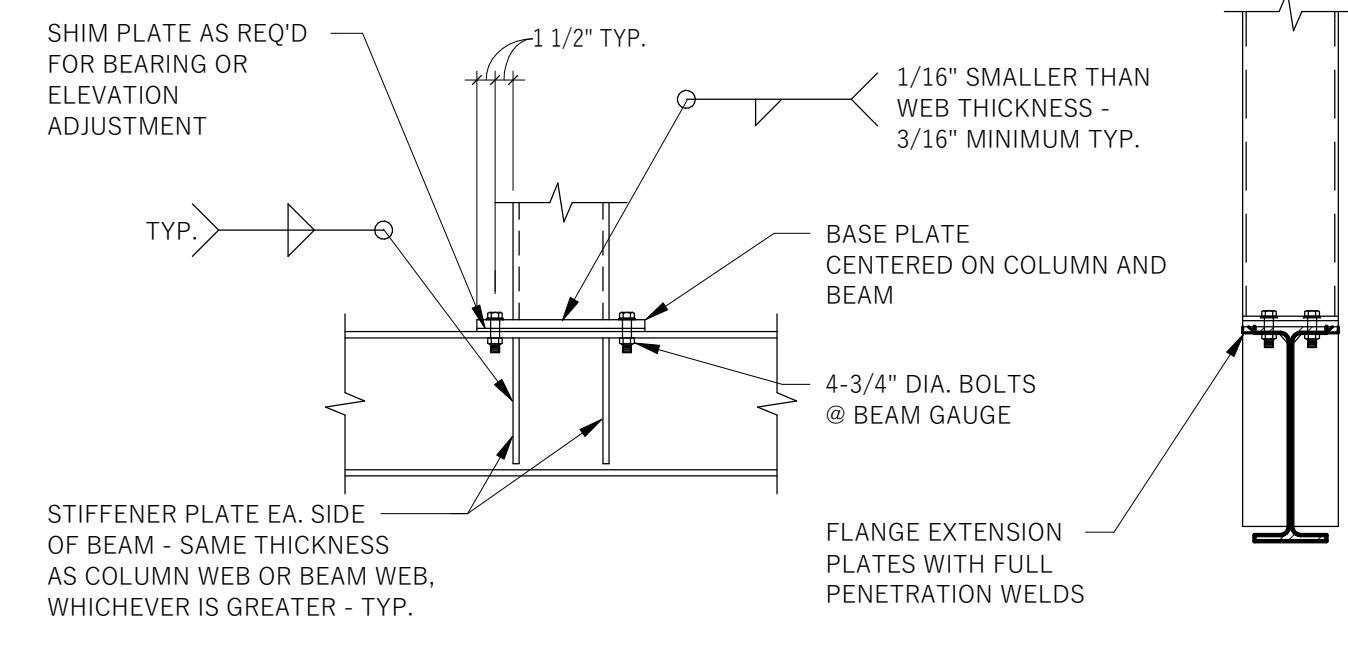

- NOTES:
- CONNECT INTERSECTING BEAMS TO STIFFENER PLATES USING BOLTS IN SINGLE SHEAR DESIGNED FOR ECCENTRIC BEAM REACTION.
 - PROVIDE FLANGE EXTENSIONS AS REQ'D TO MATCH COLUMN BASE PLATE WIDTH.

5
 S503
 3/4" = 1'-0"

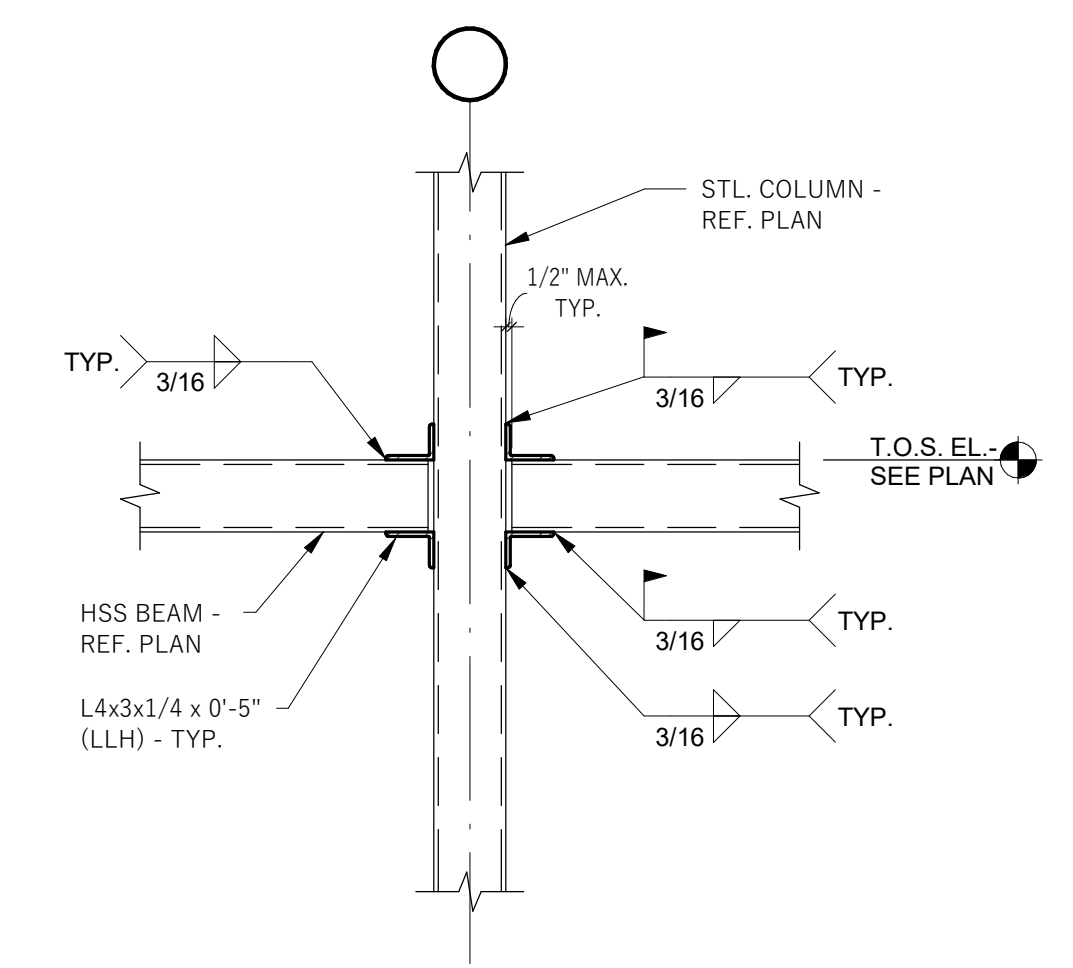

TYPICAL HSS GIRT TO COLUMN CONNECTION DETAIL

6
 S503
 3/4" = 1'-0"

ALIGN
 AUSTIN ARCHITECTS

BUILDING 1
 THE SQUARE AT CRYSTAL FALLS
 1900 S BAGDAD ROAD BLDG. 1
 LEANDER, TEXAS 78641

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
 2 06/20/22 REV 2




09/09/2024
 100% CDS-REVISED
 FLANGE CONNECTIONS


SHEET: **S503**

JCAA
 4100 Wardworth Blvd
 Wheat Ridge, CO 80033
 p 303.985.3260
 TX F-14436 #21134


PROJECT NO: 21099
 DRAWN BY: BC
 DATE: 01/28/2022
 PROJECT MGR: NHR

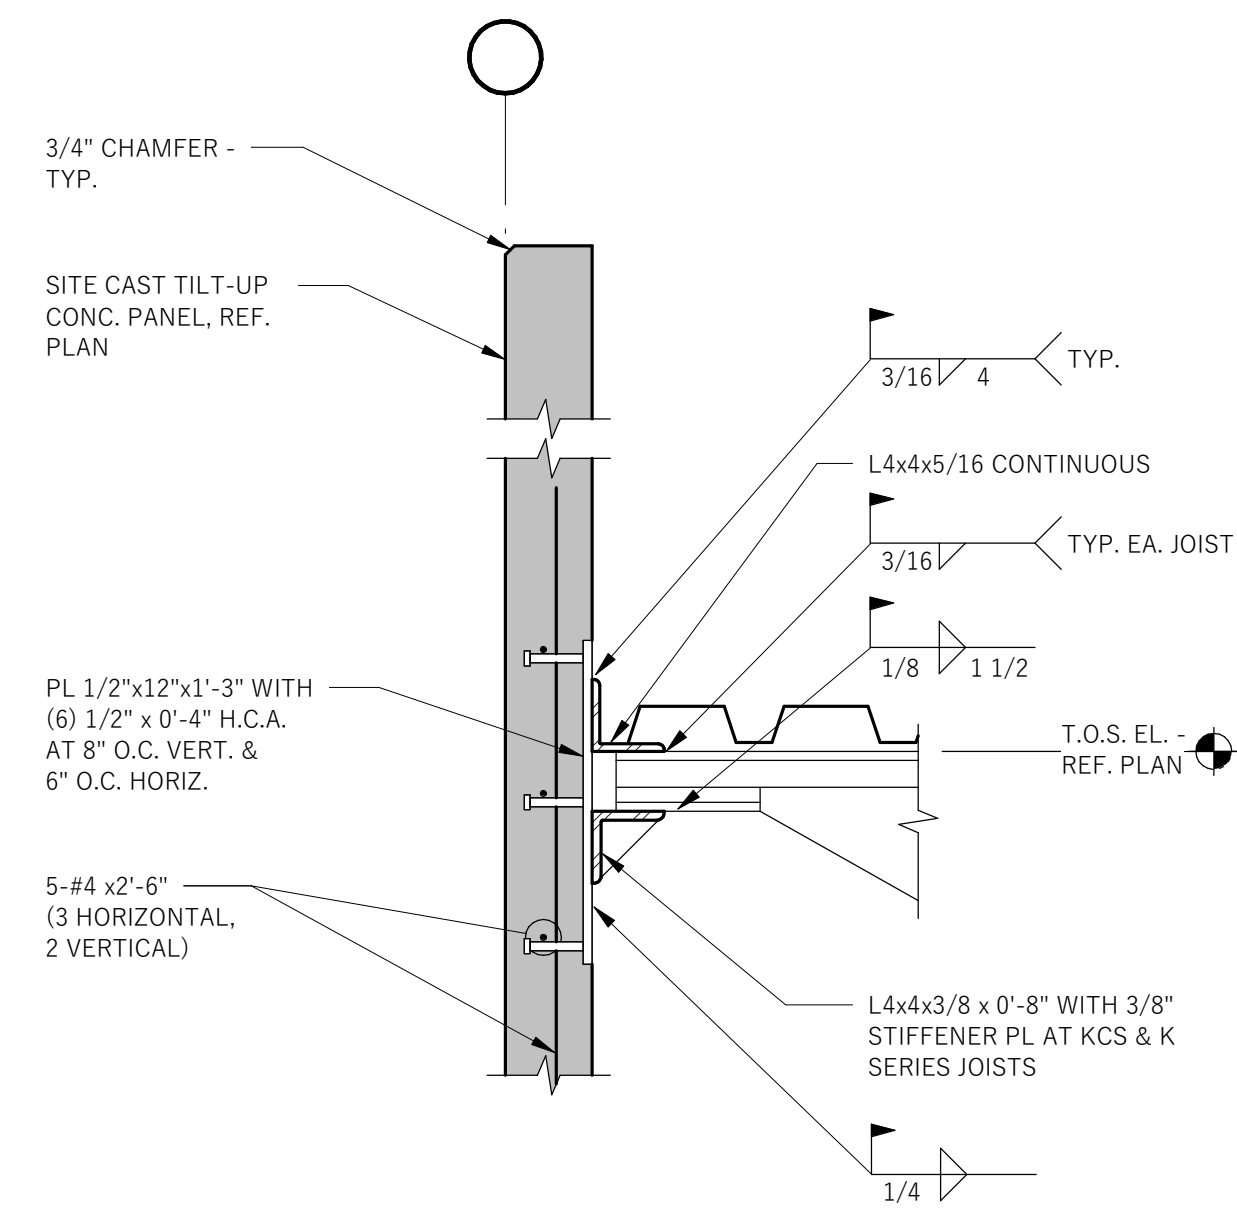


1
S601
3/4" = 1'-0"

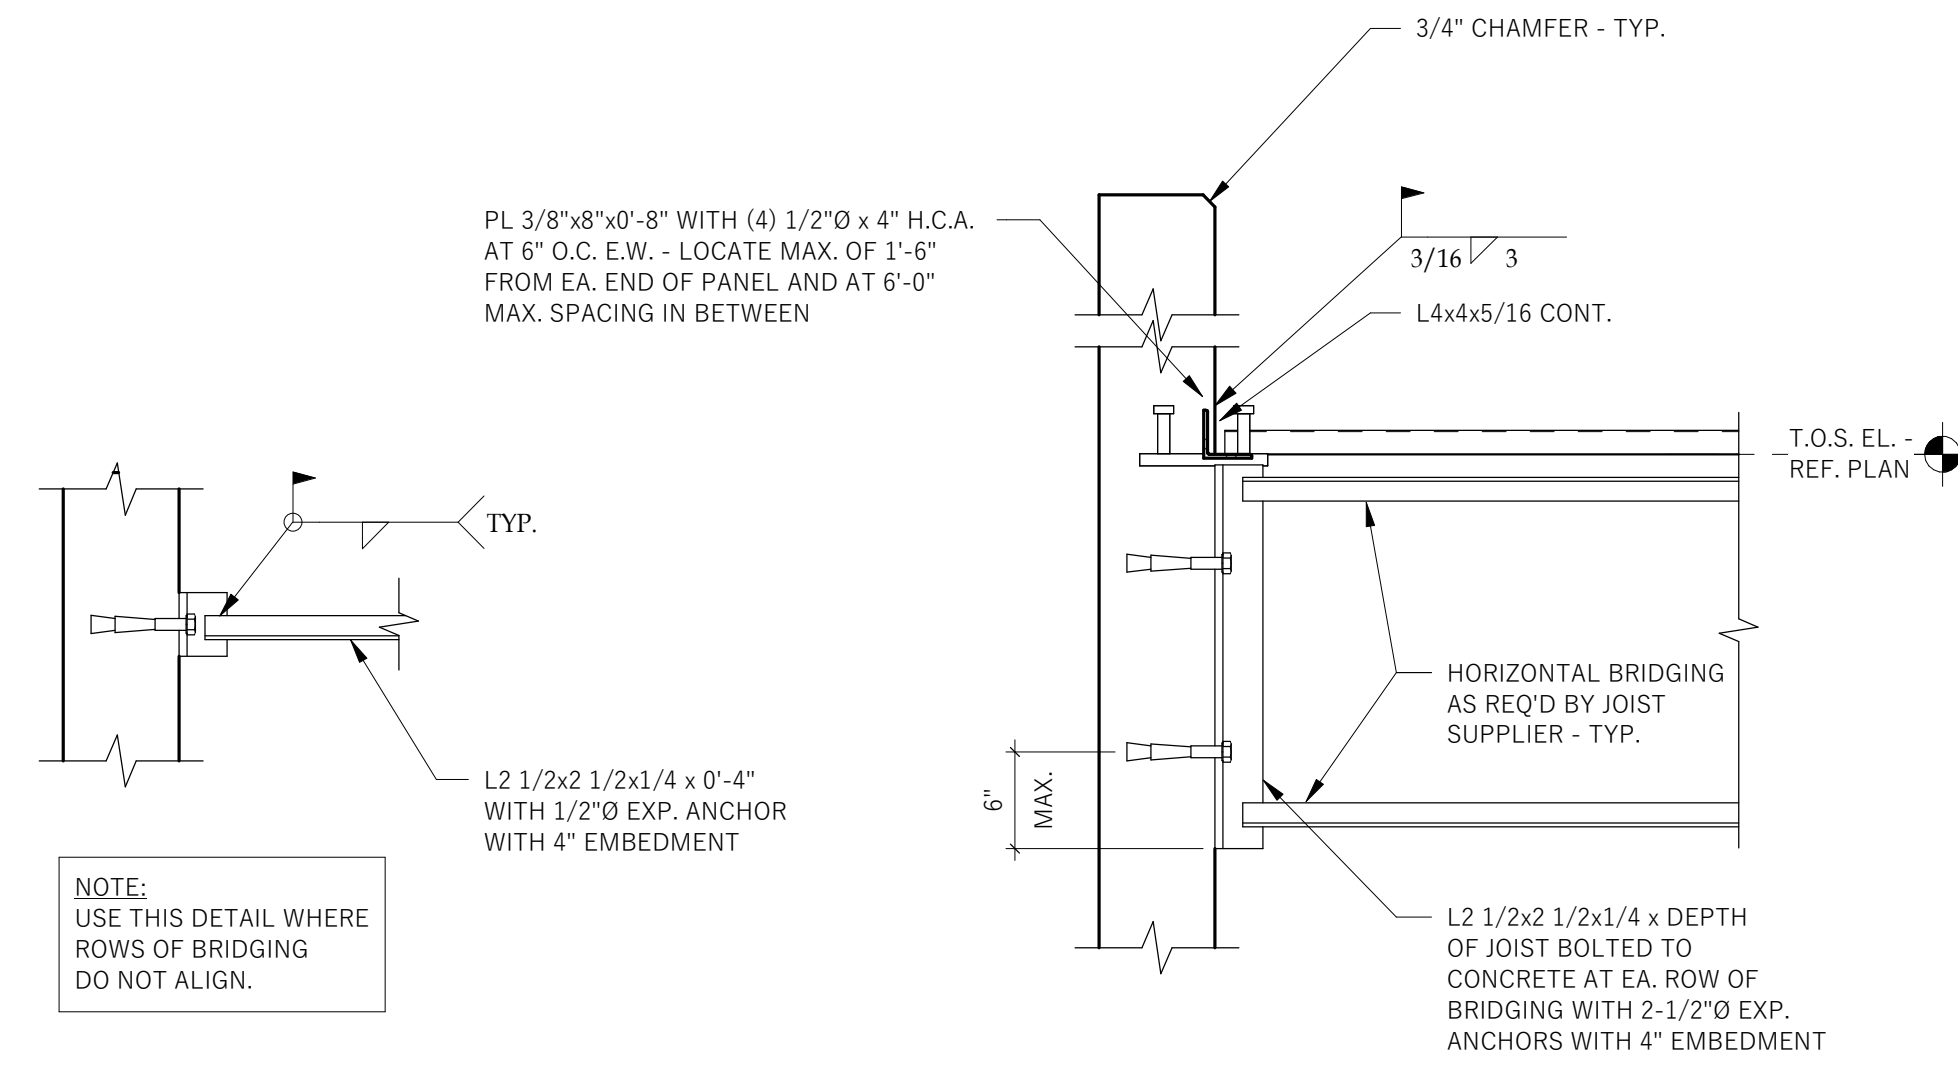

2
S601
1" = 1'-0"

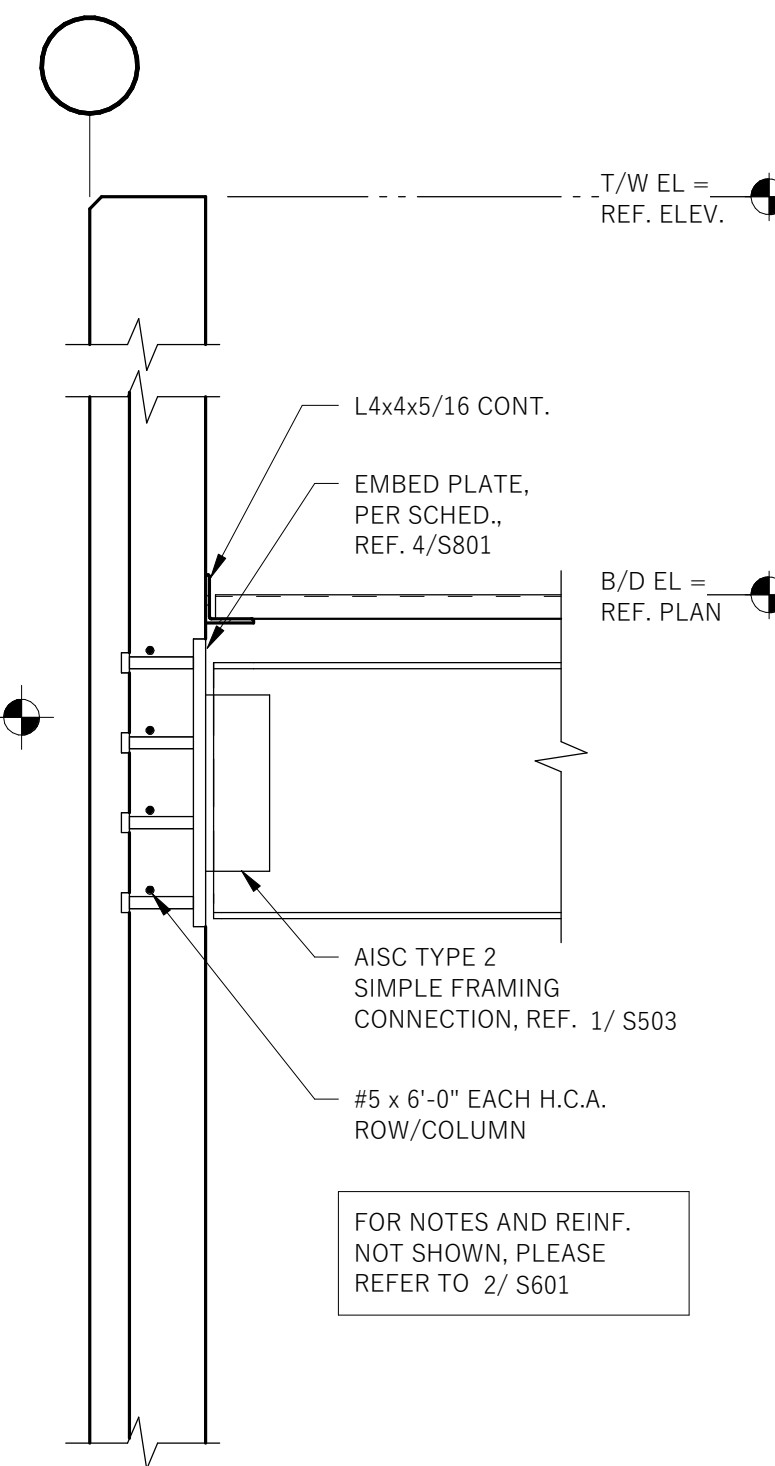

3
S601
1" = 1'-0"

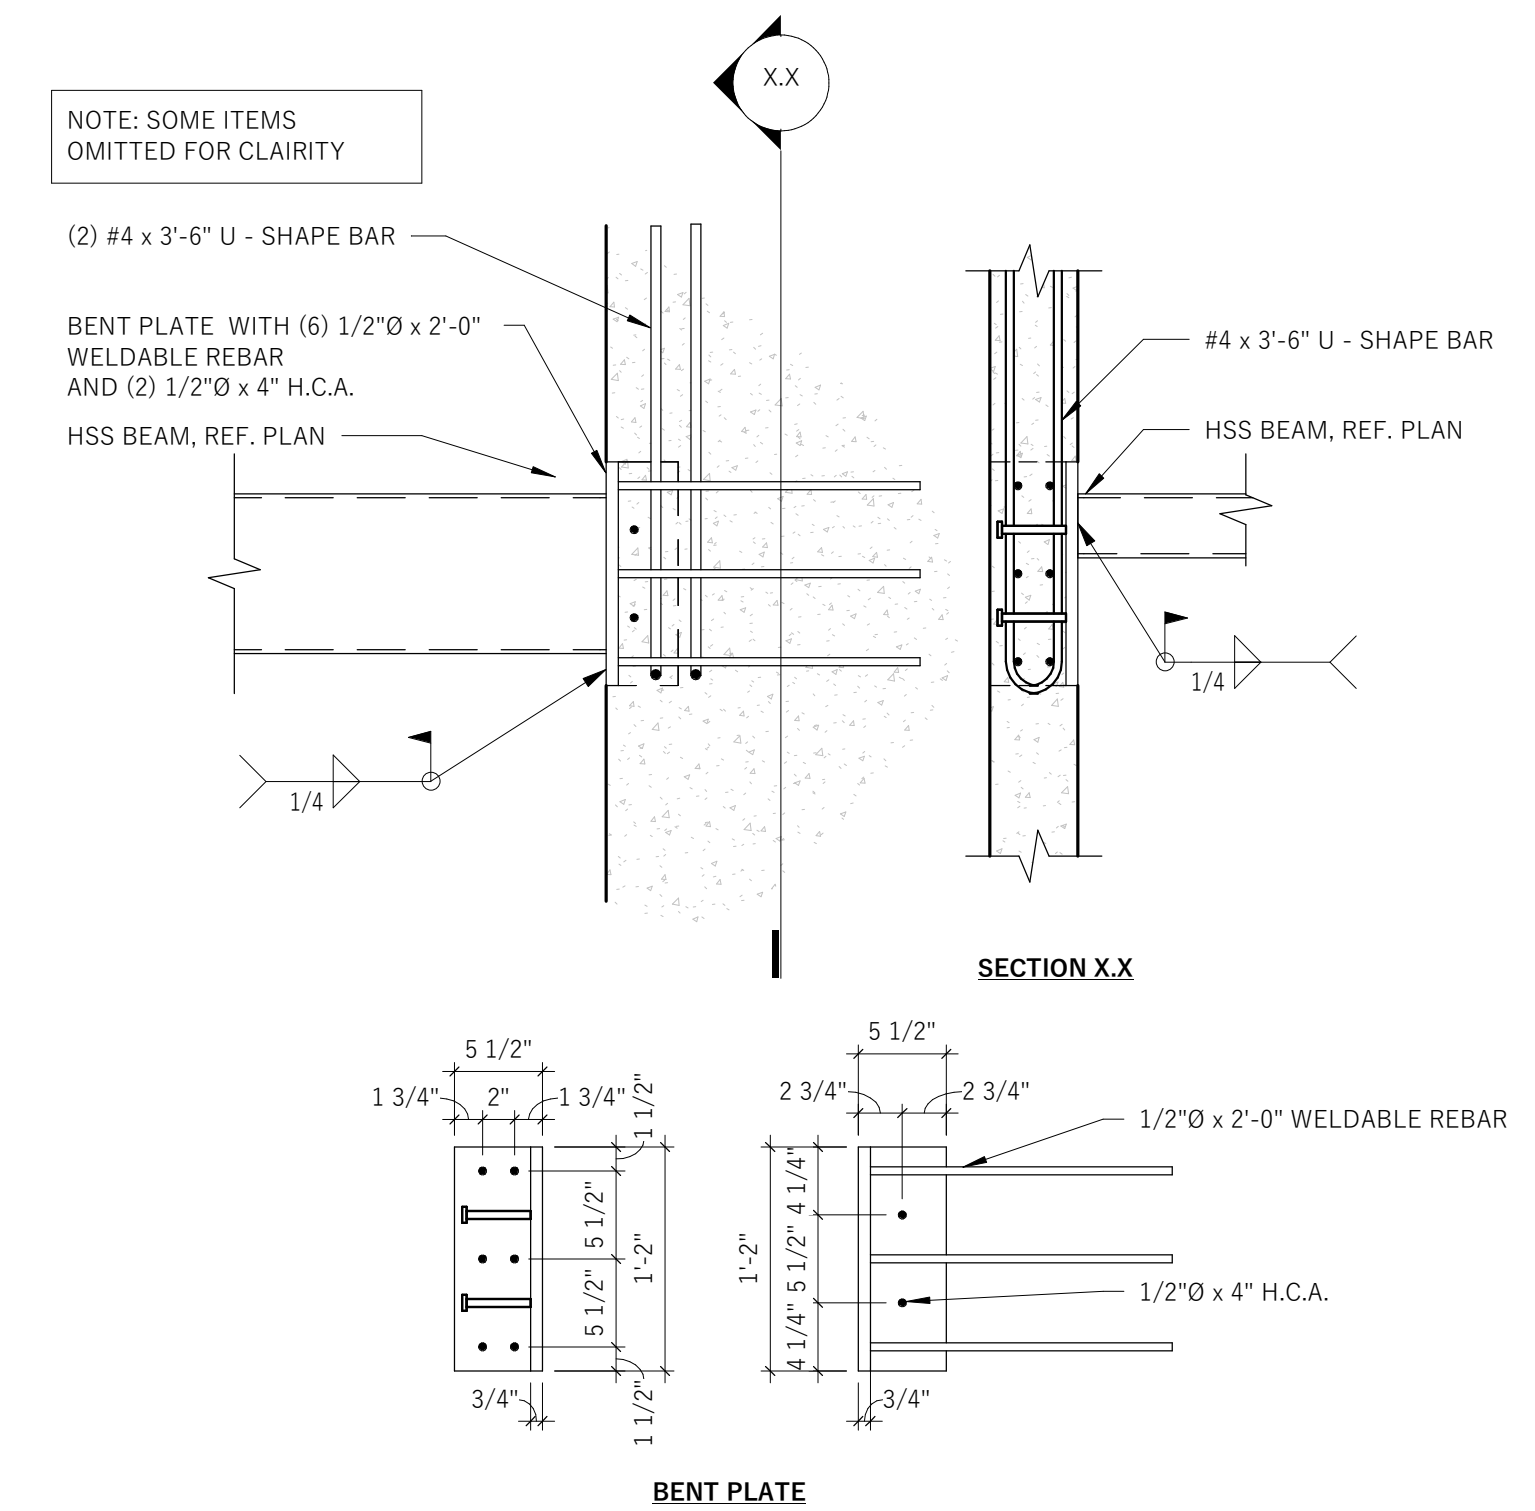


4
S601
1" = 1'-0"

EMBED PLATE SCHEDULE - SHEAR ONLY								
NOMINAL STEEL BEAM SIZE	MAXIMUM FACTORED VERTICAL BEAM SHEAR REACTION (KIPS)	MINIMUM CONNECTION DEPTH (IN)	EMBED PLATE			No STUD COLUMNS	No STUD ROWS	REMARKS
			t (in)	X B (in)	X D (in)			
W8 - W12	33	6	3/4	X 10	X 10	2	2	
W12 - W18	47	9	3/4	X 10	X 16	2	3	
W14 - W24	68	12	3/4	X 12	X 22	2	4	
W18 - W30	85	15	3/4	X 12	X 28	3	5	COLUMN SPACING 4 1/2" OC
W21 - W36	100	18	3/4	X 14	X 32	3	5	COLUMN SPACING = 5" OC ROW SPACING = 7" OC
W24 - W40	130	21	3/4	X 16	X 28	3	5	

- NOTES:**
- USE SMALLEST EMBED PLATE SIZE FOR A GIVEN NOMINAL BEAM DEPTH AND WITH A SCHEDULED MAXIMUM SHEAR REACTION EQUAL TO OR GREATER THAN THE SHEAR REACTION REQUIRED ON PLAN
 - CONTRACTOR SHALL DESIGN SINGLE-PLATE GRADE, THICKNESS, BOLT QUANTITY AND TYPE (A325, A490, N OR X) TO RESIST THE SHEAR FORCE SHOWN IN TABLES OR PLANS WHILE SATISFYING GEOMETRIC REQUIREMENTS OF THE TYPICAL EMBED PLATE DETAIL AND SCHEDULE. REF. GENERAL NOTES FOR ADDITIONAL INFORMATION REGARDING THE DESIGN OF STRUCTURAL STEEL CONNECTIONS
 - EMBED PLATES SHALL CONFORM TO ASTM A572, Fy=50 ksi
 - STUDS SHALL BE 3/4" DIAMETER x 5 1/2" LONG NOMINAL (MINIMUM), 4" LONG AT 5 1/2" TILT PANEL
 - REF. TYPICAL EMBED DETAIL FOR ASSUMED CONNECTION LOCATION RELATIVE TO EMBED PLATE. REPORT ANY AS-BUILT DEVIATION FROM THE ASSUMED CONDITION TO THE SER AS FOLLOWS: HORIZONTAL DEVIATION GREATER THAN 2" VERTICAL DEVIATION GREATER THAN 1"

5
S601
N.T.S.

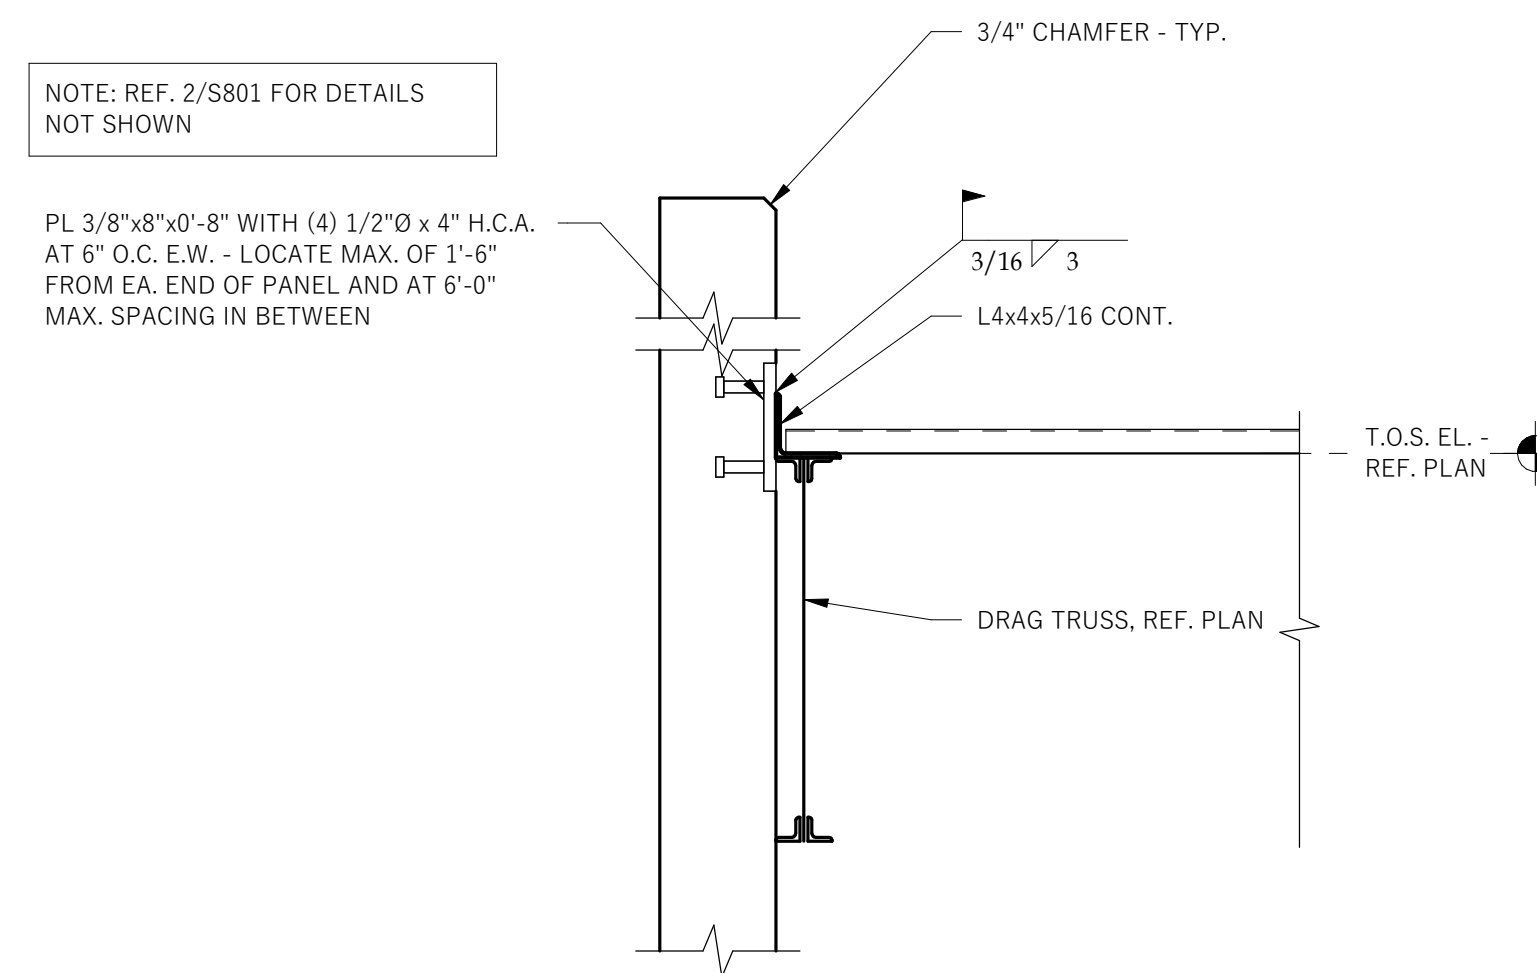

6
S601
1" = 1'-0"


COPYRIGHT © 2024. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
2 06/20/22 REV 2




09/09/2024
100% CDS-REV 05-VE
TILT WALL DETAILS

SHEET: **S601**

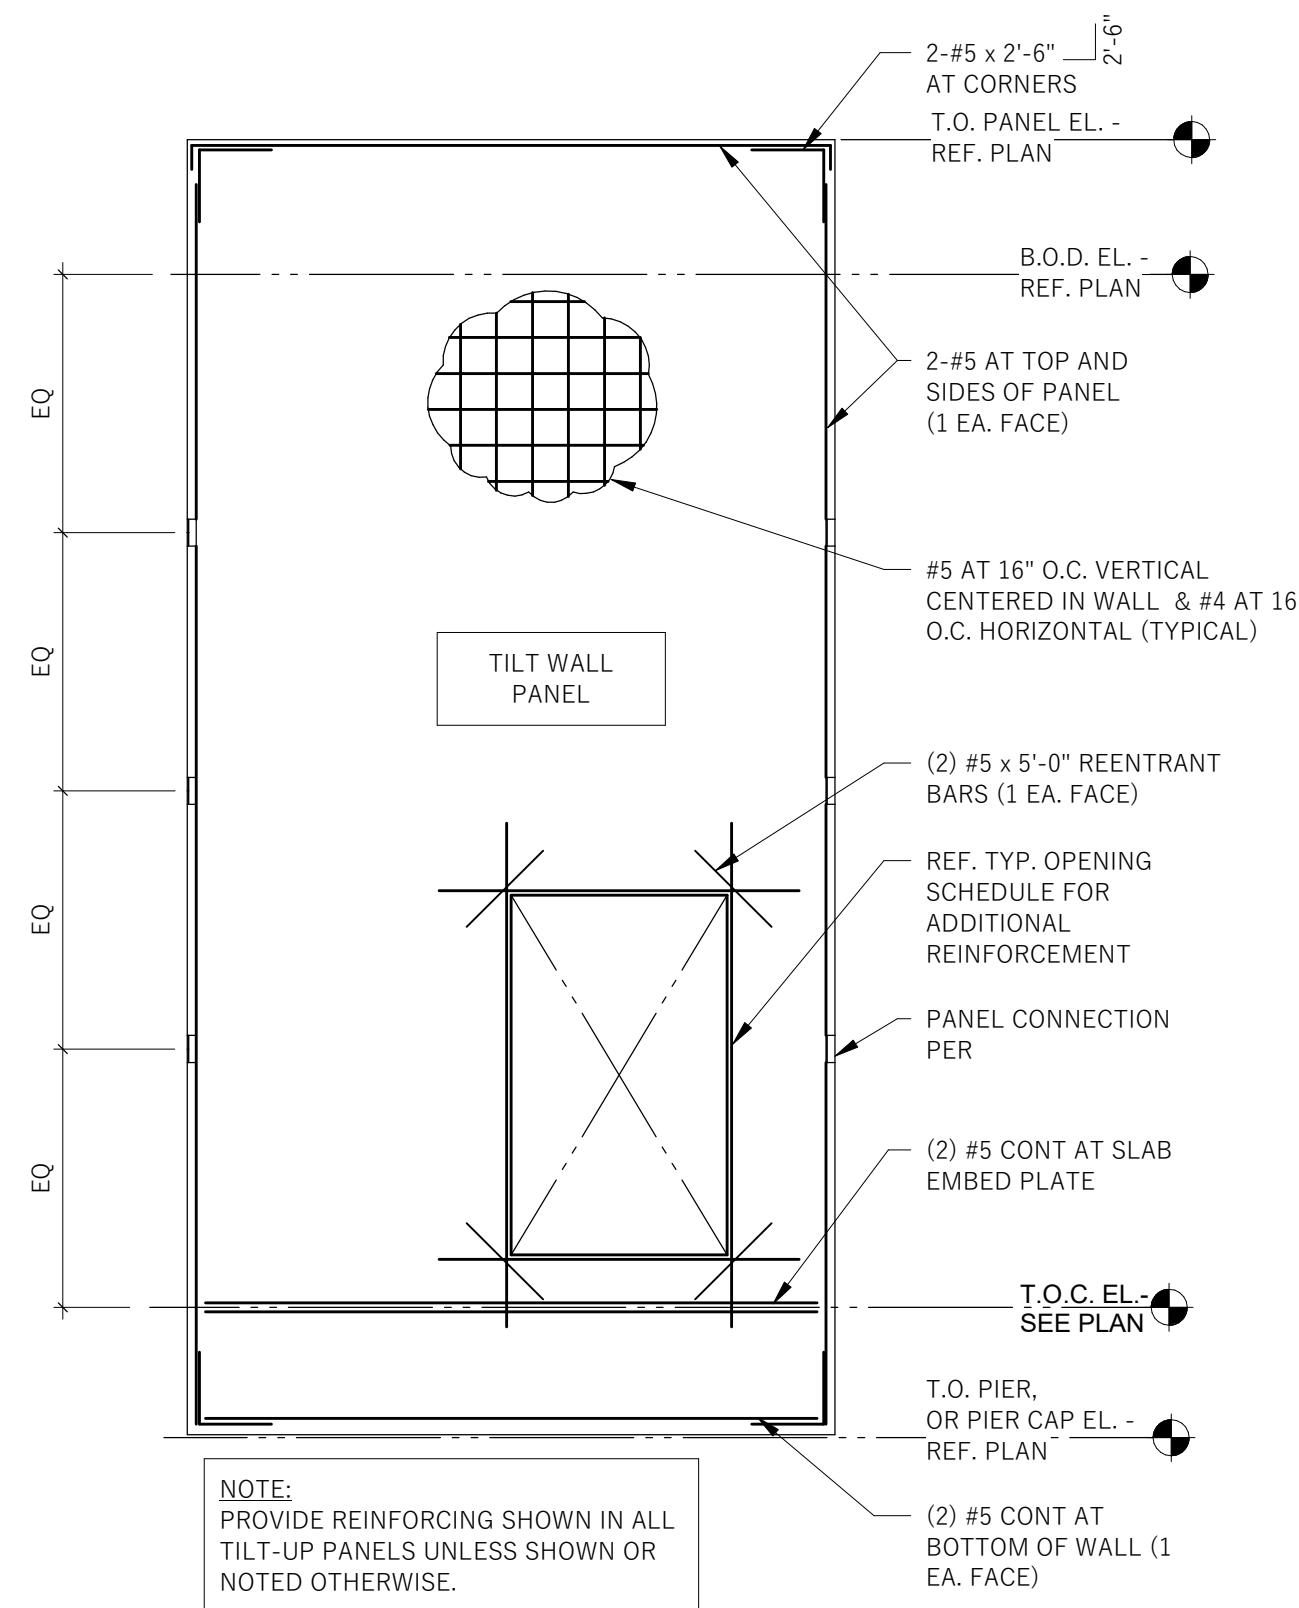


1
S602 3/16" = 1'-0"

TYPICAL PANEL REINFORCING

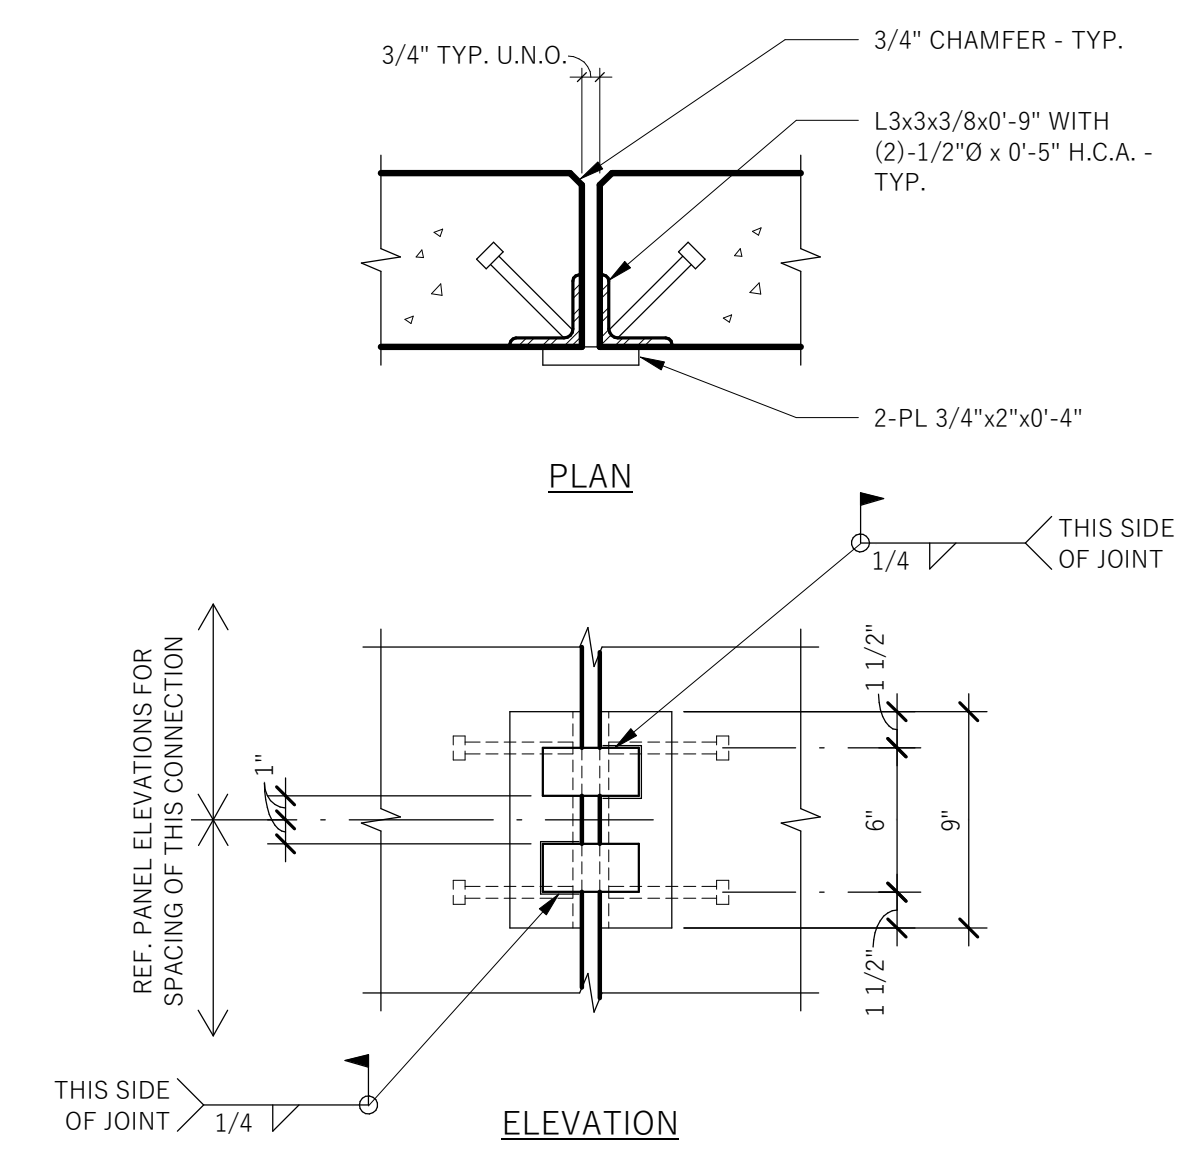


2
S602 3/4" = 1'-0"

TYPICAL TILT-UP WALL PANEL ALIGNMENT DETAIL

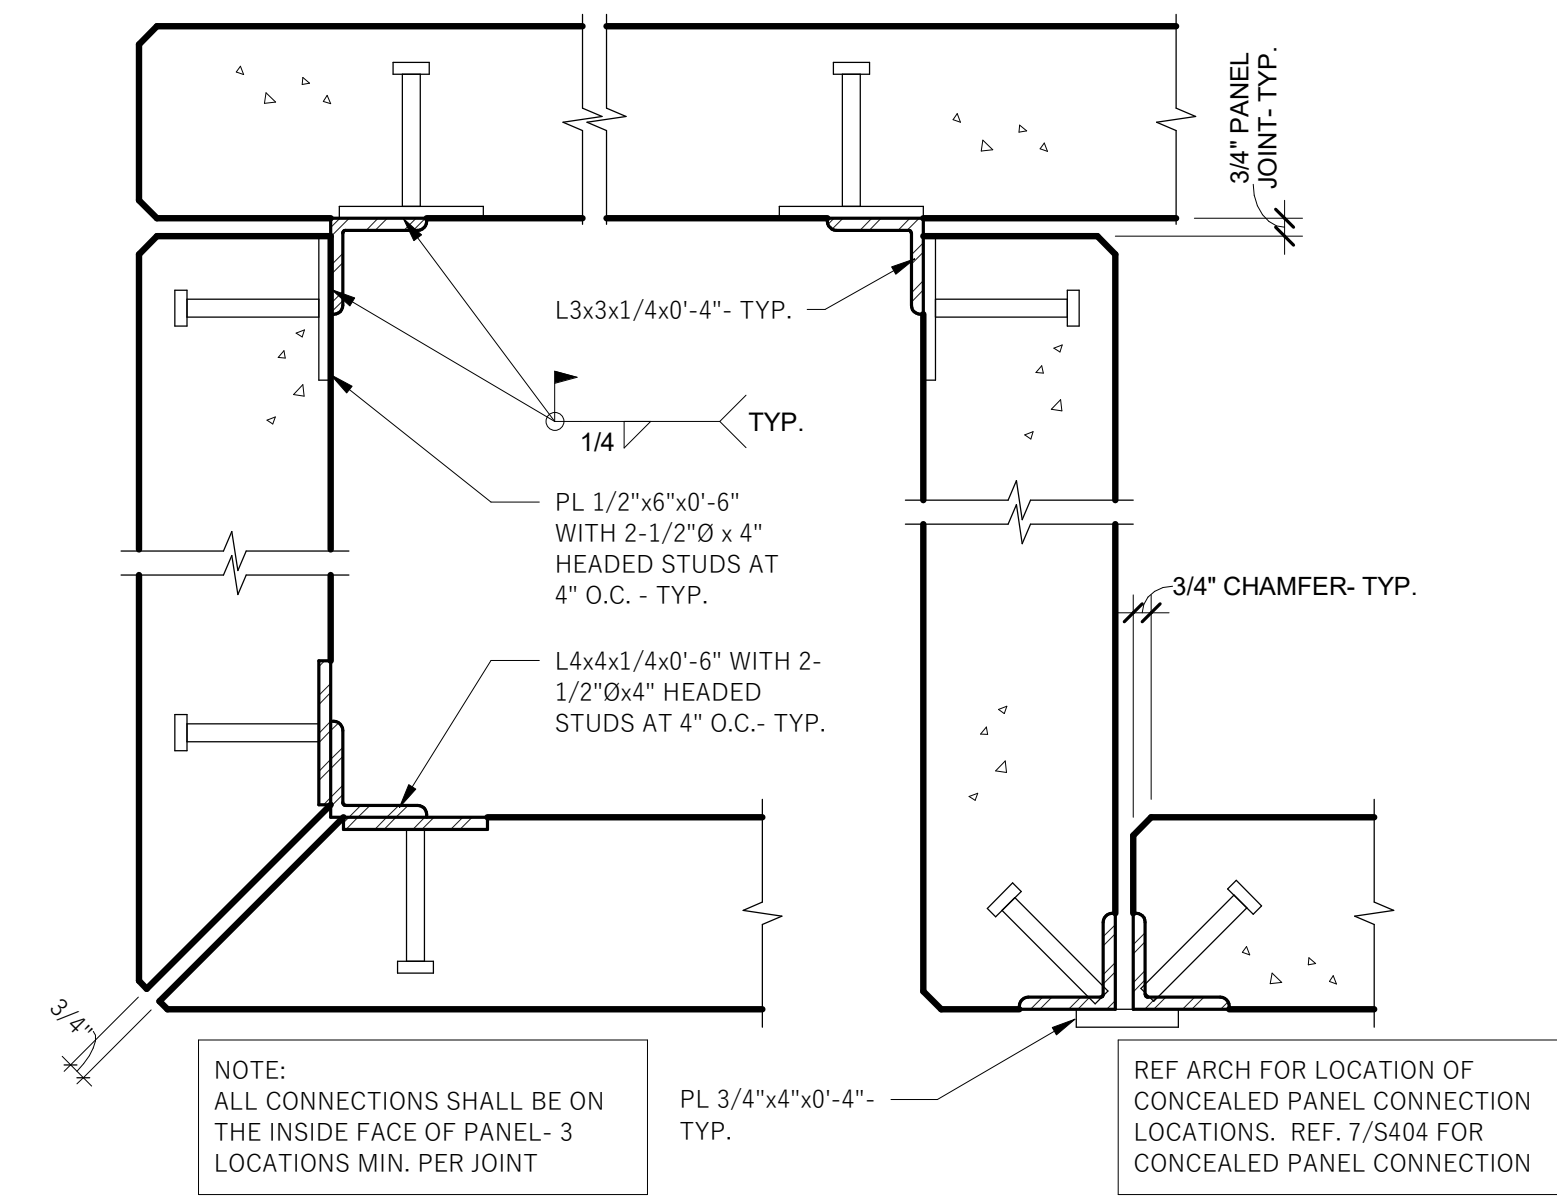


3
S602 1 1/2" = 1'-0"

TYPICAL PANEL TO PANEL CORNER CONNECTIONS DETAIL

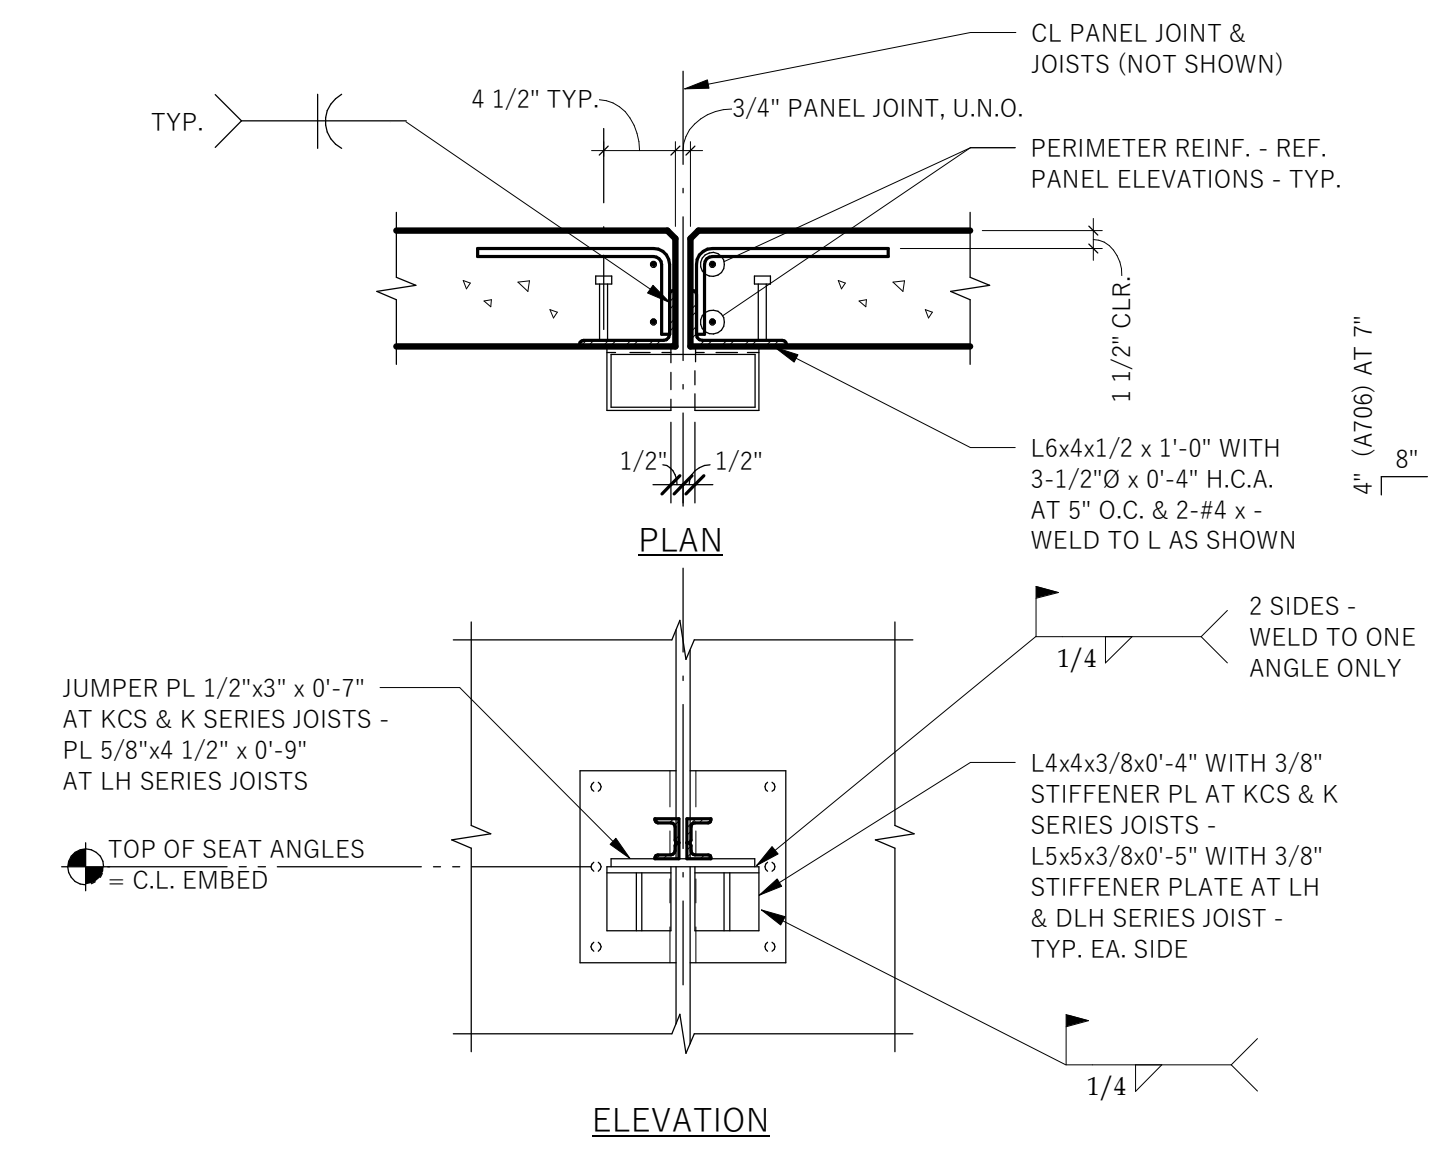

4
S602 3/4" = 1'-0"

TYPICAL JOIST SEAT AT PANEL JOINT

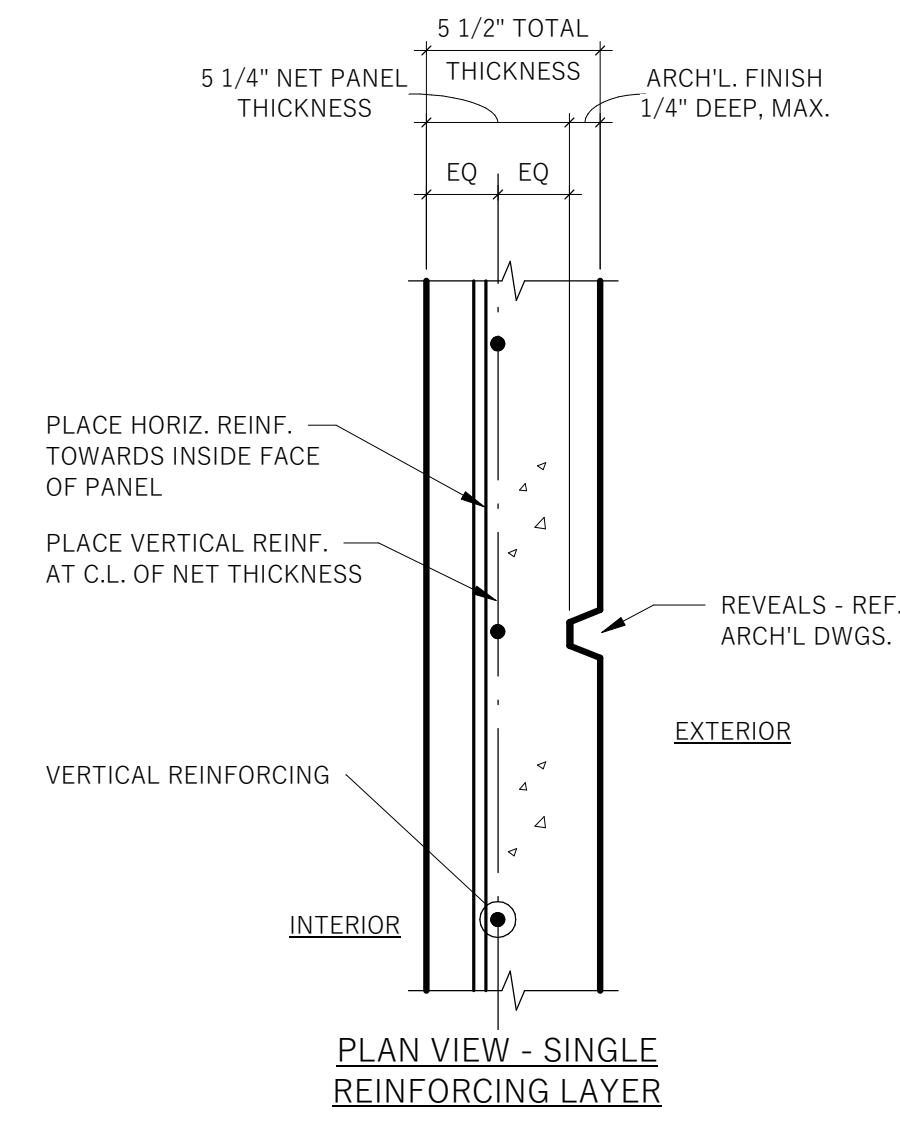

5
S602 3/4" = 1'-0"

TYP. TILT-UP REINF. PLACEMENT DETAIL

TILT-UP WALL PANEL OPENING SCHEDULE

OPENING WIDTH	VERT. REINF.	HORIZ. REINF.
≤ 4'-0"	2-#5, 1 EA. FACE	2-#5, 1 EA. FACE
> 4'-0" & ≤ 8'-0"	4-#5, 2 EA. FACE	4-#5, 2 EA. FACE
> 8'-0"	6-#5, 3 EA. FACE	6-#5, 3 EA. FACE


6
S602 3/4" = 1'-0"

TILT WALL OPENING REINF.

*PROVIDE STANDARD HOOK IN VERT. REINF. IF INTERRUPTED BY OPENING ABOVE/BELOW.

COPYRIGHT © 2024. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF ALIGN AUSTIN ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

REVISION:
2 06/20/22 REV 2

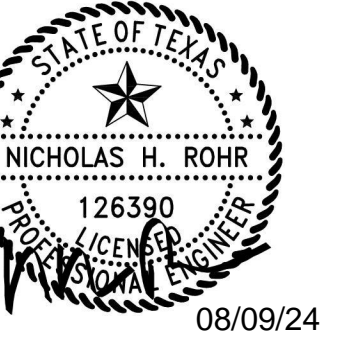

09/09/2024
100% CDS-REV05-VE
TILT WALL ADDITIONAL DETAILS

SHEET: **S602**

ELECTRICAL LEGEND

NOTE: ALL SYMBOLS SHOWN ON LEGEND ARE NOT NECESSARILY USED.

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	1X4 LINEAR FLUORESCENT FIXTURE W/ DESIGNATION	ABBREVIATIONS	
	2X2 LINEAR FLUORESCENT FIXTURE W/ DESIGNATION	AFB	ABOVE FINISHED CEILING
	2X4 LINEAR FLUORESCENT FIXTURE W/ DESIGNATION	AFD	ABOVE FINISHED FLOOR
	NIGHT LIGHT FIXTURE	AFG	ABOVE FINISHED GRADE
	LINEAR FLUORESCENT STRIP OR 6" FIXTURE W/ DESIGNATION	AHJ	AUTHORITY HAVING JURISDICTION
	RECESSED DOWNLIGHT FIXTURE W/ DESIGNATION	AL	ALUMINUM
	SURFACE OR PENDANT DOWNLIGHT FIXTURE W/ DESIGNATION	BFG	BELOW FINISHED GRADE
	WALL WASH FIXTURE W/ DESIGNATION, DIRECTION INDICATED BY TRIANGLE	C	CONDUIT
	WALL MOUNT LINEAR FLUORESCENT FIXTURE W/ DESIGNATION	CKT	CIRCUIT
	WALL MOUNT FIXTURE W/ DESIGNATION	CT	CURRENT TRANSFORMER
	SPOTLIGHT	EOMH	ELECTRICALLY OPERATED, MECHANICALLY HELD
	CEILING OR WALL MOUNT EXIT SIGN (INSTALL FACE AS INDICATED BY ARROWS)	EM	EMERGENCY
	EMERGENCY BATTERY FIXTURE	EWG	ELECTRIC WATER COOLER
	CEILING FAN	(E)	EXISTING
	20A SIMPLEX RECEPTACLE AT 18" U.N.O.	ETR	EXISTING TO REMAIN
	20A DUPLEX RECEPTACLE AT 18" U.N.O.	ER	EXISTING RELOCATED
	GFCI RECEPTACLE AT 18" U.N.O. (DUPLEX / SIMPLEX)	F/A	FIRE ALARM
	20A QUADRUPLX RECEPTACLE AT 18" U.N.O.	F/S	FIRE/SMOKE DAMPER
	20A DUPLEX RECEPTACLE 8" ABOVE COUNTER U.N.O.	G OR GND	GROUND
	20A DUPLEX RECEPTACLE SPECIAL MOUNT (FLOOR, CLG)	GEC	GROUNDING ELECTRODE CONDUCTOR
	20A ISOLATED GROUND RECEPTACLE	GF	GROUND FAULT CIRCUIT INTERRUPTER
	20A WEATHER-RESISTANT GFCI RECEPTACLE WITH WEATHERPROOF "EXTRA DUTY WHILE IN USE" COVER	IG	ISOLATED GROUND
	DEDICATED DUPLEX RECEPTACLE WITH AMP RATING NOTED	MFR	MANUFACTURER
	20A DUPLEX RECEPTACLE WITH TOP RECEPTACLE CONTROLLED BY AUTO-ON/OFF OCCUPANCY SENSOR	N1, N3R, N...	NEMA 1, NEMA 3R, NEMA RATING (AS NOTED)
	20A COMBINATION DUAL USB AND DUPLEX RECEPTACLE		
	SPECIAL RECEPTACLE AS NOTED	NIS	NOT IN ELECTRICAL SECTION
	COMBINATION TELEPHONE/DATA (TELE-DATA) OUTLET (18" ON WALL, 8" ABOVE COUNTER, FLOOR)	NL	NIGHT LIGHT
	TELEPHONE OUTLET, DATA OUTLET	NTS	NOT TO SCALE
	TELEVISION/CABLE OUTLET, CARD READER OUTLET	OH	OVERHEAD
	J-BOX (CEILING/WALL, FLOOR)	SDE	SERVICE DISTRIBUTION ENCLOSURE
	SECURITY CAMERA	SPD	SURGE PROTECTIVE DEVICE
	CONDUIT RUN EXPOSED OR CONCEALED	TT	TELEPHONE TERMINAL
	CONDUIT RUN BELOW FLOOR OR GRADE	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
	ITEM TO BE REMOVED	UG	UNDERGROUND
	SWITCHLEG	UNO	UNLESS NOTED OTHERWISE
	CIRCUIT HOMERUN, #12, THWN/THHN & QTY AS REQ'D, W/ GND, 3/4" C., U.N.O.	WP	WEATHER PROOF
	CIRCUIT HOMERUN CONTAINING 3 HOTS, NEUTRAL, & GROUND	WR	WEATHER RESISTANT
	CONDUIT STUB-UP - CAP & MARK	XFMR	TRANSFORMER
	GROUND	XP	EXPLOSION PROOF
	BUILDING STEEL GROUND	+18"	MOUNTING HEIGHT TO CENTERLINE OF DEVICE AFF OR AFF
	COLD WATER GROUND		
	CONCRETE ENCASED ELECTRODE GROUND	FIRE ALARM SYSTEM	
	PANELBOARD OR LOAD CENTER	[FACP]	FIRE ALARM CONTROL PANEL
	TRANSFORMER	[ANNUN]	FIRE ALARM ANNUNCIATOR PANEL
	DISCONNECT SWITCH (NON-FUSED UNLESS NOTED OTHERWISE WITH FUSE SIZE - AF - IN DISCONNECT SWITCH CALLOUT)	[F]	MANUAL PULL STATION DOUBLE ACTION
	MAGNETIC MOTOR STARTER	[MMS]	GENERAL ALARM COMBINATION HORN/STROBE (AUDIO/VISUAL) (WALL, CLG)
	COMBINATION DISCONNECT AND STARTER	[V]	FIRE ALARM STROBE (VISUAL DEVICE) (WALL, CLG)
	MOTOR	[S]	SPEAKER - CEILING MOUNTED, WALL MOUNTED
	EQUIPMENT CONNECTION	[S-I]	SMOKE/IONIZATION DETECTOR
	OCCUPANCY SENSOR (CEILING, FLOOR) - RATING/COVERAGE, IF SHOWN, IS IN 100'S OF SQ. FT.	[H]	HEAT DETECTOR
	PHOTOELECTRIC CELL	[D]	DUCT DETECTOR
	LIGHTING CONTACTOR	[FS]	SPRINKLER SYSTEM FLOW SWITCH
	TIMECLOCK	[TS]	SPRINKLER SYSTEM TAMPER SWITCH
	LIGHTING CONTROL PANEL	[RIS]	REMOTE TEST SWITCH
	LIGHT SWITCH AT 48" UNLESS NOTED	[E]	ELECTRIC DOOR HOLDER
SUBSCRIPTS			
3	3-WAY SWITCH		
4	4-WAY SWITCH		
O	OCCUPANCY SENSOR SWITCH		
D	DIMMER SWITCH		
K	KEY-OPERATED SWITCH		
T	TIMER SWITCH		
P	SWITCH WITH PILOT LIGHT		
M	MOTOR RATED SWITCH		
V	VACANCY SWITCH (AUTO OFF, MANUAL ON)		
o	LOWER CASE LETTER AT FIXTURES AND SWITCHES (a, b, ETC.) INDICATES SWITCHING CONTROL.		

GENERAL ELECTRICAL NOTES:

- DO NOT SCALE DRAWINGS. VERIFY DIMENSIONS ON ARCHITECTURAL DRAWINGS AND IN FIELD PRIOR TO COMMENCEMENT OF WORK.
- BEFORE BEGINNING EXCAVATIONS OF ANY NATURE WHATSOEVER, CONTRACTOR SHALL LOCATE ALL SERVICES AND UTILITIES OCCURRING WITHIN THE BOUNDS OF THE PROJECT. THE CONTRACTOR SHALL THEN PROCEED WITH CAUTION IN HIS WORK SO THAT NO UTILITY OR LINE SERVING AREAS THAT ARE TO REMAIN BE DAMAGED WITH A RESULTANT LOSS OF SERVICE. VERIFY THE SOURCE AND SERVICE OF EACH AND EVERY LINE ENCOUNTERED AND RECORD SERVICE, SIZE AND LOCATION ON RECORD DRAWINGS.
- COORDINATE EACH AND EVERY INTERRUPTION OF SERVICES AND UTILITIES WITH THE OWNER AND UTILITY COMPANIES TO ENSURE MINIMUM SHUT-DOWN TIMES ARE ACCEPTABLE.
- VERIFY EXACT LOCATION OF EQUIPMENT TO BE FURNISHED BY OTHERS PRIOR TO ROUGH-IN.
- IT IS THE INTENT OF THESE DRAWINGS TO CALL FOR FINISHED WORK, I.E., FULLY ADJUSTED, TESTED, AND READY FOR OPERATION. WHERE THE WORD "PROVIDE" IS USED, IT SHALL MEAN, "FURNISH AND INSTALL COMPLETE AND READY FOR USE".
- FOR EACH EQUIPMENT CONNECTION SHOWN, PROVIDE THE DEVICE, OUTLET, OR JUNCTION BOX REQUIRED TO CONNECT THE EQUIPMENT.
- WHERE 120 VOLT BRANCH CIRCUITS EXCEED 57', PROVIDE MINIMUM #10 AWG CONDUCTORS FROM PANEL TO FIRST DEVICE, FIXTURE, ETC. REF. VOLTAGE DROP TABLE ON THIS SHEET FOR ADDITIONAL VOLTAGE DROP CONDITIONS.
- NO SINGLE CONDUIT SHALL CONTAIN MORE THAN 6 CURRENT CARRYING CONDUCTORS, UNLESS NOTED OTHERWISE AND PROPERLY DERATED. HOMERUN CONDUIT SHALL NOT BE LESS THAN 3/4".
- ALL WIRING SHALL BE IN CONDUIT. ALL CONDUIT SHALL BE 1/2" EMT MINIMUM WITH STEEL TYPE FITTINGS. 1/2" STEEL FLEXIBLE METAL CONDUIT WILL BE ALLOWED IN MAXIMUM LENGTHS OF 6'. 3/8" AND/OR NON-METALLIC FLEXIBLE CONDUIT SHALL NOT BE USED. MC-TYPE CABLE MAY BE USED FOR INTERIOR BRANCH CIRCUIT WIRING IF ALLOWED BY THE AUTHORITY HAVING JURISDICTION. UNDERGROUND CONDUIT SHALL BE RIGID GALVANIZED STEEL (RGS) OR SCHEDULE 40 PVC WITH RGS ELLS AND RGS CONDUIT/FITTINGS WHEN EMERGING FROM GRADE, UNLESS NOTED OTHERWISE. PROVIDE CODE-SIZED GREEN GROUNDING CONDUCTOR IN ALL CONDUIT. INCREASE CONDUIT SIZE AS REQUIRED. ALL WIRING SHALL BE #12 AWG MINIMUM COPPER CONDUCTORS.
- UNLESS OTHERWISE NOTED, CONDUIT SHALL BE CONCEALED, IF POSSIBLE, AND INSTALLED SQUARE TO BUILDING LINES.
- ALL EMPTY RACEWAY SYSTEMS SHALL HAVE A #12 PULLWIRE OR EQUAL, AND SHALL BE IDENTIFIED AT ALL JUNCTION, PULL AND TERMINATION POINTS, USING PERMANENT METALLIC TAGS. TAG SHALL INDICATE INTENDED USE OF CONDUIT, ORIGINATOR, AND TERMINATION POINTS OF EACH INDIVIDUAL CONDUIT.
- WHERE FIXTURES CONTAINING BATTERY PACKS ARE SWITCHED (BY TOGGLE SWITCH, OCCUPANCY SENSOR, TIMECLOCK/LIGHTING CONTROL PANEL, ETC.), SUPPLY TO BATTERY PACKS SHALL BE UNSWITCHED.
- REVIEW ARCHITECTURAL, STRUCTURAL, CIVIL, PLUMBING, AND OTHER DRAWINGS PRIOR TO BID.
- INSTALL ALL MATERIALS IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. ANY DEVIATIONS SHALL BE BROUGHT TO THE ARCHITECT/ENGINEER'S ATTENTION PRIOR TO INSTALLATION.
- WORK SHALL BE PERFORMED IN A WORKMANLIKE MANNER TO THE SATISFACTION OF THE ARCHITECT.
- JUNCTION AND PULL BOXES OF APPROPRIATE DIMENSIONS FOR CONDUITS AND CONDUCTORS NOTED SHALL BE INSTALLED WHERE SHOWN ON THE DRAWINGS AND IN ADDITION WHERE NECESSARY OR CONVENIENT FOR INSTALLING AND PULLING WIRE.
- SPLICES IN EXTERIOR PULLBOXES SHALL BE MADE WATERPROOF USING "SCOTCHCAST" SPLICE KIT OR APPROVED EQUAL. SEAL ENDS OF CONDUITS AND DUCTS WITH "DUCTSEAL" OR APPROVED EQUAL.
- PROTECT ALL RECEPTACLES SHOWN AS GFCI-PROTECTED IN LOCATIONS THAT ARE NOT "READILY ACCESSIBLE" (PER THE NEC) WITH GFCI-TYPE CIRCUIT BREAKERS IN LIEU OF GFCI-TYPE RECEPTACLE.
- PROVIDE A PERMANENTLY AFFIXED LABEL TO EACH INDIVIDUAL RECEPTACLE FACE/COVER PLATE, DISCONNECTING MEANS, SWITCH COVER, ETC., INDICATING THE PANEL AND THE CIRCUIT SERVING THE DEVICE. TYPICAL FOR ALL EQUIPMENT, RECEPTACLES, LIGHTING SWITCHES, AND DISCONNECTS.
- VERIFY EXACT LOCATIONS OF EXISTING AND NEW UNDERGROUND UTILITIES, PIPING, AND RACEWAY SYSTEMS PRIOR TO TRENCHING. PROVIDE NECESSARY TRENCHING, BACKFILL, EXCAVATION, SUPPORTS, SERVICE FEEDERS (CONDUIT AND/OR WIRE), PULLBOXES, SAWCUTTING AND PATCHING, CONCRETE/PAVING, ETC. REQUIRED. BACKFILL TRENCHES TO 90% COMPACTION AND PATCH TO MATCH EXISTING. CONTRACTOR SHALL OBTAIN AND VERIFY EXACT UTILITY COMPANY DRAWINGS AND REQUIREMENTS.
- PROVIDE ALL UNDERGROUND CONDUIT SIZES 2" AND LARGER WITH LONG SWEEP ELLS. (MINIMUM 36" RADIUS.)
- PROVIDE 4" HIGH CONCRETE EQUIPMENT PADS BENEATH.
- FINAL CONNECTIONS TO VIBRATING EQUIPMENT SHALL BE WITH LIQUIDTIGHT FLEX AND APPROVED FITTINGS. DO NOT SECURE CONDUITS, DISCONNECTS, OR DEVICES TO DUCTWORK OR MECHANICAL EQUIPMENT.
- WIRE TERMINATION PROVISIONS FOR PANELBOARDS, CIRCUIT BREAKERS, SAFETY SWITCHES, AND ALL OTHER ELECTRICAL APPARATUS SHALL BE LISTED AS SUITABLE FOR AT LEAST 75°C (CU/AL) OR AS NOTED IN MANUFACTURER'S INSTRUCTIONS, WHICHEVER IS GREATER.
- PROVIDE ALL PANELBOARDS WITH GROUND BUS SEPARATE FROM NEUTRAL BUS.
- IT SHALL BE THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT ALL EQUIPMENT DISCONNECTS ARE PROPERLY SIZED PER THE FINAL SELECTED EQUIPMENT MANUFACTURER RECOMMENDATIONS/ REQUIREMENTS AND SAID DISCONNECTS ARE PROVIDED WITH THE REQUIRED NEC WORKING CLEARANCES. TYPICAL FOR ALL EQUIPMENT DISCONNECTS.
- DOCUMENTS CERTIFYING THAT THE INSTALLED LIGHTING CONTROLS MEET DOCUMENTED PERFORMANCE CRITERIA OF IECC SECTION C405 SHALL BE PROVIDED TO THE BUILDING OWNER WITHIN 90 DAYS FROM THE DATE OF RECEIPT OF THE CERTIFICATE OF OCCUPANCY PER IECC C408.3.2.

	208V, 1φ	120V, 1φ
#12 AWG	0 - 98 FT.	0 - 57 FT.
#10 AWG	99 - 157 FT.	58 - 91 FT.
#8 AWG	158 - 251 FT.	92 - 145 FT.
#6 AWG	252 - 397 FT.	146 - 229 FT.
#4 AWG	398 - 633 FT.	230 - 365 FT.

(VERIFY MINIMUM VOLTAGE DROP AND CONDUIT SIZE, PER N.E.C.)

LIGHT FIXTURE SCHEDULE

CALLOUT	LAMP	DESCRIPTION	MODEL	INPUT WATTS	VOLTS	NOTE 1
A	(1) 30W LED, 3000K	RECESSED DOWNLIGHT	LIGHTOLIER 6-R-N-26RDL-20-830-W-0-BK-Z10-U	30	120V 1P 2W	
AE	(1) 30W LED, 3000K	RECESSED DOWNLIGHT WITH EMER. BATTERY BACKUP PACK	LIGHTOLIER 6-R-N-26RDL-20-830-W-0-BK-Z10-U-EM	30	120V 1P 2W	
B	(1) 55W LED, 4000K	ARCHITECTURAL FULL CUTOFF WALL SCONCE - WET LISTED	SIGNIFY 101L-32L-700-WW-G1-3-UNV-DD-F1-BZ	55	120V 1P 2W	COORDINATE EXACT MOUNTING HEIGHT WITH ARCHITECT.
C	(1) 20W LED	WALL SCONCE - WET LISTED	ECLIPSE LIGHTING 5M-XL2-LED-3K-80CRI-UNV-BK-CB-0QT-D7A	20	120V 1P 2W	COORDINATE EXACT MOUNTING HEIGHT WITH ARCHITECT.
D	(1) 4.8W LED, 3500K	FULL CUTOFF WALL MOUNT	NEW STAR LIGHTING NWDEU-1-L35-UN-BK	4.8	120V 1P 2W	COORDINATE EXACT MOUNTING HEIGHT WITH ARCHITECT.
E	(1) 29W LED	WALLWASH	PATHWAY LIGHTING 4SCALB-30-3K-E2-N30-DA	29	120V 1P 2W	
N1A	(1) 71W LED	SINGLE LAMP LED POLE	NLS LIGHTING NV-1-13-32L-7-40K-UNV-HSS-SINGLE @ 18'	71	208V 2P 2W	
N1D	(1) 71W LED	SINGLE LAMP LED POLE	NLS LIGHTING NV-1-14-32L-7-40K-UNV-HSS-SINGLE @ 18'	71	208V 2P 2W	
N2A	(2) 106W LED, 4000K	2 LAMP LED POLE	NLS LIGHTING NV-1-15-32L-1-40K-UNV-TWIN @ 18'	212	208V 2P 2W	
N2C	(2) 56W LED, 4000K	2 LAMP LED POLE	NLS LIGHTING NV-1-13-16L-1-40K-UNV-TWIN @ 18'-UNV	112	208V 2P 2W	
X1	(1) LED	EXIT WITH EMER. BATTERY BACKUP PACK	LITHONIA LRP- XX-1-XX-120/277	2.7	120V 1P 2W	COORDINATE COLOR "XX" AND BACKGROUND "XX" WITH ARCHITECT PRIOR TO ORDERING/PURCHASING.

*** NOTE TO CONTRACTOR: VERIFY ALL FIXTURE SELECTIONS WITH ARCHITECT PRIOR TO ORDERING/PURCHASING. ***



CORNERSTONE ARCHITECTS

CORNERSTONE
ARCHITECTS

7000 BEE CAVES RD. SUITE 300
AUSTIN TX 78746
512.293.0007

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2022 ALL RIGHTS RESERVED
THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF CORNERSTONE ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM BY ANY METHOD, FOR ANY PURPOSE, WITHOUT PREVIOUS WRITTEN PERMISSION.

06.20.22 - Revision 2
8.26.22 - City Comments



08.26.2022
CITY COMMENTS
ELECTRICAL LEGEND, NOTES, AND SCHEDULE

SHEET: **E100**

PROJECT NO: 21099
DRAWN BY:
DATE: 01.28.2022
PROJECT MGR:

DRAWN BY: CA CHECKED BY: AD



AYS
CONSULTING ENGINEERING

Engineering, LLC
MEP CONSULTING ENGINEERING
411 W. Main Street, Suite 310 • Round Rock • TX 78664
www.AYSEng.com • 512-961-6835
TBPE Firm F-10298

KEYED NOTES:

GENERAL: REFER ALSO TO GENERAL ELECTRICAL NOTES ON SHEET E100.

1. ELECTRIC SERVICE ENTRANCE LOCATION. REFER TO ELECTRICAL RISER DIAGRAM ON SHEET E300 & SITE PLAN ON SHEET EU100.
2. COORDINATE CONNECTION AND REQUIREMENTS FOR TELEPHONE SERVICE ENTRANCE WITH LOCAL TELEPHONE COMPANY. REFER TO SITE PLAN ON SHEET EU100.
3. PROVIDE 120V, 20A, GFCI/WP/WR, DUPLEX RECEPTACLE FOR HOLIDAY LIGHTS. COORDINATE EXACT LOCATION, MOUNTING HEIGHT AND REQUIREMENTS WITH ARCHITECT PRIOR TO ROUGH-IN.
4. LOCATE 20A, 120 VOLT, DUPLEX RECEPTACLE AT ROOFTOP PARAPET WALL. VERIFY EXACT LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.
5. PROVIDE J-BOX AND 2" CONDUIT W/ PULL STRING FROM FUTURE TENANT SPACE BACK TO TELECOMMUNICATION SERVICE ENTRANCE.
6. TIME CLOCK CONTROLLED. REFER TO LIGHTING CONTROLS DIAGRAM ON SHEET E300 FOR FURTHER INFORMATION.
7. PROVIDE 12"x12"x18" N3R JUNCTION BOX ABOVE TELEPHONE PEDESTAL ON EXTERIOR WALL AT HEIGHT MATCHING INTERIOR BAR JOISTS. ROUTE 4" PVC CONDUIT (PAINTED WITH COLOR SPECIFIED BY ARCHITECT) W/ PULL STRING FROM TELEPHONE PEDESTAL TO J-BOX. CAULK AROUND BOX. SHOWN OFFSET FOR CLARITY.
8. PROVIDE PULL BOX AT CEILING FOR TENANT FEEDERS. ROUTE 1-2" EMPTY CONDUIT WITH PULL STRINGS TO ABOVE ELECTRICAL SERVICE GUTTER.
9. PROVIDE 2" CONDUITS WITH PULL STRINGS, (1) 2" CONDUIT FOR EACH TENANT TELECOMMUNICATION. REFER TO KEYED NOTE 5, THIS SHEET. CONTRACTOR TO RUN CONDUIT HIGH IN JOIST AND DOWN COLUMN TO EACH TENANT SPACE.
10. PROVIDE 2" CONDUIT WITH PULL STRINGS FOR TENANT FEEDERS, (1) 2" CONDUIT FOR EACH TENANT FEEDERS. REFER TO KEYED NOTE 5, THIS SHEET. CONTRACTOR TO RUN CONDUIT HIGH IN JOIST AND DOWN COLUMN TO EACH TENANT SPACE.
11. PROVIDE CONNECTION FOR DRIVE-THRU SIGNAGE. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH ARCHITECT PRIOR TO ROUGH-IN. COORDINATE EXACT CONNECTION REQUIREMENTS WITH THE SIGN MANUFACTURER.
12. MOUNT PHOTOCELL HIGH ON WALL FACING NORTHEAST. REF. SHEET E300 FOR LIGHTING CONTROLS DIAGRAM.

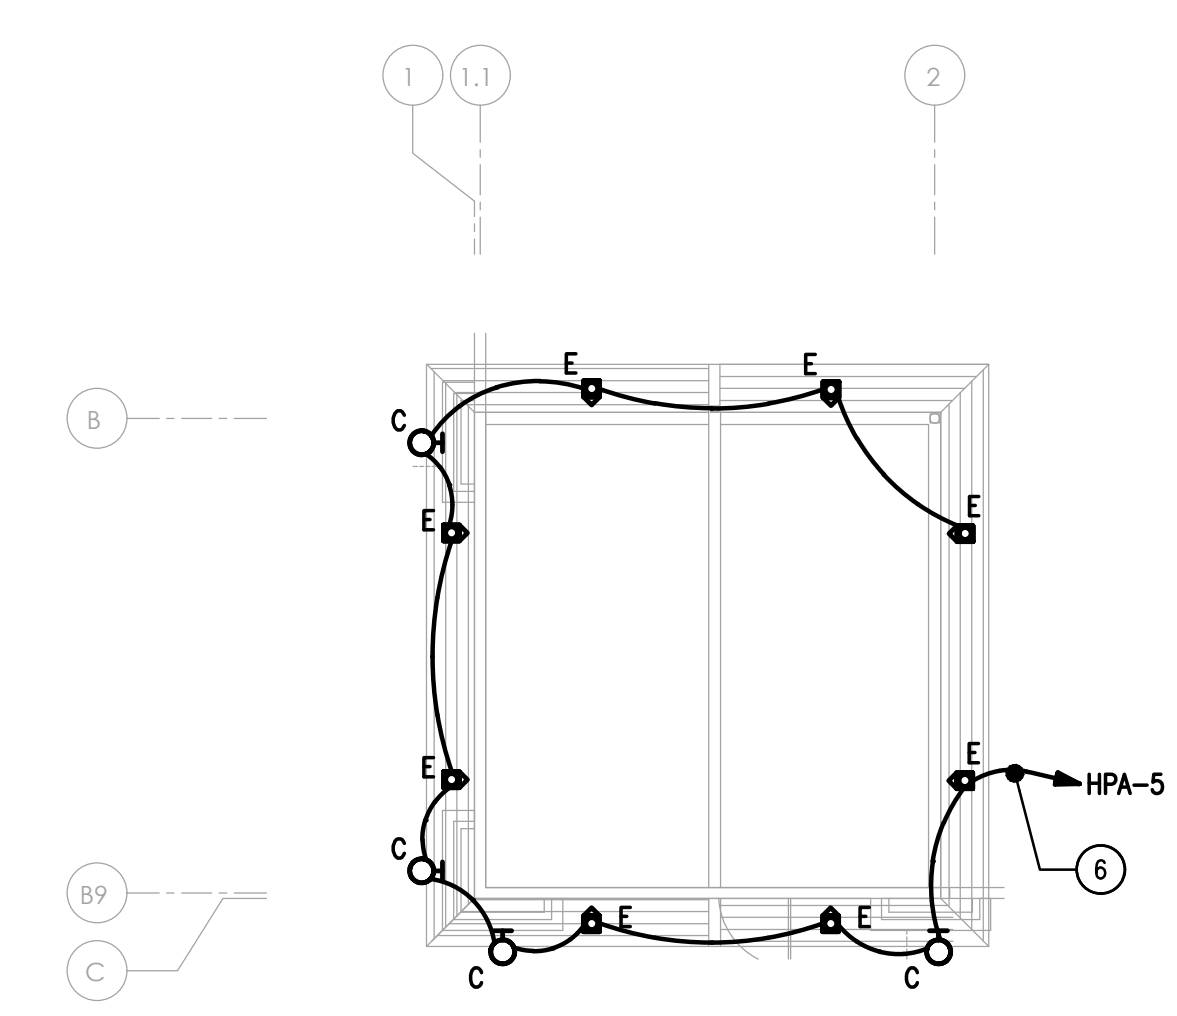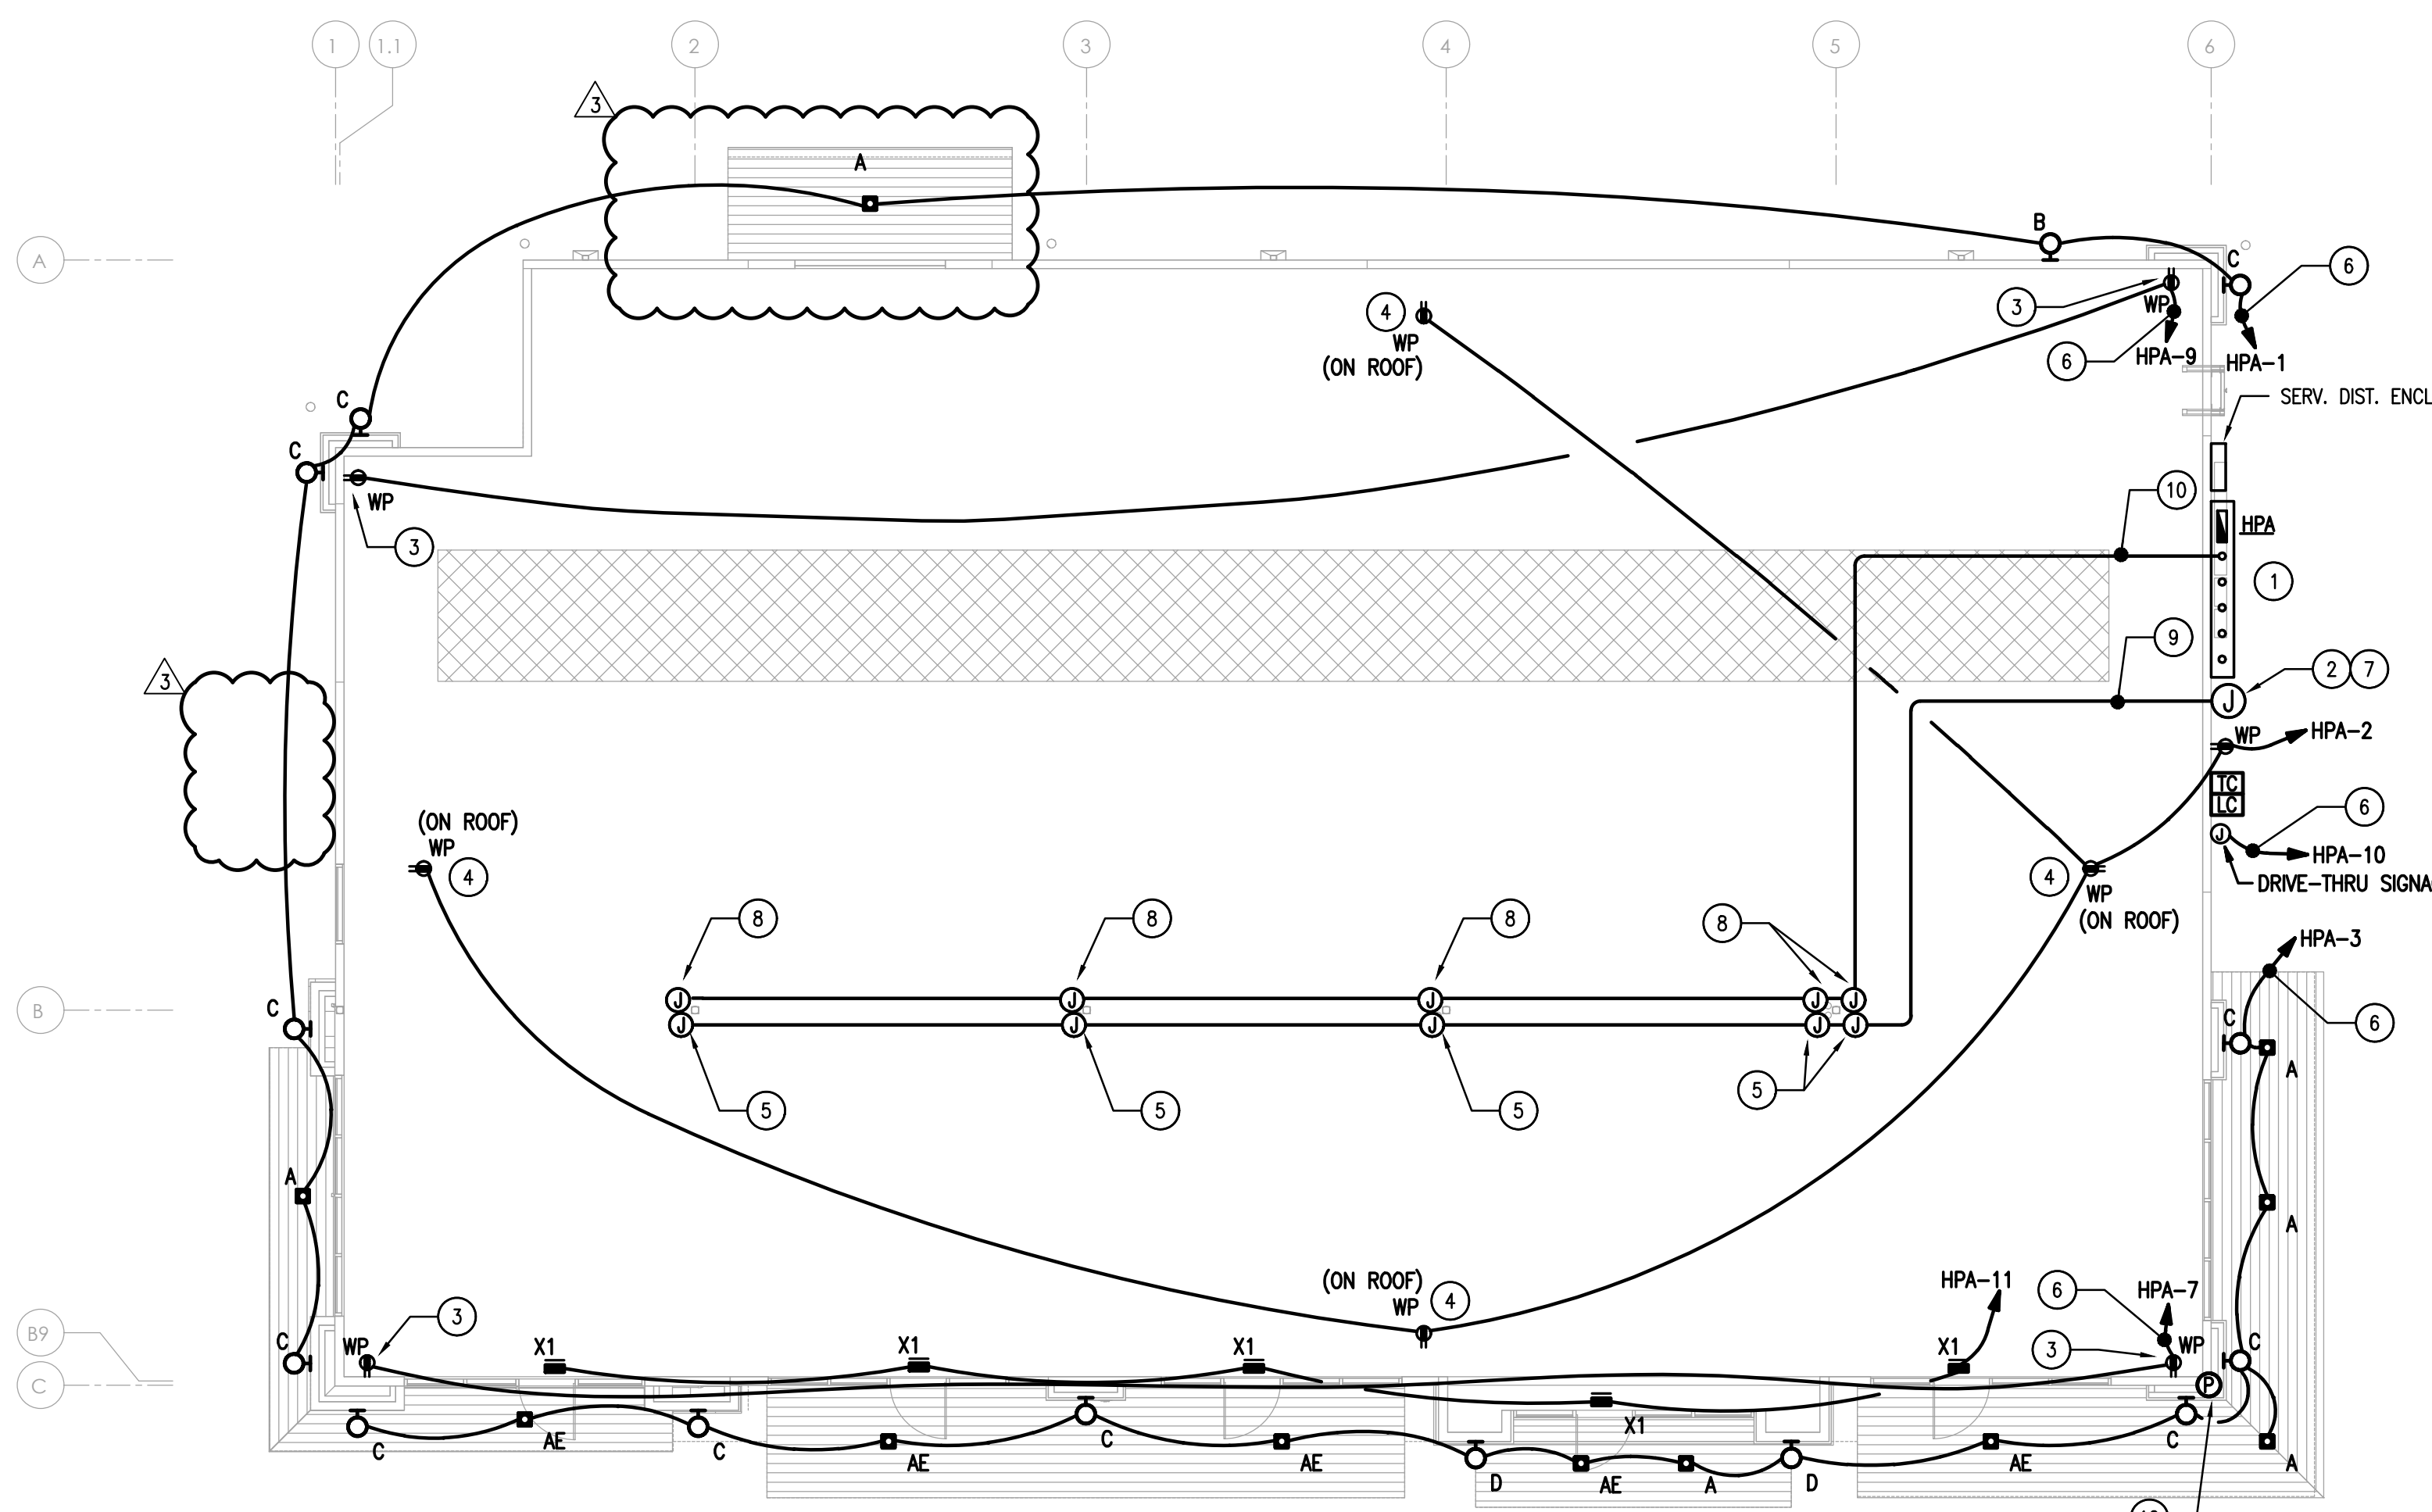


2 TOWER PLAN - LIGHTING + POWER
SCALE: 1/8" = 1'-0"
TRUE PLAN NORTH

1 FLOOR PLAN - LIGHTING + POWER
SCALE: 1/8" = 1'-0"
TRUE PLAN NORTH

HPA											
ROOM EXTERIOR BLDG 1			VOLTS 208Y/120V 3P 4W			AIC 22,000					
MOUNTING SURFACE			BUS AMPS 60			MAIN BKR MLO					
FED FROM UTILITY			NEUTRAL 100%			LUGS STANDARD					
NOTE NEMA 3R											
CKT #	CKT BKR	CIRCUIT DESCRIPTION	LOAD KVA			CKT #	CKT BKR	CIRCUIT DESCRIPTION	LOAD KVA		
			A	B	C				A	B	C
1	20/1	EXTERIOR LIGHTING	0.27			2	20/1	EXTERIOR RECEPTACLE	0.9		
3	20/1	EXTERIOR LIGHTING		0.4		4	20/2	SITE LIGHTING		0.233	
5	20/1	TOWER LIGHTING			0.312	6	-/1	SPACE			0.233
7	20/1	HOLIDAY RECEPTACLE	1			8	-/1	SPACE	0		
9	20/1	HOLIDAY RECEPTACLE		1		10	20/1	DRIVE-THRU SIGNAGE		1.2	
11	20/1	EXIT SIGN LIGHTING			0.014	12	-/1	SPACE			0
13	-/1	SPACE	0			14	-/1	SPACE	0		
15	-/1	SPACE		0		16	-/1	SPACE		0	
17	-/1	SPACE			0	18	-/1	SPACE			0
19	-/1	SPACE	0			20	-/1	SPACE	0		
21	-/1	SPACE			0	22	-/1	SPACE			0
23	-/1	SPACE			0	24	-/1	SPACE			0
TOTAL CONNECTED KVA BY PHASE									2.17	2.83	0.559
			CONN KVA			CALC KVA					
LIGHTING			1.46	1.83	(125%)	RECEPTACLES			2.9	2.9	(50%>10)
						CONTINUOUS			1.2	1.5	(125%)
						TOTAL LOAD			6.23		
						BALANCED 3-PHASE LOAD			17.3 A		

ELECTRICAL LOAD ANALYSIS		LOAD KVA
RETAIL BUILDING 1		
LOAD DESCRIPTION 120/208V., 3P, 4W		
FUTURE TENANT LOAD - (4,800 S.F. x 50W) RETAIL =		240
FUTURE TENANT LOAD - (1,200 S.F. x 65W) RESTAURANT =		78
HOUSE LOADS		
LIGHTING 1.7 KVA AT 1.25% =		1.6
RECEPTACLES AT 100% =		2.9
CONTINUOUS AT 100% =		1.5
TOTAL ESTIMATED CONNECTED LOAD =		324
282.4 KVA / 208 / $\sqrt{3}$ = AMPS		900
BUILDING SERVICE AMPACITY		1000 AMPS
BUILDING SERVICE SPARE CAPACITY		983 AMPS

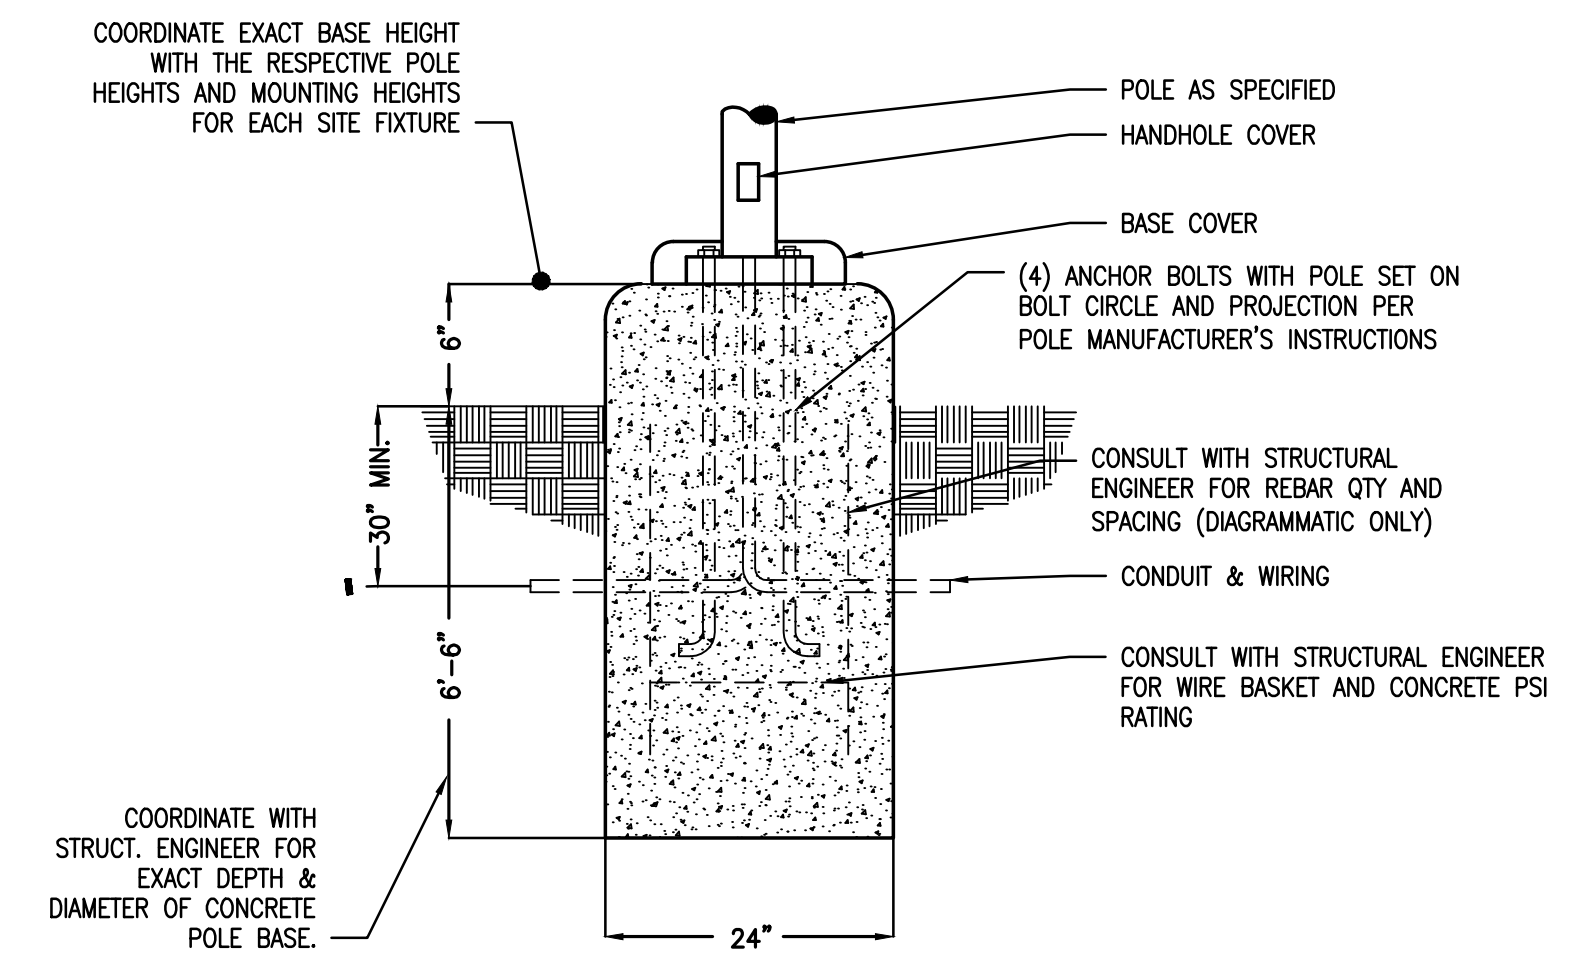

3 POLE BASE DIAGRAM
SCALE: NONE

PANELBOARD FOOT NOTES:

- * = PROVIDE LOCKABLE-TYPE CIRCUIT BREAKER
- LC = LTG. CONTROLS ASSIGNMENT. REFER TO LTG. CTRL. SCHED. ON THIS SHEET.

DESIGNATION RANGE (D)	GROUNDING ELECTRODE CONDUCTOR CU WIRE SIZE FOR:		
	GROUND ROD	CONCRETE-ENCASED ELECTRODE	STRUCTURAL STEEL AND METAL WATER PIPING (IF ANY)
20G-100G	#8	#8	#8
125G-150G	#6	#6	#6
175G-200G	#6	#4	#4
225G-300G	#6	#4	#2
350G-500G	#6	#4	#1/0
600G-800G	#6	#4	#2/0
1000G+	#6	#4	#3/0


NOTES:

- DESIGNATIONS REFER TO AMPERAGE FOLLOWED BY A "G." FOR EXAMPLE, 30G WOULD FALL WITHIN THE 20G-100G RANGE.
- CONDUCTOR CONNECTED TO FIRST ELECTRODE IN SYSTEM SHALL BE SIZED ACCORDING TO THE GROUNDING ELECTRODE REQUIRING THE LARGEST CONDUCTOR. ONLY AVAILABLE GROUNDING ELECTRODES IN SYSTEM SHALL BE CONSIDERED. ALL BONDING BETWEEN REMAINING ELECTRODES SHALL BE SIZED ACCORDING TO VALUE LISTED IN TABLE.
- GROUNDING ELECTRODE SYSTEMS SHALL CONSIST OF ALL AVAILABLE GROUNDING ELECTRODES.
- THIS TABLE IS BASED ON ARTICLE 250.66 OF THE NEC.

THE SQUARE AT CRYSTAL FALLS BLDG 1 - SHORT CIRCUIT CALCULATIONS

Equipment Name	Feeder Length (ft)	Parallel Sets	Conduit	Wire Type	Wire Size	L-L		Upstream Load Served (A)	I[SCA]	f-Value (M)	Multiplier	Calculated Values (A)	
						KVA	%Z						
Utility Transformer*						500	208	1.4	1387.9			71.429	99133
SERV. DIST. ENCL.	65	3	Non-mag Copper	#400kcmil		208		24297	99133	0.736		0.576	57100
60A ENCL. C.B.	5	1	Steel	Copper #6		208		2425	57100	0.980		0.505	28833
HPA Panel	5	1	Steel	Copper #6		208		2425	28833	0.495		0.669	19286

* = Assumed Values Used for Calculation

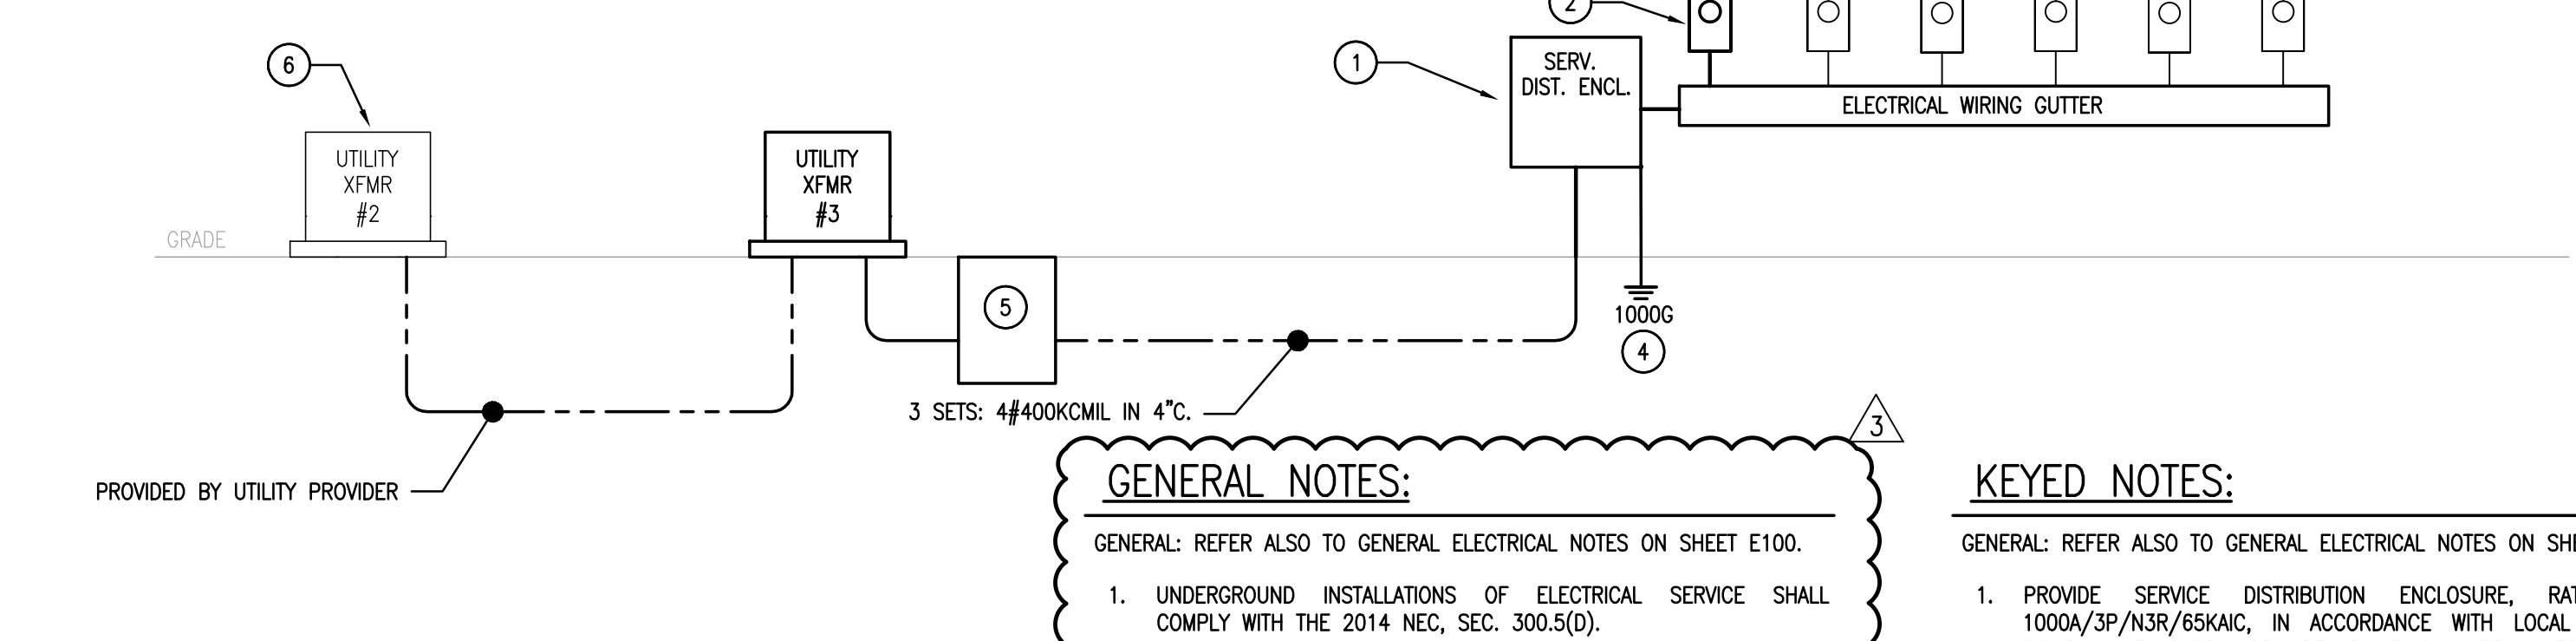

1 ELECTRICAL RISER DIAGRAM
SCALE: NONE


GENERAL NOTES:

GENERAL: REFER ALSO TO GENERAL ELECTRICAL NOTES ON SHEET E100.

- UNDERGROUND INSTALLATIONS OF ELECTRICAL SERVICE SHALL COMPLY WITH THE 2014 NEC, SEC. 300.5(0).

KEYED NOTES:

- GENERAL: REFER ALSO TO GENERAL ELECTRICAL NOTES ON SHEET E100.
- PROVIDE SERVICE DISTRIBUTION ENCLOSURE, RATED FOR 1000A/3P/N3R/65KAIC, IN ACCORDANCE WITH LOCAL ELECTRIC COMPANY STANDARDS. PROVIDE ARC FLASH LABELING TO ALL NEW EQUIPMENT.
 - PROVIDE ELECTRICAL SERVICE METER BASE PER LOCAL ELECTRIC COMPANY REQUIREMENTS.
 - FUTURE PANEL, METER & FUSED DISCONNECT TO BE PROVIDED UNDER THE TENANT FINISH-OUT CONTRACT.
 - REFER TO GROUNDING ELECTRODE CONDUCTOR SCHEDULE ON THIS SHEET.
 - PROVIDE PULLBOX AS REQUIRED BY THE UTILITY PROVIDER.
 - TRANSFORMER #2 IS ASSUMED BUILT UNDER PERMIT FOR BUILDING '2'.

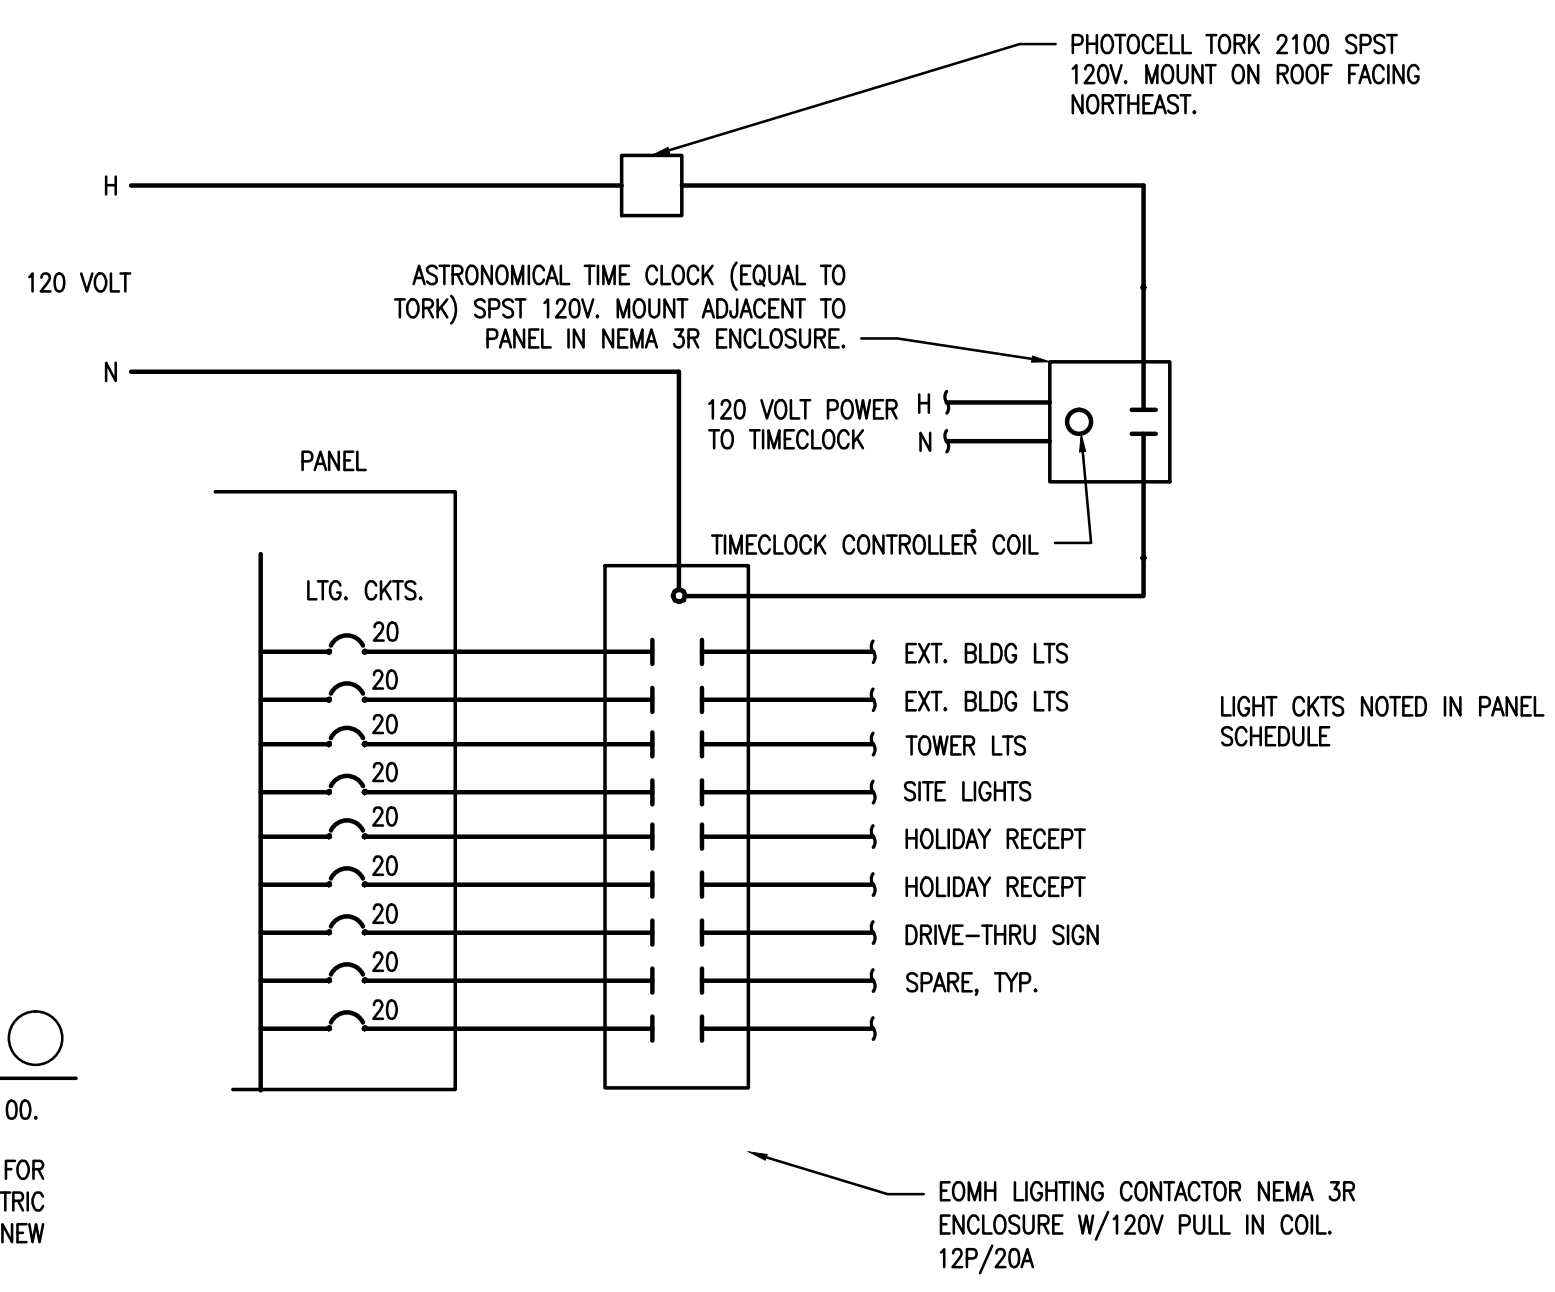

2 LIGHTING CONTROLS DIAGRAM
SCALE: NONE

DRAWN BY: CA
CHECKED BY: AD

AYS
MEP CONSULTING ENGINEERING

411 W. Main Street, Suite 310 • Round Rock, TX 78664
www.AYSEng.com • 512-961-6835
TBP# Firm F-10298



CORNERSTONE
ARCHITECTS

7000 BEE CAVES RD. SUITE 200
AUSTIN, TX 78746
913.249.0007

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2022. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF CORNERSTONE ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.


- 2 06.20.22 - Revision 2
- 3 8.26.22 - City Comments



08.26.2022
CITY COMMENTS
ELECTRICAL RISER AND DIAGRAMS

SHEET: **E300**

PROJECT NO: 21099
DRAWN BY:
DATE: 01.28.2022
PROJECT MGR:

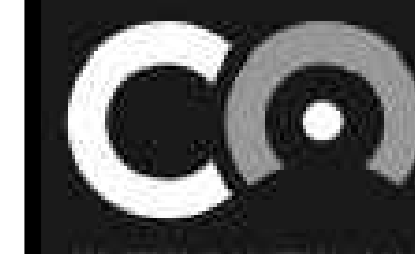

CORNERSTONE ARCHITECTS, P.C.

7000 BEE CAVES RD., SUITE 100, AUSTIN, TX 78746 512-293-0007

CORNERSTONE
ARCHITECTS

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

ELECTRICAL SPECIFICATIONS:

PART 1 – GENERAL

1.01 SCOPE OF WORK: FURNISH AND INSTALL ALL MATERIALS AND EQUIPMENT AND PROVIDE ALL LABOR, TOOLS, TRANSPORTATION, SUPERINTENDENCE AND SERVICES REQUIRED AND NECESSARY TO COMPLETE THE WORK SHOWN ON THE DRAWINGS AND/OR SPECIFIED HEREIN.

ALSO INCLUDED WILL BE ALL OTHER WORK AND MISCELLANEOUS ITEMS, NOT SPECIFICALLY MENTIONED, BUT REASONABLY INFERRED FOR A COMPLETE INSTALLATION INCLUDING ALL ACCESSORIES AND APPURTENANCES REQUIRED FOR TESTING THE SYSTEM. IT IS THE INTENT OF THE DRAWINGS AND SPECIFICATIONS THAT ALL SYSTEMS BE COMPLETE AND READY FOR OPERATION.

1.02 REGULATORY REQUIREMENTS: ALL WORK AND MATERIALS SHALL COMPLY WITH THE LATEST RULES, CODES AND REGULATIONS, INCLUDING, BUT NOT LIMITED TO THE FOLLOWING:

- A. 2015 INTERNATIONAL BUILDING CODE
- B. 2015 INTERNATIONAL FIRE CODE
- C. 2015 INTERNATIONAL PLUMBING CODE
- D. 2015 INTERNATIONAL FUEL GAS CODE
- E. 2015 INTERNATIONAL MECHANICAL CODE
- F. 2015 INTERNATIONAL ENERGY CONSERVATION CODE/ASHRAE 90.1–2013 ENERGY CODE COMPLIANCE
- G. 2014 NATIONAL ELECTRIC CODE
- H. LOCAL CODE ORDINANCES AND AMENDMENTS
- I. NATIONAL ELECTRICAL MANUFACTURER ASSOCIATION (NEMA)
- J. AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)
- K. NATIONAL ELECTRICAL SAFETY CODE (NEC)
- L. INSTITUTE OF ELECTRICAL AND ELECTRONIC ENGINEERS (IEEE)
- M. UNDERWRITERS' LABORATORIES (UL)
- N. AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)
- O. NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)
- P. OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (OSHA)
- Q. AMERICANS WITH DISABILITIES ACT (ADA)
- R. APPLICABLE UTILITY COMPANIES

1.03 LICENSE, FEES AND PERMITS: ELECTRICAL CONTRACTOR SHALL PAY FOR ALL LICENSES, PERMITS AND INSPECTION FEES REQUIRED BY THE AUTHORITY HAVING JURISDICTION AND SHALL ARRANGE FOR ALL REQUIRED INSPECTIONS.

1.04 SAFETY AND INDEMNITY: THE CONTRACTOR SHALL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

NO ACT, SERVICE, DRAWING REVIEW OR CONSTRUCTION REVIEW BY THE OWNER, THE ENGINEERS OR THEIR CONSULTANTS, IS INTENDED TO INCLUDE REVIEW OF THE ADEQUACY OF THE CONTRACTOR'S SAFETY MEASURES, IN, ON, OR NEAR THE CONSTRUCTION SITE.

1.05 DRAWINGS AND SPECIFICATIONS: ALL DRAWINGS AND SPECIFICATIONS SHALL BE CONSIDERED AS A WHOLE AND WORK OF THIS DIVISION SHOWN ANYWHERE THEREIN SHALL BE FURNISHED UNDER THIS DIVISION.

DRAWINGS ARE DIAGRAMMATIC AND INDICATE THE GENERAL ARRANGEMENT OF EQUIPMENT AND WIRING. MOST DIRECT ROUTING OF CONDUITS AND WIRING IS NOT ASSURED. EXACT REQUIREMENTS SHALL BE GOVERNED BY CONDITIONS OF THE JOB. CONSULT ALL OTHER DRAWINGS IN PREPARATION OF THE BID. EXTRA LENGTHS OF WIRING OR ADDITION OF PULL OR JUNCTION BOXES, ETC. NECESSITATED BY SUCH CONDITIONS SHALL BE INCLUDED.

1.06 CONDITIONS AT SITE: THE ELECTRICAL CONTRACTOR SHALL HAVE EXAMINED THE SITE AND FAMILIARIZED THEMSELVES WITH ALL DISCERNIBLE EXISTING CONDITIONS. NO EXTRA PAYMENT WILL BE ALLOWED FOR WORK REQUIRED BECAUSE OF THESE CONDITIONS, WHETHER SPECIFICALLY MENTIONED OR NOT.

1.07 WORKMANSHIP AND CONTRACTOR'S QUALIFICATIONS: ONLY QUALITY WORKMANSHIP WILL BE ACCEPTED. HAPHAZARD OR POOR INSTALLATION WILL BE CAUSE FOR REJECTION OF WORK. THE CONTRACTOR SHALL BE LICENSED IN THE STATE IN WHICH THE JOB IS LOCATED.

1.08 SHOP DRAWINGS AND MATERIALS LIST: SUBMIT TO OWNER IN A SINGLE PACKAGE SIX (6) COPIES OF COMPLETE SHOP DRAWINGS AND MATERIALS LIST, AS NOTED BELOW, FOR REVIEW WITHIN FIFTEEN (15) DAYS AFTER AWARD OF CONTRACT. SUBMITTALS REQUIRED AS FOLLOWS:

- A. WIRING DEVICES: RECEPTACLES, DEVICE PLATES.
- B. ENCLOSURES FOR UTILITY COMPANY METERING.
- C. ENCLOSED CIRCUIT BREAKER.
- D. PANELBOARDS.
- E. LIGHTING FIXTURES, LAMPS AND LIGHTING CONTROL EQUIPMENT.

1.09 SUBSTITUTIONS: ONE OR MORE MAKES OF MATERIALS OR METHODS MAY HAVE BEEN SPECIFIED TO ESTABLISH THE STANDARD OF QUALITY, WORKMANSHIP, FINISH AND DESIGN REQUIRED, BUT OTHER MATERIALS OR METHODS EQUAL IN QUALITY, WORKMANSHIP, FINISH, DESIGN, AND GUARANTEED PERFORMANCE WILL BE ACCEPTED. HOWEVER, ALL CHANGES AND SUBSTITUTIONS SHALL BE REQUIRED IN LETTER FORM AND SHALL BE ACCOMPANIED WITH A STATEMENT OF THE AMOUNT OF MONEY TO BE RETURNED TO THE CONTRACT IF THE SUBSTITUTION IS PERMITTED.

NO WORK INVOLVING MATERIALS SUBMITTED FOR SUBSTITUTION SHALL PROCEED UNTIL WRITTEN ACCEPTANCE IS RECEIVED FROM THE OWNER. THE OWNER IS THE SOLE JUDGE OF ACCEPTABILITY OF PREFERRED SUBSTITUTIONS. IF A SUBSTITUTION ITEM IS PERMITTED, AND ANY RE-DESIGN EFFORT IS THEREBY NECESSITATED, THE REQUIRED RE-DESIGN SHALL BE AT THE CONTRACTOR'S EXPENSE.

1.10 COORDINATION: COORDINATE WORK WITH OTHER TRADES TO AVOID CONFLICT AND TO PROVIDE CORRECT ROUGH-IN AND CONNECTION FOR EQUIPMENT FURNISHED UNDER OTHER TRADES THAT REQUIRE ELECTRICAL CONNECTIONS. INFORM CONTRACTORS OF OTHER TRADES OF THE REQUIRED ACCESS TO AND CLEARANCES AROUND ELECTRICAL EQUIPMENT TO MAINTAIN SERVICE ABILITY AND CODE COMPLIANCE.

VERIFY EQUIPMENT DIMENSIONS AND REQUIREMENTS WITH PROVISIONS SPECIFIED UNDER THIS SECTION. CHECK ACTUAL JOB CONDITIONS BEFORE FABRICATING WORK. REPORT NECESSARY CHANGES IN TIME TO PREVENT NEEDLESS WORK, CHANGES OR ADDITIONS, SUBJECT TO ADDITIONAL COMPENSATION, WHICH ARE MADE WITHOUT WRITTEN AUTHORIZATION AND IN AGREED PRICE, SHALL BE AT THE CONTRACTOR'S RISK AND EXPENSE.

1.11 ROUTINGS: ALL CONDUIT ROUTINGS, INCLUDING MC CABLE, SHALL BE PARALLEL AND PERPENDICULAR TO THE BUILDING STRUCTURE AND LINES. CONDUITS SHALL BE CONCEALED WHERE POSSIBLE UNLESS OTHERWISE NOTED. AESTHETIC APPEARANCE IS VERY IMPORTANT FOR THE WORK OF THIS PROJECT – THE CONTRACTOR WILL BE REQUIRED TO REMOVE AND REPLACE WORK THAT IS NOT NEAT AND ACCURATE. UNDERGROUND ROUTINGS, IF ANY, BETWEEN BUILDINGS MAY TAKE MOST DIRECT ROUTE.

1.12 CUTTING AND PATCHING: ALL CUTTING AND PATCHING REQUIRED FOR WORK OF THIS DIVISION IS INCLUDED HEREIN. COORDINATION WITH GENERAL CONTRACTOR AND OTHER TRADES IS THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR FOR THE CUTTING AND THE ADDED EXPENSE OF ADJUSTING FOR IMPROPER HOLES, SUPPORTS, ETC.

1.13 ACCEPTANCE DEMONSTRATION: UPON COMPLETION OF THE WORK, AT A TIME TO BE DESIGNATED BY THE OWNER, THE CONTRACTOR SHALL DEMONSTRATE FOR THE OWNER THE OPERATION OF THE ELECTRICAL INSTALLATION, INCLUDING ANY AND ALL SPECIAL ITEMS INSTALLED BY HIM/HER OR INSTALLED UNDER THEIR SUPERVISION. PROPERLY SET AUTOMATIC TIME SWITCHES TO PERFORM SWITCHING OPERATIONS IN ACCORDANCE WITH SCHEDULES PROVIDED BY THE OWNER'S REPRESENTATIVE AND DEMONSTRATE (USING THE MANUFACTURER'S OPERATING INSTRUCTIONS) HOW TO OVERRIDE AND/OR TEST TIME SWITCHES' PROGRAMMING.

1.14 RECORD DRAWINGS, EQUIPMENT DATA: MAINTAIN ONE SET OF CLEAN WORKING DRAWINGS AT THE JOB SITE AND ENTER DAILY SUCH "AS-BUILT" INFORMATION AS FEEDER AND SERVICE RATES, PULL BOX LOCATIONS AND CHANGES IN LAYOUT OR ARRANGEMENT WHICH OCCUR DURING CONSTRUCTION. DELIVER COMPLETED DRAWINGS TO THE OWNER.

DELIVER TO THE OWNER'S REPRESENTATIVE THREE COPIES OF DATA SHEETS OR OTHER CURRENT MANUFACTURERS' PUBLICATIONS FOR EACH ITEM OF ELECTRICAL EQUIPMENT FURNISHED FOR THE PROJECT INCLUDING AT LEAST THESE DATA:

- A. TECHNICAL DESCRIPTION AND REPLACEABLE PARTS LIST.
- B. PHYSICAL DESCRIPTION AND INSTALLATION INSTRUCTIONS.
- C. USER'S MANUAL AND OPERATING INSTRUCTIONS.
- D. MANUFACTURER'S WARRANTY.

1.15 CLEAN-UP: RID THE PREMISES OF SCRAP MATERIALS, TRASH AND DEBRIS BOTH DURING CONSTRUCTION AND AT COMPLETION OF THE PROJECT. LEAVE THE BUILDING AND SURROUNDING AREA IN A CLEAN AND ORDERLY CONDITION.

1.16 TEMPORARY SERVICES: PROVIDE ADEQUATE AND SAFE TEMPORARY ELECTRICAL POWER AND LIGHTING THROUGHOUT THE CONSTRUCTION AND FINISHING OF THE PREMISES FOR BENEFICIAL OCCUPANCY. IN ADDITION TO SPECIAL OR UNUSUAL REQUIREMENTS, PROVIDE AT LEAST THESE ITEMS:

- A. SIX 20-AMP CIRCUITS FOR CONSTRUCTION POWER TOOLS. PROVIDE GFI TEMPORARY CIRCUITS WITH COVERPLATES TO MEET OSHA REQUIREMENTS.
- B. FLOOD LIGHTING AND TASK LIGHTING FOR PAINTING AND OTHER FINISH WORK. WHEN PERMANENT ELECTRICAL SERVICE IS OPERABLE, DISCONNECT AND REMOVE FROM THE PREMISES THE MATERIALS AND EQUIPMENT USED FOR TEMPORARY POWER AND LIGHTING, AND RESTORE MODIFICATIONS AND REPAIR DAMAGE CAUSED BY THE INSTALLATION, USE OR REMOVAL OF TEMPORARY SERVICE DEVICES.

1.17 WARRANTY: THE CONTRACTOR SHALL UNCONDITIONALLY WARRANT ALL WORK TO BE FREE OF DEFECTS IN MATERIAL AND WORKMANSHIP FOR A PERIOD OF ONE (1) YEAR FROM THE DATE OF FINAL ACCEPTANCE AND WILL REPAIR OR REPLACE ANY DEFECTIVE WORK PROMPTLY AND WITHOUT CHARGE AND RESTORE ANY OTHER EXISTING WORK DAMAGED IN THE COURSE OF REPAIRING DEFECTIVE MATERIALS AND WORKMANSHIP.

PART 2 – PRODUCTS

2.01 MATERIAL APPROVAL: ALL MATERIALS MUST BE NEW AND BEAR UNDERWRITER'S LABORATORIES LABEL. MATERIALS THAT ARE NOT COVERED BY UL TESTING STANDARDS SHALL BE TESTED AND APPROVED BY AN INDEPENDENT TESTING LABORATORY OR A GOVERNMENTAL AGENCY.

MATERIAL NOT IN ACCORDANCE WITH THESE SPECIFICATIONS MAY BE REJECTED EITHER BEFORE OR AFTER INSTALLATION.

2.02 CONDUITS AND OTHER RACEWAYS:

- A. RIGID STEEL: HOT-DIPPED GALVANIZED.
- B. INTERMEDIATE METAL CONDUIT (IMC): HOT-DIPPED GALVANIZED.
- C. ELECTRICAL METALLIC TUBING (EMT): ELECTRO-GALVANIZED.
- D. WIREWAY: CODE GAUGE STEEL, WITH KNOCKOUTS AND HINGED COVER, CORROSION RESISTANT, GRAY BAKED ENAMEL FINISH.
- E. PROVIDE FITTINGS AND ACCESSORIES APPROVED FOR THE PURPOSE EQUAL IN ALL RESPECTS TO THE CONDUIT OR RACEWAY. EMT CONNECTORS AND COUPLINGS SHALL BE STEEL SETSCREW TYPE INDOORS AND STEEL COMPRESSION TYPE IN WET LOCATIONS AND OUTDOORS.

2.03 WIRES AND CABLES:

- A. FOR POWER AND LIGHTING SYSTEM 600V OR LESS:
 - 1. CONDUCTOR: MINIMUM SIZE #12 AWG.
 - a. #12 AND #10 AWG SOLID COPPER.
 - b. #8 AWG AND LARGER SHALL BE STRANDED COPPER FOR BRANCH CIRCUITS FOR SERVICE AND FEEDERS.
 - 2. INSULATION TYPE:
 - a. #12 TO #1 AWG: THWN FOR WET OR UNDERGROUND AND THHN FOR DRY LOCATIONS.
 - b. #1/0 THROUGH #4/0 AWG: XHHW (55 MILS).
 - c. #250 KCMIL AND LARGER: XHHW (65 MILS).
 - d. GROUNDING WIRE: TW.
- B. FOR SIGNAL AND COMMUNICATIONS CIRCUIT:
 - 1. CONDUCTORS FOR GENERAL USE SHALL BE STRANDED COPPER CONDUCTOR, #16 AWG MINIMUM, WITH THWN INSULATION FOR UNDERGROUND OR WET LOCATIONS AND THHN INSULATION FOR DRY LOCATIONS.
 - C. ACCEPTABLE PRODUCTS: GENERAL ELECTRIC, ANACONDA, OKONITE, PARANITE OR TRIANGLE PRODUCTS CONFORMING OR EXCEEDING APPLICABLE IPECA STANDARDS.

2.04 OUTLET BOXES, JUNCTION AND PULL BOXES:

- A. OUTLET BOXES: 4" SQUARE X 1-1/2" DEEP (OR LARGER) GALVANIZED SHEET STEEL KO-TYPE WITH PLASTER RING AND COVER FOR GENERAL INTERIOR USE AND CAST METAL TYPE FS OR FD WITH MATCHING SCREW COVERS FOR EXTERIOR AND EXPOSED INTERIOR LOCATIONS (GASKETED IN DAMP OR WET LOCATIONS).

B. JUNCTION BOXES SHALL BE SAME AS OUTLET BOXES UP TO 42 CU. IN. AND CODE-GAUGE STEEL IN LARGER SIZES WITH SURFACE OR FLUSH-TYPE SCREW-MOUNTED TRIM COVERS, BOTH BOXES AND COVERS INHIBITOR-PRIMED AND PAINTED INSIDE OUT.

C. PULL BOXES SHALL BE SAME AS JUNCTION BOXES UNLESS INDICATED OTHERWISE ON THE DRAWINGS, WITH COVERS.

D. ALL BOXES AND ASSOCIATED COMPONENTS SHALL BE STEEL CITY 663 SIZES, WITH P60-3B COVERPLATE OR EQUAL.

2.05 WIRING DEVICES AND PLATES SHALL BE HUBBELL, ARROW HART, LEVITON, GE OR P&S WITH HUBBELL NUMBERS USED TO SPECIFY TYPE USED.

- A. STANDARD DESIGN:
 - 1. RECEPTACLE DEVICES SHALL BE AS SPECIFIED BY ARCHITECT.
 - 2. WALL PLATES SHALL BE AS SPECIFIED BY ARCHITECT.
 - 3. RECEPTACLES SHALL BE GROUNDING TYPE #5362 (HUBBELL NUMBER).

2.06 CONDUIT HANGERS: FOR INDIVIDUAL CONDUIT RUNS NOT DIRECTLY FASTENED TO THE STRUCTURE, USE ROD HANGERS MANUFACTURED BY CADDY, UNISTRUT, OR POWERSTRUT. FOR MULTIPLE CONDUIT RUNS, USE UNISTRUT OR POWERSTRUT TRAPEZOID TYPE CONDUIT SUPPORT DESIGNED FOR MAXIMUM DEFLECTION NOT GREATER THAN 1/8".

2.07 WIRE CONNECTORS: FOR WIRE SIZES #8 AWG AND SMALLER: INSULATED PRESSURE TYPE (WITH LIVE SPRING) RATED 105 DEGREES C., 600V. FOR BUILDING WIRING AND 1000V IN SIGNS OR FIXTURES: SCOTCHKLOK OR IDEAL. FOR WIRE SIZE #6 AWG AND LARGER: T & B OR EQUIVALENT COMPRESSION TYPE WITH 3M #33+ OR PLYMOUTH "SLOPKNOT GRAY" TAPE INSULATION.

2.08 PANELBOARDS:

- A. CONSTRUCTION: CABINETS SHALL BE OF CODE GAUGE, GALVANIZED STEEL, SURFACE OR FLUSH MOUNTED AS INDICATED. DOORS SHALL BE OF COLD-ROLLED STEEL WITH CONCEALED HINGES AND FLUSH CATCH AND LOCK. ALL PANELS SHALL BE KEYS ALIKE. PANELS LOCATED ADJACENT TO EACH OTHER SHALL HAVE IDENTICALLY SIZED ENCLOSURE AND TRIMS. MINIMUM PANEL WIDTH SHALL BE 20". FINISH EXPOSED PART WITH ONE COAT OF PRIMER AND ONE COAT OF LIGHT GRAY ENAMEL SUITABLE FOR OVERPAINTING IN FIELD IF DESIRED.
- B. BUS BARS: PROVIDE GROUND BLOCK WITH FULL COMPLEMENT OF TERMINALS IN ADDITION TO INSULATED NEUTRAL BUS. FUTURE BREAKER SPACES SHALL HAVE COMPLETE PROVISION INCLUDING BUSES AND CONNECTING HARDWARE.
- C. MANUFACTURERS: PANELBOARDS SHALL BE GENERAL ELECTRIC, SQUARE D, EATON, OR SIEMENS-ITE.
- D. CIRCUIT BREAKERS: SHALL BE QUICK-MAKE, QUICK-BREAK, MOULDED CASE TYPE:
 - 1. 120/208–240 VOLT PANELS: SHALL BE BOLT-ON TYPE WITH MINIMUM SYMMETRICAL INTERRUPTING CAPACITY AS SHOWN ON THE PLANS.
 - 2. ALL BREAKERS MUST BE FULLY RATED. SERIES RATING NOT ALLOWED.
 - 3. PROVIDE MULTI-POLE UNITS WITH COMMON TRIP ELEMENT.

E. IDENTIFICATION: PROVIDE SCREWED-ON (NO ADHESIVES) BAKELITE OR PHOTO-ETCHED METALLIC NAMEPLATE IDENTIFICATION ON OUTSIDE OF EACH PANEL SHOWING PANEL DESIGNATION, VOLTAGE, AND PHASE IN MINIMUM 1/4" HIGH LETTERS. EACH PANEL SHALL CONTAIN A METAL-FRAMED CIRCUIT DIRECTORY INSIDE COVER, WITH PLASTIC PROTECTOR.

F. COMPLETE SHOP DRAWINGS ARE REQUIRED. SEE ARTICLE 1.08.

2.09 INDIVIDUALLY MOUNTED MOTOR CONTROLLERS:

- A. STARTERS FOR FRACTIONAL HORSEPOWER 120V MOTORS SHALL BE MANUAL TYPE UNLESS SHOWN OTHERWISE, EQUIPPED WITH BUILT-IN OVERLOAD PROTECTION.
- B. ACCEPTABLE MANUFACTURERS: GENERAL ELECTRIC, EATON, SIEMENS, SQUARE D, AND ALLEN BRADLEY.

2.10 MISCELLANEOUS MATERIALS:

- A. SAFETY SWITCHES: HEAVY DUTY TYPE, 600V, HORSEPOWER RATED FOR MOTORS, FUSED OR NON-FUSED AS REQUIRED. MOUNT IN ENCLOSURE WITH NEMA RATING AS REQUIRED FOR THE SPECIFIC APPLICATION. GENERAL ELECTRIC, SQUARE D, EATON OR SIEMENS-ITE.
- B. TIME CLOCK: TORK #DGLC, OR ACCEPTED SUBSTITUTE.
- C. PHOTOCELLS: TORK EPC1, OR ACCEPTED SUBSTITUTE.
- D. CONTACTORS/RELAYS: AS MANUFACTURED BY ASCO, OR ACCEPTED SUBSTITUTE, MECHANICALLY HELD WITH RELAYS AS REQUIRED TO OPERATE ON TWO WIRE CONTROL CIRCUITS.

2.11 LIGHTING:

- A. LIGHTING TO BE PROVIDED BY THE ELECTRICAL CONTRACTOR AS INDICATED ON THE DRAWINGS. SUBCONTRACTORS TO INSTALL ALL FIXTURES COMPLETE, INCLUDING LAMPS AND BALLASTS, READY FOR SERVICE.
- B. SUPPORTS: PROPER SUPPORTS AND MOUNTING ACCESSORIES, SUCH AS HANGERS, STEMS, YOKES, PLASTER FRAMES, ETC. SHALL BE PROVIDED AS REQUIRED BY THE TYPE OF CEILING INSTALLED. FIXTURES SHALL HANG PLUMB REGARDLESS OF CEILING SLOPE.
- C. FIXTURE DESIGNATION: FIXTURE TYPES ARE DESIGNATED ON DRAWINGS. FOR EXACT FIXTURE COUNT AND LOCATION, REFER TO REFLECTED CEILING PLAN.

PART 3 – EXECUTION

3.01 GENERAL:

A. ELECTRIC SYSTEM LAYOUTS INDICATED ON THE DRAWINGS ARE GENERALLY DIAGRAMMATIC AND SHALL BE FOLLOWED AS CLOSELY AS ACTUAL CONSTRUCTION AND WORK OF OTHER TRADES WILL PERMIT. GOVERN EXACT ROUTING OF CABLE AND WIRING AND THE LOCATIONS OF OUTLETS BY THE STRUCTURE AND EQUIPMENT SERVED. TAKE ALL DIMENSIONS FROM ARCHITECTURAL DRAWINGS.

B. CONSULT ALL OTHER DRAWINGS, VERIFY SCALES AND REPORT ANY DIMENSIONAL DISCREPANCIES OR OTHER CONFLICTS WITH THE ARCHITECT BEFORE SUBMITTING BID.

C. ALL HOME RUNS TO PANELBOARDS ARE INDICATED AS STARTING FROM THE OUTLET NEAREST THE PANEL AND CONTINUING IN THE GENERAL DIRECTION OF THAT PANEL. CONTINUE SUCH CIRCUITS TO THE PANEL AS THOUGH THE ROUTES WERE COMPLETELY INSTALLED. TERMINATE HOMERUNS OF SIGNAL, ALARM, AND COMMUNICATION SYSTEMS IN A SIMILAR MANNER.

D. AVOID CUTTING AND BORING HOLES THROUGH STRUCTURE OR STRUCTURAL MEMBERS WHEREVER POSSIBLE. OBTAIN PRIOR APPROVAL OF OWNER AND CONFORM TO ALL STRUCTURAL REQUIREMENTS WHEN CUTTING OR BORING THE STRUCTURE IS NECESSARY AND PERMITTED.

E. FURNISH AND INSTALL ALL NECESSARY HARDWARE, HANGERS, BLOCKING, BRACKETS, BRACING, RUNNERS, ETC. REQUIRED FOR EQUIPMENT SPECIFIED UNDER THIS SECTION.

F. PROVIDE NECESSARY BACKING REQUIRED TO INSURE RIGID MOUNTING OF OUTLET BOXES.

3.02 WIRING METHODS:

A. NO "ROMEX" OR ARMORED CABLE WIRING IS PERMITTED – ALL ELECTRICAL WIRING MUST BE IN CONDUIT.

B. CONDUIT SHALL BE RIGID STEEL, IMC, EMT, METAL CLAD (MC) CABLE, OR SCHEDULE 40 PVC AS FOLLOWS:

- 1. ABOVE GROUND: USE RIGID STEEL, IMC, MC, OR EMT. MC CABLE SHALL BE INSTALLED ONLY WHERE PERMITTED BY CODE AND THE AUTHORITY HAVING JURISDICTION.
 - a. WET LOCATIONS: RIGID STEEL OR IMC ONLY.
 - b. LOCATIONS SUBJECT TO MECHANICAL DEFORMATION: RIGID STEEL OR IMC ONLY.
 - c. DRY INTERIOR LOCATIONS FOR BRANCH CIRCUIT WIRING AND NOT SUBJECT TO MECHANICAL DEFORMATION: EMT, IMC, MC, OR RIGID STEEL CONDUIT.
 - d. DRY INTERIOR LOCATIONS FOR OTHER THAN BRANCH CIRCUIT WIRING AND NOT SUBJECT TO MECHANICAL DEFORMATION: EMT, IMC, OR RIGID STEEL CONDUIT.
- 2. UNDERGROUND: USE RIGID STEEL OR SCHEDULE 40 PVC WITH RIGID STEEL ELBS AND RIGID STEEL CONDUIT/FITTINGS WHEN EMERGING FROM GRADE, UNLESS NOTED OTHERWISE.
- C. USE FLEXIBLE CONDUITS IN THE FOLLOWING APPLICATIONS (MAX 6-FT):
 - 1. RECESSED LIGHTING FIXTURES.
 - 2. AT BUILDING JOINTS.
 - 3. AT WET LOCATIONS, FLEXIBLE CONDUIT SHALL BE LIQUIDTIGHT TYPE.
- D. LIGHT FIXTURES INSTALLED IN GYP BOARD CEILINGS MAY BE WIRED FROM FIXTURE TO FIXTURE USING MC CABLE UNLESS PROHIBITED BY THE A.H.I. VERIFY THAT LIGHT FIXTURES ARE PROVIDED WITH JUNCTION BOXES APPROVED FOR THIS PURPOSE. MC TYPE CABLE TO MEET ANS/NFPA 70 REQUIREMENTS. CABLE ARMOR TO BE INTERLOCKED STEEL METAL TAPE. MC TYPE CABLE MANUFACTURED BY AFC CABLE SYSTEMS, PIRELLI CABLE CORPORATION AND SOUTHWIRE COMPANY ARE APPROVED. MC CABLE SHALL NOT BE USED TO WIRE LIGHT FIXTURES INSTALLED IN EXPOSED CEINGS FROM FIXTURE TO FIXTURE (6-FT LIGHT FIXTURE WHIPS ARE PERMITTED).

E. ALL WIRING SHALL BE IN CONDUIT.

F. ALL CONDUIT AND MC CABLE SHALL BE SUPPORTED AS REQUIRED BY THE NEC.

3.03 INSTALLATION OF CONDUITS:

- A. GENERAL:
 - 1. RUN ALL CONDUIT CONCEALED, IF POSSIBLE, UNLESS NOTED OTHERWISE ON THE PLANS.
 - 2. RUN ALL CONDUIT PARALLEL TO OR AT RIGHT ANGLES TO CENTER LINES OF COLUMNS AND BEAMS.
 - 3. CONDUITS ABOVE CEILING SHALL NOT OBSTRUCT REMOVAL OF CEILING TILES, LIGHTING FIXTURES, AIR DIFFUSERS, ETC.
 - 4. CONDUITS SHALL NOT CROSS ANY DUCT SHAFT OR AREA DESIGNATED AS FUTURE DUCT SHAFT HORIZONTALLY. CONDUIT RISERS, WHEN ALLOWED IN DUCT SHAFT, MUST BE COORDINATED WITH MECHANICAL WORK TO AVOID ANY CONFLICT.
 - 5. INSTALL NO MORE THAN THE EQUIVALENT OF THREE 90-DEGREE BENDS IN ANY CONDUIT RUN EXCEPT FOR COMMUNICATIONS CONDUITS, FOR WHICH ONLY TWO BENDS ARE ALLOWED. PROVIDE J-BOXES AS NEEDED WHERE MORE BENDS ARE NEEDED.
- B. CONDUIT SUPPORTS:
 - 1. SUPPORT CONDUITS WITH UNDERWRITER'S LABORATORIES LISTED STEEL CONDUIT SUPPORTS AT INTERVALS REQUIRED BY THE NATIONAL ELECTRIC CODE. WIRES OR SHEET METAL STRIPS ARE NOT ACCEPTABLE FOR CONDUIT SUPPORT. USE CONDUIT HANGERS FOR ALL CONDUITS NOT DIRECTLY FASTENED TO STRUCTURE AND FOR ALL MULTIPLE CONDUIT RUNS. DO NOT ATTACH ANY CONDUIT TO MECHANICAL DUCTS OR PIPES.
 - 2. AN NFPA 251 TESTED AND APPROVED CEILING SYSTEM CAN BE USED TO SUPPORT BRANCH CIRCUIT CABLING WHERE APPROVED BY THE A.H.I.

C. CONDUIT PENETRATION:

- 1. PENETRATING FIRE RATED FLOOR OR WALL: INSTALL CONDUIT IN CONDUIT SLEEVE OR FRAMED OPENING. SEAL PENETRATION WITH FIRE RETARDANT SEALANT.
- 2. PENETRATING EXTERIOR WALL: AVOID PENETRATING EXTERIOR WALL WHERE POSSIBLE. WHERE PENETRATIONS ARE NECESSARY, BUILDING WEATHERPROOF INTEGRITY MUST BE PRESERVED. CONDUITS PENETRATING THROUGH ROOF SHALL HAVE ROOF FLASHING WITH CAULK TYPE COUNTERFLASHING SLEEVE.
- 3. PENETRATING NON-FIRE RATED DRY WALL: CONDUIT SLEEVES ARE NOT REQUIRED. PENETRATIONS MUST BE SEALED WITH PLASTER PRIOR TO PAINTING. PENETRATIONS MADE AFTER WALL FINISH IS APPLIED MUST BE AS SMALL AS POSSIBLE AND PROVIDED WITH ESCUTCHEONS, ONE ON EACH SIDE OF WALL.
- 4. PENETRATING SUSPENDED CEILING: CUT HOLE AS SMALL AS POSSIBLE TO PERMIT CONDUIT PENETRATION. PROVIDE ESCUTCHEON FOR EACH CONDUIT BELOW CEILING.

3.04 CONNECTIONS TO EQUIPMENT:

A. GENERAL:

- 1. FURNISH AND INSTALL REQUIRED POWER SUPPLY CONDUIT AND WIRING TO ALL EQUIPMENT. SEE BELOW FOR OTHER WIRING REQUIRED.

2. FURNISH AND INSTALL A DISCONNECT SWITCH IMMEDIATELY AHEAD OF AND ADJACENT TO EACH MAGNETIC MOTOR STARTER OR APPLIANCE UNLESS THE MOTOR APPLIANCE IS LOCATED ADJACENT AND WITHIN SIGHT OF THE SERVING PANELBOARD, CIRCUIT BREAKER OR SWITCH. VERIFY ALL EQUIPMENT NAMEPLATE CURRENT RATINGS PRIOR TO INSTALLATION.

3. INSTALL ALL ROUGH-IN WORK FOR EQUIPMENT FROM APPROVED SHOP DRAWINGS TO SUIT THE SPECIFIC REQUIREMENTS OF THE EQUIPMENT.

4. FURNISH AND INSTALL MANUAL THERMAL PROTECTION FOR ALL MOTORS NOT INTEGRALLY EQUIPPED WITH THERMAL PROTECTION.

5. FURNISH 120 VOLT POWER TO EACH CONTROL PANEL AND TIME SWITCH REQUIRING A SOURCE OF POWER TO OPERATE.

3.05 INSTALLATION OF CONDUCTORS:

- A. PULL NO WIRE INTO ANY PORTION OF THE CONDUIT SYSTEM UNTIL ALL CONSTRUCTION WORK WHICH MIGHT DAMAGE THE WIRE HAS BEEN COMPLETED.
- B. INSTALL ALL WIRE CONTINUOUS FROM OUTLET TO OUTLET OR TERMINAL TO TERMINAL. SPLICES IN CABLES WHEN REQUIRED SHALL BE MADE IN HAND HOLES, PULL BOXES OR JUNCTION BOXES. MAKE BRANCH CIRCUIT SPLICES IN OUTLET BOXES WITH 8" OF CORRECTLY COLOR-CODED TAILS LEFT IN THE BOX.
- C. SPLICES IN WIRES AND CABLES SHALL BE MADE UTILIZING MATERIALS AND METHODS DESCRIBED HEREIN BEFORE.
- D. MAKE ALL GROUND, NEUTRAL AND LINE CONNECTIONS TO RECEPTACLE AND WIRING DEVICE TERMINALS AS RECOMMENDED BY MANUFACTURER.
- E. PROVIDE BRADY WIRE MARKERS WHERE NUMBER OF CONDUCTORS IN A BOX EXCEEDS FOUR.

3.06 WIRE COLOR CODE:

COLOR CODING SHALL BE CONTINUOUS FOR WIRE #12 THROUGH #10 AWG. PHASE CONDUCTORS #8 AND LARGER AND CONDUCTORS OF ANY SIZE IN CABLE ASSEMBLIES MAY HAVE COLORED PHASED TAPE AT TERMINATIONS. COLOR CODE WIRES AS FOLLOWS:

VOLTAGE	PHASE A	PHASE B	PHASE C	NEUTRAL	GND
120/208V	RED	BLACK	BLUE	WHITE	GREEN

3.07 IDENTIFICATION:

- A. PROVIDE NAMEPLATES FOR PANELBOARDS, AND ALL SIMILAR DEVICES. NAMEPLATES SHALL BE SCREWED (NO ADHESIVES) ENGRAVED BAKELITE OR PHOTO-ETCHED METALLIC NAMEPLATE IDENTIFICATION SHOWING PANEL DESIGNATION, VOLTAGE AND PHASE IN MINIMUM 1/4" HIGH LETTERS.
- B. EACH PANELBOARD SHALL CONTAIN A METAL-FRAMED CIRCUIT DIRECTORY INSIDE COVER, WITH PLASTIC PROTECTOR.
- C. PANELBOARD SCHEDULE: AFTER COMPLETION OF WORK, PROVIDE TYPED/WRITTEN UPDATED PANELBOARD SCHEDULES FOR ALL PANELBOARDS. INCLUDE ROOM/EQUIPMENT DESIGNATIONS TO IDENTIFY ROOM/EQUIPMENT SERVED BY CIRCUIT.

3.08 GROUNDING:

- A. ELECTRICAL SERVICE ALTERNATING CURRENT SYSTEMS SHALL BE GROUNDED IN ACCORDANCE WITH NEC ARTICLE 250-3 TO 250-26, INCLUSIVE.
- B. GROUND NON-CURRENT CARRYING METAL PARTS OF ELECTRICAL ENCLOSURES, FRAMES OR CONDUCTOR RACEWAYS TO PROVIDE A LOW IMPEDANCE PATH FOR LINE-TO-GROUND FAULT CURRENT AND TO BOND ALL NON-CURRENT CARRYING METAL PARTS TOGETHER. PROVIDE GROUND CONDUCTOR IN EACH RACEWAY SYSTEM. WHETHER GROUND WIRE IS SPECIFICALLY LISTED OR NOT, EQUIPMENT GROUND CONDUCTOR SHALL BE ELECTRICALLY AND MECHANICALLY CONTINUOUS FROM THE ELECTRICAL CIRCUIT SOURCE TO THE EQUIPMENT TO BE GROUNDED. SIZE GROUND CONDUCTORS PER NEC ARTICLE 250.122 UNLESS LARGER CONDUCTORS ARE SHOWN ON DRAWINGS.
- C. GROUNDING CONDUCTORS SHALL BE IDENTIFIED WITH GREEN INSULATION. WHERE GREEN INSULATION IS NOT AVAILABLE ON LARGER SIZES, BLACK INSULATION SHALL BE USED AND SUITABLY IDENTIFIED WITH GREEN TAPE AT EACH JUNCTION BOX OR DEVICE ENCLOSURE.

DRAWN BY: CA CHECKED BY: AD



Engineering, LLC

MEP CONSULTING ENGINEERING
411 W. Main Street, Suite 310 • Round Rock • TX 78664
www.AYS.org.com 512-961-6835
TBE Form F-10298

COPYRIGHT © 2022. ALL RIGHTS RESERVED. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF CORNERSTONE ARCHITECTS, P.C. AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

06.20.22 - Revision 2

08.26.22 - City Comments


ELECTRICAL SPECIFICATIONS

SHEET: E400

PROJECT NO: 21099

DRAWN BY: DATE: 01.28.2022

PROJECT MGR:

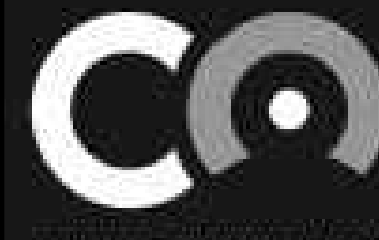

CORNERSTONEARCHITECTS.COM


CORNERSTONE
ARCHITECTS

7000 BEE CAVES RD., SUITE 200
AUSTIN, TX 78746 512.249.0007

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2022. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE
PROPERTY OF CORNERSTONE ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM,
BY ANY METHOD, FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.


- 2 06.20.22 - Revision 2
- 3 8.26.22 - City Comments
- 4 10.10.22 - City Comments #2

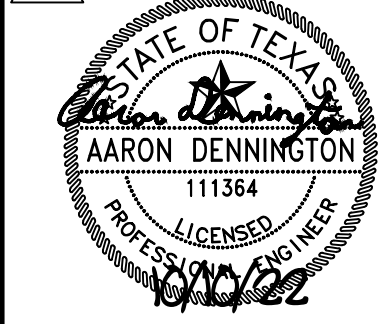

10.10.2022
CITY COMMENTS #2
SITE PLAN - ELECTRICAL

SHEET: **EU100**

PROJECT NO: 21099
DRAWN BY: [Signature]
DATE: 01.28.2022
PROJECT MGR:

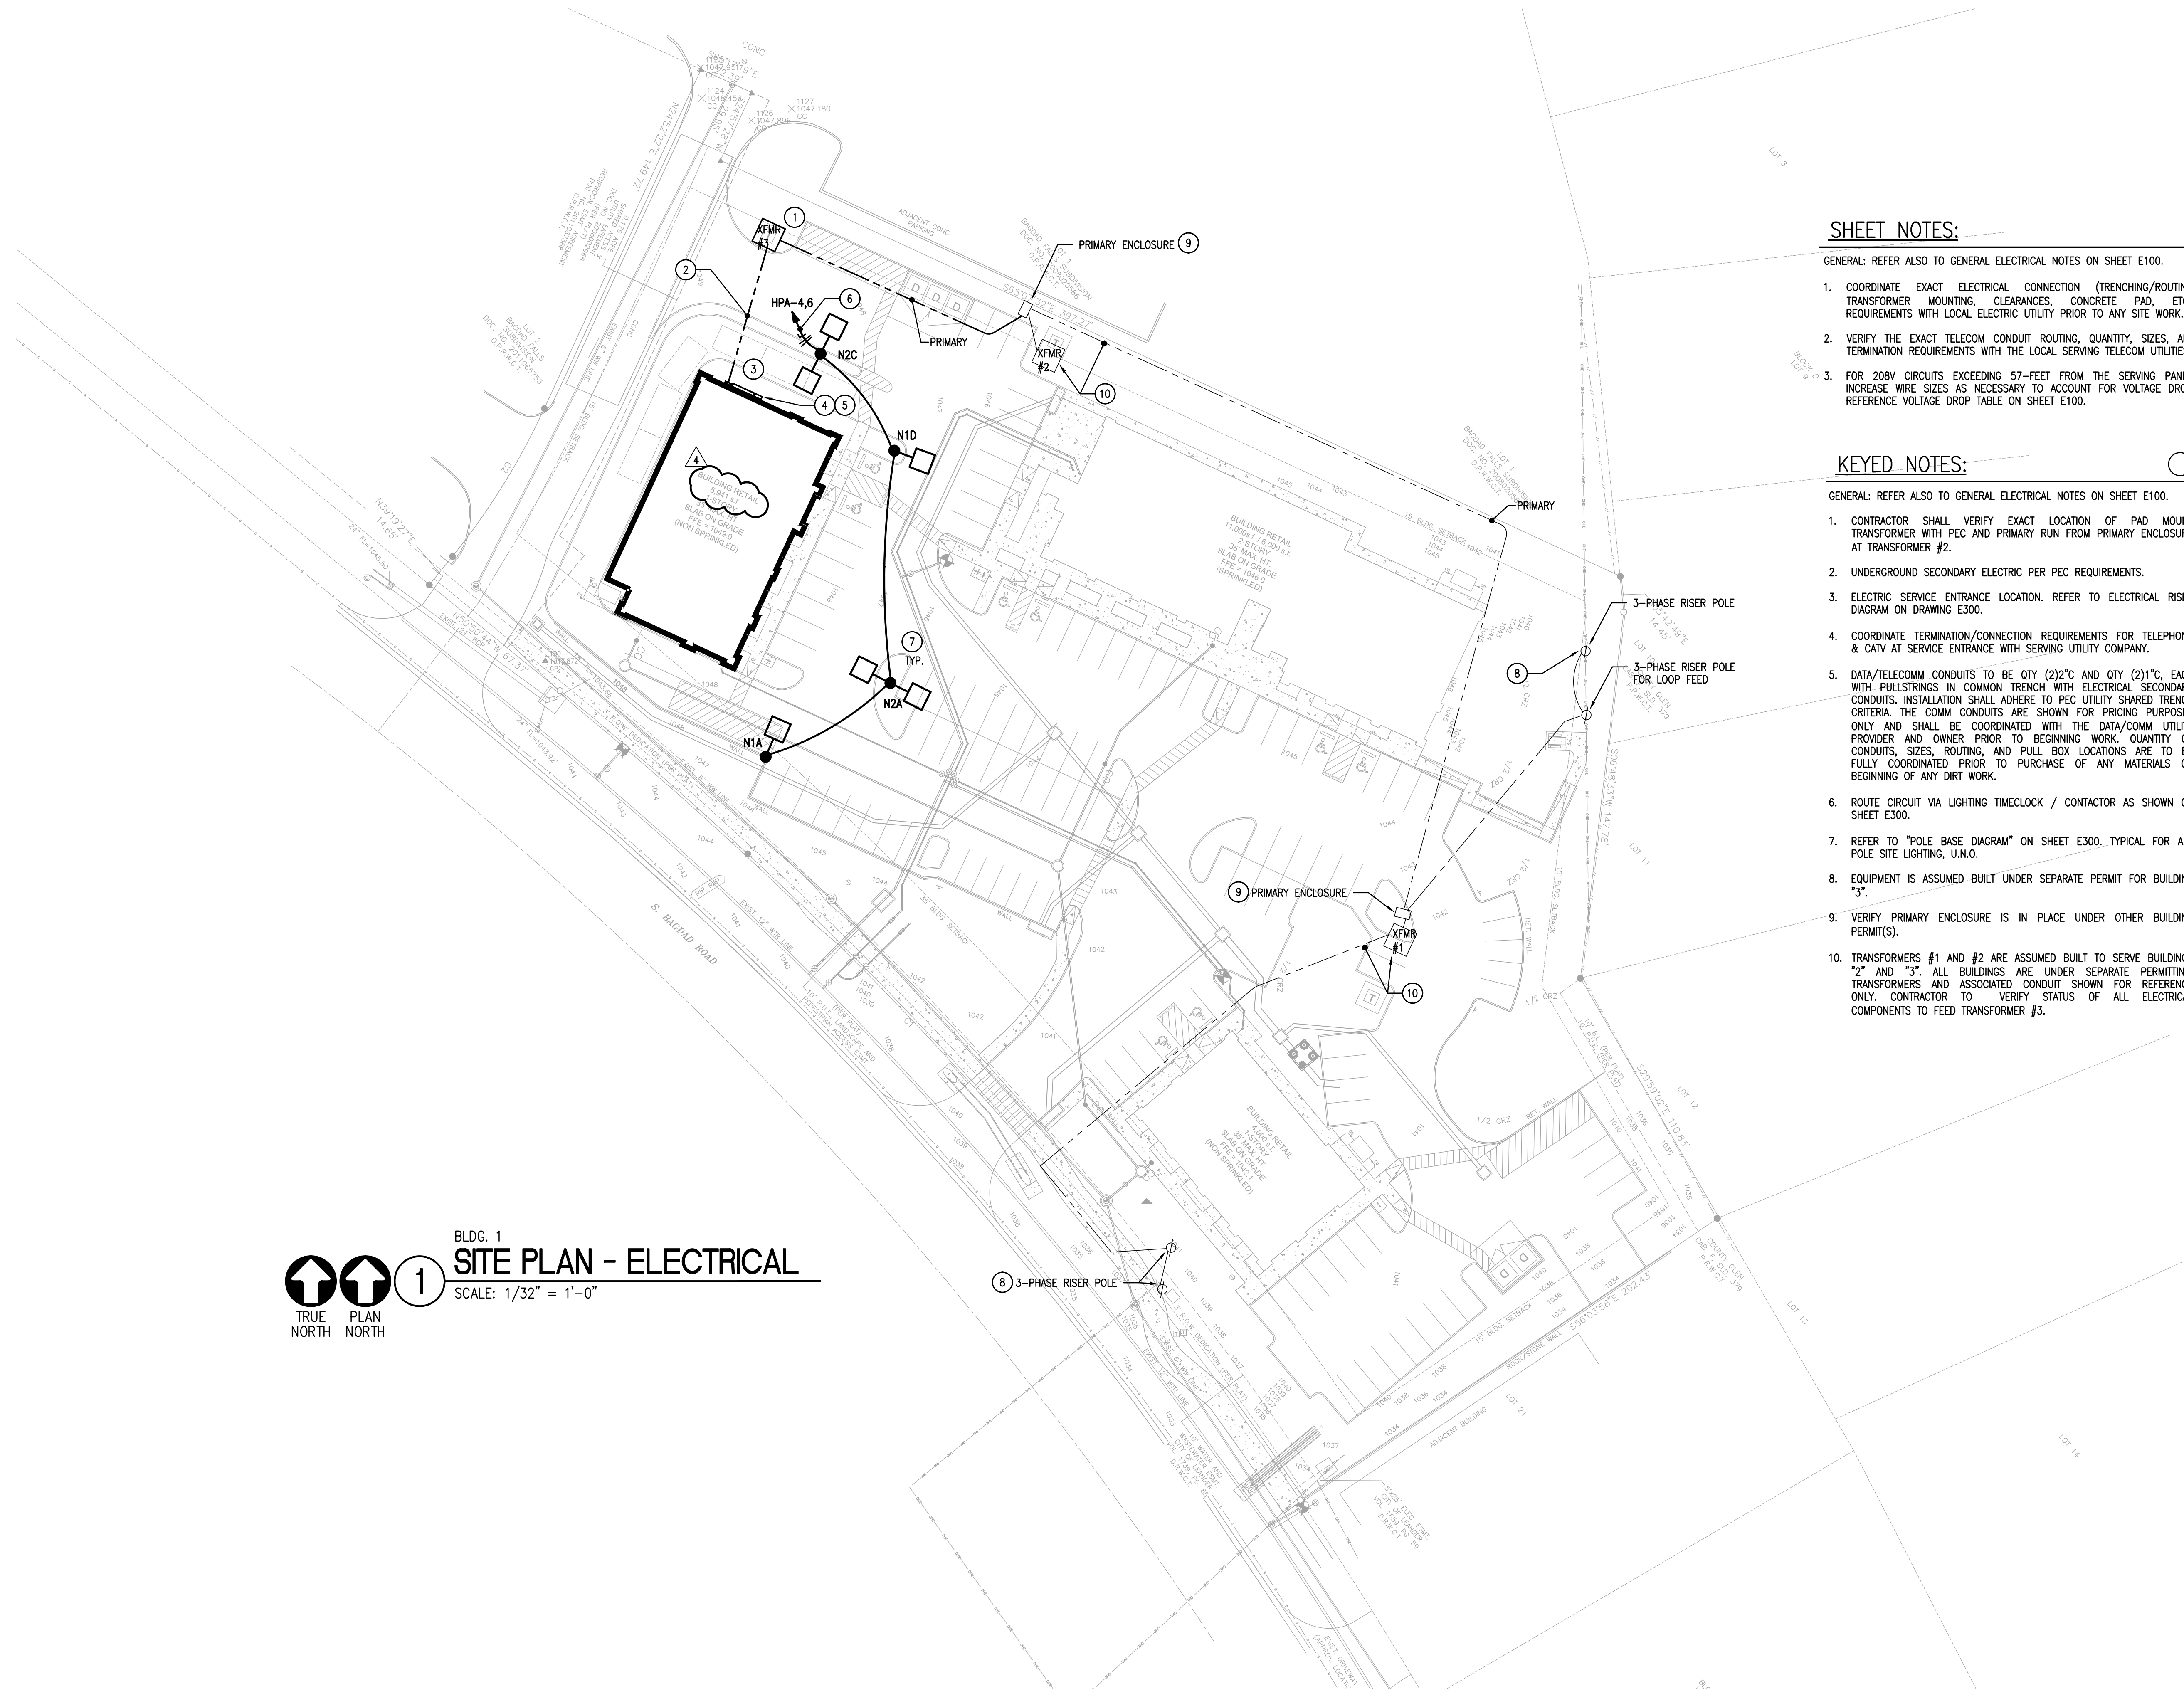

SHEET NOTES:

- GENERAL: REFER ALSO TO GENERAL ELECTRICAL NOTES ON SHEET E100.
- COORDINATE EXACT ELECTRICAL CONNECTION (TRENCHING/ROUTING, TRANSFORMER MOUNTING, CLEARANCES, CONCRETE PAD, ETC.) REQUIREMENTS WITH LOCAL ELECTRIC UTILITY PRIOR TO ANY SITE WORK.
 - VERIFY THE EXACT TELECOM CONDUIT ROUTING, QUANTITY, SIZES, AND TERMINATION REQUIREMENTS WITH THE LOCAL SERVING TELECOM UTILITIES.
 - FOR 208V CIRCUITS EXCEEDING 57-FEET FROM THE SERVING PANEL, INCREASE WIRE SIZES AS NECESSARY TO ACCOUNT FOR VOLTAGE DROP. REFERENCE VOLTAGE DROP TABLE ON SHEET E100.

KEYED NOTES:

- GENERAL: REFER ALSO TO GENERAL ELECTRICAL NOTES ON SHEET E100.
- CONTRACTOR SHALL VERIFY EXACT LOCATION OF PAD MOUNT TRANSFORMER WITH PEC AND PRIMARY RUN FROM PRIMARY ENCLOSURE AT TRANSFORMER #2.
 - UNDERGROUND SECONDARY ELECTRIC PER PEC REQUIREMENTS.
 - ELECTRIC SERVICE ENTRANCE LOCATION. REFER TO ELECTRICAL RISER DIAGRAM ON DRAWING E300.
 - COORDINATE TERMINATION/CONNECTION REQUIREMENTS FOR TELEPHONE & CATV AT SERVICE ENTRANCE WITH SERVING UTILITY COMPANY.
 - DATA/TELECOMM CONDUITS TO BE QTY (2)2" AND QTY (2)1" EACH WITH PULLSTRINGS IN COMMON TRENCH WITH ELECTRICAL SECONDARY CONDUITS. INSTALLATION SHALL ADHERE TO PEC UTILITY SHARED TRENCH CRITERIA. THE COMM CONDUITS ARE SHOWN FOR PRICING PURPOSES ONLY AND SHALL BE COORDINATED WITH THE DATA/COMM UTILITY PROVIDER AND OWNER PRIOR TO BEGINNING WORK. QUANTITY OF CONDUITS, SIZES, ROUTING, AND PULL BOX LOCATIONS ARE TO BE FULLY COORDINATED PRIOR TO PURCHASE OF ANY MATERIALS OR BEGINNING OF ANY DIRT WORK.
 - ROUTE CIRCUIT VIA LIGHTING TIMELOCK / CONTACTOR AS SHOWN ON SHEET E300.
 - REFER TO "POLE BASE DIAGRAM" ON SHEET E300. TYPICAL FOR ALL POLE SITE LIGHTING, U.N.O.
 - EQUIPMENT IS ASSUMED BUILT UNDER SEPARATE PERMIT FOR BUILDING "3".
 - VERIFY PRIMARY ENCLOSURE IS IN PLACE UNDER OTHER BUILDING PERMIT(S).
 - TRANSFORMERS #1 AND #2 ARE ASSUMED BUILT TO SERVE BUILDINGS "2" AND "3". ALL BUILDINGS ARE UNDER SEPARATE PERMITTING. TRANSFORMERS AND ASSOCIATED CONDUIT SHOWN FOR REFERENCE ONLY. CONTRACTOR TO VERIFY STATUS OF ALL ELECTRICAL COMPONENTS TO FEED TRANSFORMER #3.

BLDG. 1
SITE PLAN - ELECTRICAL
SCALE: 1/32" = 1'-0"

TRUE NORTH
PLAN NORTH

DRAWN BY: CA
CHECKED BY: AD

AYS

Engineering, LLC
MEP CONSULTING ENGINEERING
411 W. Main Street, Suite 310 • Round Rock • TX 78664
www.AYSeng.com • 512-961-6835
TBPE Firm F-10298




CORNERSTONE
ARCHITECTS

7000 BEE CAVES RD., SUITE 200
AUSTIN, TX 78746 512.219.0007

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2022. ALL RIGHTS RESERVED.
THESE DESIGNS/DRAWINGS ARE THE SOLE
PROPERTY OF CORNERSTONE ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM
BY ANY METHOD, FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.

- 2 06.20.22 - Revision 2
- 3 8.26.22 - City Comments
- 4 10.10.22 - City Comments #2

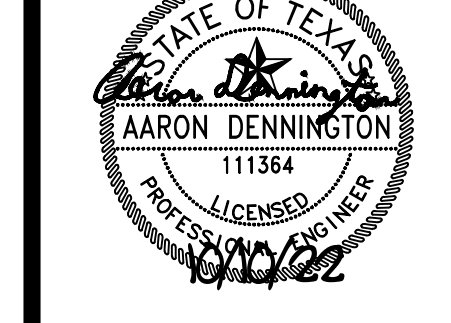

10.10.2022
CITY COMMENTS #2
SITE PLAN - PHOTOMETRICS

SHEET: **EU200**

PROJECT NO: 21099
DRAWN BY: [Signature]
DATE: 01.28.2022
PROJECT MGR: [Signature]



BLDG. 1
SITE PLAN - PHOTOMETRICS
SCALE: 1/32" = 1'-0"

TRUE NORTH
PLAN NORTH

DRAWN BY: CA
CHECKED BY: AD

AYS
CONSULTING ENGINEERING

Engineering, LLC
MEP CONSULTING ENGINEERING
411 W. Main Street, Suite 310 • Round Rock • TX 78664
www.AYSEng.com • 512-961-6835
TBPE Firm F-10298

DRAWING ABBREVIATIONS AND SYMBOLS			
ABBREVIATION	DESCRIPTION	ABBREVIATION	DESCRIPTION
ABV	ABOVE CLEANOUT	REF	REFERENCE ROOF DRAIN
CO	COLD WATER	SAN	SANITARY SEWER
CW	COLD WATER	S/S	STAINLESS STEEL
EXT FCO	EXTERIOR FLOOR CLEANOUT	TYP	TYPICAL
FCO	FLOOR CLEAN OUT	V	VENT THROUGH ROOF
FF	FINISH FLOOR	VTR	VENT THROUGH ROOF
G	NATURAL GAS	W/O	WALL CLEAN OUT
HPG	HIGH PRESSURE NATURAL GAS	WCO	WALL CLEAN OUT
		WHA	WATER HAMMER ARRESTOR

GENERAL SYMBOL LEGEND			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
(1)	NOTE BY SYMBOL DESIGNATION	(2)	CONTINUATION OF SYSTEM OR LINE

NOTES: 1. ALL ABBREVIATIONS AND SYMBOLS ARE NOT NECESSARILY USED.
2. ALL MATERIALS, LABOR, COORDINATION, AND SUPERVISION IS BY CONTRACTOR UNLESS SPECIFICALLY NOTED "BY OWNER" OR "NIC". CONTRACTOR SHALL COORDINATE AND INSTALL EQUIPMENT WHEN NOTED "OWNER FURNISHED".
3. SYMBOLS USED, BUT NOT ON THE LEGEND ARE NOTED ON THE PLAN.

PLUMBING SYMBOL LEGEND			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
(Symbol)	SANITARY SEWER	(Symbol)	FLOOR CLEANOUT
(Symbol)	PLUMBING VENT	(Symbol)	WALL CLEANOUT
(Symbol)	STORM DRAIN	(Symbol)	EXTERIOR FLOOR CLEANOUT
(Symbol)	DOMESTIC COLD WATER	(Symbol)	DOUBLE TWO-WAY EXTERIOR FLOOR CLEANOUT
(Symbol)	DOMESTIC HOT WATER	(Symbol)	ELBOW TURNING DOWN
(Symbol)	GAS LINE	(Symbol)	ELBOW TURNING UP
(Symbol)	DIRECTION OF FLOW	(Symbol)	CAPPED PIPE
(Symbol)	BALL VALVE	(Symbol)	CONCENTRIC PIPE REDUCER/INCREASER
(Symbol)	UNION	(Symbol)	ECCENTRIC PIPE REDUCER/INCREASER
(Symbol)	SANITARY WASTE OR VENT STACK WASTE OR VENT NO.	(Symbol)	PIPE SLEEVE
(Symbol)	GATE VALVE WITH C.I. VALVE BOX	(Symbol)	DIRECTION OF SLOPE (DNWARD)
(Symbol)	STRAINER W/ BLOWDOWN GATE VALVE	(Symbol)	UNION
(Symbol)	WALL HYDRANT		
(Symbol)	ROOF DRAIN		
(Symbol)	VENT THRU ROOF		

PIPING SCHEDULE					
SYMBOL	SERVICE	PIPE MATERIAL	TYPE JOINT	FITTINGS	TEST
(Symbol)	SANITARY WASTE STORM DRAIN PIPING	SCHEDULE 40 DWV PVC	SOLVENT WELD (PER MANUFACTURER'S RECOMMENDATIONS)	SCHEDULE 40 DWV PVC	10 ft. FOR 6-HOURS
(Symbol)	SANITARY VENT	SCHEDULE 40 DWV PVC	SOLVENT WELD (PER MANUFACTURER'S RECOMMENDATIONS)	SCHEDULE 40 DWV PVC	10 ft. FOR 6-HOURS
(Symbol)	DOMESTIC WATER AND ABOVE GROUND HVAC CONDENSATE DRAIN	TYPE 1' HARD DRAWN COPPER (TYPE 'K' FOR UNDERGROUND)	SWEAT WITH LEAD FREE SOLDER, SILVER SOLDER FOR UNDERGROUND	WROUGHT COPPER (CONTINUOUS NO JOINTS UNDER- FLOOR SLAB)	150 ft. FOR 24 HOURS

PLUMBING FIXTURE SCHEDULE					
CONNECTION SIZE			DESCRIPTION		
W.	V.	C.W.	H.W.	ITEM	DESCRIPTION
-	-	3/4"	-	WH-1 NON-FREEZE WATER HYDRANT	WATTS #HY-330-K-3 VACUUM BREAKER, 3/4" NPT OUTLET AND "T" HANDLE. DEPTH AS REQUIRED FOR WALL THICKNESS.
AS NOTED ON PLANS				WALL CLEANOUT: (WCO)	MIFAB No. C1400-R6-36, STAINLESS STEEL ROUND WALL CLEANOUT ACCESS COVER.
AS NOTED ON PLANS				CLEANOUT: (CO)	MIFAB No. C1000 SERIES, STAINLESS STEEL ROUND FLOOR CLEANOUT ACCESS COVER. HEAVY DUTY TOP, TAPER THREAD BRONZE PLUG, NICKLE BRONZE TOP
AS NOTED ON PLANS				WATER HAMMER ARRESTORS (WHA)	WATER HAMMER ARRESTORS MIFAB WHB-SERIES STAINLESS STEEL BELOWS TYPE

GENERAL PLUMBING NOTES:

(THESE NOTES APPLY TO ALL SHEETS)
(REFER TO SHEETS FOR ANY ADDITIONAL GENERAL NOTES)

- CONTRACTOR TO CHANGE LOCATION OF NEW PIPING, AS SHOWN, TO MEET FIELD CONDITIONS.
- CONTRACTOR SHALL NOT SCALE DRAWINGS.
- CONTRACTOR SHALL LAYOUT HIS WORK FROM ACTUAL FIELD MEASUREMENTS AND ACTUAL DIMENSIONS OF EQUIPMENT INSTALLED. ALL PIPING AND EQUIPMENT OF ALL TRADES SHALL BE PROPERLY COORDINATED AND SET TO MAINTAIN REQUIRED CLEARANCES. CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ALL LOCATIONS SUBJECT TO APPROVAL OF ARCHITECT.
- REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS OF ALL WALLS, PARTITIONS, CEILING HEIGHTS, AND EQUIPMENT.
- ROUTE ALL PIPING CONCEALED, HIDDEN FROM VIEW AND AS HIGH AS POSSIBLE ABOVE CEILING LEVELS.
- PRIOR TO BID SUBMITTAL THE CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH ARCHITECTURAL DRAWINGS. CONTRACTOR SHALL REFER TO ARCHITECTURAL DRAWINGS TO VERIFY FLOOR PLAN SCALE OF MECHANICAL DRAWINGS PRIOR TO ANY QUALITATIVE TAKE - OFF OF MATERIAL.
- INSULATE ALL DOMESTIC WATER SUPPLY (HOT AND COLD) PIPING WITH 1-INCH THICK FIBERGLASS PIPE INSULATION. FIBERGLASS PIPE INSULATION SHALL HAVE AN ALL SERVICE JACKET (ASJ) WITH SELF-SEALING LAPS (OWENS CORNING SSL-11 OR EQUAL). ALL PIPING INSULATION USED ON THE PROJECT SHALL HAVE A FLAME SPREAD RATING NOT EXCEEDING 25 AN A SMOKE DEVELOPED RATING NOT EXCEEDING 50 AS DETERMINED BY TEST PROCEDURES ASTM E 84 NPPA 225 AND U.L. 723. THESE RATINGS MUST BE AS TESTED ON THE COMPOSITE OF INSULATION JACKET OR FACING AND ADHESIVE. COMPONENTS SUCH AS ADHESIVES MASTIC AND CEMENTS SHALL MEET THE SAME INDIVIDUAL RATINGS AS THE MINIMUM REQUIREMENTS.
- SUPPORT INSULATION AT HANGERS AND SUPPORTS WITH A SHIELD OF GALVANIZED METAL COVERING NOT LESS THAN 4-INCHES ON EITHER SIDE OF THE SUPPORT BEARING AREA COVERING AT LEAST HALF OF THE PIPE CIRCUMFERENCE.
- PERFORM WORK IN ACCORDANCE WITH APPLICABLE STATUTES, ORDINANCES, CODES, AND REGULATIONS OF GOVERNMENTAL AUTHORITIES HAVING JURISDICTION. OBTAIN AND PAY FOR ALL PERMITS AND INSPECTIONS.

PLUMBING SPECIFICATIONS

PART 1 - GENERAL

- MATERIALS AND INSTALLATION SHALL COMPLY WITH ALL APPLICABLE STATE AND LOCAL CODES AND REQUIREMENTS.
- OBTAIN AND PAY FOR ALL REQUIRED PERMITS, INSPECTION FEES, TAPPING FEES, CONNECTION CHARGES, AND UTILITY COMPANY SERVICE CHARGES.
- INSTALLATION SHALL BE DONE IN A NEAT AND WORKABLE MANNER.
- DRAWINGS ARE DIAGRAMMATIC AND SHALL NOT BE SCALED FOR EXACT SIZES OR LOCATIONS. THEY ARE NOT INTENDED TO DISCLOSE ABSOLUTE OR UNCONDITIONAL KNOWLEDGE OF ACTUAL FIELD CONDITIONS.

PART 2 - PRODUCTS

- ALL DOMESTIC WATER PIPING INSIDE THE BUILDING ABOVE SLAB SHALL BE TYPE 'L' HARD DRAWN COPPER (TYPE 'K' FOR UNDERGROUND) WITH WROUGHT COPPER FITTINGS, SWEAT WITH LEAD FREE SOLDER. ALL CONDENSATE PIPING ON THE ROOF SHALL BE TYPE 'M' COPPER, OR PVC WHERE ALLOWED BY CODE.
- DOMESTIC WATER AND CONDENSATE DRAIN PIPING BELOW SLAB AND OUTSIDE SHALL BE TYPE 'K' SOFT SEAMLESS. NO JOINTS SHALL BE ALLOWED BELOW SLAB. ALL SLAB PENETRATIONS SHALL BE SLEEVED TO PROTECT PIPING FROM CORROSION BY CONCRETE.
- COPPER PIPE FITTINGS SHALL BE WROUGHT COPPER SWEEP PATTERN FITTINGS, SOLDERED USING 95-5 LEAD-FREE SOLDER OR BRAZED WITH SIL-FOS.
- ALL SANITARY WASTE, VENT AND STORM DRAINAGE PIPING INSIDE AND EXTENDING 30" OUTSIDE THE BUILDING SHALL BE SCHEDULE 40 PVC DWV EQUIVALENT TO CHARLOTTE PIPE AND MEET ASTM D-2665. EXTERIOR PVC PIPING 30" FROM BUILDING SHALL BE TYPE SDR-26 AND ASTM D-3034.
- JOINTS FOR PVC PIPING SHALL BE SOLVENT WELD TYPE INSIDE AND UNDERSLAB TO A POINT 30" OUTSIDE THE BUILDING AND NEOPRENE PUSH-ON TYPE JOINTS BEYOND OUTSIDE 30" FROM THE BUILDING.
- INSULATE AND HEAT TRACE ALL DOMESTIC HOT AND COLD WATER PIPING LOCATED IN AREAS SUBJECT TO FREEZING. INSULATION SHALL BE 1" THICK FIBERGLASS AS MANUFACTURED BY MANVILLE, OWENS-CORNING, OR KNAUF.
- ALL NATURAL GAS PIPING SHALL BE SCHEDULE 40 BLACK STEEL WITH SCREWED OR WELDED FITTINGS AND GASKET TYPE UNIONS AND FLANGES. 2" AND SMALLER - SCREWED, 2 1/4" AND LARGER WELDED
- ALL UNDERGROUND NATURAL GAS PIPING SHALL BE POLYETHYLENE (PE-2306) WITH HEAT FUSION JOINTS

PART 3 - EXECUTION

- EXCAVATION, BACKFILLING AND TRENCH WORK SHALL BE DONE IN ACCORDANCE WITH O.S.H.A. AND EXISTING SAFETY STANDARDS.
 - PROVIDE SHORING AND CLEANING NECESSARY TO KEEP TRENCHES IN GOOD WORKING CONDITION, INCLUDING PUMPING OUT WATER.
 - IN MOSTLY ROCK MATERIAL, TRENCHES SHALL BE EXCAVATED TO AT LEAST 6" BELOW THE ELEVATION OF THE BOTTOM OF THE PIPES. AFTER EXCAVATION, TRENCH SHALL THEN BE FILLED TO THE PROPER ELEVATION WITH CRUSHED LESTONE. GRAVEL SHALL BE SCOOPED OUT UNDER PIPE BELLS SO THE PIPE RESTS FIRMLY ON THE TRENCH BOTTOM.
 - IN MOSTLY EARTH OR SAND MATERIAL, THE LAST 6" OF EXCAVATION SHALL BE DONE BY HAND. TRENCH BOTTOM SHALL BE SCOOPED OUT AT PIPE BELLS SO THE PIPE RESTS FIRMLY ON THE TRENCH BOTTOM.
 - BACKFILLING AND TAMPING SHALL BE CAREFULLY DONE BY HAND SIMULTANEOUSLY ALONG BOTH SIDES OF THE PIPE USING ROCK FREE EARTH, CRUSHED STONE OR SAND UNTIL THE PIPE IS COVERED TO A DEPTH OF AT LEAST 12". THE REST OF THE FILL-UP TO THE TOPSOIL LAYER MAY BE GRAVEL OR ROCK FREE EARTH. ACCEPTABLE SOIL MATERIALS FOR BACK FILL AND FILL SHALL BE FREE OF CLAY, ROCK OR GRAVEL LARGER THAN 2" IN ANY DIMENSION, DEBRIS, WASTE, FROZEN MATERIALS AND OTHER DELETERIOUS MATTER HAVING A PLASTICITY INDEX LESS THAN 30. BACKFILL SHALL BE DONE IN LAYERS OF NOT MORE THAN 8" AND EACH LAYER SHALL BE COMPACTED. THE LAST 12" OF BACKFILL SHALL BE ROCK FREE TOPSOIL.
- SURFACE SHALL BE RESTORED TO ITS ORIGINAL CONDITION.
- PRESSURE REDUCING VALVE SHALL BE SET AT 70 PSI MAXIMUM. PRESSURE RELIEF VALVE SHALL BE SET AT 80 PSI MAXIMUM.
- EXPOSED HOT AND COLD WATER TRIM IN FINISHED AREAS SHALL BE CHROME FINISHED.
- ALL HORIZONTAL AND VERTICAL PIPING SHALL BE SUPPORTED IN ACCORDANCE WITH APPLICABLE STATE AND LOCAL CODE RECOMMENDATIONS. SUPPORTS SHALL SECURELY HOLD PIPING, PREVENT VIBRATION, COMPENSATE FOR ALL STATIC AND OPERATIONAL CONDITIONS OF THE VARIOUS SYSTEMS AND SHALL NOT BE SUBJECT TO ELECTROLYTIC ACTION. SHOCK ABSORBERS SERVICING FIXTURES WITH FLUSH VALVES SHALL BE SECURELY ANCHORED IN THEIR VERTICAL POSITION. ACCEPTABLE METHODS OF SUPPORT WILL BE THE SUMMER SYSTEM, POSIFIX, STAKFIX, PIPEFIX, HOLDRITE OR CHANNEL.
- PROVIDE J.R. SMITH OR APPROVED EQUAL SHOCK ABSORBERS #5005 THRU 5050 SIZE AS RECOMMENDED BY MANUFACTURER INSTALLED ON HOT AND COLD WATER BRANCH LINES CONTAINING SINGLE LEVER FAUCETS, FLUSH VALVES OR EQUIPMENT WITH QUICK CLOSING VALVES BETWEEN THE LAST TWO FIXTURES AS SHOWN ON THE CONTRACT DRAWINGS.
- SANITARY WASTE LINES SHALL BE UNIFORMLY GRADED TO ELEVATIONS SHOWN. IF NO ELEVATIONS ARE GIVEN, SEWERS SHALL BE PITCHED NOT LESS THAN 1/4" PER FOOT FOR ALL PIPING 2-1/2" IN DIAMETER AND SMALLER AND 1/8" PER FOOT FOR ALL PIPING 3" IN DIAMETER AND LARGER.
- SUPPORT HORIZONTAL PIPING AS FOLLOWS:

NOMINAL PIPE SIZE (IN.)	MAXIMUM DISTANCE BETWEEN SUPPORT (FT.)	MINIMUM HANGER DIAMETER (IN.)
1/2	6	3/8
3/4 TO 1-1/2	6	3/8
2 TO 2-1/2	10	3/8
3 TO 6	12	1/2
- HANGERS FOR PIPING GREATER THAN 1" SHALL PASS OVER THE INSULATION. PROVIDE SADDLES FOR INSULATED PIPING.
- INSULATION SHALL BE APPLIED WITH JOINTS TIGHTLY BUTTED. OPEN CRACKS, VOIDS AND DEPRESSIONS SHALL BE FILLED WITH HYDRAULIC SETTING CEMENT. LAPPING MATCHING THE FINISH SHALL BE PASTED NEATLY OVER JOINTS.
- FITTINGS AND VALVES SHALL BE INSULATED WITH THE SAME TYPE INSULATION AS THE PIPING OR WITH HYDRAULIC SETTING CEMENT, BUILT-UP TO THE SAME THICKNESS AS LINES. COVER SHALL BE SAME AS ADJACENT PIPING OR PVC PREFORMED JACKET.
- PROVIDE AND INSTALL A CUT-OFF VALVE, UNION AND FULL SIZE DIRT LEG AT CONNECTION TO EACH GAS-FIRED PIECE OF EQUIPMENT.
- THE SYSTEM TESTS DESCRIBED HEREIN ARE MINIMUM REQUIREMENTS. HOWEVER, ADDITIONAL TESTS AS REQUIRED BY THE AUTHORITY HAVING JURISDICTION SHALL ALSO BE PERFORMED.
- DOMESTIC WATER PIPING SHALL BE TESTED HYDROSTATICALLY AT 85 PSI. IN ADDITION PIPING SHALL BE TESTED IN ACCORDANCE WITH APPLICABLE CODE REQUIREMENTS.
- THE DOMESTIC WATER SYSTEM SHALL BE FLUSHED OUT PROGRESSIVELY BY OPENING OUTLETS AND FLOWING WATER UNTIL IT RUNS CLEAR. AFTER PIPE CLEANING IS COMPLETED, THE STRAINERS SHALL BE REMOVED, CLEANED, AND REPLACED. THEN THE ENTIRE DOMESTIC WATER SYSTEM SHALL BE DISINFECTED IN ACCORDANCE WITH THE AUTHORITY HAVING JURISDICTION.
- THE SANITARY WASTE SYSTEM SHALL BE FLUSHED OUT PROGRESSIVELY WITH FLOWING WATER UNTIL IT RUNS CLEAR.
- THE ENTIRE SANITARY WASTE SYSTEM SHALL BE TESTED AGAINST A HEAD PRESSURE OF 10', FOR 6 HOURS WITHOUT LEAKAGE.

**CITY OF LEANDER
PLUMBING PLAN CHECKING NOTES**


- NEW WATER METER RECEIPT (FROM CITY OF LEANDER TAP SALES OFFICE) WILL BE PROVIDED BY THE OWNER AND THE CIVIL ENGINEER. THESE DRAWINGS DO NOT INCLUDE WATER SUPPLY PIPING BEYOND 5'-0" FROM THE BUILDING. SITE UTILITY ITEMS SUCH AS WATER METERS ARE THE RESPONSIBILITY OF THE CIVIL ENGINEER.
- APPROVED CITY OF LEANDER WATER AND WASTE WATER DEPT. UTILITY PLOT PLANS SHOWING THE NEW WATER METER WILL BE PROVIDED BY THE OWNER AND THE CIVIL ENGINEER. THESE PLUMBING DRAWINGS DO NOT INCLUDE WATER SUPPLY PIPING BEYOND 5'-0" FROM THE BUILDING. SITE UTILITY ITEMS SUCH AS WATER METERS ARE THE RESPONSIBILITY OF THE CIVIL ENGINEER.

GENERAL NOTE:
(THIS NOTE APPLIES TO ALL SHEETS)
ALL MATERIALS, FIXTURES AND DEVICES SHALL CONFORM TO APPROVED APPLICABLE STANDARDS

GENERAL NOTE:
(THIS NOTE APPLIES TO ALL SHEETS)
ALL PLUMBING SHALL BE IN ACCORDANCE WITH CITY OF LEANDER PLUMBING CODES

NOTE:

- ROUTE ALL PIPING HIDDEN FROM VIEW AS HIGH AS POSSIBLE ABV. CLG.
- COORDINATE ROUTING OF ALL PIPING WITH ALL OTHER TRADES. OFFSET PIPING AS NECESSARY.
- UNLESS OTHERWISE NOTED, ALL PIPING SHOWN SHALL BE ROUTED ABV. CLG.
- REFERENCE PLUMBING RISER DIAGRAMS FOR ADDITIONAL SIZES, WHA SIZES AND LOCATIONS, AND ADDITIONAL INFO.

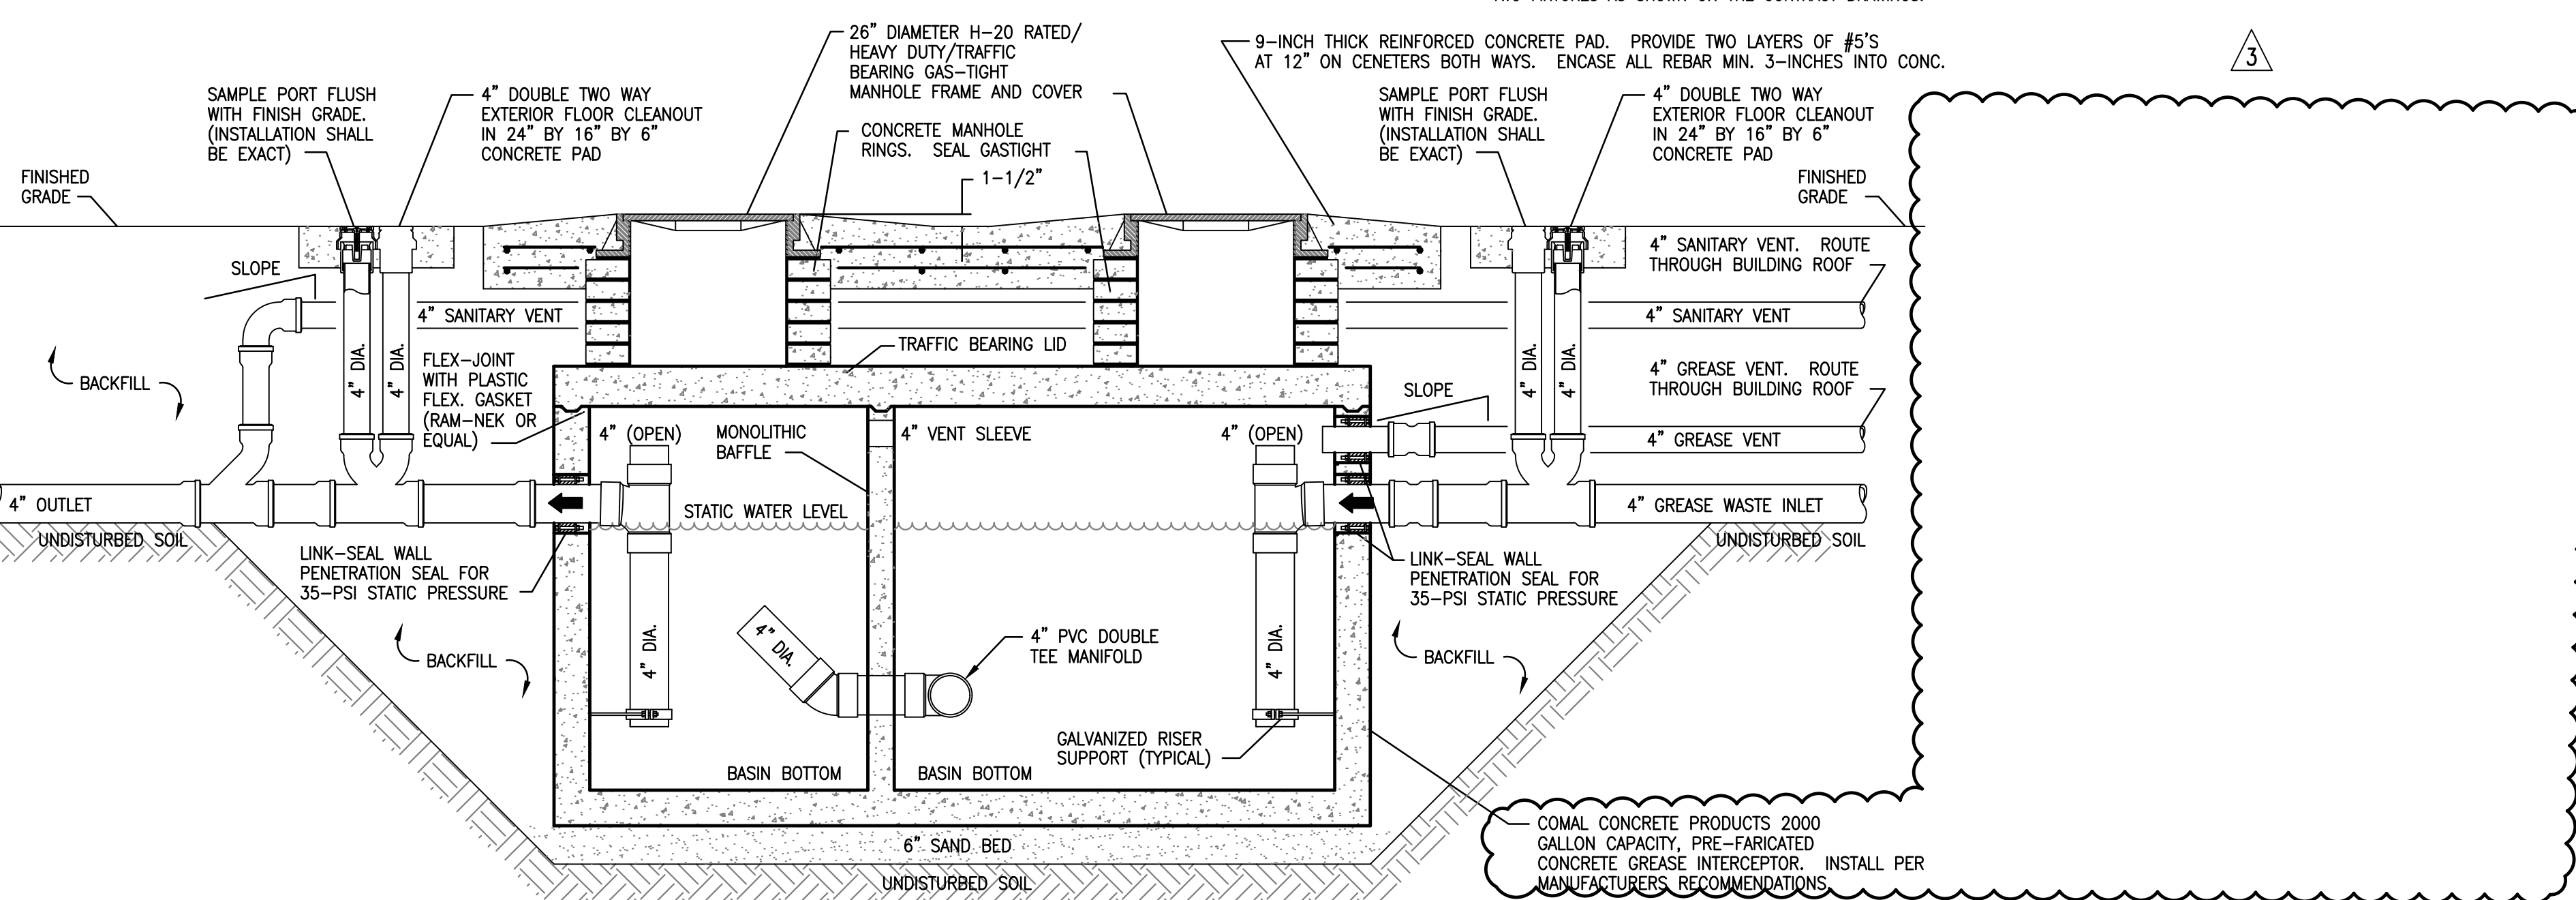

1 GREASE INTERCEPTOR DETAIL
SCALE: NOT TO SCALE

CORNERSTONE ARCHITECTS
7000 BEE CAVE RD., SUITE 100, AUSTIN, TX 78746 512.293.0007

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

Copyright © 2022. All rights reserved. THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF CORNERSTONE ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.


06.20.22 - Revision 2
8.26.22 - City Comments

08.26.2022
CITY COMMENTS
PLUMBING LEGEND, NOTES, SCHEDULE & DETAILS

SHEET: **P100**

PROJECT NO: 21099
DRAWN BY: [Signature]
DATE: 01.28.2022
PROJECT MGR: [Signature]

Engineering, LLC
MEP CONSULTING ENGINEERING
411 W. Main Street, Suite 310 • Round Rock • TX 78664
www.A.Y.S.Eng.com • 512-961-6835
TBP# Firm F-10298

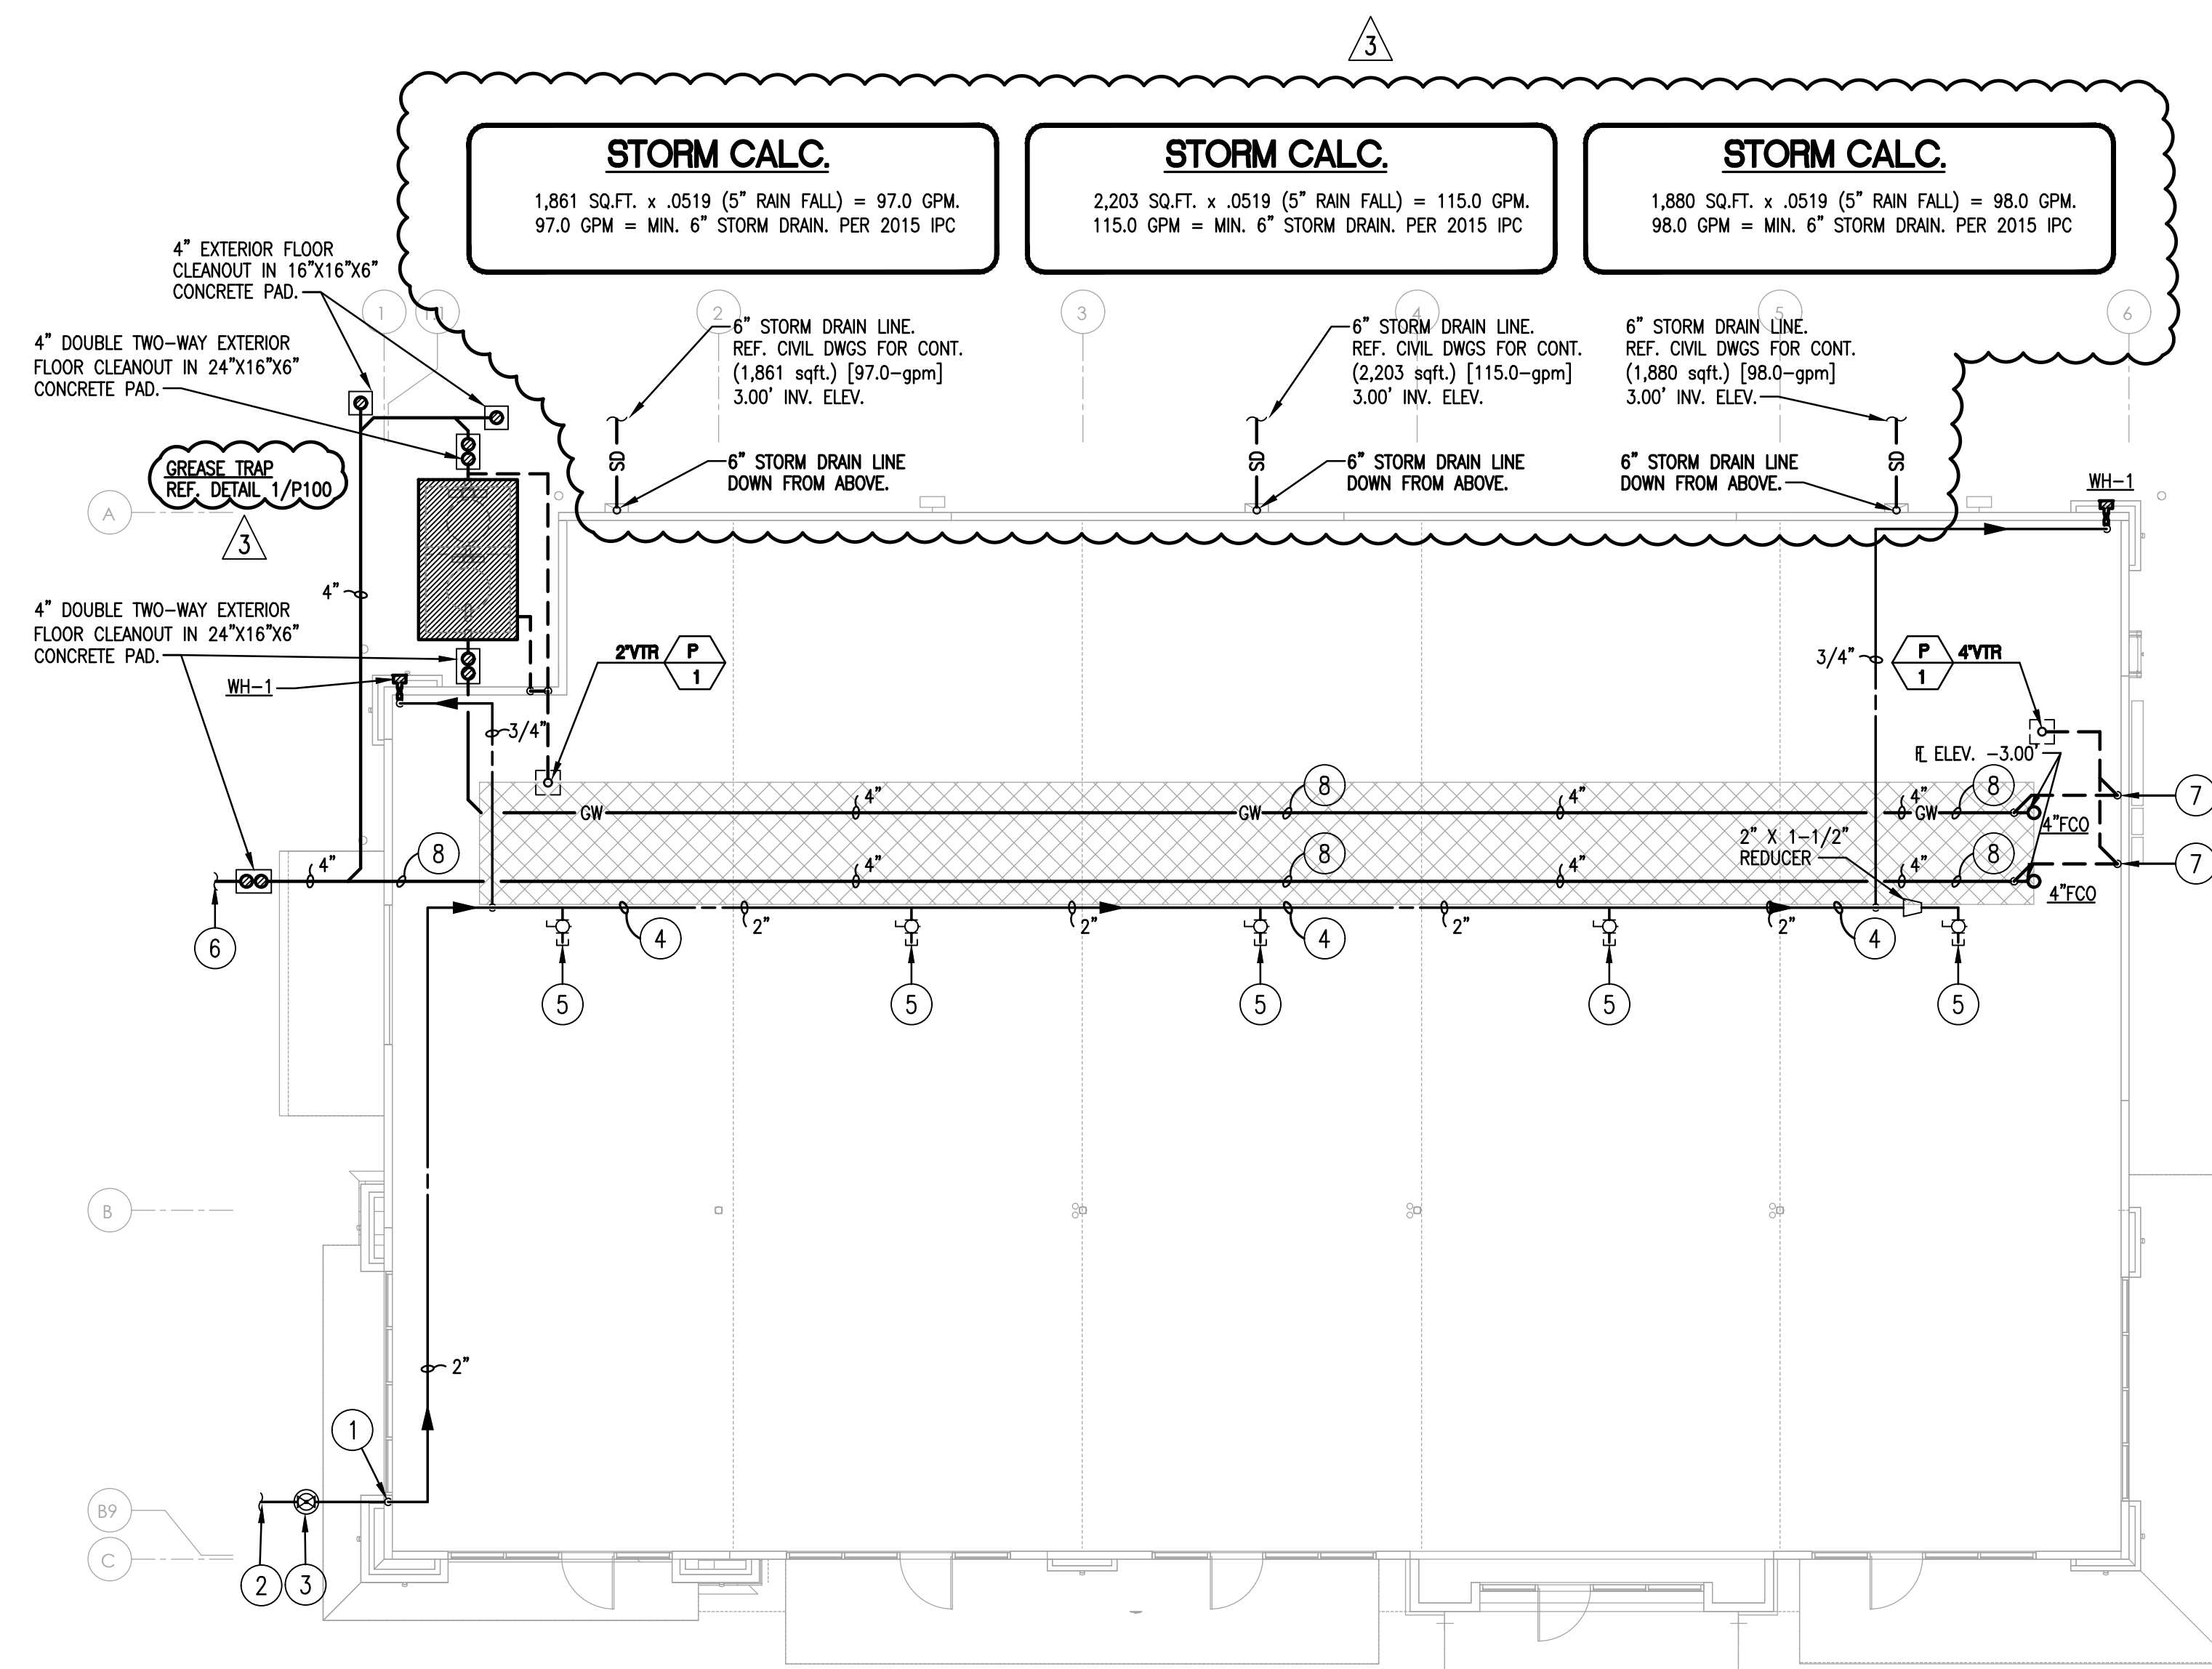

**CITY OF LEANDER
PLUMBING PLAN CHECKING NOTES**

- NEW WATER METER RECEIPT (FROM CITY OF LEANDER TAP SALES OFFICE) WILL BE PROVIDED BY THE OWNER AND THE CIVIL ENGINEER. THESE DRAWINGS DO NOT INCLUDE WATER SUPPLY PIPING BEYOND 5'-0" FROM THE BUILDING. SITE UTILITY ITEMS SUCH AS WATER METERS ARE THE RESPONSIBILITY OF THE CIVIL ENGINEER.
- APPROVED CITY OF LEANDER WATER AND WASTE WATER DEPT. UTILITY PLOT PLANS SHOWING THE NEW WATER METER WILL BE PROVIDED BY THE OWNER AND THE CIVIL ENGINEER. THESE PLUMBING DRAWING DO NOT INCLUDE WATER SUPPLY PIPING BEYOND 5'-0" FROM THE BUILDING SITE UTILITY ITEMS SUCH AS WATER METERS ARE THE RESPONSIBILITY OF THE CIVIL ENGINEER.

GENERAL NOTE:
(THIS NOTE APPLIES TO ALL SHEETS)
ALL MATERIALS, FIXTURES AND DEVICES SHALL CONFORM TO APPROVED APPLICABLE STANDARDS

PLUMBING GENERAL NOTES:

- INSULATE ALL WATER SUPPLY AND ABOVEGROUND VENT PIPING WITH 1-INCH THICK FIBERGLASS PIPE INSULATION. FIBERGLASS PIPE INSULATION SHALL HAVE AN ALL SERVICE JACKET (AS) WITH SELF-SEALING LAPS (OWENS CORNING SSL-11 OR EQUAL). ALL PIPING INSULATION USED ON THE PROJECT SHALL HAVE A FLAME SPREAD RATING NOT EXCEEDING 25 AN A SMOKE DEVELOPED RATING NOT EXCEEDING 50 AS DETERMINED BY TEST PROCEDURES ASTM E 84 NFPA 225 AND U.L. 723. THESE RATINGS SHALL BE AS TESTED ON THE COMPOSITE OF INSULATION JACKET OR FACING AND ADHESIVE. COMPONENTS SUCH AS ADHESIVES MASTIC AND CEMENTS SHALL MEET THE SAME INDIVIDUAL RATINGS AS THE MINIMUM REQUIREMENTS.
- SUPPORT INSULATED PIPE AT HANGERS AND SUPPORTS WITH A SHIELD OF GALVANIZED METAL EXTENDING NOT LESS THAN 4-INCHES ON EITHER SIDE OF THE SUPPORT BEARING AREA COVERING AT LEAST HALF OF THE PIPE CIRCUMFERENCE.
- PERFORM WORK IN ACCORDANCE WITH APPLICABLE STATUTES, ORDINANCES, CODES, AND REGULATIONS OF GOVERNMENTAL AUTHORITIES HAVING JURISDICTION. OBTAIN AND PAY FOR ALL PERMITS AND INSPECTIONS.
- ROUTE ALL ABOVEGROUND HORIZONTAL PIPING CONCEALED, HIDDEN FROM VIEW AND AS HIGH AS POSSIBLE IN ROOF JOIST SPACE (WATER AND VENT PIPING).



PLUMBING KEYED NOTES:

- 2" COLD WATER SUPPLY LINE UP FROM UNDERFLOOR. RISE WITH 1-1/2" LINE UP AS HIGH AS POSSIBLE A.F.F.
- 2" COLD WATER SUPPLY LINE. REF. CIVIL DWGS. FOR CONT.
- 2" GATE VALVE IN CAST IRON VALVE BOX.
- COLD WATER MAIN. ROUTE IN JOIST SPACE. DIRECTLY OVER SANITARY SEWER. LINE SHOWN OFFSET FOR CLARITY.
- VALVE AND CAP 1-1/2" BRANCH LINE FOR FUTURE CONNECTION (IN JOIST SPACE).
- 4" SANITARY SEWER LINE. REF. CIVIL DWGS FOR CONT. FLOW LINE = -5.00' B.F.F.
- 4" VENT UP FROM UNDERFLOOR PROVIDE 4" WALL CLEANOUT ON VERTICAL.
- SLOPE BUILDING DRAIN AT 1/8" PER FOOT TYP.

1 FLOOR PLAN - PLUMBING
SCALE: 1/8" = 1'-0"
TRUE PLAN NORTH NORTH

COPYRIGHT © 2022 ALL RIGHTS RESERVED
THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF CORNERSTONE ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

2 06.20.22 - Revision 2
3 8.26.22 - City Comments

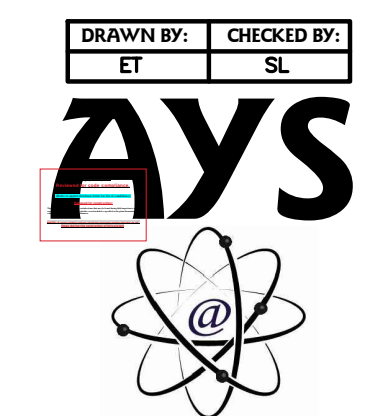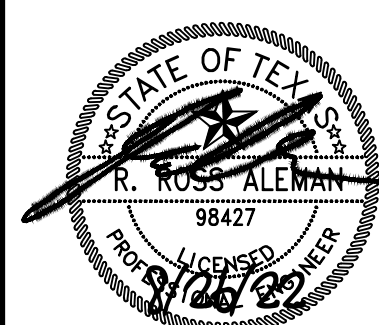

Engineering, LLC
MEP CONSULTING ENGINEERING
411 W. Main Street, Suite 310 • Round Rock • TX 78664
www.AYSEng.com • 512-961-6835
TBP# Firm F-10298

08.26.2022
CITY COMMENTS
FLOOR PLAN - PLUMBING

SHEET: P200


PROJECT NO: 21099
DRAWN BY: [Signature]
DATE: 01.28.2022
PROJECT MGR: [Signature]



CORNERSTONEARCHITECTS.COM

CORNERSTONE
ARCHITECTS

7000 BEE CAVES RD. SUITE 300 AUSTIN TX 78746 512.293.0007

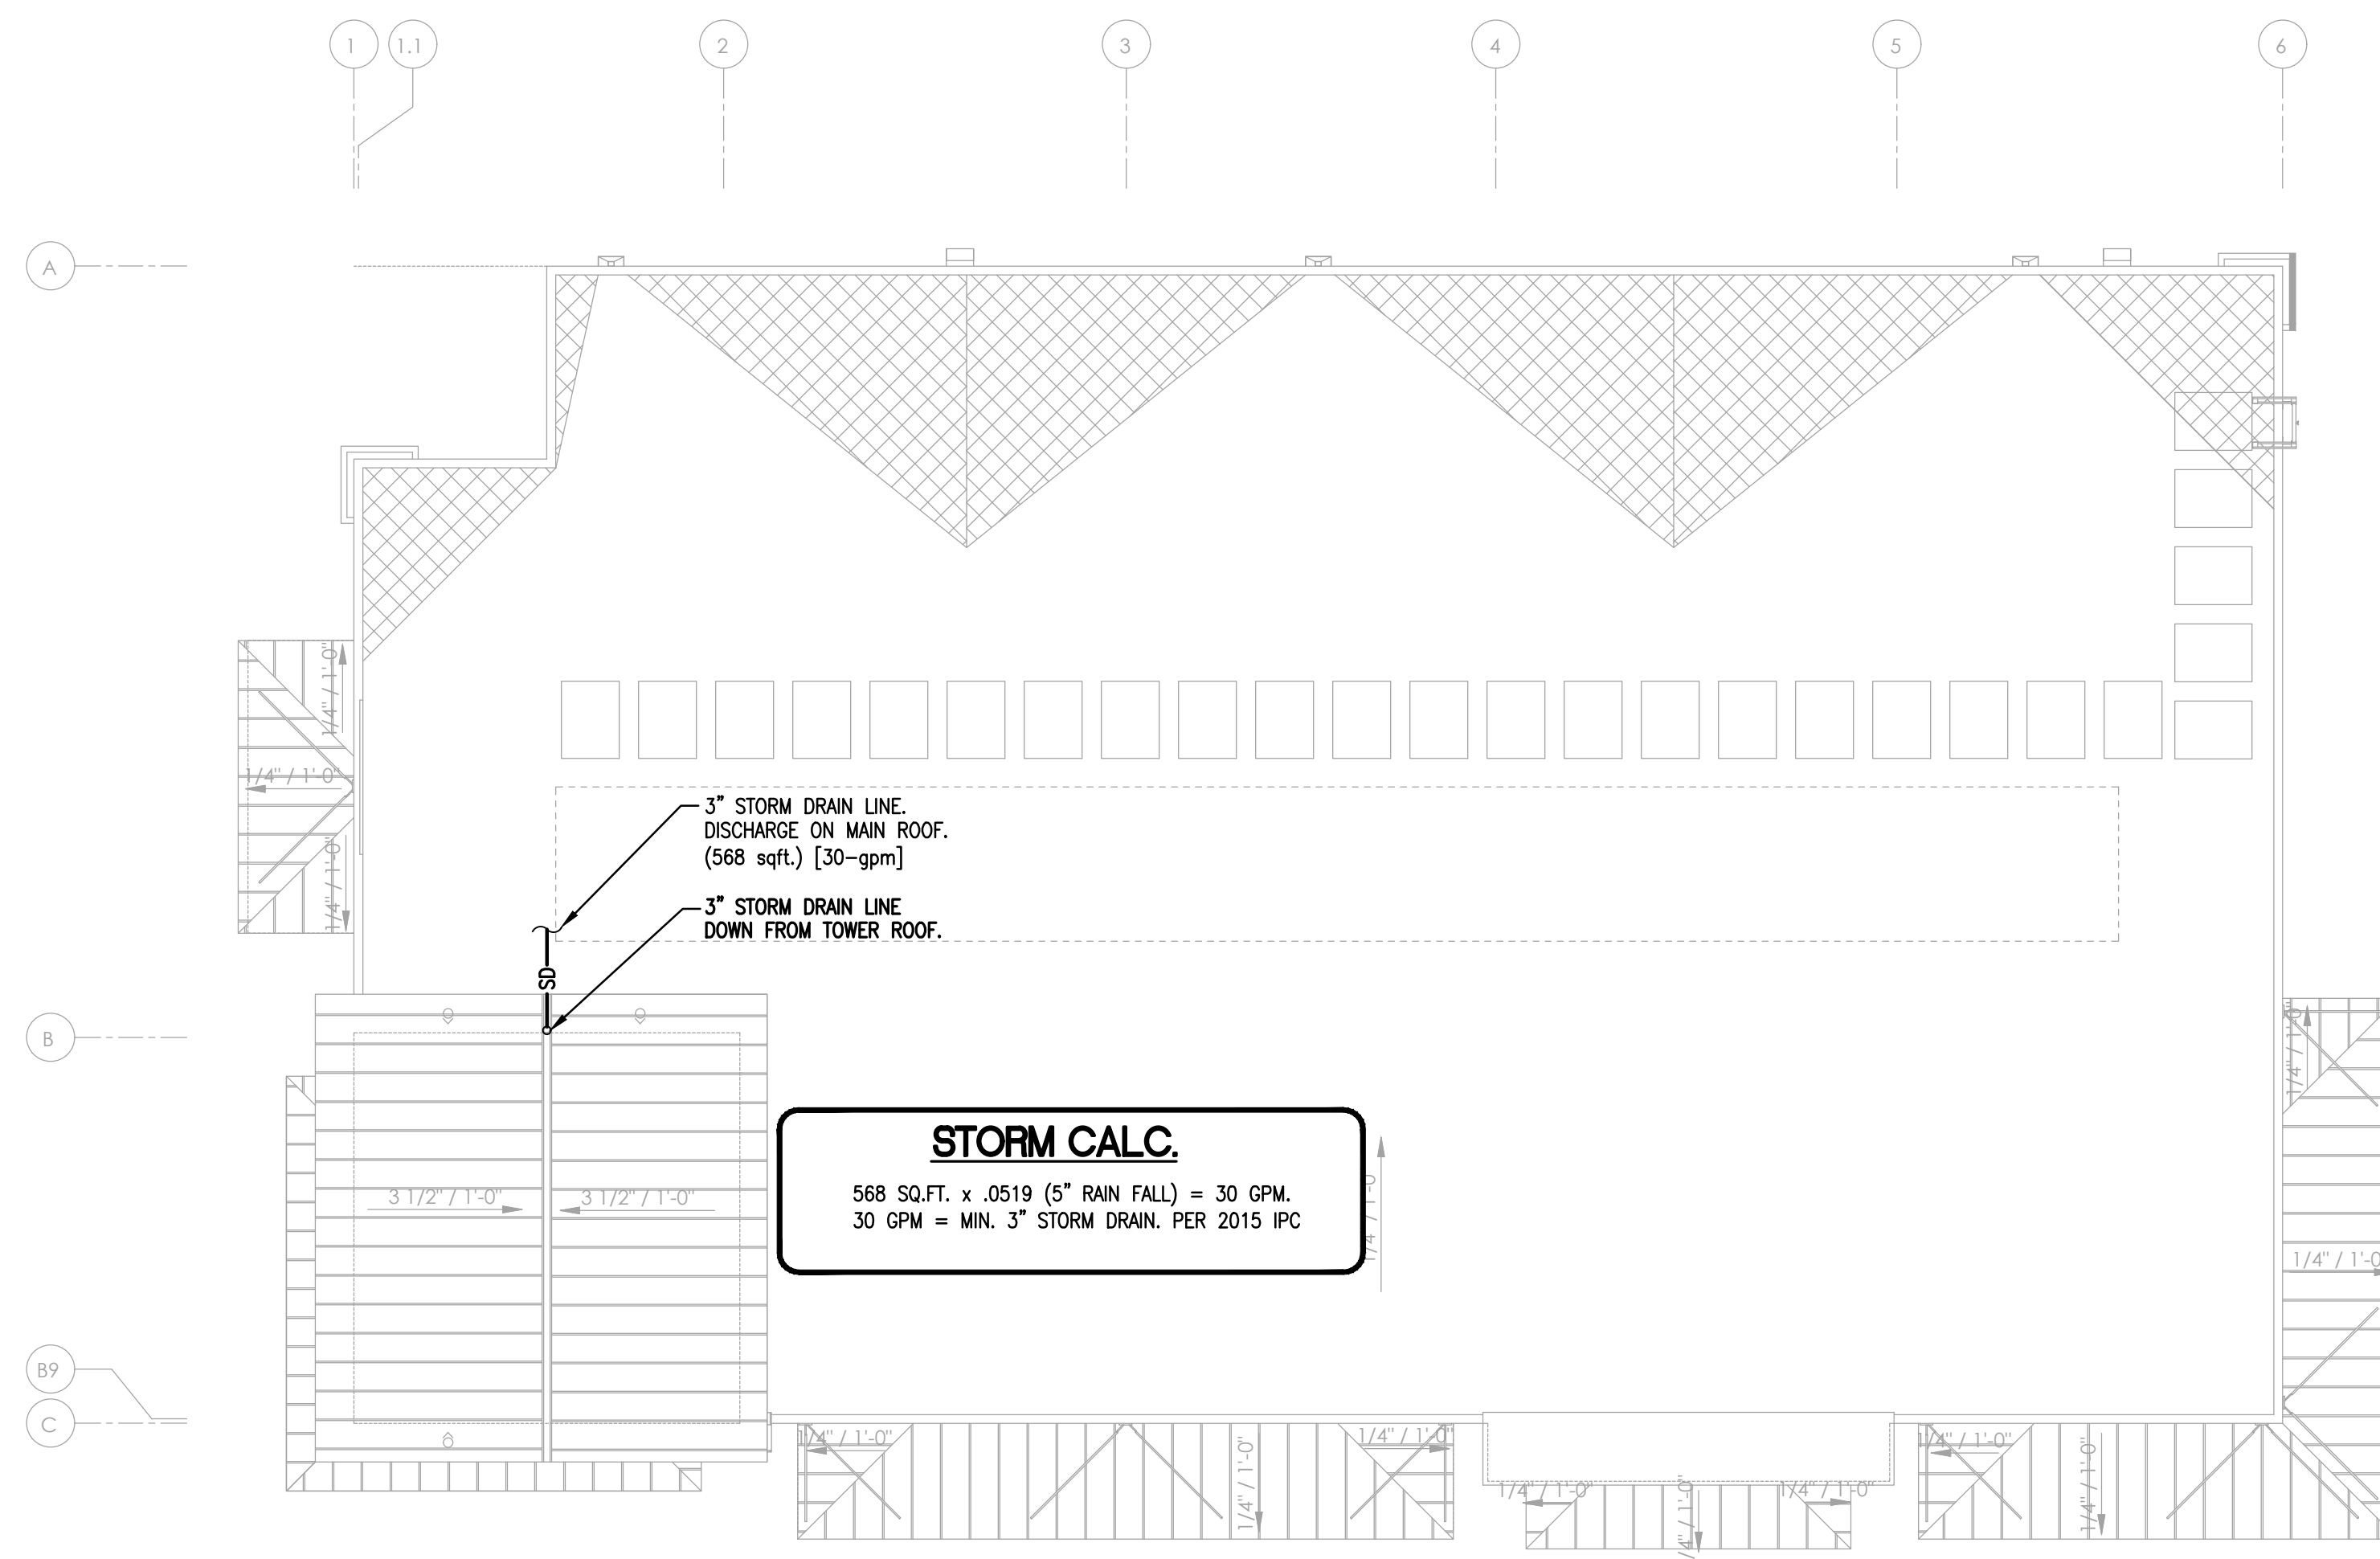

GENERAL NOTE:
(THIS NOTE APPLIES TO ALL SHEETS)
ALL MATERIALS, FIXTURES AND DEVICES SHALL CONFORM TO APPROVED APPLICABLE STANDARDS


- PLUMBING GENERAL NOTES:**
- INSULATE ALL WATER SUPPLY AND ABOVEGROUND VENT PIPING WITH 1-INCH THICK FIBERGLASS PIPE INSULATION. FIBERGLASS PIPE INSULATION SHALL HAVE AN ALL SERVICE JACKET (ASJ) WITH SELF-SEALING LAPS (OWENS CORNING SSL-11 OR EQUAL). ALL PIPING INSULATION USED ON THE PROJECT SHALL HAVE A FLAME SPREAD RATING NOT EXCEEDING 25 AND A SMOKE DEVELOPED RATING NOT EXCEEDING 50 AS DETERMINED BY TEST PROCEDURES ASTM E 84 NFPA 225 AND U.L. 723. THESE RATINGS SHALL BE AS TESTED ON THE COMPOSITE OF INSULATION JACKET OR FACING AND ADHESIVE. COMPONENTS SUCH AS ADHESIVES MASTIC AND CEMENTS SHALL MEET THE SAME INDIVIDUAL RATINGS AS THE MINIMUM REQUIREMENTS.
 - SUPPORT INSULATED PIPE AT HANGERS AND SUPPORTS WITH A SHIELD OF GALVANIZED METAL EXTENDING NOT LESS THAN 4-INCHES ON EITHER SIDE OF THE SUPPORT BEARING AREA COVERING AT LEAST HALF OF THE PIPE CIRCUMFERENCE.
 - PERFORM WORK IN ACCORDANCE WITH APPLICABLE STATUTES, ORDINANCES, CODES, AND REGULATIONS OF GOVERNMENTAL AUTHORITIES HAVING JURISDICTION. OBTAIN AND PAY FOR ALL PERMITS AND INSPECTIONS.
 - ROUTE ALL ABOVEGROUND HORIZONTAL PIPING CONCEALED, HIDDEN FROM VIEW AND AS HIGH AS POSSIBLE IN ROOF JOIST SPACE (WATER AND VENT PIPING).

1 ROOF PLAN - PLUMBING
SCALE: 1/8" = 1'-0"
TRUE PLAN NORTH NORTH

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641


COPYRIGHT © 2022 ALL RIGHTS RESERVED
THESE DESIGNS/DRAWINGS ARE THE SOLE PROPERTY OF CORNERSTONE ARCHITECTS AND MAY NOT BE REPRODUCED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE WITHOUT PREVIOUS WRITTEN PERMISSION.

- 2 06.20.22 - Revision 2
- 3 8.26.22 - City Comments

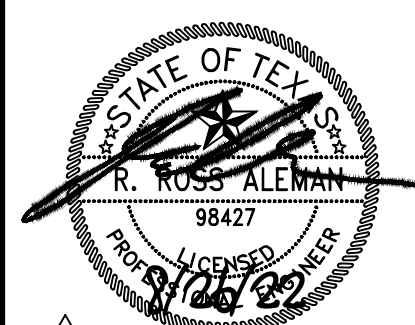

08.26.2022
CITY COMMENTS
ROOF PLAN - PLUMBING

SHEET: **P201**

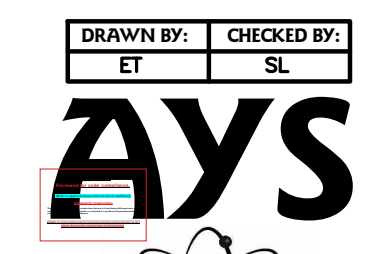

Engineering, LLC
MEP CONSULTING ENGINEERING
411 W. Main Street, Suite 310 • Round Rock • TX 78664
www.A.Y.S.eng.com • 512-961-6835
TBPE Firm F-10298

PROJECT NO: 21099
DRAWN BY: [Signature]
DATE: 01.28.2022
PROJECT MGR: [Signature]




CORNERSTONE
ARCHITECTS

7000 BEE CAVES RD. SUITE 300 • AUSTIN TX 78740 512.393.0007

BUILDING 1
THE SQUARE AT CRYSTAL FALLS
1900 S. BAGDAD ROAD, BLDG. 1
LEANDER, TEXAS 78641

COPYRIGHT © 2022 ALL RIGHTS RESERVED
THESE DESIGNS/DRAWINGS ARE THE SOLE
PROPERTY OF CORNERSTONE ARCHITECTS
AND MAY NOT BE REPRODUCED IN ANY FORM,
BY ANY METHOD, FOR ANY PURPOSE
WITHOUT PREVIOUS WRITTEN PERMISSION.

- 2 06.20.22 - Revision 2
- 3 8.26.22 - City Comments

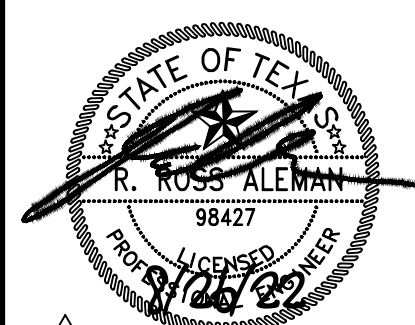

08.26.2022
CITY COMMENTS
SITE PLAN - PLUMBING


SHEET: **P202**

PROJECT NO: 21099
DRAWN BY: [Signature]
DATE: 01.28.2022
PROJECT MGR: [Signature]

GENERAL NOTE:
(THIS NOTE APPLIES TO ALL SHEETS)
ALL MATERIALS, FIXTURES AND DEVICES SHALL
CONFORM TO APPROVED APPLICABLE STANDARDS

PLUMBING GENERAL NOTES:

1. INSULATE ALL WATER SUPPLY AND ABOVEGROUND VENT PIPING WITH 1-INCH THICK FIBERGLASS PIPE INSULATION. FIBERGLASS PIPE INSULATION SHALL HAVE AN ALL SERVICE JACKET (ASJ) WITH SELF-SEALING LAPS (OWENS CORNING SSL-11 OR EQUAL). ALL PIPING INSULATION USED ON THE PROJECT SHALL HAVE A FLAME SPREAD RATING NOT EXCEEDING 25 AND A SMOKE DEVELOPED RATING NOT EXCEEDING 50 AS DETERMINED BY TEST PROCEDURES ASTM E 84 NFPA 225 AND U.L. 723. THESE RATINGS SHALL BE AS TESTED ON THE COMPOSITE OF INSULATION JACKET OR FACING AND ADHESIVE. COMPONENTS SUCH AS ADHESIVES MASTIC AND CEMENTS SHALL MEET THE SAME INDIVIDUAL RATINGS AS THE MINIMUM REQUIREMENTS.
2. SUPPORT INSULATED PIPE AT HANGERS AND SUPPORTS WITH A SHIELD OF GALVANIZED METAL EXTENDING NOT LESS THAN 4-INCHES ON EITHER SIDE OF THE SUPPORT BEARING AREA COVERING AT LEAST HALF OF THE PIPE CIRCUMFERENCE.
3. PERFORM WORK IN ACCORDANCE WITH APPLICABLE STATUTES, ORDINANCES, CODES, AND REGULATIONS OF GOVERNMENTAL AUTHORITIES HAVING JURISDICTION. OBTAIN AND PAY FOR ALL PERMITS AND INSPECTIONS.
4. ROUTE ALL ABOVEGROUND HORIZONTAL PIPING CONCEALED, HIDDEN FROM VIEW AND AS HIGH AS POSSIBLE IN ROOF JOIST SPACE (WATER AND VENT PIPING).

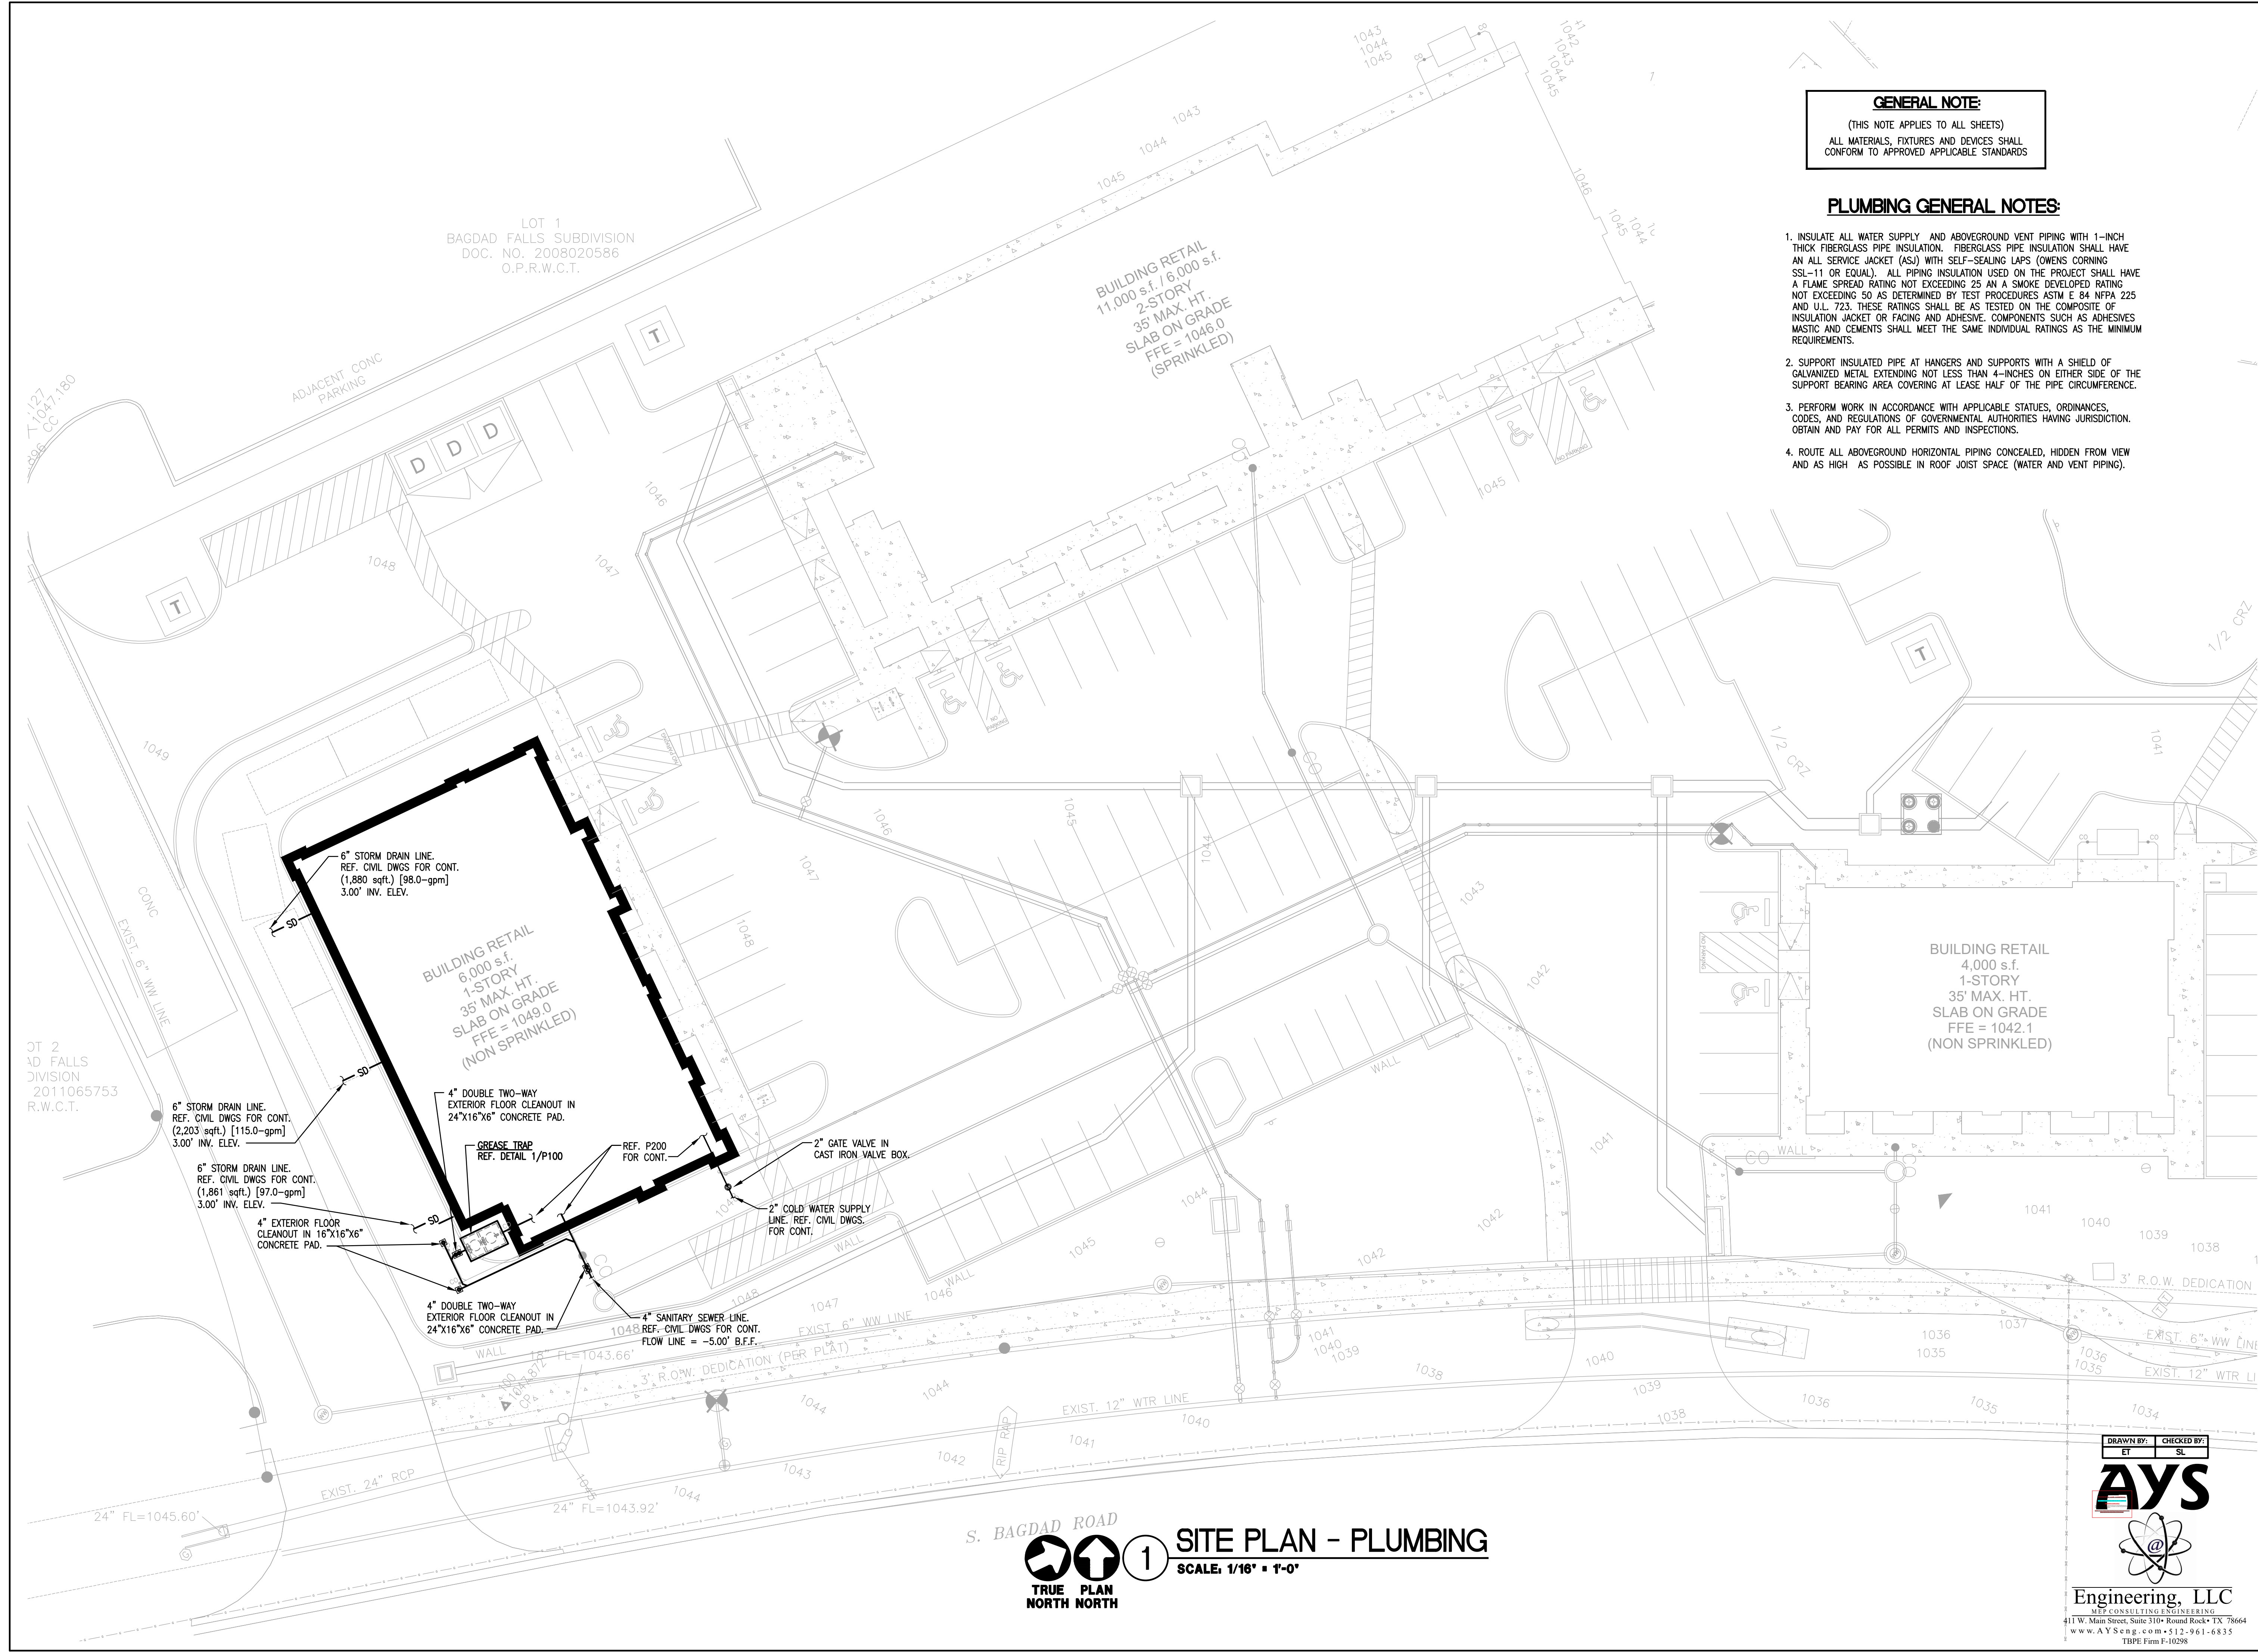

1 SITE PLAN - PLUMBING
SCALE: 1/16" = 1'-0"
TRUE PLAN NORTH

DRAWN BY: [Signature] CHECKED BY: [Signature]
ET SL

AYS
MEP CONSULTING ENGINEERING

Engineering, LLC
111 W. Main Street, Suite 310 • Round Rock • TX 78664
www.A.Y.S.Eng.com • 512-961-6835
TBPE Firm F-10298