



**GEOTECHNICAL INVESTIGATION
FOUNDATION & PAVEMENT
RECOMMENDATIONS - REVISED**

**Colony Treehouse Amenity Center
Bastrop, Texas**

Report For:

Hunt Communities Bastrop, LLC
4401 North Mesa Street
El Paso, Texas 79902

August 2023

Engineer's Job # 23106100.012

MLA Geotechnical TBPE FIRM # F-2684
Geotechnical Engineering and
Construction Materials Testing
"put us to the test"

Christopher P. Elliott
Vice President

Timothy R. Weston, P.E.
President

8/24/23



Matthew J. Rodriguez, P.E.
Senior Engineer

8/23/23



TABLE OF CONTENTS

	<u>PAGE</u>
BACKGROUND	1
ARCHITECTURAL AND STRUCTURAL ASSUMPTIONS	2
FIELD AND LABORATORY INVESTIGATION	2
SITE TOPOGRAPHY, DRAINAGE AND VEGETATION	3
SUBSURFACE CONDITIONS AND LOCAL GEOLOGY	3
CONCLUSIONS	5
RECOMMENDATIONS - FOUNDATION	7
RECOMMENDATIONS - POOL AND POOL DECKING	10
GENERAL RECOMMENDATIONS - RETAINING STRUCTURES	11
RECOMMENDATIONS - PARKING AND DRIVING LANE PAVEMENTS	13
SELECT FILL RECOMMENDATIONS	17
QUALITY ASSURANCE CONSIDERATIONS	18
REFERENCES	19
LIMITATIONS OF REPORT	20
APPENDIX A - GEOTECHNICAL DATA	
Site Maps	
Plan of Borings	
Logs of Borings	
APPENDIX B - STANDARD FIELD AND LABORATORY PROCEDURES	

GEOTECHNICAL INVESTIGATION
Foundation and Pavement Recommendations - REVISED

Colony Treehouse Amenity Center
Bastrop, Texas

BACKGROUND

This report presents the results of a soil exploration and analysis for the proposed structures and pavements located at *Colony Treehouse Amenity Center* in Bastrop, Texas. Authorization to perform this exploration and analysis was by Agreement for Engineering Services signed by Mr. Rick Neff of Hunt Communities Bastrop, LLC on February 20, 2023.

The purposes of this investigation were to determine the soil profile, the engineering characteristics of the foundation soil, and to provide criteria for use by the design engineers in preparing foundation and parking pavement designs. The scope included a review of geologic literature, a reconnaissance of the immediate site, the subsurface exploration, field and laboratory testing, and an engineering analysis and evaluation of the foundation materials.

The exploration and analysis of the subsurface conditions reported herein is considered sufficient in detail and scope to form a reasonable basis for the foundation and pavement designs. The recommendations submitted are based on the available soil information and the assumed preliminary design for the proposed structures and pavements. Any revision in the plans for the proposed structure from those stated in this report should be brought to the attention of the Geotechnical Engineer so that he may determine if changes in the foundation and/or pavement recommendations are required. Site work and foundation construction should be monitored by the Geotechnical Engineer that prepared this report or approved third party testing agency so that these recommendations may be verified, and so that deviations from expected conditions can be properly evaluated.

This report has been prepared for the exclusive use of the client and their design professionals for specific application to the proposed project in accordance with generally

accepted soils and foundation engineering practice. This report is not intended to be used as a specification or construction contract document, but as a guide and information source to those qualified professionals who prepare such documents.

ARCHITECTURAL AND STRUCTURAL ASSUMPTIONS

The proposed structures are a one or two story amenity building and swimming pool with associated parking areas and access ways. **The shape factor[§] of this slab should be considered by the Structural Engineer.** If these assumptions are not correct, please contact the Geotechnical Engineer so they may review the recommendations contained herein for accuracy, completeness, and appropriateness. As finalized plans become available, they should be shared with the Geotechnical Engineer so they may ascertain whether any modifications to the recommendations presented herein are necessary.

FIELD AND LABORATORY INVESTIGATION

Four borings were drilled to various depths spaced at locations as shown on the enclosed Logs of Borings and Plan of Borings using a B-53 drilling rig. Water was not introduced into the borings. The field investigation included completing the soil borings, performing field tests, and recovering samples. Representative soil samples were selected for laboratory index tests including Atterberg Limits, sieve analysis, and moisture content tests. The results of these tests and stratigraphy are presented on the Logs of Borings found in *Appendix A*. A key to the Soil Classification and symbols is located behind the last Log of Boring. See *Appendix B* for details of field and laboratory procedures, as applicable.

[§] The shape factor is defined as the perimeter of the slab squared divided by the slab area.

SITE TOPOGRAPHY, DRAINAGE AND VEGETATION

The site is situated on steeply sloping topography with existing slopes ranging up to approximately 10 percent. Regionally, this site drains to the northeast. The vegetation at this site included mature trees and native grasses.

SUBSURFACE CONDITIONS AND LOCAL GEOLOGY

Soil Profiles

The native soil profile identified in the borings generally consists of an upper layer of dark brown high plasticity clay (CH) that is underlain by dark brown clayey sand (SC) that varies in color to reddish brown and gray, to reddish tan, and to yellowish tan. This soil profile has the potential for volume change with respect to varying moisture contents. This potential is taken into consideration for the foundation recommendations.

Geology

Geologic maps indicate an outcropping of terrace deposits from the Quaternary Period, *Qhg*, and the Calvert Bluff Clay, *Ecb*, beneath the subject site ^(1,2). A description of each geology follows.

Local geologic maps indicate an outcropping of terrace deposits from the Quaternary Period, *Qhg*. These terrace deposits are known as the High Gravel Terrace deposits. They are the oldest series of terrace deposits in Central Texas and represent the remnants of an ancient flood plain. They are typically found at locally high elevations. These deposits consist of large gravel and cobbles with variable amounts of sand and clay. Their color ranges from brown to reddish brown and orange-brown. They consist primarily of siliceous material and therefore are often mined for their gravel content for use in building materials. These deposits are typically less than 20 feet thick. It is not uncommon for these deposits to transmit and store large amounts of ground water.

The Calvert Bluff Clay, *Ecb*, is a member of the Rockdale Formation in the Wilcox Group of Eocene Age. The Rockdale Formation is overlain unconformably by the Carrizo Sand Formation of the Claiborne Group and underlain by the Seguin Formation of the Wilcox Group. The contact between the Carrizo Sand and the Calvert Bluff Clay is sharp. Carrizo has laminated sandy clays and the Calvert Bluff has fine sands or coarse gray massive cross-bedded sands.

The Calvert Bluff is marked by glauconitic beds in the upper part and by lignite beds at the base. The Calvert Bluff was deposited by large branches of ancient rivers and in wide shallow valleys resulting in a rolling and undulating deposition profile. This depositional environment resulted in this predominately clay formation having many sand and gravel lenses. Other characteristics of the Calvert Bluff include gray sand that weathers to red or tan sand and layers of dark gray carbonaceous clay. This formation is often characterized by heavily forested areas of Oak and Mesquite trees. Regionally, this forested area is sometimes referred to as the "Timber Belt", which runs through Bastrop and Lee counties to the Northeast through Texas.

Ground Water

Ground water was not encountered in the borings during this investigation but should be anticipated in excavations that penetrate the sand layer. Ground water is a transient problem and may be encountered at other locations and in varying quantities depending on antecedent rainfall conditions and changes in land use.

CONCLUSIONS

1. Excavation and site work:

- a. Excavation may be performed using ordinary power equipment for the construction of slab-on-ground foundations at this site.
- b. All excavations should be braced and shored according to applicable law and building code. Consultation on excavations can be provided by the Geotechnical Engineer upon request. If shoring is required on this project, specific design recommendations can be developed upon analysis of the application.
- c. Ground water is possible in shallow and deep excavations depending on antecedent rainfall. During periods of high rainfall, perched ground water may cause the soils to become soft and difficult to compact.

2. Settlement potential:

- a. The potential for settlement greater than 1 inch of the natural soils on this site for light, one to two story structures may be categorized as low.
- b. Settlement potential of any uncontrolled (non-approved) fill is unpredictable.
- c. Heavy structures or structures more than three stories in height will require analysis beyond the scope of this report.

3. Expansive soil potential:

The soils at this project site exhibited plasticity indices ranging from 14 to 29. A point estimate of the potential vertical rise, PVR, of the soil profile, starting in a dry condition, was found to range from 1 ½ to 2 inches ⁽³⁾. Thus, the potential for disruptive foundation movements due to swelling soils may be categorized as moderate to high. Other magnitudes of PVR may be estimated by other methods and at other locations with varying results. However, the TxDOT Method is widely used and should be considered an index property of the site. PVR is considered in the final foundation recommendations.

4. Foundation Type:

The foundation type recommended for this project is a soil-supported, stiffened concrete slab. If recommendations for other foundation types are desired, please contact the Geotechnical Engineer. The shape factor of the slab should be considered by the Structural Engineer. The shape factor is defined as the perimeter of the slab squared divided by the slab area.

5. Faults:

Published geology maps do not indicate the presence of a fault on the project site and faulted conditions were not noted in the borings.

6. Slab Moisture:

The recommendations in this report are not intended to address the effects of moisture migration through slabs. The design team should address moisture retardant schemes and the requirements of this project.

7. Past Use of Site:

There was no evidence in the samples obtained for this study that indicated the past use of this site as a municipal landfill. See the section *Limitations of Report*.

RECOMMENDATIONS - FOUNDATION

A stiffened, slab-on-ground foundation system is recommended for this project. The following recommendations are for such a foundation system. This type of foundation system is designed to dampen soil movements beneath the foundation. These soil movements arise from varying soil moisture. Many of the recommendations in this report are intended to reduce this soil moisture variation. Some foundation movements may occur even in properly designed slab-on-ground foundations. Please contact the Geotechnical Engineer if alternate designs are desired.

1. This type of foundation includes reinforced perimeter and interior stiffening beams, monolithically cast with a reinforced slab. If PVR reduction is desired, the following table may be used. Using Table 1, remove the required amount of native soil to achieve the target PVR and target equivalent P.I. Replace the removed soil and make up required grades with select fill as per the enclosed *Select Fill Recommendations*. Please be aware that even one inch of differential movement could be excessive depending on the requirements of the structure.

Table 1: PVR Reduction and Resultant PTI ⁽⁴⁾ Parameters

Existing Soil Replaced with Select Fill	Potential Vertical Rise	e _m , feet		y _m , inches		Equivalent P.I. ⁽⁵⁾
		Center	Edge	Center	Edge	
0 feet	2.0 inches	6.7	3.5	1.58	2.52	44
2 feet	1.0 inch	6.3	3.3	1.15	1.70	38-F*

F*- Indicates the presence of fill approved for supporting foundations
 Climatic Rating, C_w = 18 (for WRI ⁽⁶⁾ design method)

Notes:

- a. Engineering judgment has been applied to the BRAB PI calculations. The Equivalent BRAB PI is included for historical purposes and for contractor's use in cost estimating. The primary design values are the WRI or Post-Tension

Design parameters and may be used in the specified design method for slabs on ground.

- b. Allowable Bearing Capacity:
Footings on this site established a minimum of 12 inches into the natively deposited soils or approved fill should be sized for allowable bearing pressures of at most 1,500 psf. Any non-approved fill encountered should not be relied upon to provide adequate bearing capacity.
 - c. Differential movement between the foundation and any adjacent flatwork should be expected, especially if the PVR is reduced beneath the foundation and not beneath the flatwork. Extending the select fill pad to be present beneath any flatwork will reduce the potential for differential movement.
2. Strip and remove from the construction area any topsoil, organics, and vegetation to a minimum depth of 6 inches below the existing natural ground surface. Any fill of unknown consistency should be removed and replaced in accordance with the enclosed ***Select Fill Recommendations*** if it is to be relied upon for slab support. Fill sections may be composed of on-site material excluding topsoil, vegetation, and organics.
 3. A moisture retardant layer of sealed, overlapping plastic sheeting should be provided between the subgrade and all slab areas and beam excavations to retard the transmission of moisture upward through the slab. ASTM 1745 can be used as a guideline ⁽⁷⁾. The design team should address moisture retardant schemes and the requirements of this project.
 4. Floor slabs may be formed on grade, if desired for economy.
 5. Trees must not be planted or remain closer to the foundation than the mature drip line of the tree without consideration by the Structural Engineer. Please contact the Structural Engineer.

6. Air conditioner condensation overflow drains should be piped into the sanitary sewer, where the building code allows. Otherwise, the air conditioner condensation overflow drain should discharge clear and away from the foundation.
7. Drainage should be maintained away from the foundation, both during and after construction. Water should not be allowed to pond near the foundation. The following items should provide for positive drainage of water away from the foundation: sidewalks and other concrete flatwork, parking areas, driveways and other surface drainage features, and landscaping.
8. French drains are recommended around any slabs where seeping ground water is encountered during construction.
9. Sidewalks and other flatwork should be doweled to the foundation elements, with adequate consideration of the differential forces that may develop.
10. Prior to construction, the Geotechnical Engineer should be given the opportunity to review the plans in order to ensure that all recommendations have been properly implemented. Also, the Geotechnical Engineer should be retained to complete necessary inspections to ensure that the foundation is installed in accordance with these recommendations.

RECOMMENDATIONS - POOL AND POOL DECKING

This site is highly expansive and additional measures may be desired to reduce the PVR beneath the pool decking and/or the swimming pool. Using the table below, remove the required amount of native soil to achieve the desired PVR below the bottom of the pool or pool decking. Proof-roll the subgrade as per TxDOT Item 216 ⁽⁸⁾. Replace the removed soil and make up required grades with select fill as per the enclosed *Select Fill Recommendations*. The Structural Engineer and the owner should discuss the requirements of this project prior to determining the amount of remove and replace to use. Please be aware that even one inch of differential movement could be excessive depending on the requirements of the structure.

Table 2: Remove and Replace vs. PVR for Pool and Pool Decking

Existing Soil Replaced with Select Fill	Potential Vertical Rise
0 feet	2.0 inches
1 foot	1.3 inches
2 feet	1.0 inch

Note: Shading indicates depth of remove and replace to achieve approximately 1 inch of PVR, recognizing that PVR is accurate to +/- 0.1 inches.

GENERAL RECOMMENDATIONS - RETAINING STRUCTURES

1. A minimum of 12 inches behind the wall should be backfilled with clean, free-draining gravel. Such material should have less than 4% passing the #200 sieve. Compact the gravel in 8 to 10 inch lifts using a hand operated walk behind vibratory compactor. No high PI clay ($PI > 25$) should be placed behind the wall within a distance equal to the height of the wall.
2. All such backfilled areas must be well drained to prevent the buildup of hydrostatic pressure within the laterally loaded area.
3. The unit weight of backfill or fill from on-site materials may be estimated at 130 pcf.
4. Footings for the wall foundations should be placed a minimum of 12 inches into the naturally deposited material or approved fill and should be sized using an allowable bearing capacity of 1,500 psf.
5. Passive resistance on the key may be designed for using an Equivalent Fluid Pressure of 250 pcf. Passive resistance at the toe of the retaining wall footing should not be counted on for resistance to either sliding or overturning.
6. The bearing strata should be verified by the Geotechnical Engineer or their designate prior to foundation construction.
7. Positive drainage should be maintained away from the wall foundations. Water should not be allowed to pond near the foundations.
8. The equivalent fluid pressure below is based on a nearly horizontal backfill. If the backfill will be sloped behind the wall to an elevation higher than the wall, the equivalent fluid pressure to be used in design will need to be reevaluated.

9. The following values may be used in the design of the walls:

Coefficient of Friction Against Sliding	Coefficient of Active Earth Pressure*	Coefficient of At-Rest Earth Pressure*
0.40	$K_a = 0.35$	$K_o = 0.52$

* If using equivalent fluid pressure methodology, use 45.5 pcf for the active condition and 67.6 pcf for the at-rest condition. If backfill is not drained, add 62.4 pcf to the above Equivalent Fluid values. Inclined backfill, adjacent buildings, or traffic areas will require special consideration.

RECOMMENDATIONS - PARKING AND DRIVING LANE PAVEMENTS

No truck traffic loads or frequencies were available at the time this report was written. Therefore, pavement thickness sections are based on primarily passenger cars and light trucks with an average of ten heavy-duty trucks per day. No specific tests (such as CBRs or resilient moduli) were performed for this study.

A. Subgrade and Foundation Soil Preparation

1. Strip and remove from the construction area all topsoil, organics, and vegetation to a minimum depth of 6 inches.
2. Proof-roll the subgrade in accordance with TxDOT Item 216 to reveal soft spots. Soft areas should be reworked and compacted until they can be successfully proof-rolled. The success of the pavement system will very much depend on the care taken to provide a sound subgrade.

B. Base Course

1. Base material shall be Type A, Grade 2 or better, according to the Texas Department of Transportation Specification Item 247.
2. Thickness of the base course should be in accordance with Table 3.
3. Base course compaction should be 100 percent of TxDOT TEX-113-E. Density control by means of field density determinations shall be exercised. The base course should be within 3 percent of optimum moisture at time of compaction.
4. Proof-roll the base course in accordance with TxDOT Item 216.
5. After compaction, testing and curing of the base material, the surface should be primed using an Asphalt Emulsion prime coat meeting TxDOT Specification Item 310.
6. A full thickness of the base course should be extended 2 feet beyond the back of curb line.

C. Flexible Pavement - Hot Mixed Asphalt Concrete (HMAC)

1. Surfacing shall consist of hot mix asphaltic concrete meeting the requirements of TxDOT Item 340, Type D mixture. The HMAC should be compacted to a minimum of 91 to 96 percent of the maximum theoretical density with all rolling completed before the HMAC temperature drops below 175° F.
2. Thickness of the HMAC should be in accordance with Table 3.
3. A flexible pavement system is not recommended in areas that will be subject to significant truck traffic. See Table 3 notes.

D. Rigid Pavement - Jointed, Reinforced Portland Cement Concrete

1. Concrete paving shall consist of thickness as given in Table 3.
2. The concrete should develop a minimum 28-day flexural strength of 500 psi with 4 to 6 percent entrained air. The 28-day compressive strength of concrete required to achieve 500 psi of flexural strength may be approximated using the following formula taken from ACI 330R: $M_r = 2.3f_c^{(2/3)}$ where M_r = flexural strength of concrete in psi, f_c = compressive strength of concrete in psi.
3. Contraction, control, and expansion jointing should be as per ACI 330-R ⁽⁹⁾. As an alternative, an accepted local practice that has been proven to work satisfactorily in similar circumstances may be used. The success of this pavement system will be strongly dependent on adequacy of the jointing. Minimum reinforcing should be No. 3 bars at 18-inches on center each way, centered in the slab or as determined by the ACI "Drag Formula."
4. ACI 330-R contains material, construction, inspection and testing, and maintenance recommendations that are appropriate for this project. They are recommended.
5. Concrete paving should be used for dumpster pads and around dumpster loading areas as per Heavy Duty Truck Lanes.

6. Contractions joint spacing is typically 15 feet on center each way. Contraction joint spacing should not exceed 20 feet on center without engineering consultation.
7. Full depth, full width isolation joints with bituminous fiber or preformed joint filler should be installed at all rigid structure interfaces, such as light pole bases, planters and buildings, or older sections of pavement.
8. All expansion joints and crack control joints should be sealed to prevent the infiltration of water into the subsurface. This is particularly important around irrigated landscaping and along the drainage path of roof downspouts.

E. General Conditions

1. Should at any stage in the construction of the pavement a non-stable or weaving condition of the subgrade or base course be noted under the wheel loads of construction equipment, such areas should be delineated and the Geotechnical Engineer consulted for remediation before completing the pavement section.
2. Seepage areas or unusual foundation soil conditions should be similarly brought to the Geotechnical Engineer's attention before proceeding with pavement completion.
3. Landscaped islands should be backfilled with low plasticity clays to reduce water intrusion into the subsurface pavement structures. Curbs should be provided with weep holes in landscaped areas to reduce the build up of hydrostatic pressure and to reduce the intrusion of water into the subsurface materials.
4. Trenches beneath pavements should be backfilled with borrow or suitable material excavated from the trench and free of stone or rock over 4 inches in diameter. The backfill should be compacted to 95 percent of the maximum dry density when determined by TxDOT test method Tex-114-E. The moisture

content should be within 3 percent of the optimum moisture content at the time of compaction.

5. If ground water or seepage is encountered at the time of construction, French drains may be required to drain or intercept the flow of water from the subsurface pavement materials. These drains should be sloped a minimum of 0.5 percent to provide positive drainage to daylight.

Table 3: Recommended Pavement Section Thickness, Inches

Expected Traffic	Average Daily Truck Traffic	Flexible Pavement		Rigid Pavement	
		HMAC	CLB	JRPCC	CLB
Passenger Vehicles	1	2.0	8	6	-
Heavy Duty Trucks*	Up to 10	2.0	10	6	-

Notes:

- Abbreviations: HMAC - Hot Mixed Asphalt Concrete, CLB - Crushed Limestone Base, JRPCC - Jointed, Reinforced Portland Cement Concrete
- Due to loose sand near the proposed subgrade, cement stabilization may be required in order to form a stable subgrade that will pass a proof-roll.
- *Heavy-duty truck parking, loading, unloading, and turning areas should use the rigid pavement option.
- Average Daily Truck Traffic excludes pickup and panel trucks.
- Inadequate drainage of the pavement system will accelerate pavement distress and result in increased maintenance costs. Adequate drainage should be provided for the pavement system. Adequate drainage consists of a curb and gutter or a shoulder and bar ditch system.
- These pavement thickness designs are intended to transfer the load from the anticipated traffic conditions. Deep seated soil swelling or settlement of fill materials may cause long wave surface roughness. The recommendations above are intended to reduce maintenance costs and increase the serviceable lifespan of the pavement system.

SELECT FILL RECOMMENDATIONS

1. **GENERAL:** Select fill, if called for on the plans, shall be placed over prepared compacted foundation soil to the dimensions shown on the plans.
2. **MATERIAL:** Select fill material shall be composed of hard durable particles of gravel or crushed stone and shall meet the following criteria:

A. Gradation shall be as follows:

<u>Sieve Size</u>	<u>Percent Finer by Weight</u>
1-3/4"	100
1-1/2"	85 - 100
3/4"	45 - 75
No. 4	25 - 70
No. 40	10 - 40

B. Material passing the No. 40 sieve shall meet the following:

<u>Percent Passing No. 40</u>	<u>Max. PI</u>	<u>Min. PI</u>
25 - 40	15	3
10 - 25	20	4

C. Maximum liquid limit of the minus no. 40 material shall be 35.

D. No organic matter is permitted.

E. Alternatives to the material requirements listed above shall be permitted at the discretion of the Geotechnical Engineer. Please submit a sample of the potential select fill to the Geotechnical Engineer for testing and review to determine if the material is acceptable.

3. **PLACEMENT AND COMPACTION:** Compaction should be to a minimum of 95 percent of maximum laboratory density determined in accordance with American Society of Testing Materials, Method ASTM D 698. Moisture content of the compacted material should be within two percentage points of optimum moisture at time of compaction.

Placement should be in lifts not exceeding six inches after compaction. Each compacted lift should be inspected and tested for density compliance prior to placing the next lift.

After completion, not less than plan thickness of select, compacted fill as herein recommended shall exist beneath any portion of the foundation, even if additional excavation of existing ground is required to meet this requirement.

4. **INSPECTION, TESTING AND CONTROL:** A 110 lb. sample of proposed fill material should be submitted to the Engineer for approval and for determination of Moisture-Density Relationship, at least seven days in advance of placement. Fill placement operations will be inspected and tested for uniformity, acceptable material, and field densities, at the Engineer's option. Testing and inspection will be at the Owner's expense or paid by allowance.

QUALITY ASSURANCE CONSIDERATIONS

Type of Work	Item	Sample Frequency	Sample Size	Minimum Testing
General Earthwork and Fill Material	Soil	1 per Soil Type	110 lbs.	<ul style="list-style-type: none"> ◆ Sieve ◆ P.I. ◆ Moisture Density Relationship
	Compaction	1 per 5000 ft ² per lift (min. of 3 per lift)		Field Density Test
Select Under-slab Fill	Select Fill Material	1 per type per 1000 cu. yds. Min. one per job	110 lbs.	<ul style="list-style-type: none"> ◆ Sieve ◆ P.I. ◆ Moisture Density Relationship
	Compaction	1 per 2000 ft ² per lift (min. of 3 per lift)		Field Density Test
Concrete or HMAC	Mix Design	1 per concrete class		<ul style="list-style-type: none"> ◆ Review & approval with confirmatory cylinders ◆ Plant & materials approval, testing, if questionable
Concrete or HMAC	Aggregates (coarse & fine)	1 per 500 cu. yd. Min. 1 per job	30 lbs.	Sieve, organic impurities, specific gravity
	Cement	1 per 1000 cu. yds. Min. 1 per job	10 lbs.	<ul style="list-style-type: none"> ◆ Fineness ◆ Chemical compound ◆ See mill reports
	Concrete Placement	1 per 50 cu. yds. Or each days pour (if less)		<ul style="list-style-type: none"> ◆ Slump ◆ Air Test ◆ 5 compressive cylinder tests, test 2 at 7 days, 2 at 28 days, 1 hold
HMAC Surface Course	HMAC	1 per 500 tons or each day's laydown		<ul style="list-style-type: none"> ◆ 3 cores for density ◆ Extraction/gradation tests ◆ Stability tests ◆ Thickness ◆ Temperature
Pier or Footing Inspection	Inspection and verification of bearing	Each Pier or Slab Footing		Qualified Inspector with Engineer's Review
	Concrete & Steel Placement	Each Pier or Slab Footing		Qualified Inspector
	Inspection of Reinforcing	Slab Pre-pour and Cable Stressing		Qualified Inspector

REFERENCES

1. Local geologic maps published by The Bureau of Economic Geology. Austin, Texas including:
 - “Geologic Atlas of Texas” 15-minute quadrangles. March 9, 2004 geospatial data.
 - “Geologic Map of the Austin Area, Texas 1992” Geology of Austin Area Plate VII.
 - “Geologic Map of the West Half of Taylor Texas, 30 x 60 min quad.” 2005. misc. map 43
 - “Geologic Map of the New Braunfels, Texas 30 x 60 min quad” 2000. misc. map 39
2. The Geology of Texas, Volume I, Stratigraphy, The University of Texas Bulletin No. 3232: August 22, 1932, The University of Texas, Austin, Texas, 1981.
3. “Method for Determining Potential Vertical Rise, PVR, Test Method Tex-124-E”, Manual of Testing Procedures, Texas Department of Transportation Materials and Tests Division, September 1995.
4. “Design of Post-Tensioned Slabs-on-Ground”, Third Edition. Post-Tensioning Institute, Farmington Hills, MI, 2008.
5. “Criteria for Selection and Design of Residential Slabs-on-Ground”, Building Research Advisory Board, National Research Council of the National Academy of Sciences, Report #33, 1968.
6. “Design of Slabs-on-Ground Foundations – A Design, Construction & Inspection Aid For Consulting Engineers”, Wire Reinforcement Institute, Hartford, Connecticut, Latest adopted version.
7. “Standard Specification for Plastic Water Vapor Retarders Use in Contact with Soil or Granular Fill under Concrete Slabs.” ASTM E 1745. 100 Barr Harbor Dr., West Conshohocken, PA 19428.
8. City of Austin, Texas Standard Specifications. American Legal Publishing Corporation. 432 Walnut Street. Cincinnati, OH. 45202-309. (800) 445-5588. Latest version. (www.amlegal.com)
9. “ACI Committee Report 330R - Guide for Design and Construction of Concrete Parking Lots”, ACI Manual of Concrete Practice - Part 2, American Concrete Institute, Farmington Hills, MI; 1996.

LIMITATIONS OF REPORT

The conditions of the site at locations other than the boring locations are not expressed or implied and conditions may be different at different times from the time of borings. Contractors or others desiring more information are advised to secure their own supplemental borings. This investigation and report do not, and are not intended to, determine the environmental conditions or evaluate possible hazardous or toxic waste conditions on this site or adjacent sites. Interested persons requiring this information are advised to contact MLA Geotechnical.


The recommendations in this report are not intended to address the interior environmental effects of moisture migration through slabs. The Client is responsible for addressing the requirements of this project with respect to moisture migration through slab-on-ground foundations.

Diverse strategies can be applied during building design, construction, operation, and maintenance to prevent significant amounts of mold from growing on indoor surfaces. The geotechnical engineer in charge of this project is not a mold prevention consultant and none of the services performed in connection with this study were designed or conducted for the purpose of mold prevention. Proper implementation of the recommendations conveyed in this report may not in itself be sufficient to prevent mold from growing in or on the structure(s) involved.

The analysis and recommendations contained herein are based on the available data as shown in this report and the writer's professional expertise, experience and training, and no other warranty is expressed or implied concerning the satisfactory use of these recommendations or data.

© MLA Geotechnical 2023

APPENDIX A
GEOTECHNICAL DATA

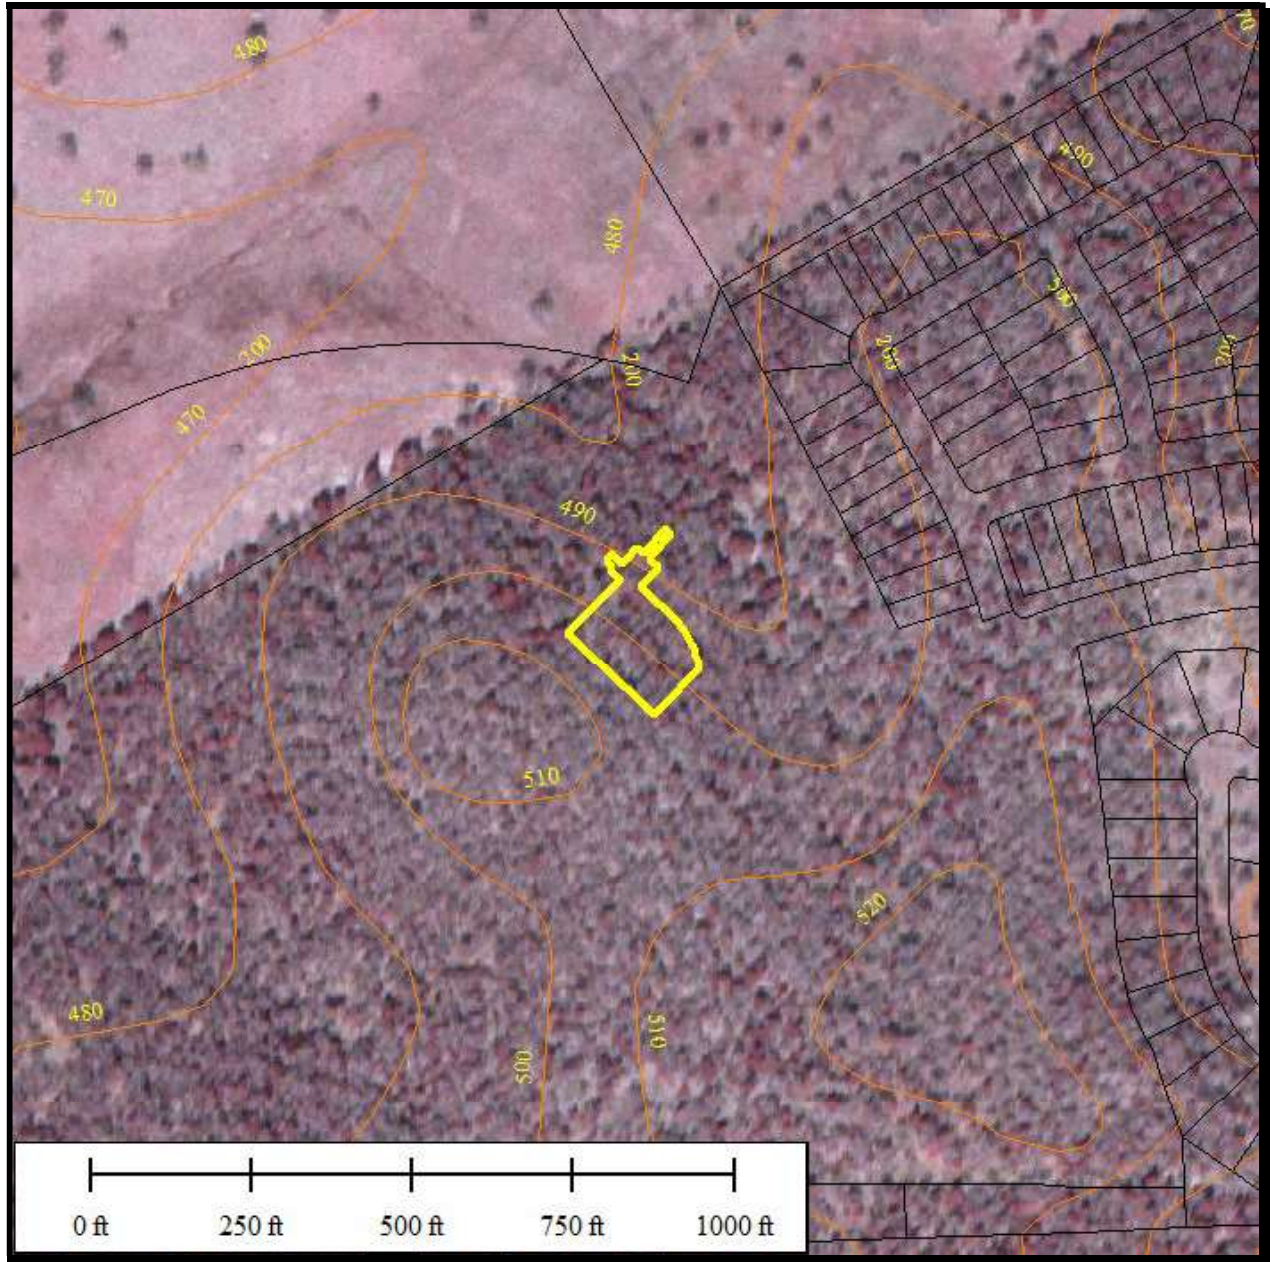


**Approximate location of site in yellow
 CAPCOG contours (2008) in orange
 Bastrop County parcels (2022) in black**

NAPP Aerial Photograph of Site – 1995

Source: TEXAS NATURAL RESOURCES INFORMATION SYSTEM
 3.75-minute DOQQ. 1-meter ground resolution. apx. date 1995-6
 (<http://www.tnris.state.tx.us/digital.htm>)




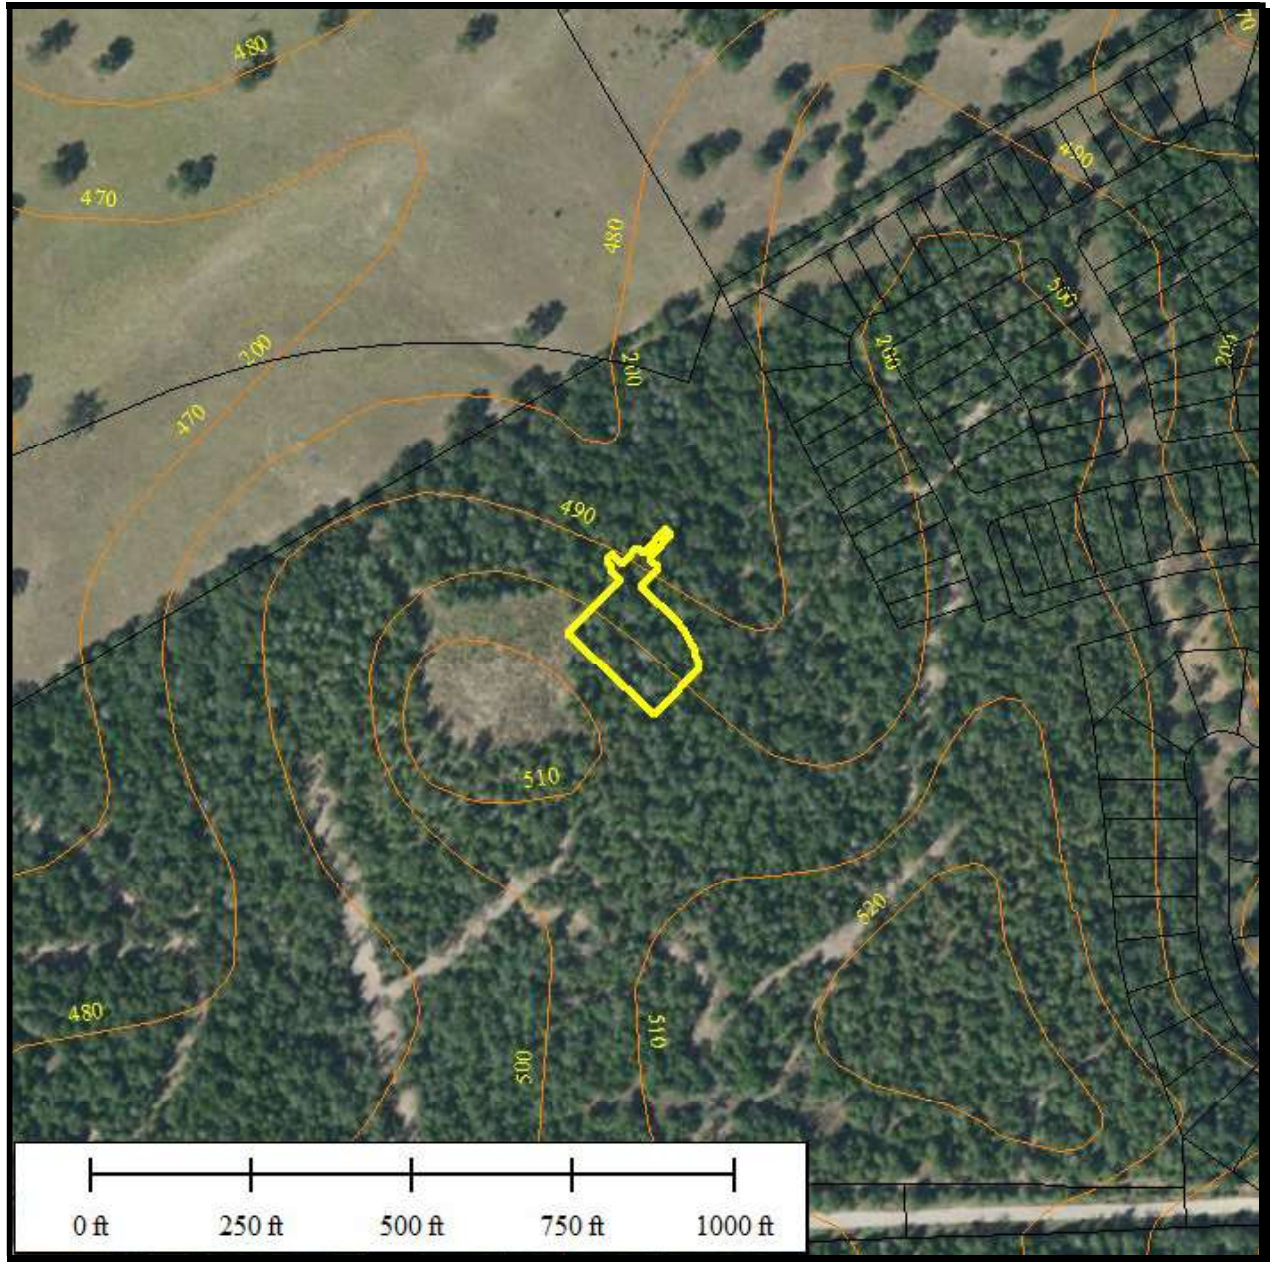


Approximate location of site in yellow
CAPCOG contours (2008) in orange
Bastrop County parcels (2022) in black

Aerial Photograph of Site – 2020

Source: TEXAS NATURAL RESOURCES INFORMATION SYSTEM
 Apx. Date - 2020
 (<https://tnris.org/>)



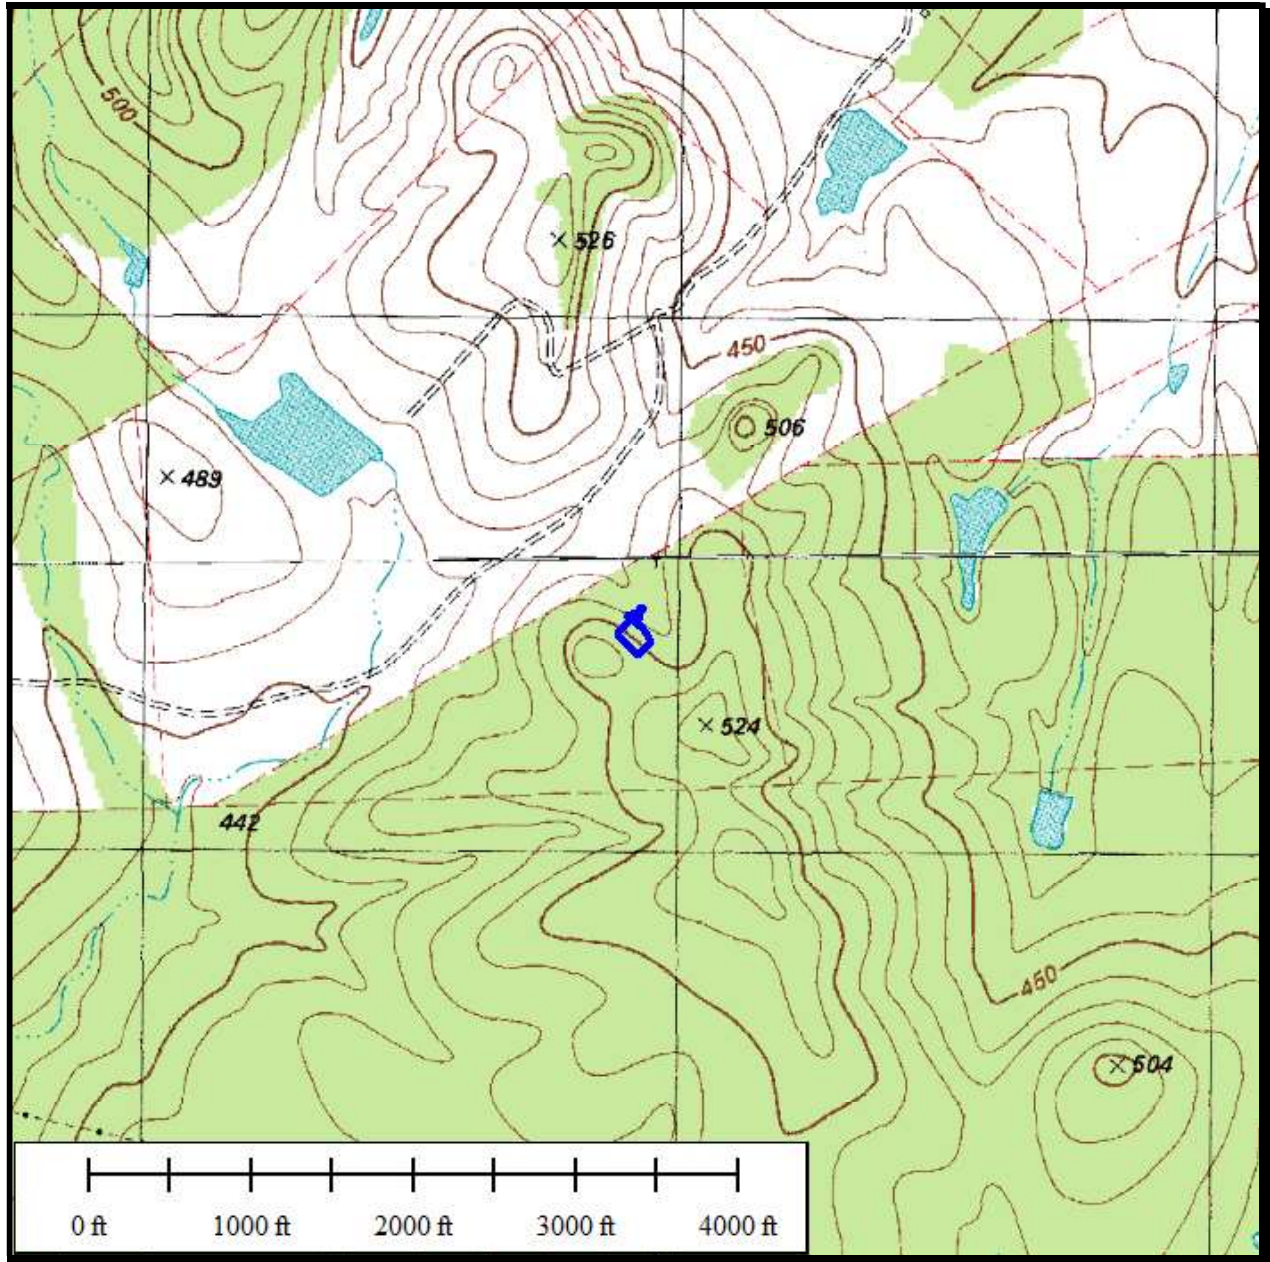


Approximate location of site in blue

**U.S. 7.5 Minute Series Topographic Map
Bastrop Southwest Quadrangle, Texas
Contour Interval = 10 feet**

Source: TEXAS NATURAL RESOURCES INFORMATION SYSTEM
(<http://www.tnris.state.tx.us/digital.htm>)



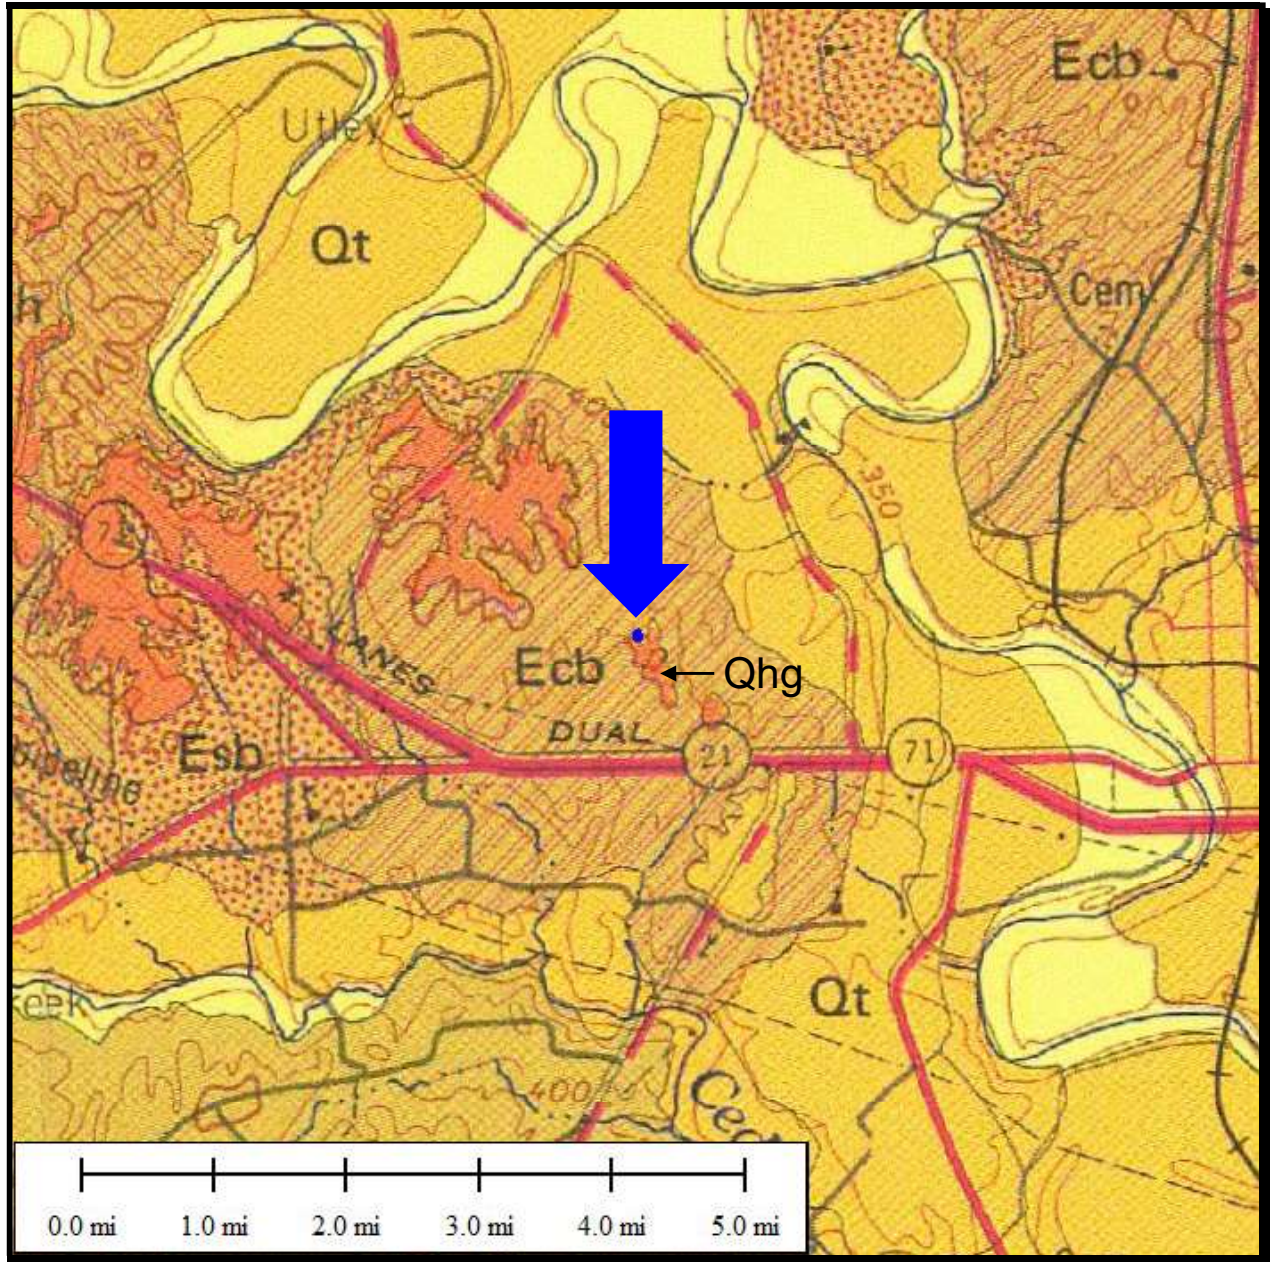


Approximate location of site in blue

**Geologic Setting of Site
Geologic Atlas of Texas
Contour Interval = 50 feet**

Original Source: Bureau of Economic Geology, The University of Texas at Austin, latest version
Digital Source: 15-minute Digital GAT Quads. TCEQ March 9, 2004



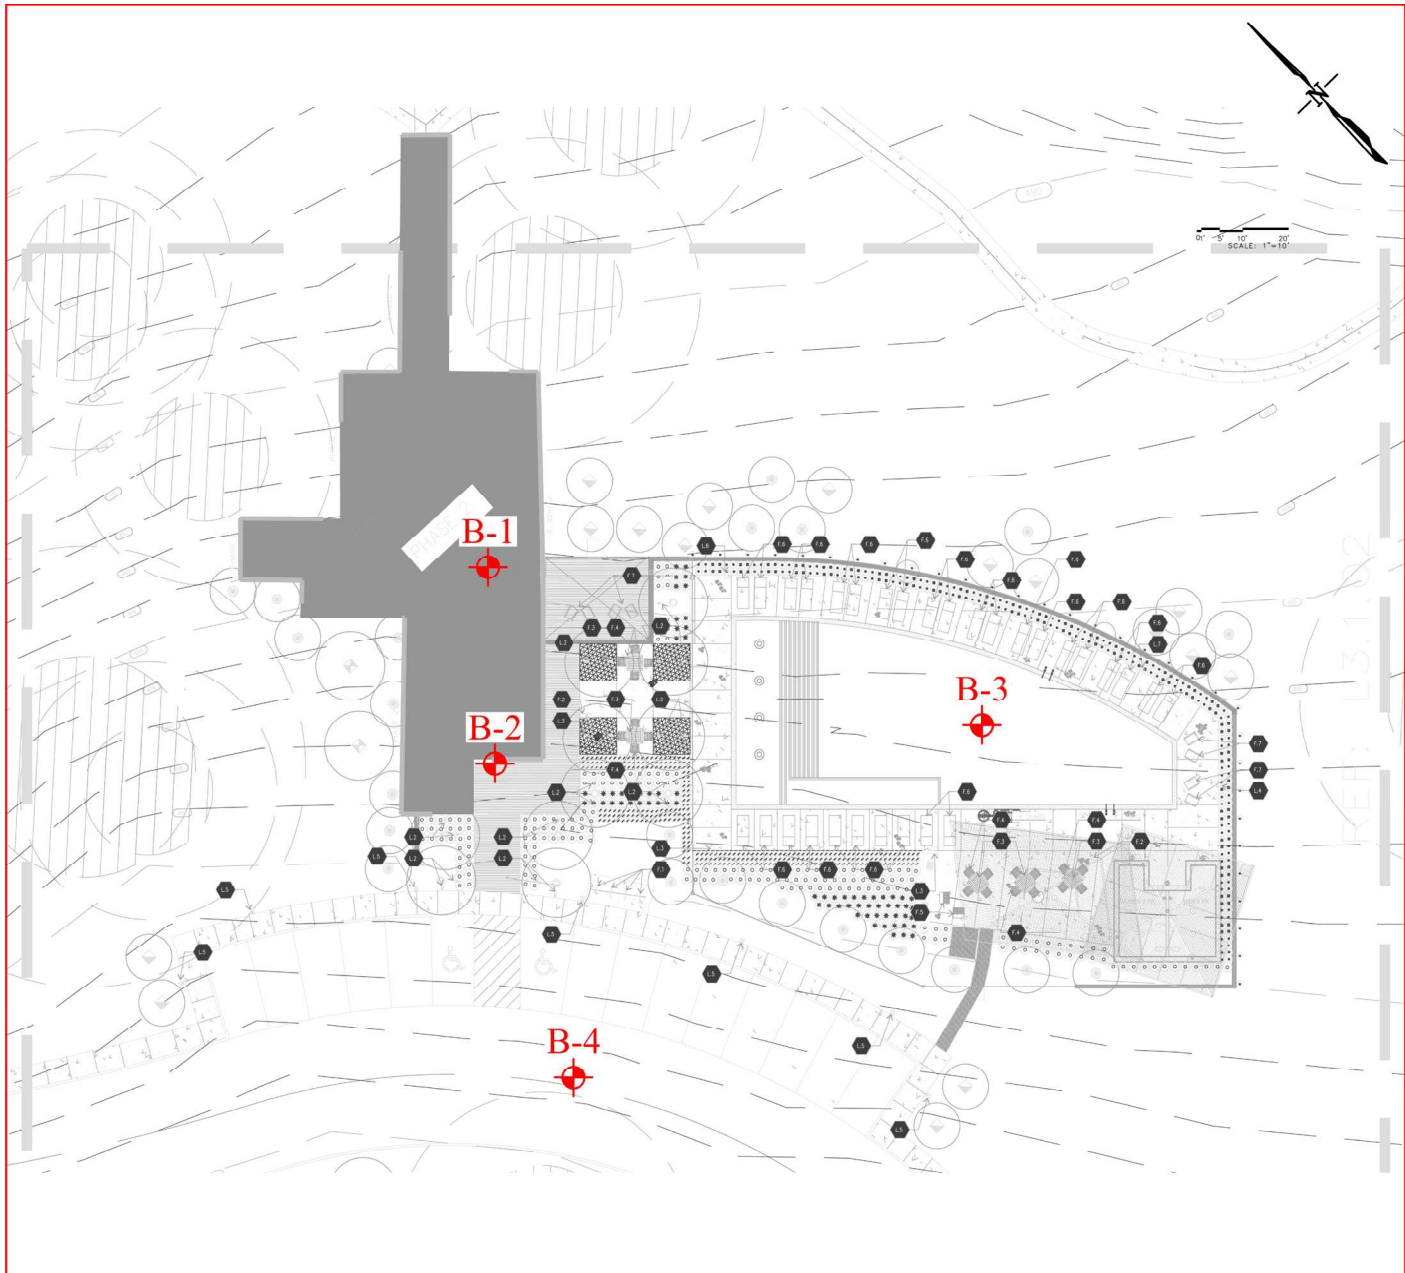

SCALE = N.T.S.

PAGE 1 OF 1

PLAN OF BORINGS


Colony Treehouse Amenity Center
 Bastrop, Texas
 Job. No.: 23106100.012
 Client: Hunt Communities Bastrop, LLC

LEGEND

B-#	Boring Number
	Approx. Boring Location

V
I
C
I
N
I
T
Y

M
A
P

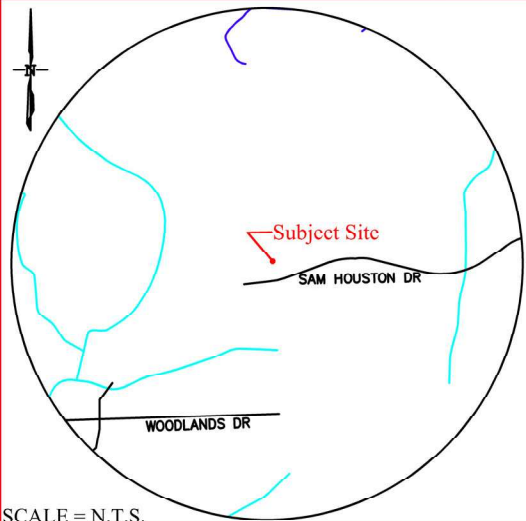

SCALE = N.T.S.



"put us to the test"

LOG OF BORING

Boring B-1

PAGE 1 OF 1

Job Name: Colony Treehouse Amenity Center

Job Location: Bastrop, Texas

Engineer's Job #: 23106100.012

Client: Hunt Communities Bastrop, LLC

Drill Date: March 25, 2023

Ground Elevation: n/a

Ground Water Levels:


Hole Size: 4.5 in.

AT TIME OF DRILLING: ---

AT END OF DRILLING: ---

AFTER DRILLING: ---

Notes:

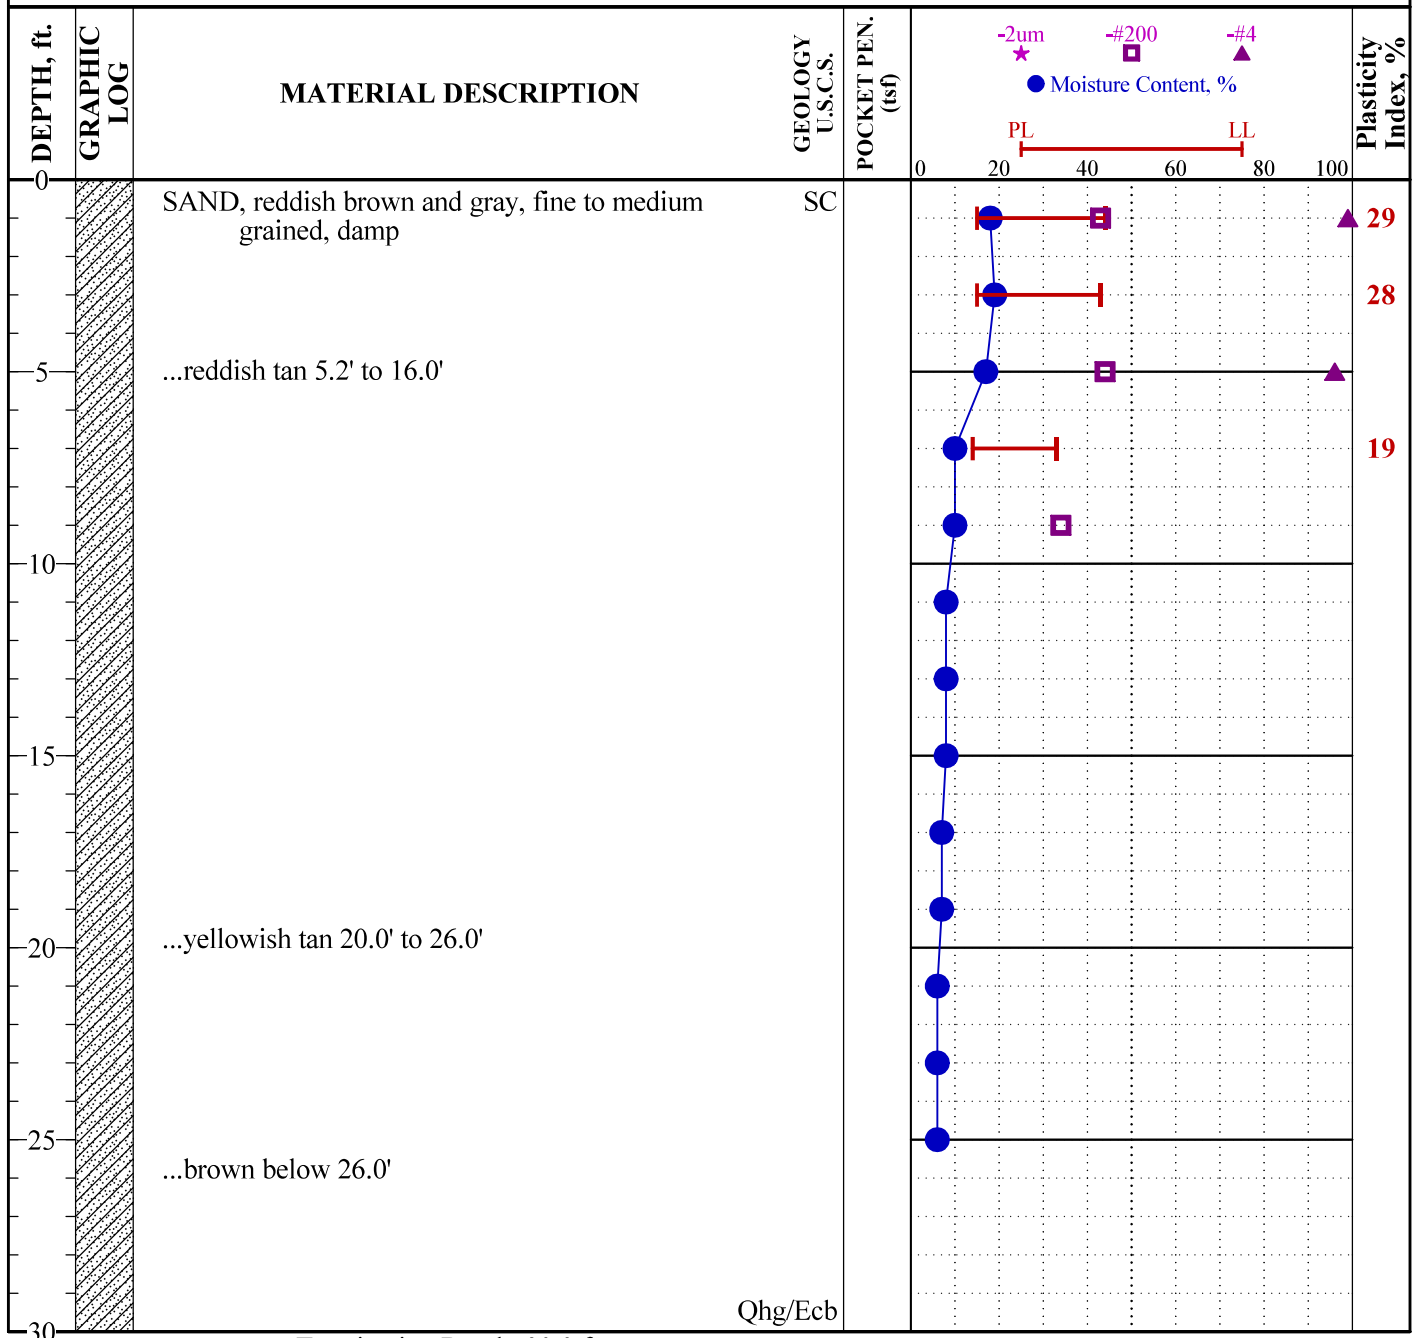

Termination Depth: 30.0 feet

23106100.012 - COLONY TREEHOUSE AMENITY CENTER - LOGS.GPJ 8/14/23



"put us to the test"

LOG OF BORING

Boring B-2

PAGE 1 OF 1

Job Name: Colony Treehouse Amenity Center

Job Location: Bastrop, Texas

Engineer's Job #: 23106100.012

Client: Hunt Communities Bastrop, LLC

Drill Date: March 25, 2023

Ground Elevation: n/a

Ground Water Levels:


Hole Size: 4.5 in.

AT TIME OF DRILLING: ---

AT END OF DRILLING: ---

AFTER DRILLING: ---

Notes:

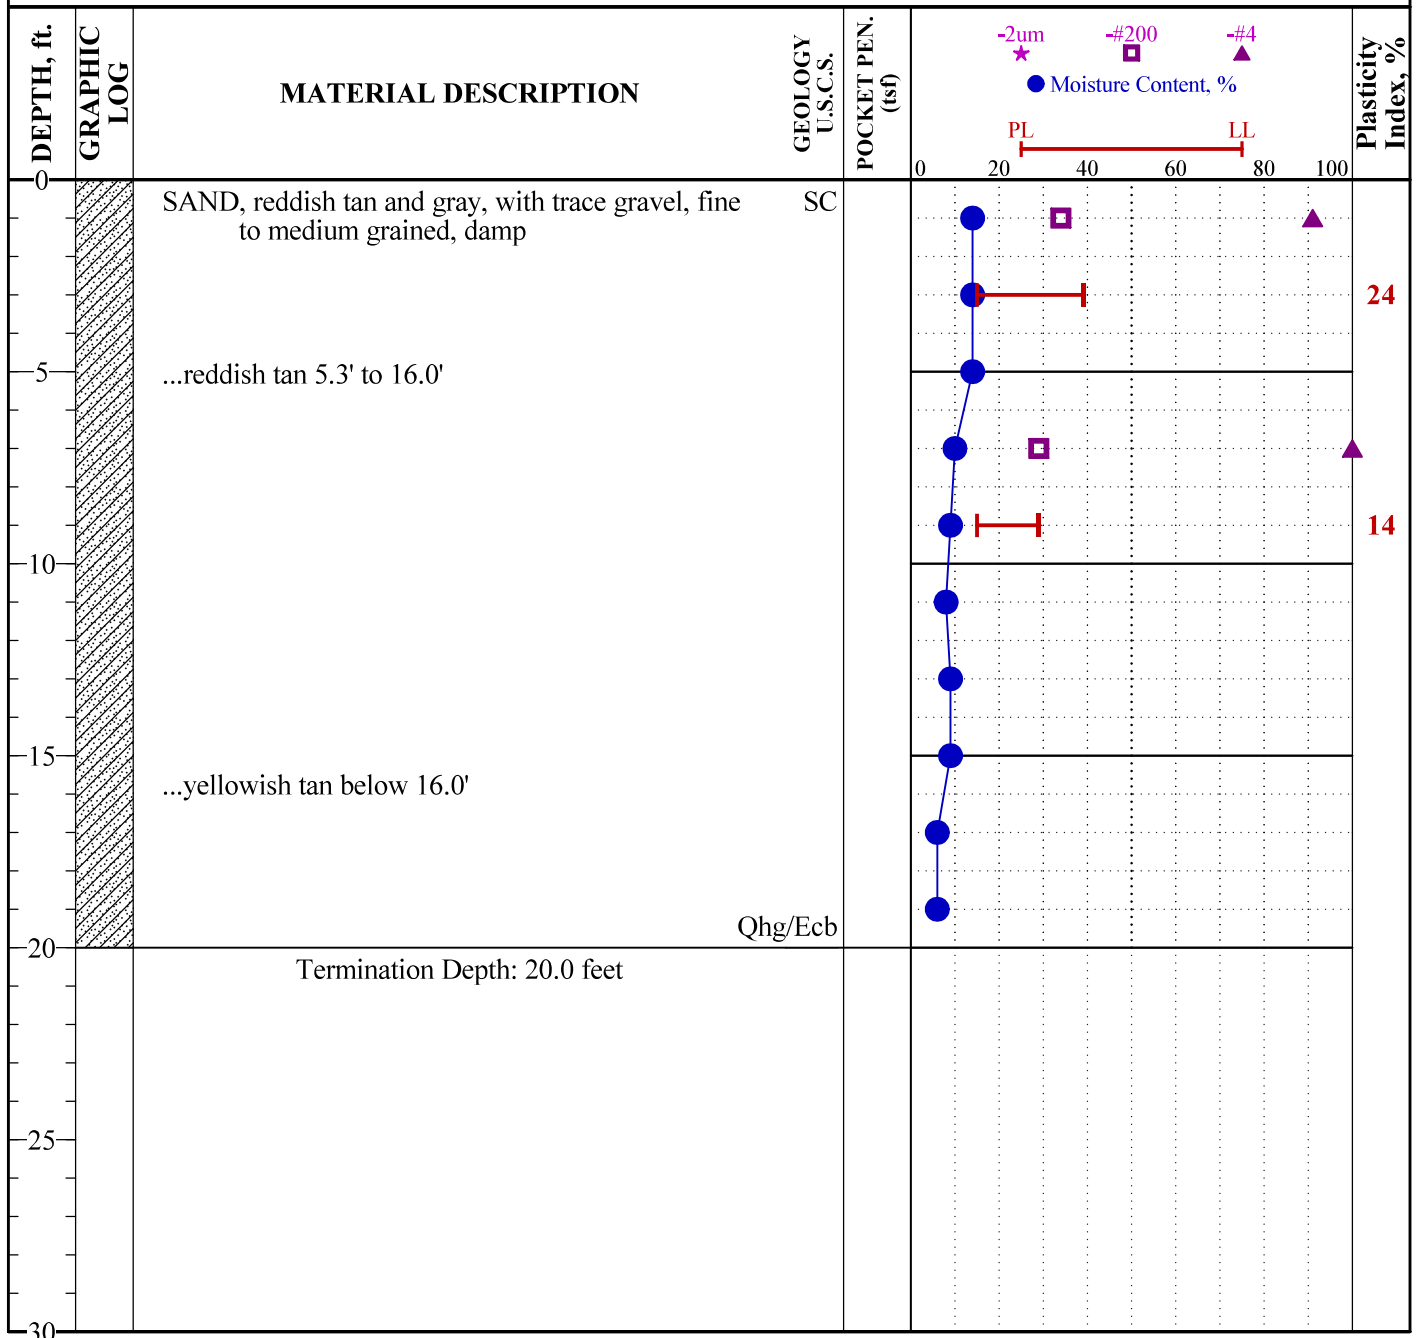

23106100.012 - COLONY TREEHOUSE AMENITY CENTER - LOGS.GPJ 8/14/23



"put us to the test"

LOG OF BORING

Boring B-3

PAGE 1 OF 1

Job Name: Colony Treehouse Amenity Center

Job Location: Bastrop, Texas

Engineer's Job #: 23106100.012

Client: Hunt Communities Bastrop, LLC

Drill Date: March 25, 2023

Ground Elevation: n/a

Ground Water Levels:

Hole Size: 4.5 in.

AT TIME OF DRILLING: ---


AT END OF DRILLING: ---

AFTER DRILLING: ---

Notes:

DEPTH, ft.	GRAPHIC LOG	MATERIAL DESCRIPTION	GEOLOGY U.S.C.S.	POCKET PEN. (tsf)	<div style="display: flex; justify-content: space-between; align-items: center;"> <div style="text-align: center;"> <p>-2um ★</p> <p>-#200 □</p> <p>-#4 ▲</p> <p>● Moisture Content, %</p> </div> <div style="text-align: center;"> <p>PL — LL</p> </div> </div>	Plasticity Index, %
0		CLAY, dark brown, sandy, damp	CH			
5		SAND, dark brown, with gravel, fine to medium grained, damp ...reddish brown and gray, with trace gravel 2.0' to 5.8'	SC			
10		...reddish tan 5.8' to 10.0'				
15		...tan below 10.0'				
15		Termination Depth: 15.0 feet	Qhg/Ecb			
20						
25						
30						

23106100.012 - COLONY TREEHOUSE AMENITY CENTER - LOGS.GPJ 8/14/23

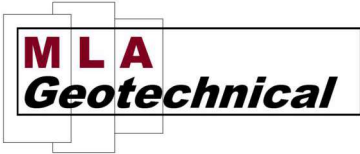

"put us to the test"

LOG OF BORING

Boring B-4

PAGE 1 OF 1

Job Name: Colony Treehouse Amenity Center

Job Location: Bastrop, Texas

Engineer's Job #: 23106100.012

Client: Hunt Communities Bastrop, LLC

Drill Date: March 25, 2023

Ground Elevation: n/a

Ground Water Levels:

Hole Size: 4.5 in.

AT TIME OF DRILLING: ---

AT END OF DRILLING: ---

AFTER DRILLING: ---

Notes:

DEPTH, ft.	GRAPHIC LOG	MATERIAL DESCRIPTION	GEOLOGY U.S.C.S.	POCKET PEN. (tsf)	<div style="display: flex; justify-content: space-between; align-items: center;"> <div style="text-align: center;"> <p>-2um ★</p> <p>-#200 □</p> <p>-#4 ▲</p> <p>● Moisture Content, %</p> </div> <div style="text-align: center;"> <p>PL — LL</p> </div> </div>	Plasticity Index, %
0		CLAY, reddish tan and gray, sandy, with gravel, damp	CL-CH			
5		SAND, reddish tan and gray, with trace gravel, fine to medium grained, damp ...brown below 4.8'	SC			
7.0		Termination Depth: 7.0 feet	Qhg/Ecb			
10						
15						
20						
25						
30						

23106100.012 - COLONY TREEHOUSE AMENITY CENTER - LOGS.GPJ 8/14/23

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS	
			GRAPH	LETTER		
COARSE GRAINED SOILS	GRAVEL AND GRAVELLY SOILS	CLEAN GRAVELS (LITTLE OR NO FINES)		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
				GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
		GRAVELS WITH FINES (APPRECIABLE AMOUNT OF FINES)		GM	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES	
	MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE				GC	CLAYEY GRAVELS, GRAVEL - SAND - CLAY MIXTURES
		SAND AND SANDY SOILS	CLEAN SANDS (LITTLE OR NO FINES)		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES
						SP
SANDS WITH FINES (APPRECIABLE AMOUNT OF FINES)			SM	SILTY SANDS, SAND - SILT MIXTURES		
				SC	CLAYEY SANDS, SAND - CLAY MIXTURES	
FINE GRAINED SOILS	SILTS AND CLAYS	LIQUID LIMIT LESS THAN 50		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY	
				CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS	
				OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY	
				CH	INORGANIC CLAYS OF HIGH PLASTICITY	
		CLAYS	LIQUID LIMIT GREATER THAN 50		CL-CH	LOW PI CLAYS WITH APPRECIABLE HIGH PI MOTTLING, CLAY WITH BORDERLINE CLASSIFICATION
SOILS OF MODERATE PLASTICITY				FILL	MATERIAL NOT NATURALLY DEPOSITED	
OTHER MATERIALS				LS	WEATHERED LIMESTONE	
					INTACT LIMESTONE	

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS

Key to Terms and Abbreviations

Descriptive Terms Characterizing Soils and Rock	Standard Description Abbreviations and Terms	Symbols and Abbreviations for Test Data
<p>Argillaceous – having appreciable amounts of clay in the soil or rock mass. Used most often in describing limestones, occasionally sandstones.</p> <p>Calcareous – containing appreciable quantities of calcium carbonate. Can be either nodular or “powder.”</p> <p>Crumbly – cohesive soils which break into small blocks or crumbs on drying.</p> <p>Evaporite – deposits of salts and other soluble compounds. Most commonly calcium carbonate or gypsum. May be in either “powder” or visible crystal form.</p> <p>Ferruginous – having deposits of iron or nodules, typically oxidized and dark red in color.</p> <p>Ferrous – see Ferruginous</p> <p>Fissured – containing shrinkage cracks frequently filled with fine sand or silt, usually more or less vertical.</p> <p>Fossiliferous – containing appreciable quantities of fossils, fossil fragments, or traces of fossils</p> <p>Laminated – composed of thin layers of varying color or texture. Layers are typically distinct and varying in composition from sand to silt and clay.</p> <p>Mottled – characterized as having multiple colors organized in a marbled pattern.</p> <p>Slickensided – having inclined planes of weakness that are slick and glossy in appearance.</p> <p>Varved – see Laminated.</p>	<p>brn = brown dk = dark lt = light wx = weathered calc = calcareous sw = severely weathered cw = completely weathered n/a = not available b. = below</p> <p>Engineering Units pcf = pounds per cubic foot psf = pounds per square foot tsf = tons per square foot pF = picofarad psi = pounds per square inch kips = thousand pounds (force) ksf = kips per square foot</p>	<p>LL = Liquid Limit PL = Plastic Limit PI = Plasticity Index (LL-PL) NP = non-plastic γ_d = dry unit weight q_u = unconfined compressive strength q_c = confined compressive strength SPT = standard penetration test TCP = Texas cone penetration test (Texas Highway Department) N or N_{SPT} = blows per foot from SPT N_{TCP} = blows per foot from TCP SCR = standard core recovery RQD = rock quality designation RQI = see RQD</p>

Terms Describing Consistency of Soil and Rock

COARSE GRAINED MATERIAL		SEDIMENTARY ROCK	
DESCRIPTIVE TERM	BLOWS/FT (SPT)	DESCRIPTIVE TERM	STRENGTH, TSF
very loose	0 – 4	soft	4 – 8
loose	4 – 10	medium	8 – 15
firm (medium)	10 – 30	hard	15 – 50
dense	30 – 50	very hard	over 50
very dense	over 50		

Describing Consistency of Fine Grained Soil

DESCRIPTIVE TERM	BLOWS/FT (SPT)	UNCONFINED COMPRESSION, TSF
very soft	< 2	< 0.25
soft	2 – 4	0.25 – 0.50
medium stiff	4 – 8	0.50 – 1.00
stiff	8 – 15	1.00 – 2.00
very stiff	15 – 30	2.00 – 4.00
hard	over 30	over 4.00

Sample Type Key

	Auger Cuttings
	Shelby Tube
	Split Spoon (SPT)
	Texas Cone (TCP)
	Rock Core
	No Sample

Revised: October 2018

APPENDIX B

STANDARD FIELD AND LABORATORY PROCEDURES

STANDARD FIELD AND LABORATORY PROCEDURES

STANDARD FIELD PROCEDURES

Drilling and Sampling

Borings and test pits are typically staked in the field by the drillers, using simple taping or pacing procedures and locations are assumed to be accurate to within several feet. Unless noted otherwise, ground surface elevations (GSE) when shown on logs are estimated from topographic maps and are assumed to be accurate to within a foot. A Plan of Borings or Plan of Test Pits showing the boring locations and the proposed structures is provided in the Appendix.

A log of each boring or pit is prepared as drilling and sampling progressed. In the laboratory, the driller's classification and description is reviewed by a Geotechnical Engineer. Individual logs of each boring or pit are provided in the Appendix. Descriptive terms and symbols used on the logs are in accordance with the Unified Soil Classification System (ASTM D-2487). A reference key is also provided. The stratification of the subsurface material represents the soil conditions at the actual boring locations, and variations may occur between borings. Lines of demarcation represent the approximate boundary between the different material types, but the transition may be gradual.

A truck-mounted rotary drill rig utilizing rotary wash drilling or continuous flight hollow or solid stem auger procedures is used to advance the borings, unless otherwise noted. A backhoe provided by others is used to place test pits. Test pits are advanced to the required depth, refusal (typically bedrock) or to the limits of the equipment. Samples of soil are obtained from the borings or test pit spoils for subsequent laboratory study. Samples are sealed in plastic bags and marked as to depth and boring/pit locations in the field. Cores are wrapped in a polyethylene wrap to preserve field moisture conditions, placed in core boxes and marked as to depth and core runs. Unless notified to the contrary, samples and cores will be stored for 90 days, then discarded.

Standard Penetration Test and Split-Barrel Sampling of Soils (ASTM D-1586) (SPT)

This sampling method consists of driving a 2 inch outside diameter split barrel sampler using a 140 pound hammer freely falling through a distance of 30 inches. The sampler is first seated 6 inches into the material to be sampled and then driven an additional 12 inches. The number of blows required to drive the sampler the final 12 inches is known as the Standard Penetration Resistance. The results of the SPT is recorded on the boring logs as "N" values.

Thin-Walled Tube Sampling of Soils (ASTM D-1587) (Shelby Tube Sampling)

This method consists of pushing thin walled steel tubes, usually 3 inches in diameter, into the soils to be sampled using hydraulic pressure or other means. Cohesive soils are usually sampled in this manner and relatively undisturbed samples are recovered.

Soil Investigation and Sampling by Auger Borings (ASTM D-1452)

This method consists of auguring a hole and removing representative soil samples from the auger flight or bit at intervals or with each change in the substrata. Disturbed samples are obtained and this method is, therefore, limited to situations where it is satisfactory to determine the approximate subsurface profile and obtain samples suitable for Index Property testing.

Diamond Core Drilling for Site Investigation (ASTM D-2113)

This method consists of advancing a hole into hard strata by rotating a single or double tube core barrel equipped with a cutting bit. Diamond, tungsten carbide, or other cutting agents may be used for the bit. Wash water or air is used to remove the cuttings and to cool the bit. Normally, a 3 inch outside diameter by 2-1/8 inch inside diameter coring bit is used unless otherwise noted. The rock or hard material recovered within the core barrel is examined in the field and in the laboratory and the cores are stored in partitioned boxes. The intactness of all rock core specimens is evaluated in two ways. The first method is the Standard Core Recovery (SCR) expressed as the length of the total core recovered divided by the length of the core run, expressed as a percentage:

$$\text{SCR} = \frac{\text{total core length recovered}}{\text{length of core run}} \times 100\%$$

This value is exhibited on the boring logs as the Standard Core Recovery (SCR).

The second procedure for evaluating the intactness of the rock cores is by Rock Quality Designation (RQD). The RQD provides an additional qualitative measure of soundness of the rock. This index is determined by measuring the intact recovered core unit which exceed four inches in length divided by the total length of the core run:

$$\text{RQD} = \frac{\text{all core lengths greater than 4"} \times 100\%}{\text{length of core run}}$$

The RQD is also expressed as a percentage and is shown on the boring logs.

Vane Shear Tests

In-situ vane shear tests may be used to determine the shear strength of soft to medium cohesive soil. This test consists of placing a four-bladed vane in the undisturbed soil and determining the torsional force applied at the ground surface required to cause the cylindrical perimeter surface of the vane to be sheared. The torsional force sufficient to cause shearing is converted to a unit of shearing resistance or cohesion of the soil surrounding the cylindrical surface.

THD Cone Penetrometer Test

The THD Cone Penetrometer Test is a standard field test to determine the relative density or consistency and load carrying capacity of foundation soils. This test is performed in much the same manner as the Standard Penetration Test described above. In this test, a 3 inch diameter penetrometer cone is used in place of a split-spoon sampler. This test calls for a 170-pound weight falling 24 inches. The actual test in hard materials consists of driving the penetrometer cone and accurately recording the inches of penetration for the first and second 50 blows for a total of 100 blows. These results are then correlated using a table of load capacity vs. number of inches penetrated per 100 blows.

Pocket Penetrometer Test

A pocket penetrometer or hand penetrometer is a small device used to estimate the shear capacity or unconfined compressive strength of a soil sample. The device consists of a spring-loaded probe which measures the pressure required to penetrate the probe into a soil sample for specified depth. This test can only be performed on cohesive soil samples. This pressure is reported in tons per square foot (tsf) on the Logs of Boring. A hyphen (-) indicates that the soil sample was too loose or too soft to perform the test. This test is considered rudimentary and too inaccurate to be used for direct design parameters; however, this test is useful for correlations among soil strata and general stiffness descriptions.

Ground Water Observation

Ground moisture observations are made during the operations and are reported on the logs of boring or pit. Moisture condition of cuttings are noted, however, the use of water for circulation precludes direct observation of wet conditions. Water levels after completing the borings or pits are noted. Seasonal variations, temperatures and recent rainfall conditions may influence the levels of the ground water table and water may be present in excavations, even though not indicated on the logs.

STANDARD LABORATORY PROCEDURES

To adequately characterize the subsurface material at this site, some or all of the following laboratory tests are performed. The results of the actual tests performed are shown graphically on the Logs of Boring or Pit.

Moisture Content - ASTM D-2216

Natural moisture contents of the samples (based on dry weight of soil) are determined for selected samples at depths shown on the respective boring logs. These moisture contents are useful in delineating the depth of the zone of moisture change and as a gauge of correlation between the various index properties and the engineering properties of the soil. For example, the relationship between the plasticity index and moisture content is a source of information for the correlation of shear strength data.

Dry Density - ASTM D-7263

The dry density, γ_d , (bulk density or unit weight) of the samples is determined for selected samples at depths shown on the respective boring logs using Method B of the aforementioned ASTM standard. The in-situ density was determined from undisturbed SPT samples and the dry density was calculated using moisture content results. These dry density values are useful for calculating other characteristic values such as porosity, void ratio, and mass composition of soil. Additionally, these values can also be used to assess the degree of compaction or consolidation of fill materials.

Atterberg Limits - ASTM D-4318

The Atterberg Limits are the moisture contents at the time the soil meets certain arbitrarily defined tests. At the moisture content defined as the plastic limit, P_w , the soil is assumed to change from a semi-solid state to a plastic state. By the addition of more moisture, the soil may be brought up to the moisture content defined as the liquid limit, L_w , or that point where the soil changes from a plastic state to a liquid state. A soil existing at a moisture content between these two previously described states is said to be in a plastic state. The difference between the liquid limit, L_w , and the plastic limit, P_w , is termed the plasticity index, I_w . As the plasticity index increases, the ability of a soil to attract water and remain in a plastic state increases. The Atterberg Limits that were determined are plotted on the appropriate log.

The Atterberg Limits are quite useful in soil exploration as an indexing parameter. Using the Atterberg Limits and grain size analysis, A. Casagrande developed the Unified Soils Classification System (USCS) which is widely used in the geotechnical engineering field. This system related the liquid limit to the plasticity index by dividing a classification chart into various zones according to degrees of plasticity of clays and silts. Although the Atterberg Limits are an indexing parameter, K. Terzaghi has related these limits to various engineering properties of a soil. Some of these relationships are as follows:

1. As the grain size of the soil decreases, the Atterberg Limits increase.
2. As the percent clay in the soil increases, the Atterberg Limits increase.
3. As the shear strength increases, the Atterberg Limits decrease.
4. As the compressibility of a soil increases, the Atterberg Limits increase.

Free Swell Test - ASTM D-4546-96

The free swell test assesses the potential for swell of soil. This value is useful for the design of various structures such as slab-on-ground foundations, piers and piles, and underground utilities. Method B of the aforementioned ASTM standard determines the amount of swell (vertical heave) of a sample. This is done by placing the sample in a consolidometer under a seating load equal to the overburden pressure and giving the sample free access to water. The height is measured and the swell is calculated as the vertical displacement divided by the original height of the specimen. The results of these tests are presented on the Logs of Boring at the depth of the samples tested.

Swell Pressure Test - ASTM D-4546-96

The swell pressure test assesses the potential for swell of soil. This value is useful for the design of various structures such as slab-on-ground foundations, piers and piles, and underground utilities. Method C of the aforementioned ASTM standard determines the pressure required to keep a soil sample at equilibrium under swelling conditions. This is done by placing the sample in a consolidometer under a seating load and giving the sample free access to water. A constant height of the sample is maintained and the vertical pressure on the sample is adjusted until equilibrium is reached. The vertical pressure on the sample at equilibrium is reported as the swell pressure. The results of these tests are presented on the Logs of Boring at the depth of the samples tested.

Soil Suction Test - ASTM D-5298-94

Soil suction (potential) tests are performed to determine both the matric and total suction values for the samples tested. Soil suction measures the free energy of the pore water in a soil. In a practical sense, soil suction is an indication of the affinity of a given soil sample to retain water. Soil suction provides useful information on a variety of characteristics of the soil that are affected by the soil water including volume change, deformation, and strength.

Soil suction tests are performed using the filter paper method per ASTM D-5298. Results of these tests are shown graphically on the logs of boring and tabulated in summary sheet of laboratory data.

For matric suction values found using this method, it should be noted that when the soil is in a dry state adequate contact between the filter paper and the soil may not be possible. This lack of contact may result in the determination of total suction instead of matric suction.

Triaxial Shear Test - ASTM D-2850-70

Triaxial tests may be performed on samples that are approximately 2.83 inches in diameter, unless a smaller diameter sample was necessary to achieve a more favorable length:diameter (L:D) ratio. A minimum length to diameter ratio (L:D) of 2.0 is maintained to reduce end effects.

The triaxial tests are typically unconsolidated-undrained using nitrogen gas for chamber confining pressure. Confining pressures are selected to conform to in-situ hydrostatic pressure considering the earth to be a fluid of 120 pcf. In this test, undisturbed Shelby tube samples are trimmed so that their ends are square and then pressed in a triaxial compression machine. The load at which failure occurs is the compressive strength. The results of the triaxial tests and the correlated hand penetrometer strengths can be utilized to develop soil shear strength values. These test provide the confined compressive strength, q_c , which are presented on the Logs of Boring at the depth of the samples tested.

Unconfined Compressive Strength of Rock Cores - ASTM D-2938

The unconfined compressive strength, q_u , is a valuable parameter useful in the design of foundation footings. This value, q_u , is related to the shearing resistance of the rock and thus to the capacity of the rock to support a load. In completing this test it is imperative that the length:diameter ratio of the core specimens are maintained at a minimum of 2:1. This ratio is set so that the shear plane will not extend through either of the end caps. If the ratio is less than 2.0 a correction is applied to the result.

Grain Size Analysis - ASTM D-421 and D-422

Grain size analysis tests are performed to determine the particle size and distribution of the samples tested. The grain size distribution of the soils coarser than the Standard Number 200 sieve is determined by passing the sample through a standard set of nested sieves, and the distribution of sizes smaller than the No. 200 sieve is determined by a sedimentation process, using a hydrometer. The results are given on the log of Boring/Pit or on Grain Size Distribution semi-log graphs within the report.

Slake Durability Test - ASTM D-4644

The slake durability test provides an index for the durability of a shale, or similar rock, considering the effects of wetting, drying, and abrasion. This index is used to quantify the strength of weak rock formations when exposed to natural wetting and drying cycles, especially in the context of underground tunneling and excavation. The index, $I_d(2)$, represents the percentage, by mass, of rock material retained after two wetting and drying cycles. These cycles are simulated by oven drying the sample followed by ten minutes of tumbling and soaking in water within a drum and trough apparatus. After tumbling and soaking, the sample is oven-dried and the mass of the sample is recorded. The results of these tests are presented on the Logs of Boring at the depth of the samples tested.

Brazilian Tensile Strength - ASTM D-3967

The Brazilian (splitting) tensile strength, σ_t , is useful in rock mechanics design, especially in regard to tunneling. This value is an indirect representation of the true uniaxial tensile strength. The Brazilian test is typically used more commonly than direct tensile strength tests because it is less difficult, more cost effective, and more represented of in-situ conditions. The test is conducted by mechanically compressing a rock core sample along its vertical diameter, causing the sample to fail due to tension along the horizontal diameter caused by the Poisson effect.

CERCHAR Abrasivity Index (CAI) Test - ASTM D-7625

The CERCHAR Abrasivity Index (CAI) is used to determine the abrasivity of rocks. This is particularly useful in assessing the potential wearing on cutting tools during excavation. The CAI of a rock is determined by the CERCHAR test, which consists of scraping steel pins across a rock surface and measuring the wear of each pin. The rock specimen is held in a mechanical vice, while a conical steel pin fastened to a 15-pound head is drug across the face of the specimen using a lever being pulled 1 centimeter in 1 second. The CAI is calculated based on the resultant diameter on the end of the pin.